Weston & Sampson

westonandsampson.com

55 Walkers Brook Drive, Suite 100
Reading, MA 01867
tel: 978.532.1900

Notice of Intent

October 2023

LITTLETON WATER SUPPLY CONNECTION

PREPARED FOR:
LITTLETON ELECTRIC LIGHT & WATER DEPARTMENT

SUBMITTED TO:
LITTLETON CONSERVATION COMMISSION

55 Walkers Brook Drive, Suite 100, Reading, MA 01867
Tel: 978.532.1900

Littleton- Well and Water Main Extension
WSE Project No. ENG23-0720

October 31, 2023

Littleton Conservation Commission
37 Shattuck Street
Littleton, MA 01460

Re: NOI Filing
Littleton Water Source,
Whitcomb Avenue

Dear Members of the Littleton Commission:

On behalf of the Littleton Electric Light & Water Departments, Weston & Sampson Engineers, Inc. is hereby enclosing two (2) copies (including original) of the Notice of Intent submittal (including plans) to fulfill the requirements of the Massachusetts Wetlands Protection Act, M.G.L. Chapter 131, Section 40 submittal requirements and the Town of Littleton submittal requirements. This submittal is a formal Notice of Intent for the new source, new raw water pipe and extension of finished water main project occurring on Whitcomb Avenue.

As part of the filing, we have attached the following:

Appendix A: Project Description
Appendix B: Alternative Analysis
Appendix C: Stormwater Report
Appendix D: Project Maps
Appendix E: Applicable Technical Specifications
Appendix F: Abutters Information
Appendix G: Wetlands Memorandum
Appendix H: Photographs
Appendix I: Plans

If you have any questions regarding this submittal, please contact me at (978) 532-1900.

Very truly yours,

WESTON & SAMPSON

Alexandra Gaspar
Environmental Scientist III

Enter your transmittal number → Transmittal Number

Your unique Transmittal Number can be accessed online:
http://www.mass.gov/eea/agencies/massdep/service/approvals/transmittal-form-for-payment.html

Massachusetts Department of Environmental Protection

Transmittal Form for Permit Application and Payment

1. Please type or print. A separate Transmittal Form must be completed for each permit application.

2. Make your check payable to the Commonwealth of Massachusetts and mail it with a copy of this form to: MassDEP, P.O. Box 4062, Boston, MA 02211.

3. Three copies of this form will be needed.

Copy 1 - the original must accompany your permit application. **Copy 2** must accompany your fee payment. **Copy 3** should be retained for your records

4. Both fee-paying and exempt applicants must mail a copy of this transmittal form to:

MassDEP
P.O. Box 4062
Boston, MA
02211

*** Note:**
For BWSC Permits, enter the LSP.

A. Permit Information

1. Permit Code: 4 to 7 character code from permit instructions	2. Name of Permit Category
WPA Form 3	wetlands

3. Type of Project or Activity: utilities

B. Applicant Information – Firm or Individual

1. Name of Firm - Or, if party needing this approval is an individual enter name below: Littleton Electric Light & Water Department

2. **Last Name** of Individual	3. **First Name** of Individual	4. MI

5. Street Address: 39 Ayer Road PO Box 2406

6. City/Town	7. State	8. Zip Code	9. Telephone #	10. Ext. #
Littleton	MA	01460		

11. Contact Person	12. e-mail address
Corey Godfrey	cgodfrey@lelwd.com

C. Facility, Site or Individual Requiring Approval

1. Name of Facility, Site Or Individual:

2. Street Address: Whitcomb Avenue and Taylor Street

3. City/Town	4. State	5. Zip Code	6. Telephone #	7. Ext. #
Littleton	MA	01460		

8. DEP Facility Number (if Known)	9. Federal I.D. Number (if Known)	10. BWSC Tracking # (if Known)

D. Application Prepared by (if different from Section B)*

1. Name of Firm Or Individual: Weston and Sampson

2. Address: 55 Walkers Brook Drive, Suite 100

3. City/Town	4. State	5. Zip Code	6. Telephone #	7. Ext. #
Reading	MA	01867	978-532-1900	

8. Contact Person	9. LSP Number (BWSC Permits only)
Alexandra Gaspar	

E. Permit - Project Coordination

1. Is this project subject to MEPA review? ☒ yes ☐ no
   If yes, enter the project's EOEA file number - assigned when an Environmental Notification Form is submitted to the MEPA unit: 16736 (EOEA File Number)

F. Amount Due

DEP Use Only

Permit No:

Rec'd Date:

Reviewer:

Special Provisions:

1. ☒ **Fee** Exempt (city, town or municipal housing authority)(state agency if fee is $100 or less).
   There are no fee exemptions for BWSC permits, regardless of applicant status.
2. ☐ Hardship Request - payment extensions according to 310 CMR 4.04(3)(c).
3. ☐ Alternative Schedule Project (according to 310 CMR 4.05 and 4.10).
4. ☐ Homeowner (according to 310 CMR 4.02).

Check Number	Dollar Amount	Date

Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands

WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40

Provided by MassDEP:

MassDEP File Number

Document Transaction Number

Littleton
City/Town

Important:
When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



Note:
Before completing this form consult your local Conservation Commission regarding any municipal bylaw or ordinance.

A. General Information

1. Project Location (**Note:** electronic filers will click on button to locate project site):

Whitcomb Avenue & Taylor Street — a. Street Address
Littleton — b. City/Town
01460 — c. Zip Code

Latitude and Longitude:
42.525894 — d. Latitude
-71.524314 — e. Longitude

R10-14 — f. Assessors Map/Plat Number
1 — g. Parcel /Lot Number

2. Applicant:

Corey — a. First Name
Godfrey — b. Last Name
Littleton Electric Light & Water Departments — c. Organization
39 Ayer Road P.O. Box 2406 — d. Street Address
Littleton — e. City/Town
MA — f. State
01460 — g. Zip Code
h. Phone Number
i. Fax Number
cgodfrey@lelwd.com — j. Email Address

3. Property owner (required if different from applicant): ☐ Check if more than one owner

a. First Name
b. Last Name
c. Organization
d. Street Address
e. City/Town
f. State
g. Zip Code
h. Phone Number
i. Fax Number
j. Email address

4. Representative (if any):

Alexandra — a. First Name
Gaspar — b. Last Name
Weston & Sampson — c. Company
55 Walkers Brook Drive Suite 100 — d. Street Address
Reading — e. City/Town
MA — f. State
01867 — g. Zip Code
978-532-1900 — h. Phone Number
i. Fax Number
gaspara@wseinc.com — j. Email address

5. Total WPA Fee Paid (from NOI Wetland Fee Transmittal Form):

exempt — a. Total Fee Paid
b. State Fee Paid
c. City/Town Fee Paid

Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands

WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40

Provided by MassDEP:

MassDEP File Number

Document Transaction Number

Littleton
City/Town

A. General Information (continued)

6. General Project Description:

A connection of the new water supply well to a WTP via a raw water transmission main, and construction of a finished water main from the LELWD system to bring a treated water supply to the Town of Boxborough

7a. Project Type Checklist: (Limited Project Types see Section A. 7b.)

1. ☐ Single Family Home
2. ☐ Residential Subdivision
3. ☐ Commercial/Industrial
4. ☐ Dock/Pier
5. ☒ Utilities
6. ☐ Coastal engineering Structure
7. ☐ Agriculture (e.g., cranberries, forestry)
8. ☐ Transportation
9. ☐ Other

7b. Is any portion of the proposed activity eligible to be treated as a limited project (including Ecological Restoration Limited Project) subject to 310 CMR 10.24 (coastal) or 310 CMR 10.53 (inland)?

1. ☒ Yes ☐ No

If yes, describe which limited project applies to this project. (See 310 CMR 10.24 and 10.53 for a complete list and description of limited project types)

10.53 (3)(d) The construction, reconstruction, operation and maintenance of underground and overhead public utilities.

If the proposed activity is eligible to be treated as an Ecological Restoration Limited Project (310 CMR10.24(8), 310 CMR 10.53(4)), complete and attach Appendix A: Ecological Restoration Limited Project Checklist and Signed Certification.

8. Property recorded at the Registry of Deeds for:

Middlesex
a. County

b. Certificate # (if registered land)

68514
c. Book

128
d. Page Number

B. Buffer Zone & Resource Area Impacts (temporary & permanent)

1. ☐ Buffer Zone Only – Check if the project is located only in the Buffer Zone of a Bordering Vegetated Wetland, Inland Bank, or Coastal Resource Area.
2. ☒ Inland Resource Areas (see 310 CMR 10.54-10.58; if not applicable, go to Section B.3, Coastal Resource Areas).

Check all that apply below. Attach narrative and any supporting documentation describing how the project will meet all performance standards for each of the resource areas altered, including standards requiring consideration of alternative project design or location.

Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands

WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40

Provided by MassDEP:

MassDEP File Number

Document Transaction Number

Littleton
City/Town

B. Buffer Zone & Resource Area Impacts (temporary & permanent) (cont'd)

For all projects affecting other Resource Areas, please attach a narrative explaining how the resource area was delineated.

Resource Area	Size of Proposed Alteration	Proposed Replacement (if any)
a. ☒ Bank	1. linear feet	2. linear feet
b. ☒ Bordering Vegetated Wetland	60,651 1. square feet	60,651 2. square feet
c. ☐ Land Under Waterbodies and Waterways	1. square feet 3. cubic yards dredged	2. square feet

Resource Area	Size of Proposed Alteration	Proposed Replacement (if any)
d. ☒ Bordering Land Subject to Flooding	22,811 1. square feet 0 3. cubic feet of flood storage lost	22,811 2. square feet 0 4. cubic feet replaced
e. ☐ Isolated Land Subject to Flooding	1. square feet 2. cubic feet of flood storage lost	3. cubic feet replaced
f. ☒ Riverfront Area	Beaver Brook, Unnamed Intermittent Stream, 1. Name of Waterway (if available) - **specify coastal or inland**	

2. Width of Riverfront Area (check one):

☐ 25 ft. - Designated Densely Developed Areas only

☐ 100 ft. - New agricultural projects only

☒ 200 ft. - All other projects

3. Total area of Riverfront Area on the site of the proposed project: 248,619 square feet

4. Proposed alteration of the Riverfront Area:

a. total square feet	b. square feet within 100 ft.	c. square feet between 100 ft. and 200 ft.
12,643	5,333	7,310

5. Has an alternatives analysis been done and is it attached to this NOI? ☒ Yes ☐ No

6. Was the lot where the activity is proposed created prior to August 1, 1996? ☒ Yes ☐ No

3. ☐ Coastal Resource Areas: (See 310 CMR 10.25-10.35)

Note: for coastal riverfront areas, please complete **Section B.2.f**. above.

Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands

WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40

Provided by MassDEP:

MassDEP File Number

Document Transaction Number

Littleton
City/Town

B. Buffer Zone & Resource Area Impacts (temporary & permanent) (cont'd)

Check all that apply below. Attach narrative and supporting documentation describing how the project will meet all performance standards for each of the resource areas altered, including standards requiring consideration of alternative project design or location.

Online Users: Include your document transaction number (provided on your receipt page) with all supplementary information you submit to the Department.

Resource Area	Size of Proposed Alteration	Proposed Replacement (if any)
a. ☐ Designated Port Areas	Indicate size under Land Under the Ocean, below	
b. ☐ Land Under the Ocean	1. square feet 2. cubic yards dredged	
c. ☐ Barrier Beach	Indicate size under Coastal Beaches and/or Coastal Dunes below	
d. ☐ Coastal Beaches	1. square feet	2. cubic yards beach nourishment
e. ☐ Coastal Dunes	1. square feet	2. cubic yards dune nourishment

Resource Area	Size of Proposed Alteration	Proposed Replacement (if any)
f. ☐ Coastal Banks	1. linear feet	
g. ☐ Rocky Intertidal Shores	1. square feet	
h. ☐ Salt Marshes	1. square feet	2. sq ft restoration, rehab., creation
i. ☐ Land Under Salt Ponds	1. square feet 2. cubic yards dredged	
j. ☐ Land Containing Shellfish	1. square feet	
k. ☐ Fish Runs	Indicate size under Coastal Banks, inland Bank, Land Under the Ocean, and/or inland Land Under Waterbodies and Waterways, above 1. cubic yards dredged	
l. ☐ Land Subject to Coastal Storm Flowage	1. square feet	

4. ☐ Restoration/Enhancement

If the project is for the purpose of restoring or enhancing a wetland resource area in addition to the square footage that has been entered in Section B.2.b or B.3.h above, please enter the additional amount here.

a. square feet of BVW

b. square feet of Salt Marsh

5. ☐ Project Involves Stream Crossings

a. number of new stream crossings

b. number of replacement stream crossings

Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands
WPA Form 3 – Notice of Intent
Massachusetts Wetlands Protection Act M.G.L. c. 131, §40

Provided by MassDEP:
MassDEP File Number
Document Transaction Number
Littleton
City/Town

C. Other Applicable Standards and Requirements

☐ This is a proposal for an Ecological Restoration Limited Project. Skip Section C and complete Appendix A: Ecological Restoration Limited Project Checklists – Required Actions (310 CMR 10.11).

Streamlined Massachusetts Endangered Species Act/Wetlands Protection Act Review

1. Is any portion of the proposed project located in **Estimated Habitat of Rare Wildlife** as indicated on the most recent Estimated Habitat Map of State-Listed Rare Wetland Wildlife published by the Natural Heritage and Endangered Species Program (NHESP)? To view habitat maps, see the *Massachusetts Natural Heritage Atlas* or go to http://maps.massgis.state.ma.us/PRI_EST_HAB/viewer.htm.

a. ☒ Yes ☐ No

If yes, include proof of mailing or hand delivery of NOI to:

Natural Heritage and Endangered Species Program
Division of Fisheries and Wildlife
1 Rabbit Hill Road
Westborough, MA 01581

4/18/2023
b. Date of map

If *yes*, the project is also subject to Massachusetts Endangered Species Act (MESA) review (321 CMR 10.18). To qualify for a streamlined, 30-day, MESA/Wetlands Protection Act review, please complete Section C.1.c, and include requested materials with this Notice of Intent (NOI); *OR* complete Section C.2.f, if applicable. *If MESA supplemental information is not included with the NOI, by completing Section 1 of this form, the NHESP will require a separate MESA filing which may take up to 90 days to review (unless noted exceptions in Section 2 apply, see below).*

c. Submit Supplemental Information for Endangered Species Review*

1. ☐ Percentage/acreage of property to be altered:

(a) within wetland Resource Area _____ percentage/acreage

(b) outside Resource Area _____ percentage/acreage

2. ☐ Assessor's Map or right-of-way plan of site

2. ☐ Project plans for entire project site, including wetland resource areas and areas outside of wetlands jurisdiction, showing existing and proposed conditions, existing and proposed tree/vegetation clearing line, and clearly demarcated limits of work **

(a) ☐ Project description (including description of impacts outside of wetland resource area & buffer zone)

(b) ☐ Photographs representative of the site

* Some projects **not** in Estimated Habitat may be located in Priority Habitat, and require NHESP review (see https://www.mass.gov/ma-endangered-species-act-mesa-regulatory-review).
Priority Habitat includes habitat for state-listed plants and strictly upland species not protected by the Wetlands Protection Act.
** MESA projects may not be segmented (321 CMR 10.16). The applicant must disclose full development plans even if such plans are not required as part of the Notice of Intent process.

Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands

WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40

Provided by MassDEP:

MassDEP File Number

Document Transaction Number

Littleton
City/Town

C. Other Applicable Standards and Requirements (cont'd)

(c) ☐ MESA filing fee (fee information available at https://www.mass.gov/how-to/how-to-file-for-a-mesa-project-review).
Make check payable to "Commonwealth of Massachusetts - NHESP" and ***mail to NHESP*** at above address

*Projects altering **10 or more acres** of land, also submit:*

(d) ☐ Vegetation cover type map of site

(e) ☐ Project plans showing Priority & Estimated Habitat boundaries

(f) OR Check One of the Following

1. ☐ Project is exempt from MESA review.
Attach applicant letter indicating which MESA exemption applies. (See 321 CMR 10.14, https://www.mass.gov/service-details/exemptions-from-review-for-projectsactivities-in-priority-habitat; the NOI must still be sent to NHESP if the project is within estimated habitat pursuant to 310 CMR 10.37 and 10.59.)

2. ☒ Separate MESA review ongoing. 23-4202 (a. NHESP Tracking #) 5/17/2023 (b. Date submitted to NHESP)

3. ☐ Separate MESA review completed.
Include copy of NHESP "no Take" determination or valid Conservation & Management Permit with approved plan.

3. For coastal projects only, is any portion of the proposed project located below the mean high water line or in a fish run?

a. ☒ Not applicable – project is in inland resource area only b. ☐ Yes ☐ No

If yes, include proof of mailing, hand delivery, or electronic delivery of NOI to either:

South Shore - Cohasset to Rhode Island border, and the Cape & Islands:

Division of Marine Fisheries -
Southeast Marine Fisheries Station
Attn: Environmental Reviewer
836 South Rodney French Blvd.
New Bedford, MA 02744
Email: dmf.envreview-south@mass.gov

North Shore - Hull to New Hampshire border:

Division of Marine Fisheries -
North Shore Office
Attn: Environmental Reviewer
30 Emerson Avenue
Gloucester, MA 01930
Email: dmf.envreview-north@mass.gov

Also if yes, the project may require a Chapter 91 license. For coastal towns in the Northeast Region, please contact MassDEP's Boston Office. For coastal towns in the Southeast Region, please contact MassDEP's Southeast Regional Office.

c. ☐ Is this an aquaculture project? d. ☐ Yes ☐ No

If yes, include a copy of the Division of Marine Fisheries Certification Letter (M.G.L. c. 130, § 57).

Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands

WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40

Provided by MassDEP:

MassDEP File Number

Document Transaction Number

Littleton
City/Town

C. Other Applicable Standards and Requirements (cont'd)

Online Users: Include your document transaction number (provided on your receipt page) with all supplementary information you submit to the Department.

4. Is any portion of the proposed project within an Area of Critical Environmental Concern (ACEC)?

   a. ☐ Yes ☒ No If yes, provide name of ACEC (see instructions to WPA Form 3 or MassDEP Website for ACEC locations). **Note:** electronic filers click on Website.

   b. ACEC

5. Is any portion of the proposed project within an area designated as an Outstanding Resource Water (ORW) as designated in the Massachusetts Surface Water Quality Standards, 314 CMR 4.00?

   a. ☐ Yes ☒ No

6. Is any portion of the site subject to a Wetlands Restriction Order under the Inland Wetlands Restriction Act (M.G.L. c. 131, § 40A) or the Coastal Wetlands Restriction Act (M.G.L. c. 130, § 105)?

   a. ☐ Yes ☒ No

7. Is this project subject to provisions of the MassDEP Stormwater Management Standards?

   a. ☒ Yes. Attach a copy of the Stormwater Report as required by the Stormwater Management Standards per 310 CMR 10.05(6)(k)-(q) and check if:

      1. ☐ Applying for Low Impact Development (LID) site design credits (as described in Stormwater Management Handbook Vol. 2, Chapter 3)

      2. ☒ A portion of the site constitutes redevelopment

      3. ☐ Proprietary BMPs are included in the Stormwater Management System.

   b. ☐ No. Check why the project is exempt:

      1. ☐ Single-family house

      2. ☐ Emergency road repair

      3. ☐ Small Residential Subdivision (less than or equal to 4 single-family houses or less than or equal to 4 units in multi-family housing project) with no discharge to Critical Areas.

D. Additional Information

☐ This is a proposal for an Ecological Restoration Limited Project. Skip Section D and complete Appendix A: Ecological Restoration Notice of Intent – Minimum Required Documents (310 CMR 10.12).

Applicants must include the following with this Notice of Intent (NOI). See instructions for details.

Online Users: Attach the document transaction number (provided on your receipt page) for any of the following information you submit to the Department.

1. ☒ USGS or other map of the area (along with a narrative description, if necessary) containing sufficient information for the Conservation Commission and the Department to locate the site. (Electronic filers may omit this item.)

2. ☒ Plans identifying the location of proposed activities (including activities proposed to serve as a Bordering Vegetated Wetland [BVW] replication area or other mitigating measure) relative to the boundaries of each affected resource area.

Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands

WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40

Provided by MassDEP:

MassDEP File Number

Document Transaction Number

Littleton
City/Town

D. Additional Information (cont'd)

3. ☒ Identify the method for BVW and other resource area boundary delineations (MassDEP BVW Field Data Form(s), Determination of Applicability, Order of Resource Area Delineation, etc.), and attach documentation of the methodology.

4. ☒ List the titles and dates for all plans and other materials submitted with this NOI.

Water Supply fom Littleton to Boxborough
a. Plan Title

Weston & Sampson Engineers, Inc.
b. Prepared By

Tara McManus, PE
c. Signed and Stamped by

October 2023
d. Final Revision Date

1"=40'
e. Scale

Taylor Street Well and Raw Water Main
f. Additional Plan or Document Title

October 2023
g. Date

5. ☐ If there is more than one property owner, please attach a list of these property owners not listed on this form.

6. ☒ Attach proof of mailing for Natural Heritage and Endangered Species Program, if needed.

7. ☐ Attach proof of mailing for Massachusetts Division of Marine Fisheries, if needed.

8. ☒ Attach NOI Wetland Fee Transmittal Form

9. ☒ Attach Stormwater Report, if needed.

E. Fees

1. ☒ Fee Exempt: No filing fee shall be assessed for projects of any city, town, county, or district of the Commonwealth, federally recognized Indian tribe housing authority, municipal housing authority, or the Massachusetts Bay Transportation Authority.

Applicants must submit the following information (in addition to pages 1 and 2 of the NOI Wetland Fee Transmittal Form) to confirm fee payment:

2. Municipal Check Number

3. Check date

4. State Check Number

5. Check date

6. Payor name on check: First Name

7. Payor name on check: Last Name

Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands

WPA Form 3 – Notice of Intent

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40

Provided by MassDEP:

MassDEP File Number

Document Transaction Number

Littleton
City/Town

F. Signatures and Submittal Requirements

I hereby certify under the penalties of perjury that the foregoing Notice of Intent and accompanying plans, documents, and supporting data are true and complete to the best of my knowledge. I understand that the Conservation Commission will place notification of this Notice in a local newspaper at the expense of the applicant in accordance with the wetlands regulations, 310 CMR 10.05(5)(a).

I further certify under penalties of perjury that all abutters were notified of this application, pursuant to the requirements of M.G.L. c. 131, § 40. Notice must be made by Certificate of Mailing or in writing by hand delivery or certified mail (return receipt requested) to all abutters within 100 feet of the property line of the project location.

1. Signature of Applicant

2. Date: 8-17-2023

3. Signature of Property Owner (if different)

4. Date

5. Signature of Representative (if any)

6. Date: 8/8/2023

For Conservation Commission:
Two copies of the completed Notice of Intent (Form 3), including supporting plans and documents, two copies of the NOI Wetland Fee Transmittal Form, and the city/town fee payment, to the Conservation Commission by certified mail or hand delivery.

For MassDEP:
One copy of the completed Notice of Intent (Form 3), including supporting plans and documents, one copy of the NOI Wetland Fee Transmittal Form, and a **copy** of the state fee payment to the MassDEP Regional Office (see Instructions) by certified mail or hand delivery.

Other:
If the applicant has checked the "yes" box in any part of Section C, Item 3, above, refer to that section and the Instructions for additional submittal requirements.

The original and copies must be sent simultaneously. Failure by the applicant to send copies in a timely manner may result in dismissal of the Notice of Intent.

Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands

NOI Wetland Fee Transmittal Form

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40

Important: When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



A. Applicant Information

1. Location of Project:

Whitcomb Avenue and Taylor Street	Littleton
a. Street Address	b. City/Town
exempt	
c. Check number	d. Fee amount

2. Applicant Mailing Address:

Corey	Godfrey	
a. First Name	b. Last Name	
Littleton Electric Light & Water Departments		
c. Organization		
39 Ayer Road P.O. Box 2406		
d. Mailing Address		
Littleton	MA	01460
e. City/Town	f. State	g. Zip Code
		cgodfrey@lelwd.com
h. Phone Number	i. Fax Number	j. Email Address

3. Property Owner (if different):

a. First Name	b. Last Name	
c. Organization		
d. Mailing Address		
e. City/Town	f. State	g. Zip Code
h. Phone Number	i. Fax Number	j. Email Address

B. Fees

To calculate filing fees, refer to the category fee list and examples in the instructions for filling out WPA Form 3 (Notice of Intent).

Fee should be calculated using the following process & worksheet. ***Please see Instructions before filling out worksheet.***

Step 1/Type of Activity: Describe each type of activity that will occur in wetland resource area and buffer zone.

Step 2/Number of Activities: Identify the number of each type of activity.

Step 3/Individual Activity Fee: Identify each activity fee from the six project categories listed in the instructions.

Step 4/Subtotal Activity Fee: Multiply the number of activities (identified in Step 2) times the fee per category (identified in Step 3) to reach a subtotal fee amount. Note: If any of these activities are in a Riverfront Area in addition to another Resource Area or the Buffer Zone, the fee per activity should be multiplied by 1.5 and then added to the subtotal amount.

Step 5/Total Project Fee: Determine the total project fee by adding the subtotal amounts from Step 4.

Step 6/Fee Payments: To calculate the state share of the fee, divide the total fee in half and subtract $12.50. To calculate the city/town share of the fee, divide the total fee in half and add $12.50.

Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands

NOI Wetland Fee Transmittal Form

Massachusetts Wetlands Protection Act M.G.L. c. 131, §40

B. Fees (continued)

Step 1/Type of Activity	Step 2/Number of Activities	Step 3/Individual Activity Fee	Step 4/Subtotal Activity Fee
exempt			

Step 5/Total Project Fee:

Step 6/Fee Payments:

Total Project Fee:	exempt a. Total Fee from Step 5
State share of filing Fee:	exempt b. 1/2 Total Fee **less $**12.50
City/Town share of filling Fee:	exempt c. 1/2 Total Fee **plus** $12.50

C. Submittal Requirements

a.) Complete pages 1 and 2 and send with a check or money order for the state share of the fee, payable to the Commonwealth of Massachusetts.

Department of Environmental Protection
Box 4062
Boston, MA 02211

b.) **To the Conservation Commission:** Send the Notice of Intent or Abbreviated Notice of Intent; a **copy** of this form; and the city/town fee payment.

To MassDEP Regional Office (see Instructions): Send a copy of the Notice of Intent or Abbreviated Notice of Intent; a **copy** of this form; and a **copy** of the state fee payment. (E-filers of Notices of Intent may submit these electronically.)

Appendix A

Project Description

Background (Littleton)

The proposed project includes a new water supply well for the Littleton Electric Light & Water Departments (LELWD), connection of the new water supply well to a WTP in Littleton via a raw water transmission main, and construction of a finished water main from the LELWD system to bring a treated water supply to the Town of Boxborough.

This project is the result of careful coordination and planning among the two municipalities of Littleton and Boxborough, the Massachusetts Department of Environmental Protection (MassDEP) and Massachusetts Department of Transportation (MassDOT), and is the direct result of the MassDOT Snow and Ice Control Program identifying the impacts of sodium and chloride contamination to water supplies from the application and storage of road salt. In the 2017 Environmental Status and Planning Report by MassDOT, the Boxborough Executive Center office building was identified as the highest maximum sodium concentration for a public water system located within 0.5 miles of a MassDOT roadway.

While this project description gives an overview of the project in its entirety, this submission is only seeking approval for the portion of work occurring in Littleton, which includes the construction of the water supply well and raw water main. The finished water main will be permitted with the Town of Boxborough Conservation Commission.

Site Description

Boxborough

Much of the project work is installation of water main which will occur in the existing roadway along the proposed route of the finished water main. Affected roadways include Beaver Brook Road, Swanson Road and Codman Hill Road.

Littleton

The location of the new water supply well is located on a parcel that lies within a valley between higher elevation residential neighborhoods to the northwest and Route 495 to the southeast. Monarch Drive, Taylor Street and MA Route 2 border the parcel along the southeast, east, and north boundaries, respectively. Entrance to the site is located through a commercial access point at 151 Taylor Street.

Within the property boundaries are wetlands and Beaver Brook, a small stream that runs the length of the northwestern portion of the parcel, flowing southwest to northeast. Beaver Brook is approximately 1,014 feet northwest of the proposed well location. The confluence of Beaver Brook with an unnamed tributary from Black Pond is approximately 1,505 feet downstream from the parcel, which continues on as Beaver Brook. Beaver Brook flows northeast which eventually drains into Forge Pond. The proposed Zone II of the new water supply well extends upgradient of the well to the drainage basin divides and to the till/stratified drift boundaries.

Scope of Work

Boxborough

The project will include a finished water main from the existing Littleton water main at Nancy's Way near the Boxborough Town Line, progressing south along Beaver Brook Road and Swanson Road and terminating at the existing Codman Hill Condominiums PWS located at 276 Codman Hill Road in Boxborough, Massachusetts.

Trenches in pavement shall have the traveled way surface cut in a straight line. Pipe trenches shall be made as narrow as practicable (about 5' in width). Excavation shall only be between these cuts. The pipe shall be installed with a minimum of 5'-0" of cover, unless specifically indicated otherwise on the plans or required by the Engineer. Prior to backfilling, the Contractor shall compact the exposed natural subgrade. Where specified and required by the Engineer and after placement of the gravel subbase, the Contractor shall place temporary bituminous pavement above the trench, between the edges of the existing pavement. The temporary pavement shall be repaired as necessary to maintain the surface of the pavement until replaced by permanent pavement. All water pumped or drained from the work shall be disposed of in a manner that will not result in undue interference with other work or damage to adjacent properties, pavements and other surfaces, buildings, structures, and utilities.

Littleton

The LELWD is proposing developing a new water supply well at 153 Taylor Street which, during an 8-hour pump test, saw PFAS 6 levels of approximately 14 parts per trillion (ppt). The new well is expected to supply approximately 0.5 million gallons per day (mgd). The LELWD is currently constructing a new 3 MGD water treatment plant (WTP) at 15 Whitcomb Avenue under a separate project to treat for per- and polyfluoroalkyl substances (PFAS) found in their existing raw water sources. Under this proposed project, raw water from the proposed new well will be pumped to the WTP and will provide additional water to the existing customers of Littleton and is proposed to provide water to 11 public water systems (PWS) in Boxborough that are impacted by PFAS, sodium, chloride, and/or perchlorate. Work under this project includes a new finished water main extending from the existing Littleton water main in Whitcomb Avenue and continuing south approximately 4.5 miles to the Codman Hill Condominiums (PWS #2037001) in Boxborough.

Regulatory Review

Permit specific discussions are provided, below, for the Massachusetts Environmental Policy Act, Massachusetts Endangered Species Act, and Notice of Intent applications under the Massachusetts Wetlands Protection Act.

MA Endangered Species Act (MESA, 321 CMR 10.0)

The portion of the work occurring in Boxborough is considered exempt under 321 CMR 10.14(10): installation of utility lines. However, other portions of the overall project are not exempt, and therefore a MESA filing has been filed separately and can be found using reference number 23-4202.

Massachusetts Environmental Policy Act (MEPA, 301 CMR 11.0)

The purpose of MEPA and 301 CMR 11.00 is to provide meaningful opportunities for public review of the potential environmental impacts of a project for which a permit is required from an agency of the Commonwealth, and to assist agencies of the Commonwealth in using all feasible means to avoid damage to the environment or, to the extent damage to the environment cannot be avoided, to minimize and mitigate damage to the environment to the maximum extent practicable. MEPA's review is intended to inform the participating agencies of the project, to maximize Consistency between agency actions, and to facilitate coordination of all environmental and development review and permitting processes of the Commonwealth. The MEPA process provides an opportunity for the project proponent to identify required agency actions and to describe and analyze how the project will comply with applicable regulatory standards and requirements. Through review of the MEPA documents, each participating agency can

comment on aspects of the project or issues regarding its agency action that require additional description or analysis. There are twelve MEPA review threshold categories contained in the Act covering the following topics of Land, State Listed Species, Wetlands, Waterways and Tidelands, Water, Wastewater, Transportation, Energy, Air, Solid and Hazardous Waste, Historical and Archaeological Resources, Areas of Critical Concern, and Regulations. In addition to triggering a threshold, a state action (i.e., state funding or state permitting) is necessary to trigger MEPA review. The following MEPA threshold is triggered for this project under the Wetlands, Waterways and Tidelands:

11.03 (3)(b)(f) alteration of ½ or more acres of any other wetlands. (floodzone, riverfront area)

In addition, this project triggers a MEPA threshold related to Water:

11.03 (4)(b)(1) New withdrawal or Expansion in withdrawal of 100,000 or more gpd from a water source that requires new construction for the withdrawal.

Environmental Justice Communities Discussion

Per 301 CMR 11.00, MEPA requires all Environmental Justice (EJ) communities within a mile of the project location be identified and notified. Using the MEPA EJ community mapper, a map was generated to identify all communities within a mile. It is required to notify all local community-based organizations and tribal organizations with an Environmental Justice Screening form via an e-mail list provided by the MEPA-EJ Director; the screening form was sent out on 4/24/2023. Additionally, a notification was posted in the Boston Herald on 4/25/2023. As of 6/22/2023, no comments from the surrounding Environmental Justice Communities have been received.

A public meeting was held on January 19, 2023 to describe the project and provide opportunity for questions and answers from municipal and state officials.

Climate Resiliency Discussion

Per 301 CMR 11.05(5) MEPA updated requirements, an RMAT climate resilience design standards tool was used to generate a report on the projects to address climate risk.

The Massachusetts Wetlands Protection Act (310 CMR 10.00)

The Massachusetts Wetlands Protection Act (MGL c.131 § 40) (WPA) and implementing regulations (310 CMR 10.00) is a state statute administered locally. While a Notice of Intent (NOI) submission would be reviewed by the local Conservation Commissions (Littleton, Boxborough, Harvard), this permit is being discussed under this state review discussion because of the state regulations that govern the WPA submissions. Jurisdiction under the WPA would occur for proposed removal, fill, dredge and/or alteration of a wetland resource protected under the WPA. The WPA requires the preparation of a NOI for work within a wetland resource area, work within 100-feet of certain resource areas and/or within the 100-year flood plain. The general performance standards for work or activities occurring within each wetland resource are identified in the WPA. Resource areas impacted by the proposed work include the following:

- Bordering Land Subject to Flooding
- Riverfront Area

In addition, work will occur within the 100' Wetlands Buffer Zone. It is anticipated that there will be 37,493 sf of work within the buffer zone. All work is temporary in nature and the buffer will be returned to existing condition following project completion.

Bordering Land Subject to Flooding

1. Compensatory storage shall be provided for all flood storage volume that will be lost as the result of a proposed project within Bordering Land Subject to Flooding, when in the judgment of the issuing authority said loss will cause an increase or will contribute incrementally to an increase in the horizontal extent and level of flood waters during peak flows. Compensatory storage shall mean a volume not previously used for flood storage and shall be incrementally equal to the theoretical volume of flood water at each elevation, up to and including the 100-year flood elevation, which would be displaced by the proposed project. Such compensatory volume shall have an unrestricted hydraulic connection to the same waterway or water body. Further, with respect to waterways, such compensatory volume shall be provided within the same reach of the river, stream, or creek.

2. Work within Bordering Land Subject to Flooding, including that work required to provide the above-specified compensatory storage, shall not restrict flows so as to cause an increase in flood stage or velocity.

The work within BLSF will not restrict flows that cause an increase in flood stage or velocity. All work is occurring within paved roadway. There will be no volume added or change in grade within the flood zone.

3. Work in those portions of bordering land subject to flooding found to be significant to the protection of wildlife habitat shall not impair its capacity to provide important wildlife habitat functions. Except for work which would adversely affect vernal pool habitat a project or projects on a single lot, for which Notice(s) of Intent is filed on or after November 1, 1987, that (cumulatively) alter(s) up to 10% or 5,000 square feet (whichever is less) of land in this resource area found to be significant to the protection of wildlife habitat, shall not be deemed to impair its capacity to provide important wildlife habitat functions. Additional alterations beyond the above threshold, or altering vernal pool habitat, may be permitted if they will have no adverse effects on wildlife habitat, as determined by procedures contained in 310 CMR 10.60.

Some portions of the work within BLSF also fall within National Heritage and Endangered Species (NHESP) Estimated and Priority Habitat. Communication with MassWildlife regarding compliance with the Massachusetts Endangered Species Act (MESA) is ongoing and will be resolved prior to commencement of work. However, work is in the road, which is not habitat area, so we do not anticipate a "take" of habitat.

Riverfront Area (Redevelopment Standards)

(a) At a minimum, proposed work shall result in an improvement over existing conditions of the capacity of the riverfront area to protect the interests identified in M.G.L. c. 131 § 40. When a lot is previously developed but no portion of the riverfront area is degraded, the requirements of 310 CMR 10.58(4) shall be met.

While this work will not result in an improvement, all work within the riverfront area is occurring on degraded area (paved road).

(b) Stormwater management is provided according to standards established by the Department.

The MA Stormwater Standards are being met. Please see Appendix C for Stormwater Report.

(c) Within 200 foot riverfront areas, proposed work shall not be located closer to the river than existing conditions or 100 feet, whichever is less, or not closer than existing conditions within 25 foot riverfront areas, except in accordance with 310 CMR 10.58(5)(f) or (g).

All work will be within existing roadway. No new impervious area will be added closer to the river than what already exists. The riverfront will be returned to existing condition following construction.

(d) Proposed work, including expansion of existing structures, shall be located outside the riverfront area or toward the riverfront area boundary and away from the river, except in accordance with 310 CMR 10.58(5)(f) or (g).

There will be no expansion of existing structures within the riverfront area. Proposed work within the riverfront is occurring in paved roadway. The riverfront will be returned to existing condition following construction.

(e) The area of proposed work shall not exceed the amount of degraded area, provided that the proposed work may alter up to 10% if the degraded area is less than 10% of the riverfront area, except in accordance with 310 CMR 10.58(5)(f) or (g).

All of this work is occurring in previously degraded area (roadway). No new degraded area is anticipated within the riverfront area as part of this project.

(f) When an applicant proposes restoration on-site of degraded riverfront area, alteration may be allowed notwithstanding the criteria of 310 CMR 10.58(5)(c), (d), and (e) at a ratio in square feet of at least 1:1 of restored area to area of alteration not conforming to the criteria. Areas immediately along the river shall be selected for restoration. Alteration not conforming to the criteria shall begin at the riverfront area boundary. Restoration shall include: 1. removal of all debris, but retaining any trees or other mature vegetation; 2. grading to a topography which reduces runoff and increases infiltration; 3. coverage by topsoil at a depth consistent with natural conditions at the site; and 4. seeding and planting with an erosion control seed mixture, followed by plantings of herbaceous and woody species appropriate to the site;

N/A, no restoration of degraded riverfront area is proposed.

Appendix B
Alternative Analysis

Alternatives Analysis
Littleton/Boxborough New Well and Finished Water Main
Littleton and Boxborough, MA

Project Goal: Provide a treated water supply to eleven public water systems (PWS) in Boxborough that are currently impacted by PFAS, sodium, chloride, and/or perchlorate; and increase the redundancy for the water system in Littleton.

The Alternative Analysis are presented below, including 1 New Source and Raw Water Main Alternatives 2 Finished Water Main Alternatives:

Analysis 1 New Source and Raw Water Main Alternatives

Alternative 1: No Build

Under this alternative, no construction would occur. While there would be no impacts to wetland resources, the impacted PWS would not be provided with an alternative water supply and would continue to suffer serious water quality issues and the residents would not have access to drinking water that meets all MassDEP's Drinking Water Standards and Guidelines. In addition, the Town of Littleton would not gain the redundancy in its drinking water system necessary to provide residents with drinking water at all times.

This alternative does not meet the project goals.

Alternative 2: Drill Individual Replacement Wells for each PWS

Under this alternative, each individual PWS would have a new source of supply drilled and the contaminated wells could be abandoned. This alternative is not feasible due to the extent of the contamination in the local aquifers. Replacement wells would likely need to be drilled in different geological formations, which may require thousands of additional feet of water main to be constructed for each system. In addition, there is no guarantee of water quality in the short or long term at the replacement wells and no redundancy of supply provided.

This alternative does not meet the project goals.

Alternative 3: Add Treatment to each PWS

Under this alternative, each individual PWS would be updated to include treatment for the contaminants of concern and the new well would not be constructed in Littleton. Treatment systems for the contaminants of concern require significant infrastructure, operations and maintenance, and produce individual waste streams that may negatively impact the environment. Reverse Osmosis (RO) would be the only feasible treatment for treatment of sodium and chloride contamination. This treatment process produces a concentrated waste stream that would ultimately be disposed of through underground injection. The discovery of the PFAS contamination in the area groundwater complicates the viability of this treatment alternative, as the concentrations of PFAS within the waste streams of each individual system will limit disposal options. This alternative also does not provide redundancy.

This alternative does not meet the project goals.

Alternative 4: Municipal Interconnection

Under this alternative, the contaminated PWS would be connected to a nearby municipal water system. Systems within 1 mile of the contaminated PWS were considered due to feasibility of design and construction of the project. There is no centralized PWS in Boxborough.

The Town of Harvard operates a small system with approximately 98 service connections that is served by two wells and has a third well for emergency supply. This system has no treatment and does not have capacity to connect the contaminated PWS. This system was not considered further for an interconnection.

The Littleton Electric Light & Water Departments (LELWD) operates a water system serving residents in Littleton, MA. LELWD is currently constructing a Water Treatment Plant (WTP) at Whitcomb Avenue with a capacity of 3 million gallons per day (MGD) to treat water from its groundwater wells for PFAS as well as other contaminants. LELWD has also been conducting hydrogeological testing and investigation over the past 35+ years to locate a new well source to provide additional redundancy within their system. The well site is located at the parcel at 153 Taylor Street in Littleton. With the addition of this well to the system, and the treatment capacity at the Whitcomb Avenue WTP, LELWD will have the additional supply necessary to provide treated water to the PWS in Boxborough.

This alternative supports the project goal and was further refined below.

Alternative 5a & 5b: Municipal Interconnection to LELWD - Alternative Routes

To connect the new well to the Whitcomb Avenue WTP, two alternative routes (Option 1 and Option 2) were explored. These alternatives are documented in the memorandum "Raw Water Main Alternatives Analysis" dated December 21, 2021. Both routes include work in close proximity to the wetland areas

a. Option 1: Raw water main (approximately 6,250 linear feet) installed from the well to the WTP by directional drilling under Beaver Brook and the surrounding wetlands.
b. Option 2: Raw water main (approximately 10,800 linear feet) installed from the well along Taylor Street, Porter Road, and Whitcomb Avenue.

Option 1 was further refined to limit the distance required for directional drilling from 1,850 feet to approximately 170 feet and the path of the raw water main was brought as close to the existing right of way and previously disturbed areas as much as possible to reduce environmental impacts.

This alternative supports the project goal and is the preferred alternative.

Analysis 2 Finished Water Main Alternatives

For the finished water main connecting from the WTP at 15 Whitcomb Avenue in Littleton to 330 Codman Hill Road in Boxborough, the following alternatives were considered.

Alternative 1: No Build

Under this alternative, no construction would occur. While there would be no impacts to environmental resources, the impacted PWS would not be provided with an alternative water supply and would continue to suffer serious water quality issues and the residents would not have access to drinking water that meets all MassDEP's Drinking Water Standards and Guidelines.

This alternative does not meet the project goals.

Alternative 2: Construct Water Main in Existing Roadway

This alternative includes construction of a finished water main within the existing right of ways for Whitcomb Avenue, Littleton County Road, Beaver Brook Road, Swanson Road, Codman Hill Road, for an approximate length of 23,200 linear feet. This option limits construction to the pre-existing roadway and will have limited environmental impact while achieving the project goal of providing safe drinking water to impacted residents.

Conclusion

The combination of a refined Alternative 5a for the New Source and Raw Water Main and Alternative 2 for the Finished Water Main is recommended as the preferred alternative for implementation. Even though impacts to wetland resources are proposed, an overall improvement of current conditions will be achieved with this proposed project. Residents and businesses will be provided with a safe source of drinking water that meets all MassDEP's Drinking Water Standards and Guidelines, and redundancy in existing water supplies will be improved.

Appendix C
Stormwater Report

Stormwater Report

Littleton, Massachusetts

Taylor Street Well and Raw Water Main

October 16, 2023

JOB NO: ENG23-0679

Weston & Sampson
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
www.westonandsampson.com
Tel: 978-532-1900 Fax: 978-977-0100

Table of Contents

Stormwater Checklist

Stormwater Report Summary

Attachment A - Locus Map

Attachment B - NRCS Soils Map, Soils Report, and HSG Classifications

Attachment C - Frimpter Analysis Memorandum

Attachment D - HydroCAD Reports

Attachment E - Calculations

1. TSS Removal Calculations
2. Recharge Volume Calculations
3. Water Quality Volume Calculations
4. Sediment Forebay Sizing Calculations

Attachment F - Long Term Pollution Prevention Plan

Attachment G - Construction Period Pollution and Erosion and Sedimentation Control Plan

Attachment H - Operations & Maintenance Plan

Attachment I - Illicit Discharge Statement

Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands Program

Checklist for Stormwater Report

A. Introduction

Important: When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



A Stormwater Report must be submitted with the Notice of Intent permit application to document compliance with the Stormwater Management Standards. The following checklist is NOT a substitute for the Stormwater Report (which should provide more substantive and detailed information) but is offered here as a tool to help the applicant organize their Stormwater Management documentation for their Report and for the reviewer to assess this information in a consistent format. As noted in the Checklist, the Stormwater Report must contain the engineering computations and supporting information set forth in Volume 3 of the Massachusetts Stormwater Handbook. The Stormwater Report must be prepared and certified by a Registered Professional Engineer (RPE) licensed in the Commonwealth.

The Stormwater Report must include:

- The Stormwater Checklist completed and stamped by a Registered Professional Engineer (see page 2) that certifies that the Stormwater Report contains all required submittals.[1] This Checklist is to be used as the cover for the completed Stormwater Report.
- Applicant/Project Name
- Project Address
- Name of Firm and Registered Professional Engineer that prepared the Report
- Long-Term Pollution Prevention Plan required by Standards 4-6
- Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan required by Standard 8[2]
- Operation and Maintenance Plan required by Standard 9

In addition to all plans and supporting information, the Stormwater Report must include a brief narrative describing stormwater management practices, including environmentally sensitive site design and LID techniques, along with a diagram depicting runoff through the proposed BMP treatment train. Plans are required to show existing and proposed conditions, identify all wetland resource areas, NRCS soil types, critical areas, Land Uses with Higher Potential Pollutant Loads (LUHPPL), and any areas on the site where infiltration rate is greater than 2.4 inches per hour. The Plans shall identify the drainage areas for both existing and proposed conditions at a scale that enables verification of supporting calculations.

As noted in the Checklist, the Stormwater Management Report shall document compliance with each of the Stormwater Management Standards as provided in the Massachusetts Stormwater Handbook. The soils evaluation and calculations shall be done using the methodologies set forth in Volume 3 of the Massachusetts Stormwater Handbook.

To ensure that the Stormwater Report is complete, applicants are required to fill in the Stormwater Report Checklist by checking the box to indicate that the specified information has been included in the Stormwater Report. If any of the information specified in the checklist has not been submitted, the applicant must provide an explanation. The completed Stormwater Report Checklist and Certification must be submitted with the Stormwater Report.

---

[1] The Stormwater Report may also include the Illicit Discharge Compliance Statement required by Standard 10. If not included in the Stormwater Report, the Illicit Discharge Compliance Statement must be submitted prior to the discharge of stormwater runoff to the post-construction best management practices.

[2] For some complex projects, it may not be possible to include the Construction Period Erosion and Sedimentation Control Plan in the Stormwater Report. In that event, the issuing authority has the discretion to issue an Order of Conditions that approves the project and includes a condition requiring the proponent to submit the Construction Period Erosion and Sedimentation Control Plan before commencing any land disturbance activity on the site.

Massachusetts Department of Environmental Protection
Bureau of Resource Protection - Wetlands Program

Checklist for Stormwater Report

B. Stormwater Checklist and Certification

The following checklist is intended to serve as a guide for applicants as to the elements that ordinarily need to be addressed in a complete Stormwater Report. The checklist is also intended to provide conservation commissions and other reviewing authorities with a summary of the components necessary for a comprehensive Stormwater Report that addresses the ten Stormwater Standards.

Note: Because stormwater requirements vary from project to project, it is possible that a complete Stormwater Report may not include information on some of the subjects specified in the Checklist. If it is determined that a specific item does not apply to the project under review, please note that the item is not applicable (N.A.) and provide the reasons for that determination.

A complete checklist must include the Certification set forth below signed by the Registered Professional Engineer who prepared the Stormwater Report.

Registered Professional Engineer's Certification

I have reviewed the Stormwater Report, including the soil evaluation, computations, Long-term Pollution Prevention Plan, the Construction Period Erosion and Sedimentation Control Plan (if included), the Long-term Post-Construction Operation and Maintenance Plan, the Illicit Discharge Compliance Statement (if included) and the plans showing the stormwater management system, and have determined that they have been prepared in accordance with the requirements of the Stormwater Management Standards as further elaborated by the Massachusetts Stormwater Handbook. I have also determined that the information presented in the Stormwater Checklist is accurate and that the information presented in the Stormwater Report accurately reflects conditions at the site as of the date of this permit application.

Registered Professional Engineer Block and Signature

10/12/2023
Signature and Date

Checklist

Project Type: Is the application for new development, redevelopment, or a mix of new and redevelopment?

☒ New development

☐ Redevelopment

☐ Mix of New Development and Redevelopment

Checklist for Stormwater Report

Checklist (continued)

LID Measures: Stormwater Standards require LID measures to be considered. Document what environmentally sensitive design and LID Techniques were considered during the planning and design of the project:

- ☐ No disturbance to any Wetland Resource Areas
- ☐ Site Design Practices (e.g. clustered development, reduced frontage setbacks)
- ☐ Reduced Impervious Area (Redevelopment Only)
- ☒ Minimizing disturbance to existing trees and shrubs
- ☐ LID Site Design Credit Requested:
  - ☐ Credit 1
  - ☐ Credit 2
  - ☐ Credit 3
- ☒ Use of “country drainage” versus curb and gutter conveyance and pipe
- ☐ Bioretention Cells (includes Rain Gardens)
- ☐ Constructed Stormwater Wetlands (includes Gravel Wetlands designs)
- ☐ Treebox Filter
- ☐ Water Quality Swale
- ☐ Grass Channel
- ☐ Green Roof
- ☐ Other (describe): _____

Standard 1: No New Untreated Discharges

- ☒ No new untreated discharges
- ☒ Outlets have been designed so there is no erosion or scour to wetlands and waters of the Commonwealth
- ☒ Supporting calculations specified in Volume 3 of the Massachusetts Stormwater Handbook included.

Checklist for Stormwater Report

Checklist (continued)

Standard 2: Peak Rate Attenuation

☐ Standard 2 waiver requested because the project is located in land subject to coastal storm flowage and stormwater discharge is to a wetland subject to coastal flooding.

☐ Evaluation provided to determine whether off-site flooding increases during the 100-year 24-hour storm.

☒ Calculations provided to show that post-development peak discharge rates do not exceed pre-development rates for the 2-year and 10-year 24-hour storms. If evaluation shows that off-site flooding increases during the 100-year 24-hour storm, calculations are also provided to show that post-development peak discharge rates do not exceed pre-development rates for the 100-year 24-hour storm.

Standard 3: Recharge

☒ Soil Analysis provided.

☒ Required Recharge Volume calculation provided.

☐ Required Recharge volume reduced through use of the LID site Design Credits.

☒ Sizing the infiltration, BMPs is based on the following method: Check the method used.

☒ Static ☐ Simple Dynamic ☐ Dynamic Field[1]

☐ Runoff from all impervious areas at the site discharging to the infiltration BMP.

☒ Runoff from all impervious areas at the site is *not* discharging to the infiltration BMP and calculations are provided showing that the drainage area contributing runoff to the infiltration BMPs is sufficient to generate the required recharge volume.

☒ Recharge BMPs have been sized to infiltrate the Required Recharge Volume.

☐ Recharge BMPs have been sized to infiltrate the Required Recharge Volume *only* to the maximum extent practicable for the following reason:

- ☐ Site is comprised solely of C and D soils and/or bedrock at the land surface
- ☐ M.G.L. c. 21E sites pursuant to 310 CMR 40.0000
- ☐ Solid Waste Landfill pursuant to 310 CMR 19.000
- ☐ Project is otherwise subject to Stormwater Management Standards only to the maximum extent practicable.

☒ Calculations showing that the infiltration BMPs will drain in 72 hours are provided.

☐ Property includes a M.G.L. c. 21E site or a solid waste landfill and a mounding analysis is included.

---

[1] 80% TSS removal is required prior to discharge to infiltration BMP if Dynamic Field method is used.

Checklist for Stormwater Report

Checklist (continued)

Standard 3: Recharge (continued)

☐ The infiltration BMP is used to attenuate peak flows during storms greater than or equal to the 10-year 24-hour storm and separation to seasonal high groundwater is less than 4 feet and a mounding analysis is provided.

☐ Documentation is provided showing that infiltration BMPs do not adversely impact nearby wetland resource areas.

Standard 4: Water Quality

The Long-Term Pollution Prevention Plan typically includes the following:

- Good housekeeping practices;
- Provisions for storing materials and waste products inside or under cover;
- Vehicle washing controls;
- Requirements for routine inspections and maintenance of stormwater BMPs;
- Spill prevention and response plans;
- Provisions for maintenance of lawns, gardens, and other landscaped areas;
- Requirements for storage and use of fertilizers, herbicides, and pesticides;
- Pet waste management provisions;
- Provisions for operation and management of septic systems;
- Provisions for solid waste management;
- Snow disposal and plowing plans relative to Wetland Resource Areas;
- Winter Road Salt and/or Sand Use and Storage restrictions;
- Street sweeping schedules;
- Provisions for prevention of illicit discharges to the stormwater management system;
- Documentation that Stormwater BMPs are designed to provide for shutdown and containment in the event of a spill or discharges to or near critical areas or from LUHPPL;
- Training for staff or personnel involved with implementing Long-Term Pollution Prevention Plan;
- List of Emergency contacts for implementing Long-Term Pollution Prevention Plan.

☐ A Long-Term Pollution Prevention Plan is attached to Stormwater Report and is included as an attachment to the Wetlands Notice of Intent.

☒ Treatment BMPs subject to the 44% TSS removal pretreatment requirement and the one inch rule for calculating the water quality volume are included, and discharge:

- ☒ is within the Zone II or Interim Wellhead Protection Area
- ☐ is near or to other critical areas
- ☐ is within soils with a rapid infiltration rate (greater than 2.4 inches per hour)
- ☐ involves runoff from land uses with higher potential pollutant loads.

☐ The Required Water Quality Volume is reduced through use of the LID site Design Credits.

☒ Calculations documenting that the treatment train meets the 80% TSS removal requirement and, if applicable, the 44% TSS removal pretreatment requirement, are provided.

Checklist for Stormwater Report

Checklist (continued)

Standard 4: Water Quality (continued)

☒ The BMP is sized (and calculations provided) based on:

- ☒ The ½" or 1" Water Quality Volume or
- ☐ The equivalent flow rate associated with the Water Quality Volume and documentation is provided showing that the BMP treats the required water quality volume.

☐ The applicant proposes to use proprietary BMPs, and documentation supporting use of proprietary BMP and proposed TSS removal rate is provided. This documentation may be in the form of the propriety BMP checklist found in Volume 2, Chapter 4 of the Massachusetts Stormwater Handbook and submitting copies of the TARP Report, STEP Report, and/or other third party studies verifying performance of the proprietary BMPs.

☐ A TMDL exists that indicates a need to reduce pollutants other than TSS and documentation showing that the BMPs selected are consistent with the TMDL is provided.

Standard 5: Land Uses With Higher Potential Pollutant Loads (LUHPPLs)

☐ The NPDES Multi-Sector General Permit covers the land use and the Stormwater Pollution Prevention Plan (SWPPP) has been included with the Stormwater Report.

☐ The NPDES Multi-Sector General Permit covers the land use and the SWPPP will be submitted ***prior to*** the discharge of stormwater to the post-construction stormwater BMPs.

☐ The NPDES Multi-Sector General Permit does ***not*** cover the land use.

☐ LUHPPLs are located at the site and industry specific source control and pollution prevention measures have been proposed to reduce or eliminate the exposure of LUHPPLs to rain, snow, snow melt and runoff, and been included in the long term Pollution Prevention Plan.

☐ All exposure has been eliminated.

☐ All exposure has ***not*** been eliminated and all BMPs selected are on MassDEP LUHPPL list.

☐ The LUHPPL has the potential to generate runoff with moderate to higher concentrations of oil and grease (e.g. all parking lots with >1000 vehicle trips per day) and the treatment train includes an oil grit separator, a filtering bioretention area, a sand filter or equivalent.

Standard 6: Critical Areas

☒ The discharge is near or to a critical area and the treatment train includes only BMPs that MassDEP has approved for stormwater discharges to or near that particular class of critical area.

☒ Critical areas and BMPs are identified in the Stormwater Report.

Checklist for Stormwater Report

Checklist (continued)

Standard 7: Redevelopments and Other Projects Subject to the Standards only to the maximum extent practicable

☐ The project is subject to the Stormwater Management Standards only to the maximum Extent Practicable as a:

- ☐ Limited Project
- ☐ Small Residential Projects: 5-9 single family houses or 5-9 units in a multi-family development provided there is no discharge that may potentially affect a critical area.
- ☐ Small Residential Projects: 2-4 single family houses or 2-4 units in a multi-family development with a discharge to a critical area
- ☐ Marina and/or boatyard provided the hull painting, service and maintenance areas are protected from exposure to rain, snow, snow melt and runoff
- ☐ Bike Path and/or Foot Path
- ☐ Redevelopment Project
- ☐ Redevelopment portion of mix of new and redevelopment.

☐ Certain standards are not fully met (Standard No. 1, 8, 9, and 10 must always be fully met) and an explanation of why these standards are not met is contained in the Stormwater Report.

☐ The project involves redevelopment and a description of all measures that have been taken to improve existing conditions is provided in the Stormwater Report. The redevelopment checklist found in Volume 2 Chapter 3 of the Massachusetts Stormwater Handbook may be used to document that the proposed stormwater management system (a) complies with Standards 2, 3 and the pretreatment and structural BMP requirements of Standards 4-6 to the maximum extent practicable and (b) improves existing conditions.

Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control

A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan must include the following information:

- Narrative;
- Construction Period Operation and Maintenance Plan;
- Names of Persons or Entity Responsible for Plan Compliance;
- Construction Period Pollution Prevention Measures;
- Erosion and Sedimentation Control Plan Drawings;
- Detail drawings and specifications for erosion control BMPs, including sizing calculations;
- Vegetation Planning;
- Site Development Plan;
- Construction Sequencing Plan;
- Sequencing of Erosion and Sedimentation Controls;
- Operation and Maintenance of Erosion and Sedimentation Controls;
- Inspection Schedule;
- Maintenance Schedule;
- Inspection and Maintenance Log Form.

☒ A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan containing the information set forth above has been included in the Stormwater Report.

Checklist for Stormwater Report

Checklist (continued)

Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control (continued)

☐ The project is highly complex and information is included in the Stormwater Report that explains why it is not possible to submit the Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan with the application. A Construction Period Pollution Prevention and Erosion and Sedimentation Control has ***not*** been included in the Stormwater Report but will be submitted ***before*** land disturbance begins.

☐ The project is ***not*** covered by a NPDES Construction General Permit.

☐ The project is covered by a NPDES Construction General Permit and a copy of the SWPPP is in the Stormwater Report.

☒ The project is covered by a NPDES Construction General Permit but no SWPPP been submitted. The SWPPP will be submitted BEFORE land disturbance begins.

Standard 9: Operation and Maintenance Plan

☒ The Post Construction Operation and Maintenance Plan is included in the Stormwater Report and includes the following information:

- ☒ Name of the stormwater management system owners;
- ☒ Party responsible for operation and maintenance;
- ☒ Schedule for implementation of routine and non-routine maintenance tasks;
- ☒ Plan showing the location of all stormwater BMPs maintenance access areas;
- ☒ Description and delineation of public safety features;
- ☒ Estimated operation and maintenance budget; and
- ☒ Operation and Maintenance Log Form.

☐ The responsible party is ***not*** the owner of the parcel where the BMP is located and the Stormwater Report includes the following submissions:

- ☐ A copy of the legal instrument (deed, homeowner's association, utility trust or other legal entity) that establishes the terms of and legal responsibility for the operation and maintenance of the project site stormwater BMPs;
- ☐ A plan and easement deed that allows site access for the legal entity to operate and maintain BMP functions.

Standard 10: Prohibition of Illicit Discharges

☒ The Long-Term Pollution Prevention Plan includes measures to prevent illicit discharges;

☒ An Illicit Discharge Compliance Statement is attached;

☐ NO Illicit Discharge Compliance Statement is attached but will be submitted ***prior to*** the discharge of any stormwater to post-construction BMPs.

Stormwater Report Summary

October 16, 2023

Applicant/Project Name: Littleton Electric Light & Water Department
Taylor Street Well and Raw Water Main

Project Address: 151 & 153 Taylor Street, Littleton, MA

Application Prepared by:
Firm: Weston & Sampson, Inc.
Registered PE: James Pearson, P.E.

Below is an explanation regarding MassDEP Standards 1-10 as they apply to the Taylor Street Well and Raw Water Main project:

Project Information

The Littleton Electric Light & Water Department proposes to develop a new drinking water well at a Town owned parcel located off Taylor Street to augment the Town's active water supply sources. Access to the site will be provided through an easement located on abutting property owned by Amazon. Work involved with this project will include the construction of a 1,200-foot± access road, with approximately 800-feet constructed of gravel and 400-feet of asphalt, a well building, a raw water main, and stormwater management infrastructure. Other work will include grading, landscaping, and utilities in support of the well building.

The existing site is predominantly wooded and surrounded by a large wetland complex. Terrain is complex, with flat upland grassed areas, and undulating rolling hills located within wooded areas. Elevations range from 237-feet to 233-feet on the grassed portion of the Amazon site, and from 244-feet to 223-feet on the wooded portion located on Town owned property. Resource areas include bordering vegetated wetland, the 100-foot wetland buffer, and a Zone II wellhead protection area. NRCS soil mapping shows the site being comprised primarily of Quonset sandy loam and sandy Udorthents. Numerous well borings throughout the area generally confirm the subsurface conditions.

Standard 1: No New Untreated Discharges

The proposed project will create no new untreated discharges. Runoff from approximately 40%± of impervious areas subject to vehicular access will be captured in the stormwater management system and treated prior to discharge while the remaining 60%± of impervious area discharging to the bordering vegetated wetland is considered *De Minimis*. Existing topography, lack of head differential, and the location of the proposed drinking water well in proximity to the wetland preclude the installation of a TSS treatment practice at this location.

Runoff generated from this portion of the site is minimal, equivalent to 0.29-CFS during the 2-year 24-hour storm event, and TSS generated from this untreated portion of pavement will be negligible. Access to the well road will be controlled with extremely limited use, only accessible to employees of the Littleton Water Department and authorized personnel on an infrequent basis to conduct maintenance at the well building.

The proposed treatment practices will remove 90% of TSS from runoff received, and the vast majority of the site will flow overland across grassed and wooded areas, over highly pervious sandy soil (HSG-A), infiltrating much of the runoff, and removing TSS prior to reaching the bordering vegetated wetland.

Standard 2: Peak Rate Attenuation

Existing and proposed conditions were modeled using HydroCAD computer software. A table, summarizing peak discharges for the 2-Yr, 10-Yr, 25-Yr, 50-Yr, and 100-Yr storm events can be found in Attachment D of this report. The proposed design is such that peak discharge rates do not exceed pre-development rates, even in the 100-year storm scenario.

To ensure that the work incorporates the performance standards recommended in the DEP's Stormwater Management Policy, necessary erosion and sedimentation control measures will be utilized during construction, as depicted on the site plans.

Standard 3: Recharge

Standard 3 has been met. The required recharge volume has been provided within the proposed stormwater BMP based upon the adjusted capture area calculation, as the BMP only captures 40%± of the impervious area located within the project limits. Supporting calculations can be found in Attachment E of this report.

Standard 4: Water Quality

Standard 4 has been met. Treatment practices have been designed to capture the required water quality volume and provide treatment to remove greater than 44% of TSS prior to entering the infiltration BMP and greater than 80% of TSS overall, based upon 1-IN of runoff volume due to the location of the project within a Zone II. Supporting calculations can be found in Attachment E of this report.

During the project, appropriate BMPs will be used to minimize sedimentation and soil erosion.

Standard 5: Land Uses with Higher Potential Pollutant Loads (LUHPPLs)

This site is not considered a LUHPPL, Standard 5 does not apply.

Standard 6: Critical Areas

This project is located within a Zone II of a public water supply.

Standard 7: Redevelopments and Other Projects Subject to the Standards Only to the Maximum Extent Practicable

This is not a redevelopment project, Standard 7 does not apply.

Standard 8: Construction Period Pollution Prevention and Erosion and Sediment Control

A detailed Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan is included in Attachment G of this report. To ensure that the work incorporates the performance standards recommended in the DEP's Stormwater Management Policy, necessary erosion and sedimentation control measures will be utilized during construction.

Standard 9: Operation and Maintenance Plan

An operations and maintenance plan is included in Attachment H of this report.

Standard 10: Prohibition of Illicit Discharges

An illicit discharge compliance statement has been included in Attachment I of this report.

Registered Professional Engineer's Certification

I have reviewed the Stormwater Report, including any relevant soil evaluations, computations, Long-term Pollution Prevention Plan, the Construction Period Erosion and Sedimentation Control Plan, the Long-term Post-Construction Operation and Maintenance Plan, the Illicit Discharge Compliance Statement and the plans showing the stormwater management system, and have determined that they have been prepared in accordance with the requirements of the Stormwater Management Standards as further elaborated by the Massachusetts Stormwater Handbook. I have also determined that the information presented in the Stormwater Checklist is accurate and that the information presented in the Stormwater Report accurately reflects conditions at the site as of the date of this permit application.

Registered Professional Engineer Block and Signature

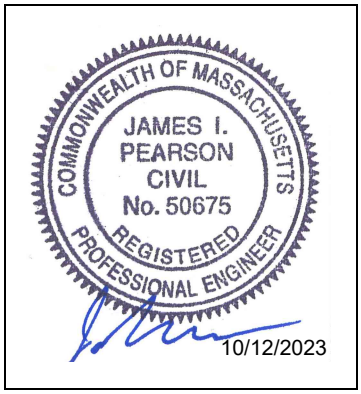

10/12/2023

Signature and Date

Attachment A - Locus Map

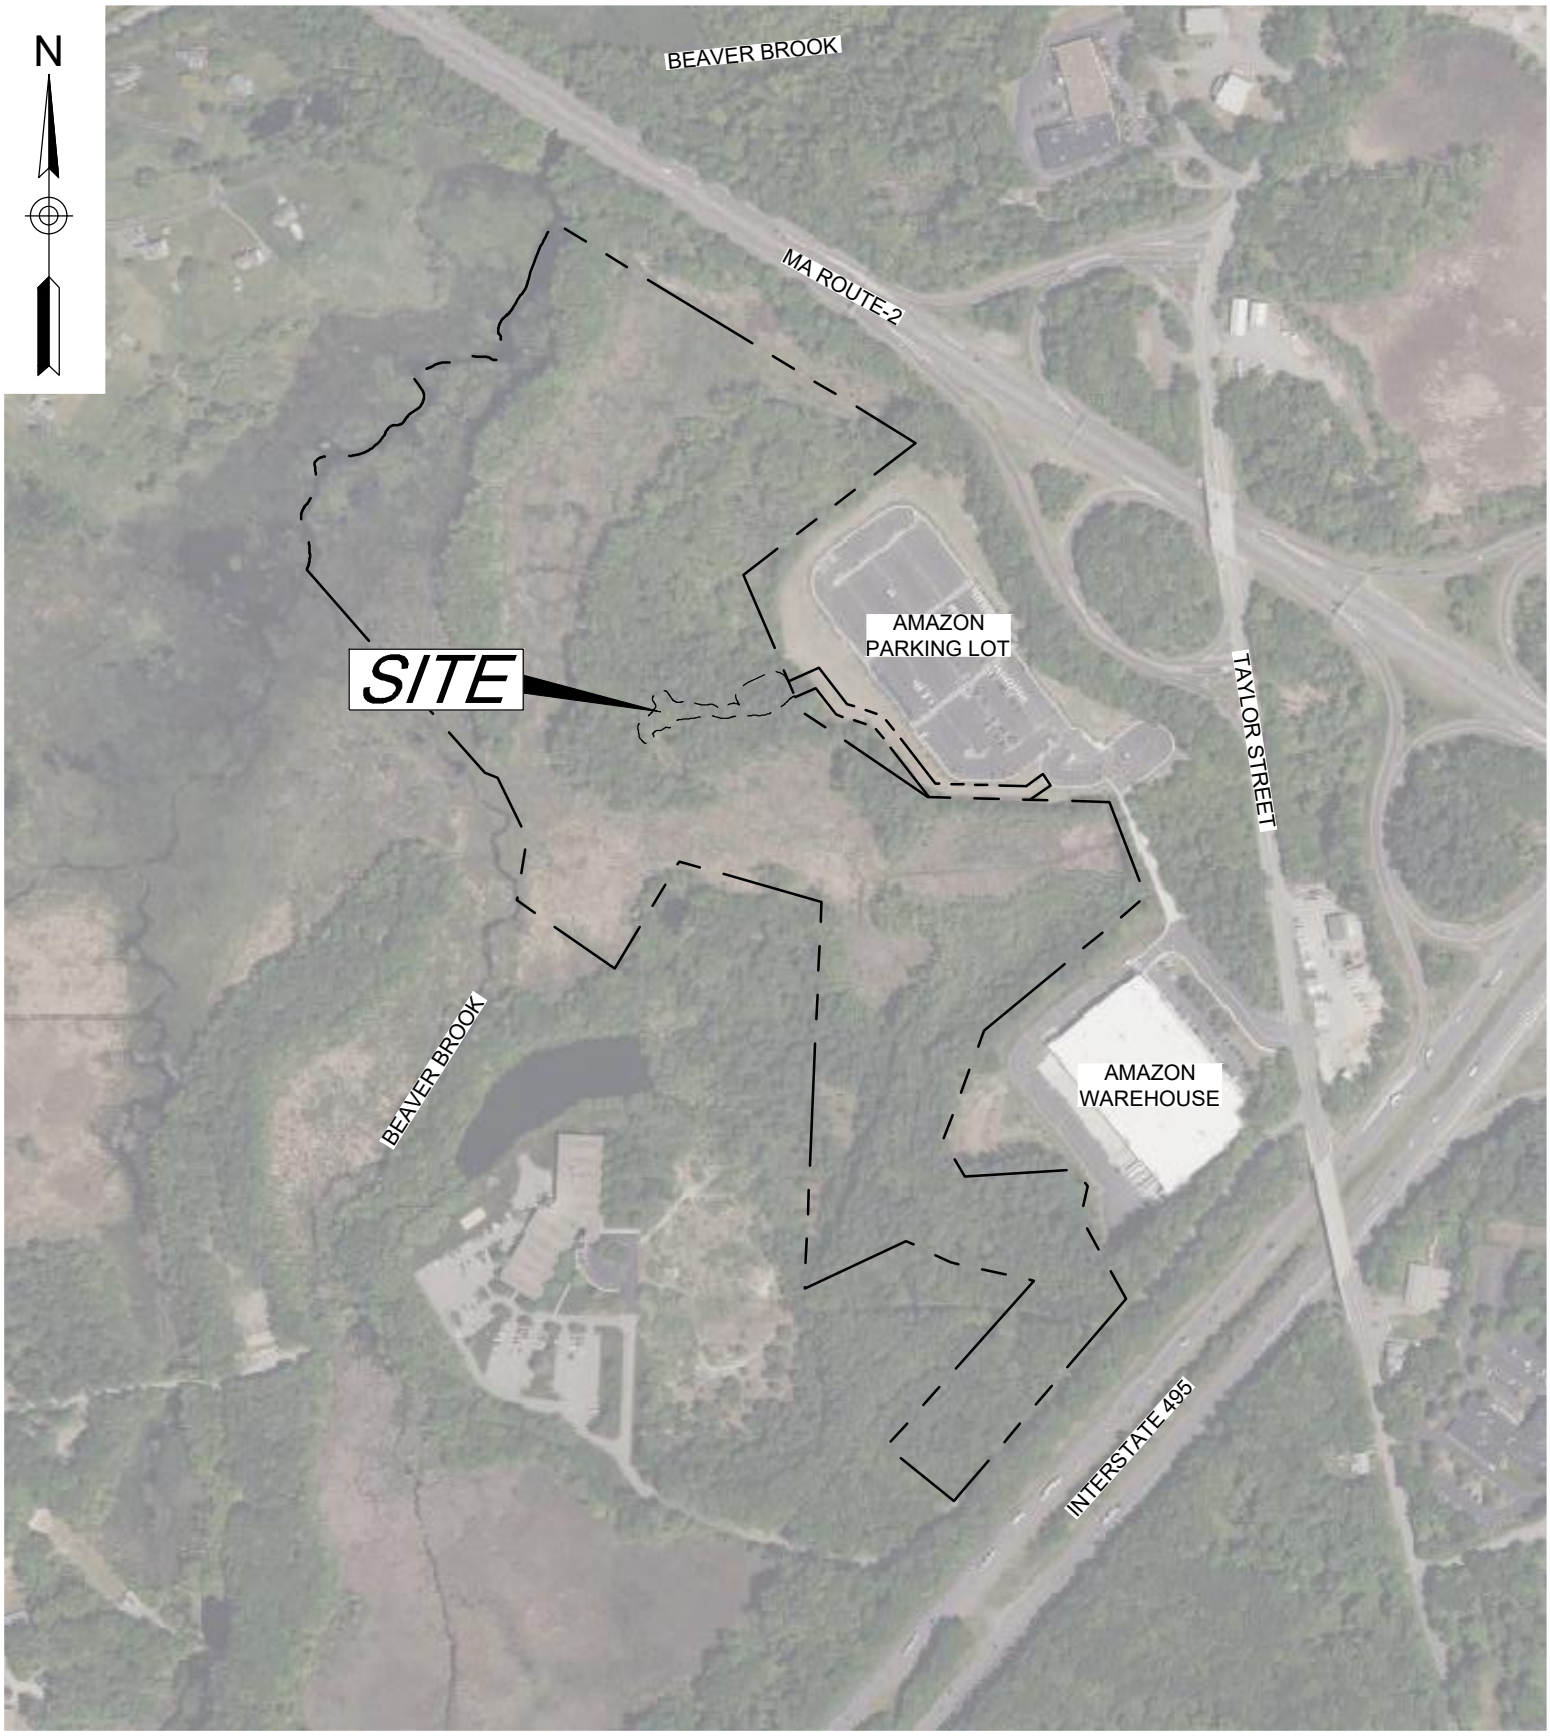

500 250 0 500

SCALE 1"= 500

LOCUS MAP

Weston & Sampson℠

Weston & Sampson Engineers, Inc.

55 Walkers Brook Drive, Suite 100, Reading MA 01867

Attachment B - NRCS Soils Map, Soils Report, and HSG Classifications

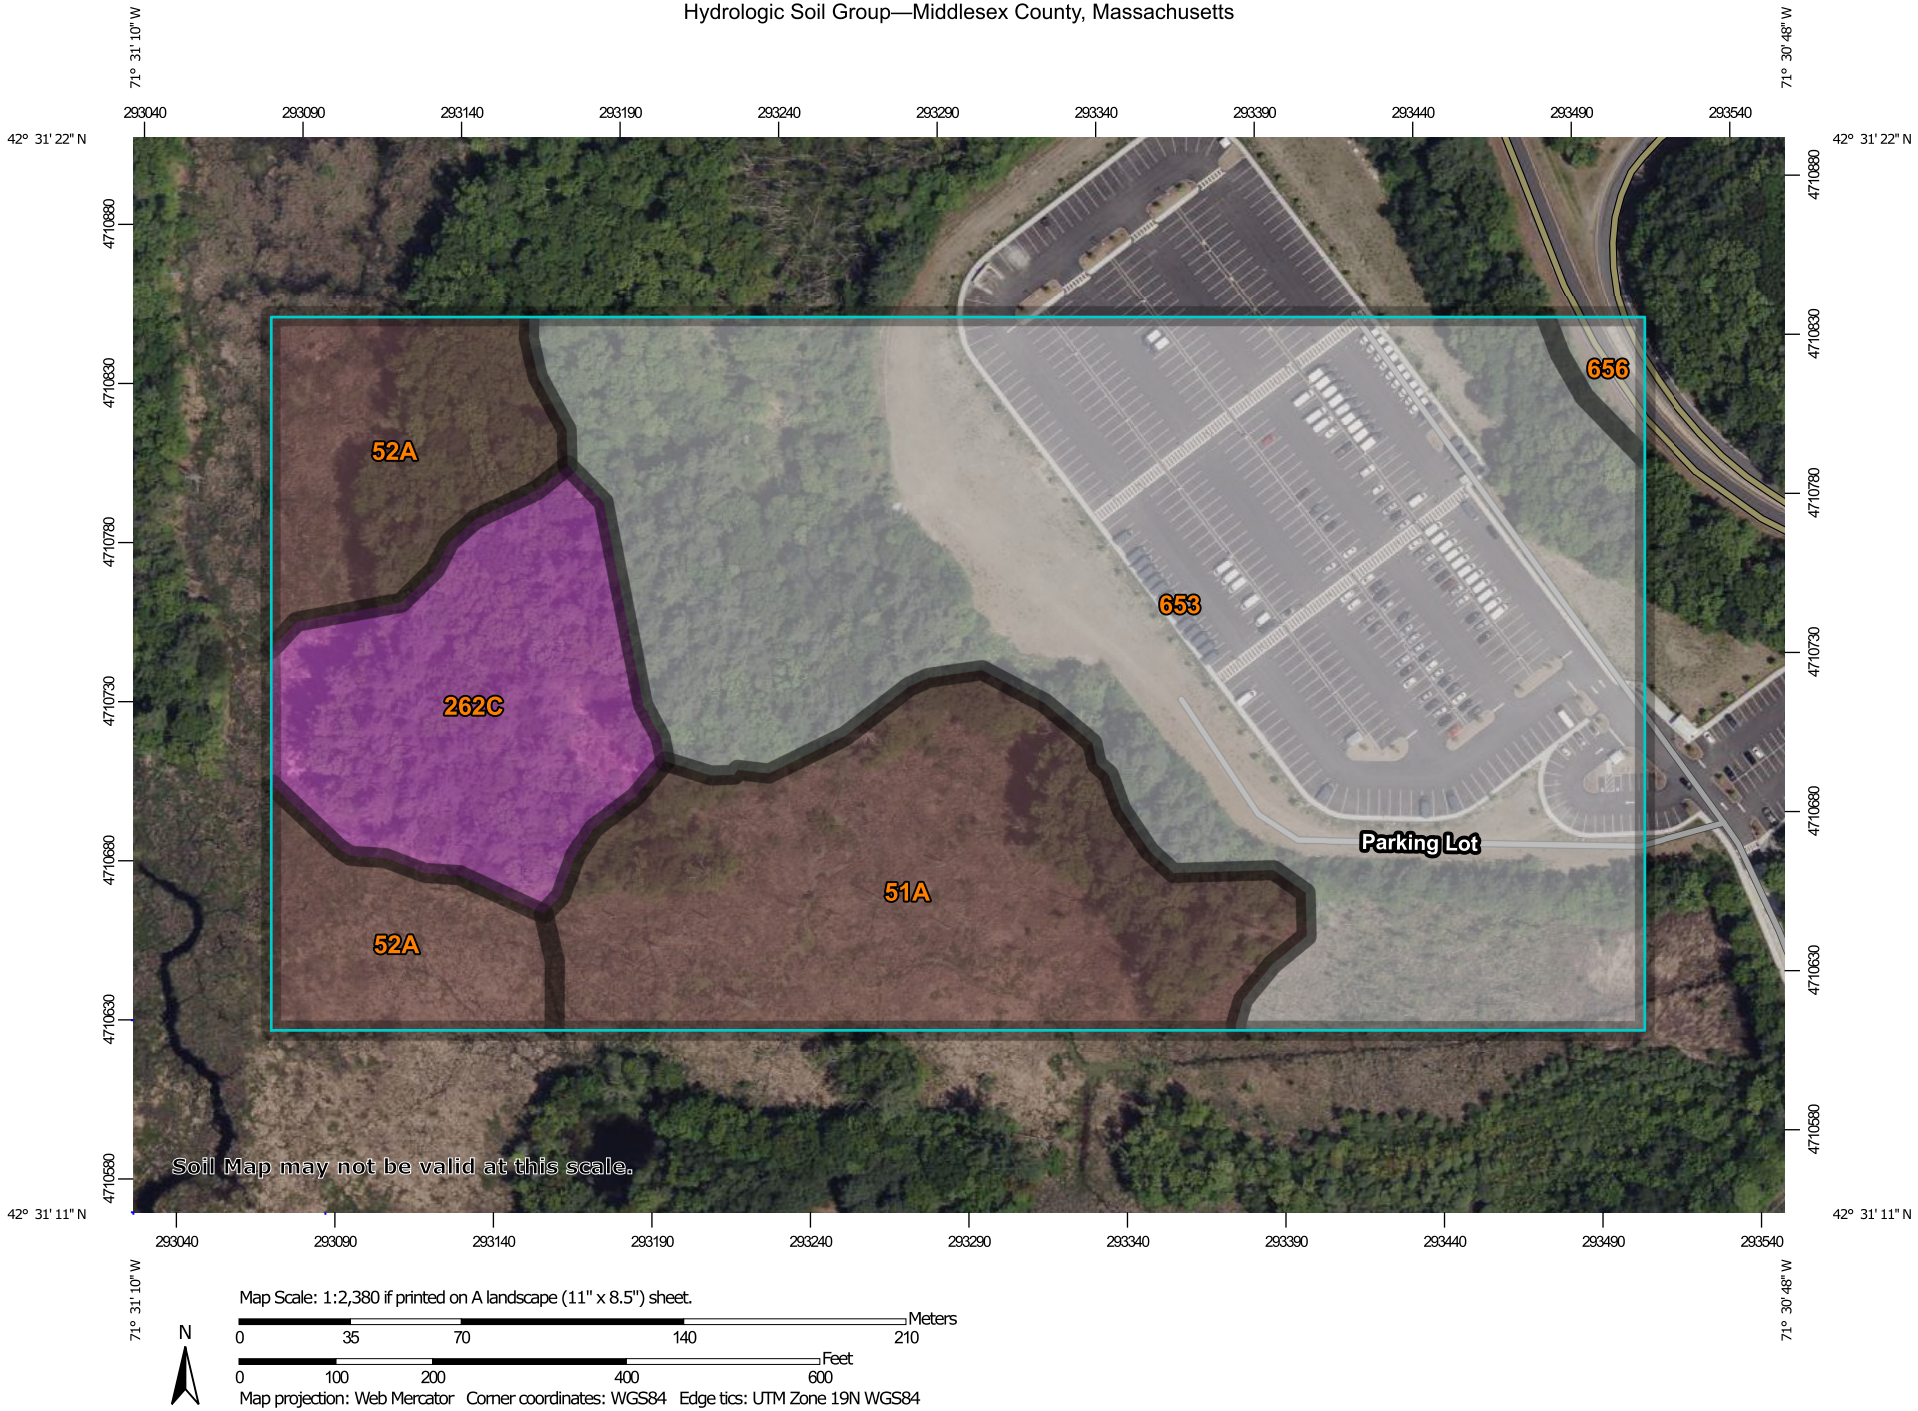

Map Scale: 1:2,380 if printed on A landscape (11" x 8.5") sheet.

N

Meters: 0 35 70 140 210

Feet: 0 100 200 400 600

Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 19N WGS84

MAP LEGEND

Area of Interest (AOI)

- Area of Interest (AOI)

Soils

Soil Rating Polygons

- A
- A/D
- B
- B/D
- C
- C/D
- D
- Not rated or not available

Soil Rating Lines

- A
- A/D
- B
- B/D
- C
- C/D
- D
- Not rated or not available

Soil Rating Points

- A
- A/D
- B
- B/D
- C
- C/D
- D
- Not rated or not available

Water Features

- Streams and Canals

Transportation

- Rails
- Interstate Highways
- US Routes
- Major Roads
- Local Roads

Background

- Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:25,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL:
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Middlesex County, Massachusetts
Survey Area Data: Version 22, Sep 9, 2022

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: May 22, 2022—Jun 5, 2022

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
51A	Swansea muck, 0 to 1 percent slopes	B/D	4.6	19.1%
52A	Freetown muck, 0 to 1 percent slopes	B/D	2.9	12.0%
262C	Quonset sandy loam, 8 to 15 percent slopes	A	2.7	11.3%
653	Udorthents, sandy		13.7	56.8%
656	Udorthents-Urban land complex		0.2	0.9%
Totals for Area of Interest			**24.1**	**100.0%**

Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

Rating Options

Aggregation Method: Dominant Condition

Component Percent Cutoff: None Specified

Tie-break Rule: Higher

Attachment C - Frimpter Analysis Memorandum

712 Brook Street, Suite 103, Rocky Hill, CT 06067
Tel: 860.513.1473

M E M O R A N D U M

TO:	File
FROM:	Jill Getchell
DATE:	September 29, 2023
SUBJECT:	Seasonal High Groundwater Estimations

Weston & Sampson has evaluated probable high groundwater elevations at the proposed Taylor Street Well Site in Littleton, Massachusetts. Using the data set from the pumping test conducted in September 2022, the Frimpter Method (USGS OFR 80-1205), a method for estimating the seasonal high groundwater elevation for a single point, was conducted on the 200-ft Observation Well located near the proposed Taylor Street Well. The Frimpter method for estimation of probable high groundwater levels (S_h) at unmonitored sites and is represented by the following relationship:

$$S_h = S_c - \frac{S_r}{OW_r}(OW_c - OW_{max})$$

where,

S_c = measured depth to water at site (feet)
S_r = range of water level where the site is located (feet)
OW_r = measured depth to water in well which is used to correlate with the water levels at the site (feet)
OW_c = depth to recorded maximum water level at the observation well which is used to correlate with the water levels at the site (feet)
OW_{max} = recorded upper limit of annual range of water level at the observation well that is used to correlate with the water levels at the site (feet)

The measured depth to water at the site on September 23, 2022 (highest observed static elevation) was used as the basis for the calculation. The site was assumed to be equivalent to a valley flat composed of sand and gravel due to the site's topography. An appropriate range of water levels (S_r) was assumed to be 4.2 feet (Frimpter, 1980). OW_r, OW_c and OW_{max} were each extracted from the nearby USGS monitoring wells (MA-WWW 160 WESTFORD, MA and MA-ACW 158 ACTON, MA). These USGS wells were used for the evaluation based on the distance from the 200-ft observation well and aquifer characteristics. Probable High Groundwater Elevations are summarized in the table below:

	MA-ACW 158 ACTON, MA	MA-WWW 160 WESTFORD, MA
200-ft OB Well DTW (ft btoc)	9.31	
200-ft OB Well Stickup Height (ft)	0.92	
200-ft OB Well TOC Elevation (ft NAVD 88)	230.88	
S_c (ft bg)	8.39	8.39
S_r (ft)	4.2	4.2
OW_c (ft bg)	19.94	12.66
OW_{max} (ft)	13.34	9.56
OW_r (ft bg)	6.35	3.51
S_h (ft bg)	4.03	4.68
S_h Elevation (ft NAVD 88)	225.94	225.28

Therefore, the estimated range of probable high groundwater levels at the site range from 4.03 to 4.68 ft bg (225.28 to 225.94 ft NAVD 88).

Attachment D - HydroCAD Reports

Stormwater Discharge Summary Table

Taylor Street Well and Raw Water Main
Littleton, MA
October 16, 2023

		Peak Discharge (CFS)	
Analysis Point	**24-Hr Storm Event**	**Pre-Development**	**Post-Development**
A	2-YR	0.00	0.00
	10-YR	0.04	0.03
	25-YR	0.19	0.16
	50-YR	0.61	0.50
	100-YR	1.60	1.32

NOAA Atlas 14, Volume 10, Version 3
Location name: Littleton, Massachusetts, USA*
Latitude: 42.5185°, Longitude: -71.5132°
Elevation: 243 ft**
* source: ESRI Maps
** source: USGS

POINT PRECIPITATION FREQUENCY ESTIMATES

Sanja Perica, Sandra Pavlovic, Michael St. Laurent, Carl Trypaluk, Dale Unruh, Orlan Wilhite

NOAA, National Weather Service, Silver Spring, Maryland

PF_tabular | PF_graphical | Maps_&_aerials

PF tabular

PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches)[1]

Duration	Average recurrence interval (years)									
	1	2	5	10	25	50	100	200	500	1000
5-min	**0.326** (0.254-0.411)	**0.388** (0.302-0.490)	**0.489** (0.381-0.620)	**0.572** (0.442-0.729)	**0.687** (0.515-0.912)	**0.773** (0.568-1.05)	**0.865** (0.617-1.21)	**0.970** (0.654-1.38)	**1.12** (0.729-1.66)	**1.25** (0.792-1.88)
10-min	**0.462** (0.360-0.583)	**0.549** (0.428-0.694)	**0.692** (0.538-0.877)	**0.811** (0.626-1.03)	**0.974** (0.729-1.29)	**1.10** (0.805-1.48)	**1.23** (0.874-1.72)	**1.38** (0.927-1.96)	**1.59** (1.03-2.34)	**1.77** (1.12-2.66)
15-min	**0.543** (0.424-0.686)	**0.646** (0.504-0.816)	**0.814** (0.633-1.03)	**0.954** (0.737-1.22)	**1.15** (0.858-1.52)	**1.29** (0.947-1.75)	**1.44** (1.03-2.02)	**1.62** (1.09-2.31)	**1.87** (1.21-2.76)	**2.09** (1.32-3.13)
30-min	**0.737** (0.576-0.931)	**0.878** (0.685-1.11)	**1.11** (0.861-1.40)	**1.30** (1.00-1.65)	**1.56** (1.17-2.07)	**1.76** (1.29-2.38)	**1.96** (1.40-2.75)	**2.20** (1.48-3.14)	**2.55** (1.65-3.76)	**2.84** (1.80-4.26)
60-min	**0.932** (0.727-1.18)	**1.11** (0.865-1.40)	**1.40** (1.09-1.77)	**1.64** (1.27-2.09)	**1.97** (1.48-2.62)	**2.22** (1.63-3.01)	**2.48** (1.77-3.49)	**2.79** (1.88-3.98)	**3.23** (2.09-4.76)	**3.60** (2.28-5.40)
2-hr	**1.18** (0.926-1.47)	**1.42** (1.12-1.78)	**1.82** (1.43-2.29)	**2.15** (1.68-2.72)	**2.61** (1.97-3.45)	**2.95** (2.18-3.98)	**3.31** (2.39-4.64)	**3.75** (2.54-5.31)	**4.42** (2.87-6.45)	**4.98** (3.16-7.41)
3-hr	**1.35** (1.07-1.68)	**1.64** (1.30-2.05)	**2.12** (1.67-2.65)	**2.51** (1.96-3.16)	**3.05** (2.32-4.02)	**3.45** (2.57-4.64)	**3.89** (2.82-5.44)	**4.42** (3.00-6.23)	**5.23** (3.41-7.61)	**5.93** (3.77-8.78)
6-hr	**1.72** (1.38-2.13)	**2.10** (1.67-2.60)	**2.72** (2.16-3.37)	**3.23** (2.55-4.02)	**3.93** (3.01-5.13)	**4.45** (3.34-5.94)	**5.02** (3.66-6.97)	**5.71** (3.89-7.98)	**6.78** (4.43-9.77)	**7.70** (4.91-11.3)
12-hr	**2.19** (1.76-2.68)	**2.66** (2.14-3.26)	**3.43** (2.74-4.22)	**4.07** (3.24-5.03)	**4.95** (3.81-6.40)	**5.60** (4.22-7.40)	**6.31** (4.63-8.67)	**7.16** (4.90-9.92)	**8.48** (5.56-12.1)	**9.60** (6.15-14.0)
24-hr	**2.62** (2.13-3.18)	**3.20** (2.59-3.89)	**4.14** (3.35-5.05)	**4.93** (3.95-6.04)	**6.01** (4.66-7.71)	**6.81** (5.17-8.92)	**7.68** (5.67-10.5)	**8.73** (6.00-12.0)	**10.3** (6.82-14.7)	**11.7** (7.54-16.9)
2-day	**2.97** (2.43-3.58)	**3.66** (2.99-4.41)	**4.79** (3.90-5.79)	**5.73** (4.63-6.96)	**7.02** (5.49-8.94)	**7.97** (6.10-10.4)	**9.01** (6.70-12.2)	**10.3** (7.10-14.0)	**12.3** (8.12-17.2)	**14.0** (9.02-20.0)
3-day	**3.24** (2.67-3.88)	**3.98** (3.27-4.78)	**5.20** (4.25-6.25)	**6.20** (5.04-7.50)	**7.58** (5.96-9.61)	**8.60** (6.61-11.1)	**9.72** (7.26-13.1)	**11.1** (7.68-15.0)	**13.2** (8.76-18.5)	**15.1** (9.72-21.4)
4-day	**3.50** (2.89-4.18)	**4.27** (3.52-5.10)	**5.52** (4.53-6.62)	**6.56** (5.35-7.91)	**8.00** (6.30-10.1)	**9.06** (6.98-11.7)	**10.2** (7.63-13.7)	**11.6** (8.07-15.7)	**13.8** (9.16-19.2)	**15.7** (10.1-22.2)
7-day	**4.21** (3.50-4.99)	**5.02** (4.17-5.96)	**6.34** (5.24-7.55)	**7.44** (6.11-8.90)	**8.95** (7.08-11.2)	**10.1** (7.79-12.8)	**11.3** (8.44-14.9)	**12.7** (8.87-17.0)	**14.9** (9.93-20.6)	**16.8** (10.9-23.6)
10-day	**4.89** (4.08-5.77)	**5.72** (4.77-6.76)	**7.08** (5.89-8.40)	**8.21** (6.78-9.78)	**9.77** (7.76-12.1)	**10.9** (8.47-13.8)	**12.2** (9.10-16.0)	**13.6** (9.52-18.1)	**15.7** (10.5-21.6)	**17.5** (11.4-24.5)
20-day	**6.90** (5.81-8.07)	**7.79** (6.56-9.13)	**9.26** (7.76-10.9)	**10.5** (8.71-12.4)	**12.1** (9.69-14.8)	**13.4** (10.4-16.7)	**14.7** (11.0-18.9)	**16.1** (11.3-21.2)	**18.0** (12.1-24.5)	**19.5** (12.7-27.0)
30-day	**8.57** (7.26-9.97)	**9.51** (8.05-11.1)	**11.1** (9.32-12.9)	**12.3** (10.3-14.5)	**14.1** (11.3-17.1)	**15.5** (12.0-19.1)	**16.8** (12.5-21.3)	**18.2** (12.9-23.8)	**19.9** (13.4-26.9)	**21.2** (13.8-29.3)
45-day	**10.6** (9.06-12.3)	**11.7** (9.91-13.5)	**13.3** (11.3-15.5)	**14.7** (12.3-17.1)	**16.6** (13.3-19.9)	**18.0** (14.1-22.0)	**19.5** (14.5-24.4)	**20.8** (14.8-27.0)	**22.4** (15.1-30.1)	**23.5** (15.4-32.2)
60-day	**12.4** (10.6-14.3)	**13.5** (11.5-15.5)	**15.2** (12.9-17.6)	**16.6** (14.0-19.4)	**18.6** (15.0-22.3)	**20.2** (15.8-24.5)	**21.7** (16.1-27.0)	**23.0** (16.4-29.8)	**24.5** (16.6-32.8)	**25.6** (16.7-34.9)

[1] Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS).

Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values.

Please refer to NOAA Atlas 14 document for more information.

Back to Top

PF graphical

N

LEGEND
- WOODS
- GRASS
- DIRT

BVW-41 BVW-43 BVW-44 BVW-40 BVW-39 BVW-45 BVW-38 BVW-46 BVW-37 BVW-47 BVW-36 BVW-48 BVW-35 BVW-49 BVW-34 BVW-50 BVW-33 BVW-51 BVW-32 BVW-52 BVW-31 BVW-53 BVW-30 BVW-54 BVW-29 BVW-55 BVW-28 BVW-56 BVW-27 BVW-57 BVW-26 BVW-58 BVW-25 BVW-59 BVW-24 BVW-60 BVW-23 BVW-22 BVW-21 BVW-20 BVW-19 BVW-18 BVW-17 BVW-16 BVW-15 BVW-14 BVW-13 BVW-12 BVW-11 BVW-10 BVW-9 BVW-8 BVW-7 BVW-6 BVW-5 BVW-4 BVW-3 BVW-2 BVW-1

BVW A5 BVW A4 BVW A3 BVW A2 BVW 62/BVW A1 BVW 61

BVW DD1 BVW DD2 BVW DD3 BVW DD4 BVW DD5 BVW DD6 BVW DD7 BVW DD8 BVW DD9 BVW DD10 BVW DD11 BVW DD12 BVW DD13 BVW DD14 BVW DD15 BVW DD16 BVW DD17 BVW DD18 BVW DD19 BVW DD20 BVW DD21 BVW DD22 BVW DD23 BVW DD24 BVW DD25

EX WETLAND

100-FT WETLAND BUFFER (TYP)

A

A1

DIRT TRAIL

N/F
LML LITTLETON LLC
151 TAYLOR STREET
R10-14-1

N/F
LITTLETON WATER DEPARTMENT
153 TAYLOR STREET
R10-14-0

50 25 0 50 100
SCALE: 1"=50'

Project:
LITTLETON WATER DEPARTMENT

LITTLETON LELWD ELECTRIC LIGHT & WATER DEPARTMENTS

TAYLOR STREET WELL AND RAW WATER MAIN

151 & 153 TAYLOR STREET, LITTLETON, MA 01460

Weston & Sampson

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

Seal:

Issued For:
PERMITTING - NOT FOR CONSTRUCTION

Scale:	AS SHOWN
Date:	OCTOBER 16, 2023
Drawn By:	AKG
Reviewed By:	JIP
Approved By:	JIP
W&S Project No.:	ENG23-0679
W&S File No.:	

Drawing Title:
EXISTING HYDROLOGIC MAP

Sheet Number:
FIG-1

Rev: 1.8 Date: 10/24/2019

COPYRIGHT 2023 WESTON & SAMPSON

\\wsinfs01\Projects\ENG\...\Exhibits\Property Tax Bounds\Exhibit\Permits\[SurroundPOINTS] - FIX HYDRO.dwg

N

LEGEND
- WOODS
- GRASS
- DIRT
- GRAVEL / RIP-RAP
- IMPERVIOUS

BVW-41 BVW-43 BVW-44 BVW-40 BVW-39 BVW-45 BVW-38 BVW-46 BVW-37 BVW-47 BVW-36 BVW-48 BVW-35 BVW-49 BVW-34 BVW-50 BVW-33 BVW-51 BVW-32 BVW-52 BVW-31 BVW-53 BVW-30 BVW-54 BVW-29 BVW-55 BVW-28 BVW-56 BVW-27 BVW-57 BVW-26 BVW-58 BVW-25 BVW-59 BVW-24 BVW-60 BVW-23 BVW-61 BVW-22 BVW 62/BVW A1 BVW-21 BVW A2 BVW-20 BVW A3 BVW-19 BVW A4 BVW-18 BVW A5 BVW-17 BVW-16 BVW-15 BVW-14 BVW-13 BVW-12 BVW-11 BVW-10 BVW-9 BVW-8 BVW-7 BVW-6 BVW-5 BVW-4 BVW-3 BVW-2 BVW-1

BVW DD1 BVW DD2 BVW DD3 BVW DD4 BVW DD5 BVW DD6 BVW DD7 BVW DD8 BVW DD9 BVW DD10 BVW DD11 BVW DD12 BVW DD13 BVW DD14 BVW DD15 BVW DD16 BVW DD17 BVW DD18 BVW DD19 BVW DD20 BVW DD21 BVW DD22 BVW DD23 BVW DD24

EX WETLAND

100-FT WETLAND BUFFER (TYP)

DIRT TRAIL

A1 A2 IB-1 A A

N/F
LML LITTLETON LLC
151 TAYLOR STREET
R10-14-1

N/F
LITTLETON WATER DEPARTMENT
153 TAYLOR STREET
R10-14-0

50 25 0 50 100
SCALE: 1"=50'

Project:
LITTLETON WATER DEPARTMENT

TAYLOR STREET WELL AND RAW WATER MAIN

151 & 153 TAYLOR STREET, LITTLETON, MA 01460

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

Seal:

Issued For:
PERMITTING - NOT FOR CONSTRUCTION

Scale:	AS SHOWN
Date:	OCTOBER 16, 2023
Drawn By:	AKG
Reviewed By:	JIP
Approved By:	JIP
W&S Project No.:	ENG23-0679
W&S File No.:	

Drawing Title:
PROPOSED HYDROLOGIC MAP

Sheet Number:
FIG-2

Rev: 1.8 Date: 10/24/2019

COPYRIGHT 2023 WESTON & SAMPSON

\\wes01\cad\0595\Projects\0595.1901\Cad\Property Tree Source Approved\06 Permits\Stormwater\DWG\FIG-2 PR HYDRO.dwg

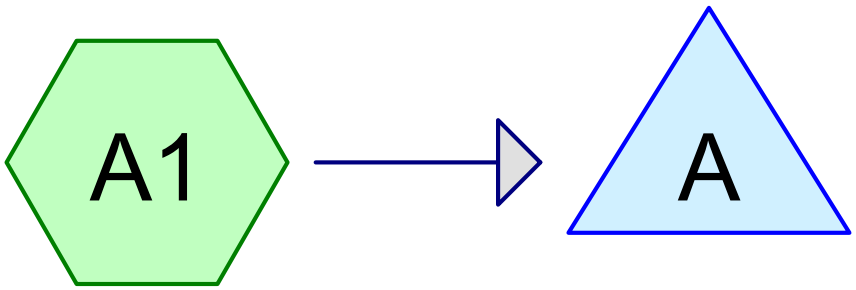

Subcat Reach Pond Link

Routing Diagram for EX-HydroCAD
Prepared by Weston & Sampson Engineers, Inc, Printed 10/11/2023
HydroCAD® 10.20-3c s/n 00455 © 2023 HydroCAD Software Solutions LLC

Rainfall Events Listing

Event#	Event Name	Storm Type	Curve	Mode	Duration (hours)	B/B	Depth (inches)	AMC
1	2-Yr	Type III 24-hr		Default	24.00	1	3.20	2
2	10-Yr	Type III 24-hr		Default	24.00	1	4.93	2
3	25-Yr	Type III 24-hr		Default	24.00	1	6.01	2
4	50-Yr	Type III 24-hr		Default	24.00	1	6.81	2
5	100-Yr	Type III 24-hr		Default	24.00	1	7.68	2

Area Listing (all nodes)

Area (sq-ft)	CN	Description (subcatchment-numbers)
77,738	39	>75% Grass cover, Good, HSG A (A1)
6,735	77	Bare soil, HSG A (A1)
279,165	30	Woods, Good, HSG A (A1)
363,638	**33**	**TOTAL AREA**

Soil Listing (all nodes)

Area (sq-ft)	Soil Group	Subcatchment Numbers
363,638	HSG A	A1
0	HSG B	
0	HSG C	
0	HSG D	
0	Other	
363,638		**TOTAL AREA**

Ground Covers (all nodes)

HSG-A (sq-ft)	HSG-B (sq-ft)	HSG-C (sq-ft)	HSG-D (sq-ft)	Other (sq-ft)	Total (sq-ft)	Ground Cover	Su Nu
77,738	0	0	0	0	77,738	>75% Grass cover, Good	
6,735	0	0	0	0	6,735	Bare soil	
279,165	0	0	0	0	279,165	Woods, Good	
363,638	**0**	**0**	**0**	**0**	**363,638**	**TOTAL AREA**	

Time span=1.00-36.00 hrs, dt=0.01 hrs, 3501 points x 2
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentA1: SUB-A1 Runoff Area=363,638 sf 0.00% Impervious Runoff Depth=0.00"
Flow Length=114' Tc=14.0 min CN=33 Runoff=0.00 cfs 0 cf

Pond A: POI-A Inflow=0.00 cfs 0 cf
Primary=0.00 cfs 0 cf

Total Runoff Area = 363,638 sf Runoff Volume = 0 cf Average Runoff Depth = 0.00"
100.00% Pervious = 363,638 sf 0.00% Impervious = 0 sf

Summary for Subcatchment A1: SUB-A1

Runoff = 0.00 cfs @ 1.00 hrs, Volume= 0 cf, Depth= 0.00"
Routed to Pond A : POI-A

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-Yr Rainfall=3.20"

	Area (sf)	CN	Description
	279,165	30	Woods, Good, HSG A
	77,738	39	>75% Grass cover, Good, HSG A
*	6,735	77	Bare soil, HSG A
	363,638	33	Weighted Average
	363,638		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.8	50	0.0175	0.07		**Sheet Flow,** Woods: Light underbrush n= 0.400 P2= 3.30"
1.1	43	0.0175	0.66		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
0.1	21	0.2850	2.67		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
14.0	114	Total			

Subcatchment A1: SUB-A1

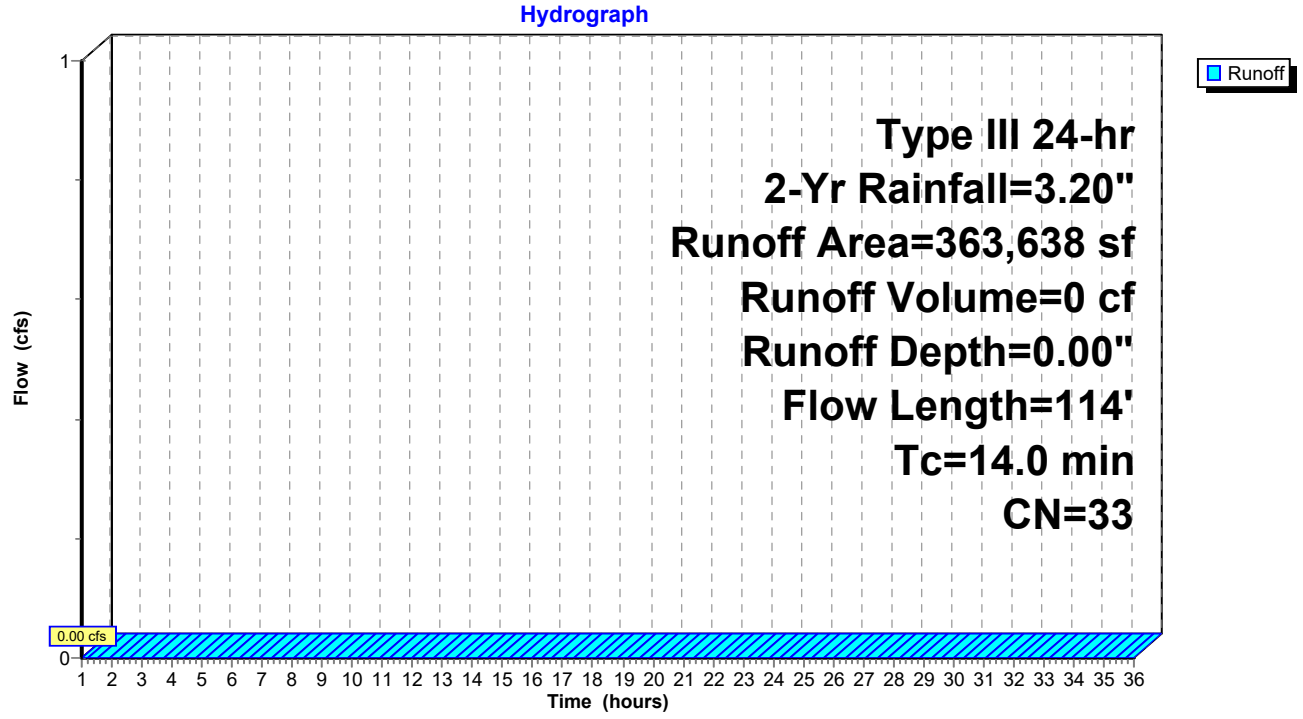

Summary for Pond A: POI-A

Inflow Area = 363,638 sf, 0.00% Impervious, Inflow Depth = 0.00" for 2-Yr event
Inflow = 0.00 cfs @ 1.00 hrs, Volume= 0 cf
Primary = 0.00 cfs @ 1.00 hrs, Volume= 0 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2

Pond A: POI-A

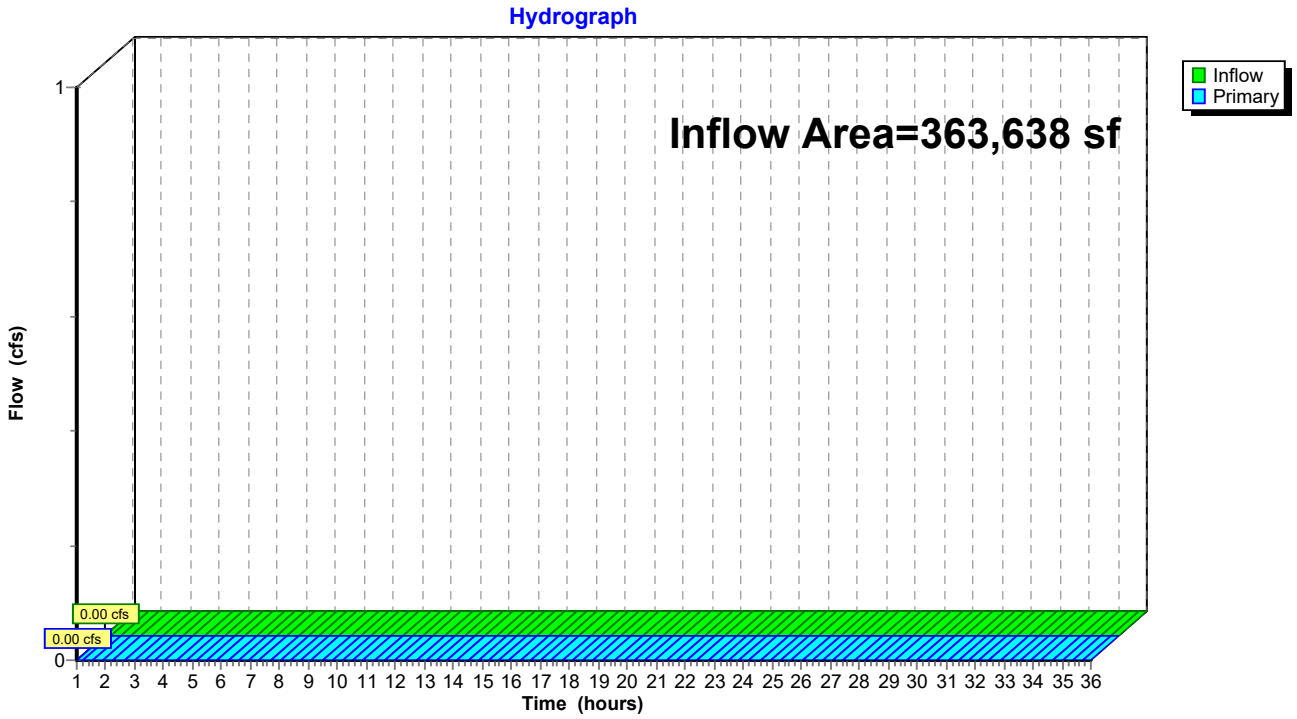

Time span=1.00-36.00 hrs, dt=0.01 hrs, 3501 points x 2
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentA1: SUB-A1 Runoff Area=363,638 sf 0.00% Impervious Runoff Depth=0.04"
Flow Length=114' Tc=14.0 min CN=33 Runoff=0.04 cfs 1,082 cf

Pond A: POI-A Inflow=0.04 cfs 1,082 cf
Primary=0.04 cfs 1,082 cf

Total Runoff Area = 363,638 sf Runoff Volume = 1,082 cf Average Runoff Depth = 0.04"
100.00% Pervious = 363,638 sf 0.00% Impervious = 0 sf

Summary for Subcatchment A1: SUB-A1

Runoff = 0.04 cfs @ 17.22 hrs, Volume= 1,082 cf, Depth= 0.04"
Routed to Pond A : POI-A

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-Yr Rainfall=4.93"

	Area (sf)	CN	Description
	279,165	30	Woods, Good, HSG A
	77,738	39	>75% Grass cover, Good, HSG A
*	6,735	77	Bare soil, HSG A
	363,638	33	Weighted Average
	363,638		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.8	50	0.0175	0.07		**Sheet Flow,** Woods: Light underbrush n= 0.400 P2= 3.30"
1.1	43	0.0175	0.66		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
0.1	21	0.2850	2.67		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
14.0	114	Total			

Subcatchment A1: SUB-A1

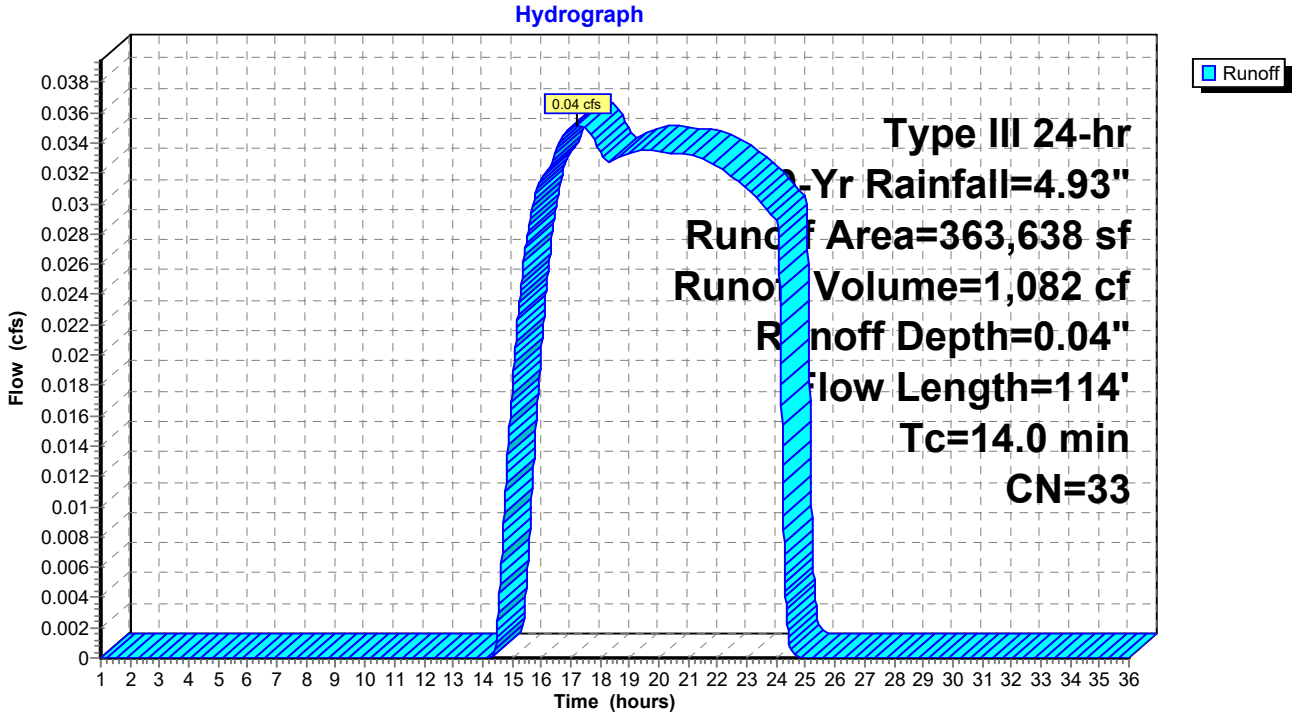

Summary for Pond A: POI-A

Inflow Area = 363,638 sf, 0.00% Impervious, Inflow Depth = 0.04" for 10-Yr event
Inflow = 0.04 cfs @ 17.22 hrs, Volume= 1,082 cf
Primary = 0.04 cfs @ 17.22 hrs, Volume= 1,082 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2

Pond A: POI-A

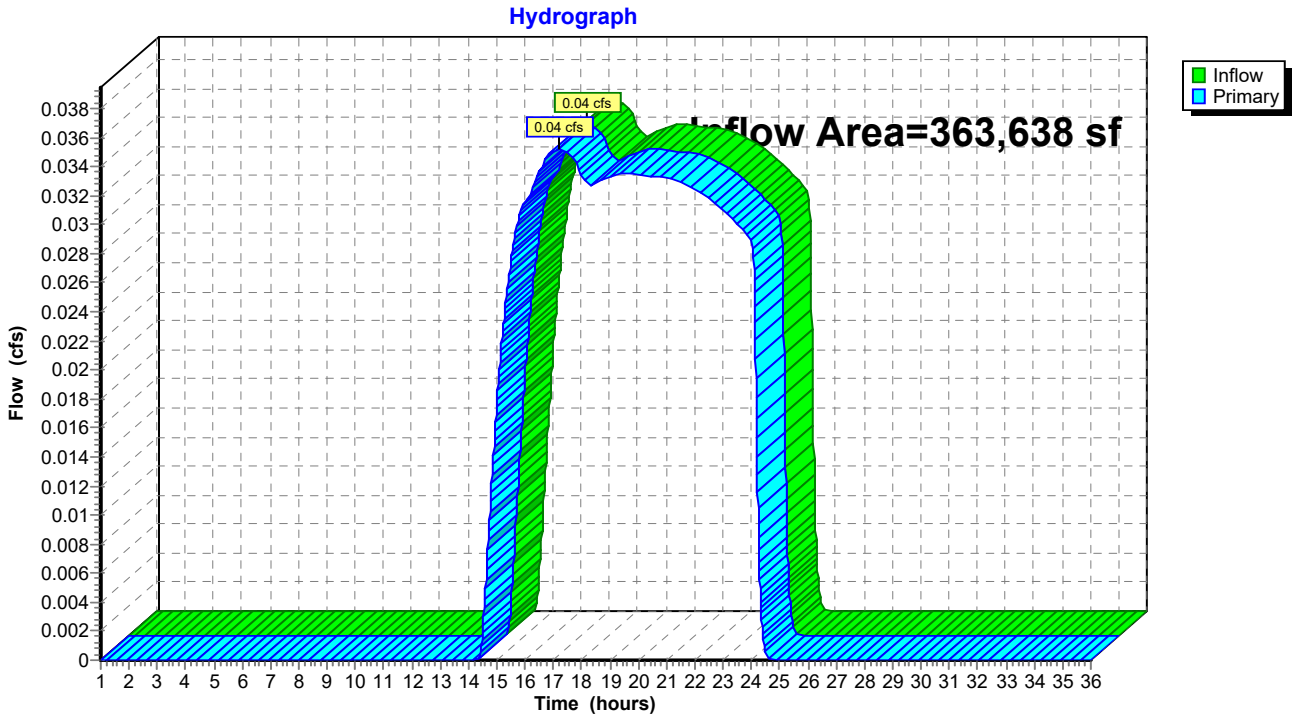

Time span=1.00-36.00 hrs, dt=0.01 hrs, 3501 points x 2
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentA1: SUB-A1 Runoff Area=363,638 sf 0.00% Impervious Runoff Depth=0.17"
Flow Length=114' Tc=14.0 min CN=33 Runoff=0.19 cfs 5,175 cf

Pond A: POI-A Inflow=0.19 cfs 5,175 cf
Primary=0.19 cfs 5,175 cf

Total Runoff Area = 363,638 sf Runoff Volume = 5,175 cf Average Runoff Depth = 0.17"
100.00% Pervious = 363,638 sf 0.00% Impervious = 0 sf

Summary for Subcatchment A1: SUB-A1

Runoff = 0.19 cfs @ 14.67 hrs, Volume= 5,175 cf, Depth= 0.17"
Routed to Pond A : POI-A

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-Yr Rainfall=6.01"

	Area (sf)	CN	Description
	279,165	30	Woods, Good, HSG A
	77,738	39	>75% Grass cover, Good, HSG A
*	6,735	77	Bare soil, HSG A
	363,638	33	Weighted Average
	363,638		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.8	50	0.0175	0.07		**Sheet Flow,** Woods: Light underbrush n= 0.400 P2= 3.30"
1.1	43	0.0175	0.66		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
0.1	21	0.2850	2.67		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
14.0	114	Total			

Subcatchment A1: SUB-A1

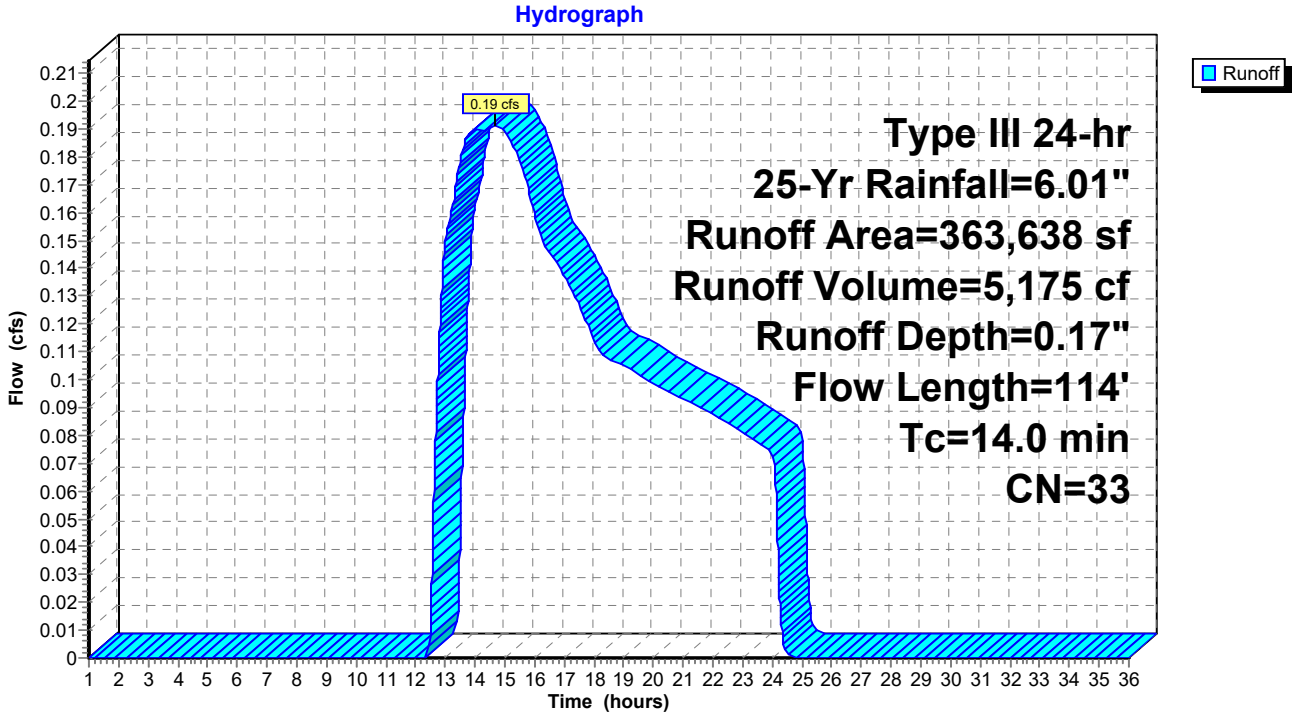

Summary for Pond A: POI-A

Inflow Area = 363,638 sf, 0.00% Impervious, Inflow Depth = 0.17" for 25-Yr event
Inflow = 0.19 cfs @ 14.67 hrs, Volume= 5,175 cf
Primary = 0.19 cfs @ 14.67 hrs, Volume= 5,175 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2

Pond A: POI-A

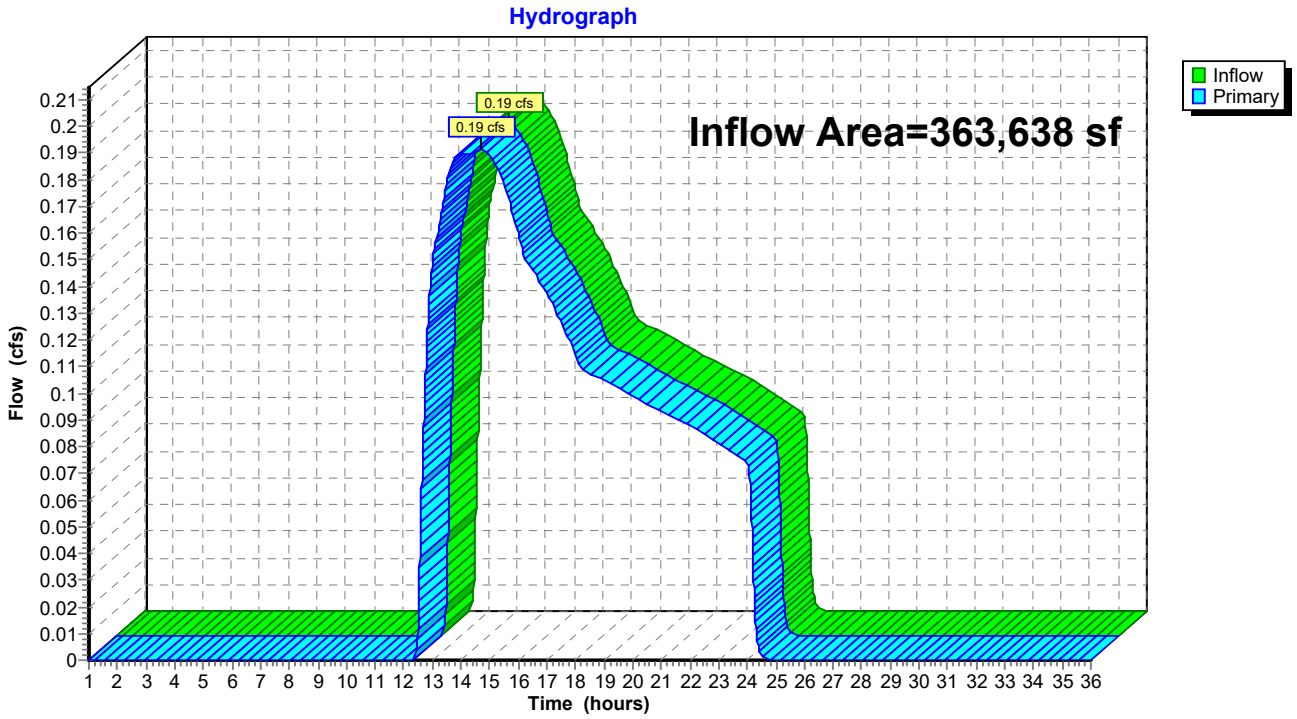

Time span=1.00-36.00 hrs, dt=0.01 hrs, 3501 points x 2
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentA1: SUB-A1 Runoff Area=363,638 sf 0.00% Impervious Runoff Depth=0.33"
Flow Length=114' Tc=14.0 min CN=33 Runoff=0.61 cfs 9,937 cf

Pond A: POI-A Inflow=0.61 cfs 9,937 cf
Primary=0.61 cfs 9,937 cf

Total Runoff Area = 363,638 sf Runoff Volume = 9,937 cf Average Runoff Depth = 0.33"
100.00% Pervious = 363,638 sf 0.00% Impervious = 0 sf

Summary for Subcatchment A1: SUB-A1

Runoff = 0.61 cfs @ 12.55 hrs, Volume= 9,937 cf, Depth= 0.33"
Routed to Pond A : POI-A

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-Yr Rainfall=6.81"

	Area (sf)	CN	Description
	279,165	30	Woods, Good, HSG A
	77,738	39	>75% Grass cover, Good, HSG A
*	6,735	77	Bare soil, HSG A
	363,638	33	Weighted Average
	363,638		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.8	50	0.0175	0.07		**Sheet Flow,** Woods: Light underbrush n= 0.400 P2= 3.30"
1.1	43	0.0175	0.66		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
0.1	21	0.2850	2.67		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
14.0	114	Total			

Subcatchment A1: SUB-A1

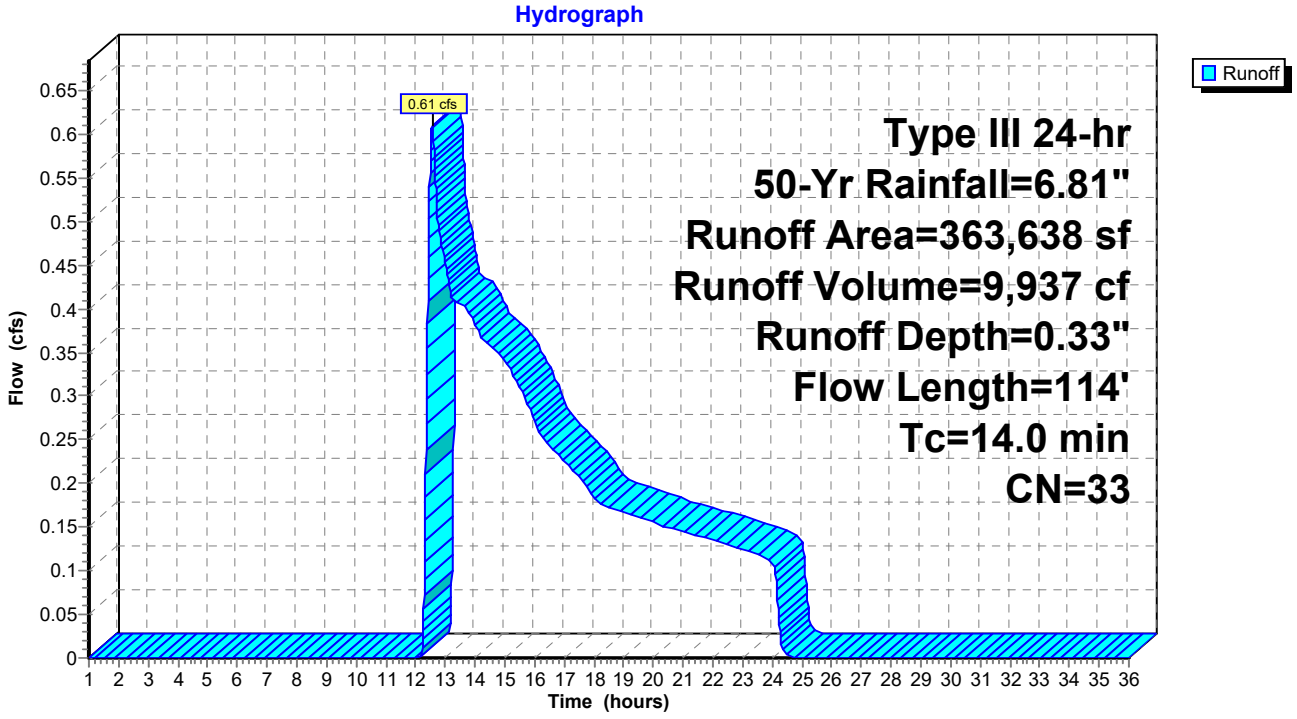

Summary for Pond A: POI-A

Inflow Area = 363,638 sf, 0.00% Impervious, Inflow Depth = 0.33" for 50-Yr event
Inflow = 0.61 cfs @ 12.55 hrs, Volume= 9,937 cf
Primary = 0.61 cfs @ 12.55 hrs, Volume= 9,937 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2

Pond A: POI-A

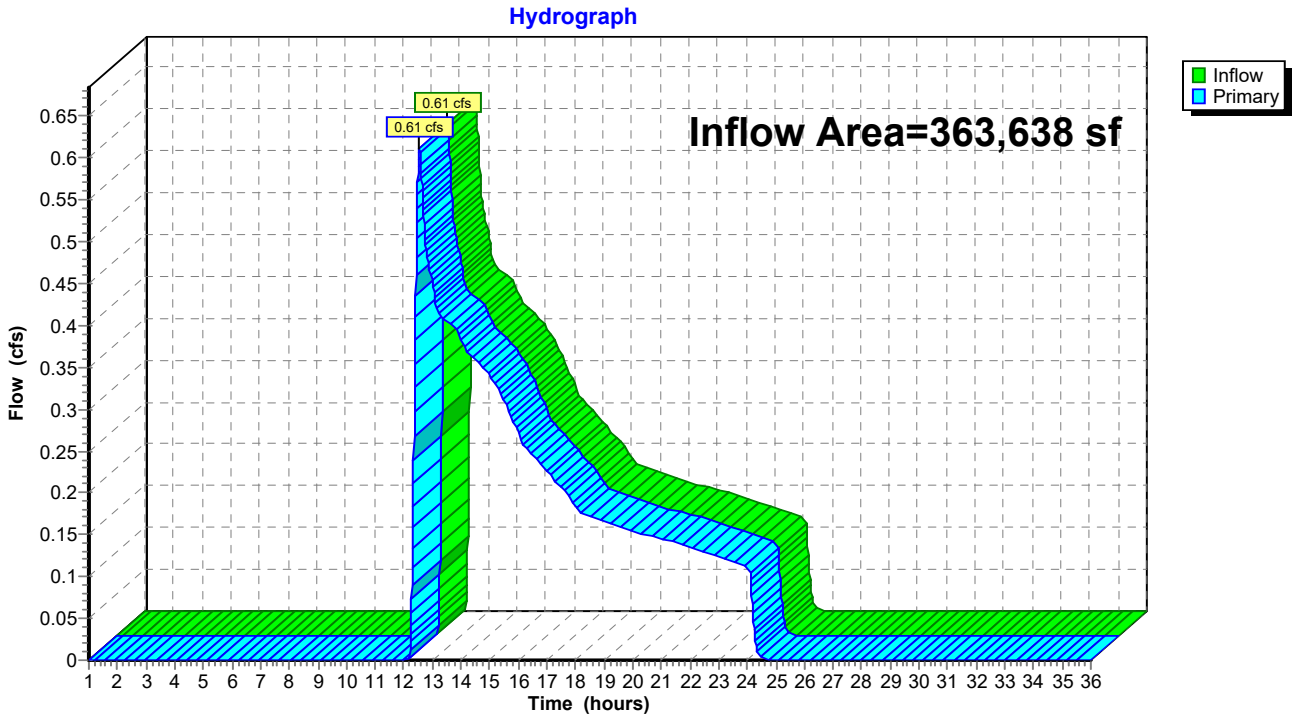

Time span=1.00-36.00 hrs, dt=0.01 hrs, 3501 points x 2
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentA1: SUB-A1 Runoff Area=363,638 sf 0.00% Impervious Runoff Depth=0.55"
Flow Length=114' Tc=14.0 min CN=33 Runoff=1.60 cfs 16,594 cf

Pond A: POI-A Inflow=1.60 cfs 16,594 cf
Primary=1.60 cfs 16,594 cf

Total Runoff Area = 363,638 sf Runoff Volume = 16,594 cf Average Runoff Depth = 0.55"
100.00% Pervious = 363,638 sf 0.00% Impervious = 0 sf

Summary for Subcatchment A1: SUB-A1

Runoff = 1.60 cfs @ 12.48 hrs, Volume= 16,594 cf, Depth= 0.55"
Routed to Pond A : POI-A

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-Yr Rainfall=7.68"

	Area (sf)	CN	Description
	279,165	30	Woods, Good, HSG A
	77,738	39	>75% Grass cover, Good, HSG A
*	6,735	77	Bare soil, HSG A
	363,638	33	Weighted Average
	363,638		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.8	50	0.0175	0.07		**Sheet Flow,** Woods: Light underbrush n= 0.400 P2= 3.30"
1.1	43	0.0175	0.66		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
0.1	21	0.2850	2.67		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
14.0	114	Total			

Subcatchment A1: SUB-A1

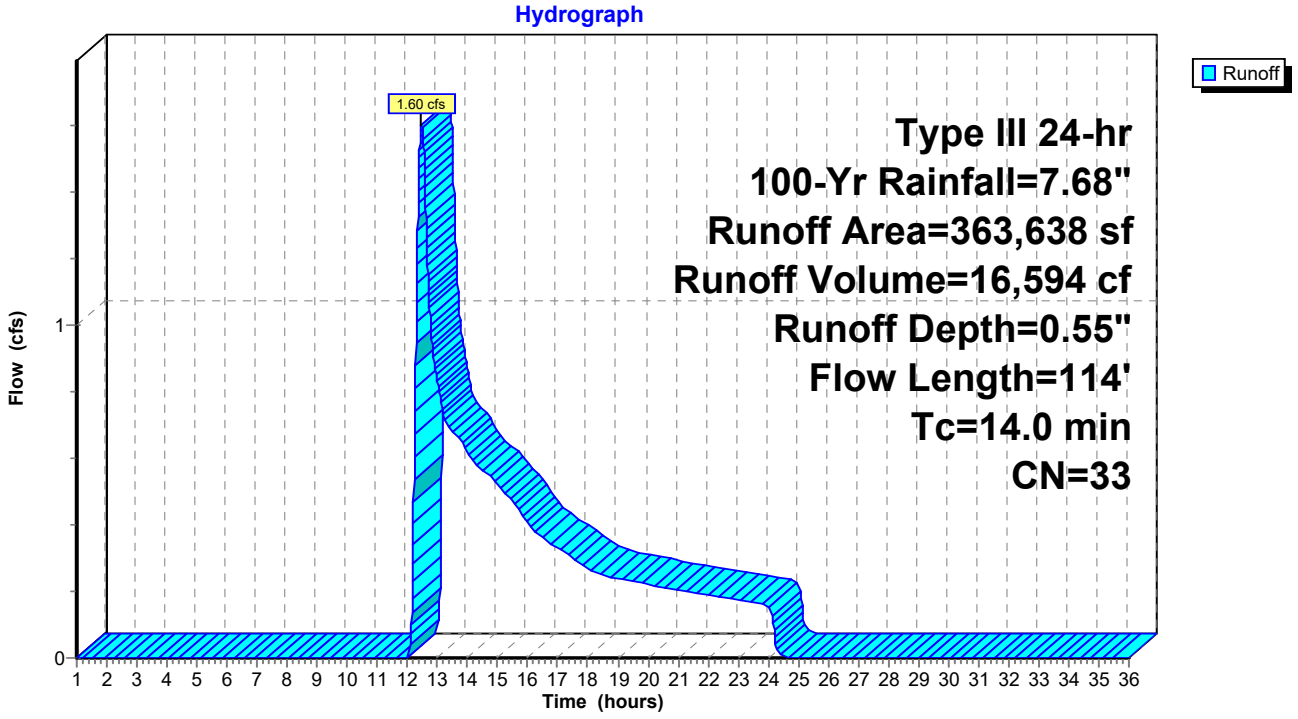

Summary for Pond A: POI-A

Inflow Area = 363,638 sf, 0.00% Impervious, Inflow Depth = 0.55" for 100-Yr event
Inflow = 1.60 cfs @ 12.48 hrs, Volume= 16,594 cf
Primary = 1.60 cfs @ 12.48 hrs, Volume= 16,594 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2

Pond A: POI-A

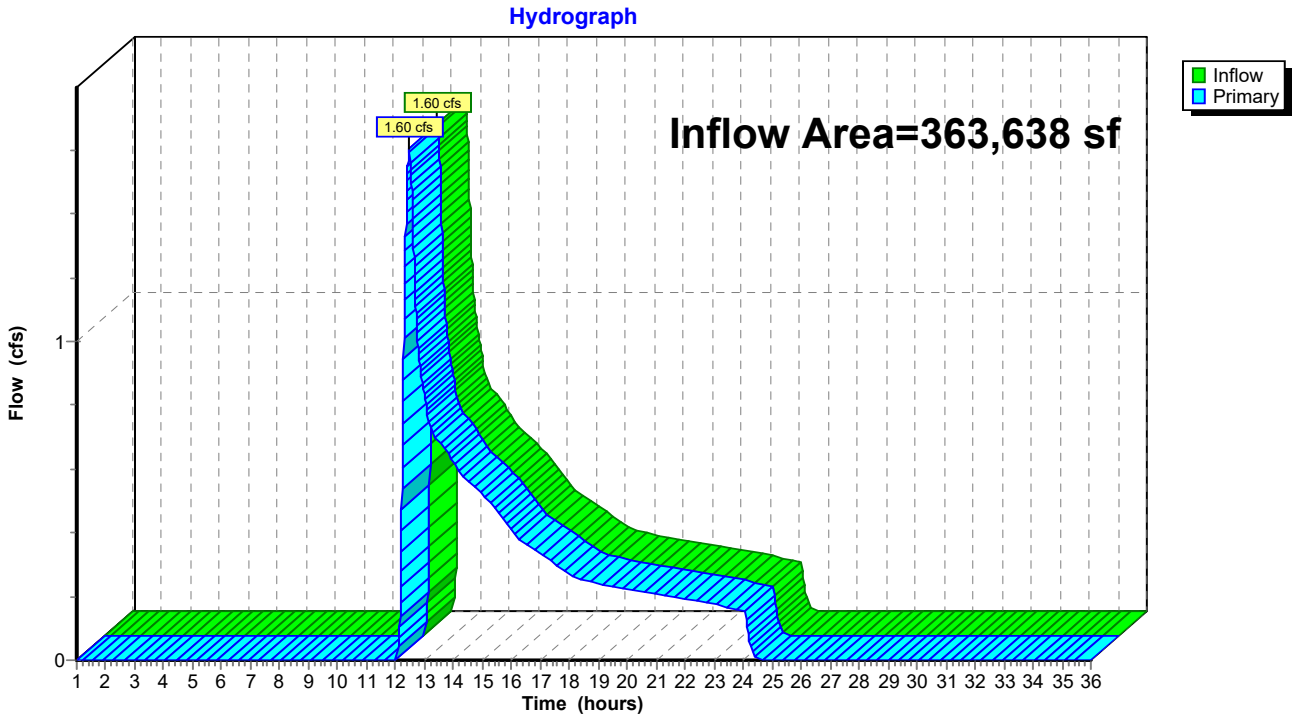

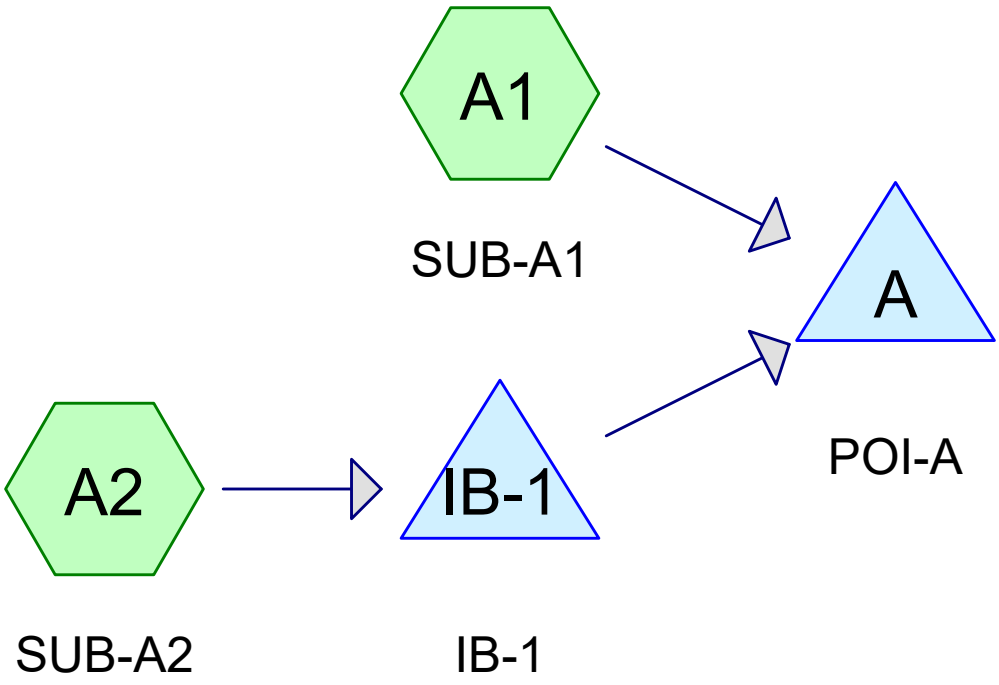

Subcat Reach Pond Link

Routing Diagram for PR-HydroCAD
Prepared by Weston & Sampson Engineers, Inc, Printed 10/11/2023
HydroCAD® 10.20-3c s/n 00455 © 2023 HydroCAD Software Solutions LLC

Rainfall Events Listing

Event#	Event Name	Storm Type	Curve	Mode	Duration (hours)	B/B	Depth (inches)	AMC
1	2-Yr	Type III 24-hr		Default	24.00	1	3.20	2
2	10-Yr	Type III 24-hr		Default	24.00	1	4.93	2
3	25-Yr	Type III 24-hr		Default	24.00	1	6.01	2
4	50-Yr	Type III 24-hr		Default	24.00	1	6.81	2
5	100-Yr	Type III 24-hr		Default	24.00	1	7.68	2

Area Listing (all nodes)

Area (sq-ft)	CN	Description (subcatchment-numbers)
78,653	39	>75% Grass cover, Good, HSG A (A1, A2)
5,518	77	Bare soil, HSG A (A1)
11,455	76	Gravel driveway, HSG A (A2)
6,762	98	Paved driveway, HSG A (A1, A2)
1,768	76	Rip-rap, HSG A (A1, A2)
240	98	Roofs, HSG A (A1)
259,242	30	Woods, Good, HSG A (A1, A2)
363,638	**36**	**TOTAL AREA**

Soil Listing (all nodes)

Area (sq-ft)	Soil Group	Subcatchment Numbers
363,638	HSG A	A1, A2
0	HSG B	
0	HSG C	
0	HSG D	
0	Other	
363,638		**TOTAL AREA**

Ground Covers (all nodes)

HSG-A (sq-ft)	HSG-B (sq-ft)	HSG-C (sq-ft)	HSG-D (sq-ft)	Other (sq-ft)	Total (sq-ft)	Ground Cover	Su Nu
78,653	0	0	0	0	78,653	>75% Grass cover, Good	
5,518	0	0	0	0	5,518	Bare soil	
11,455	0	0	0	0	11,455	Gravel driveway	
6,762	0	0	0	0	6,762	Paved driveway	
1,768	0	0	0	0	1,768	Rip-rap	
240	0	0	0	0	240	Roofs	
259,242	0	0	0	0	259,242	Woods, Good	
363,638	**0**	**0**	**0**	**0**	**363,638**	**TOTAL AREA**	

Time span=1.00-36.00 hrs, dt=0.01 hrs, 3501 points x 2
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentA1: SUB-A1 Runoff Area=297,579 sf 1.40% Impervious Runoff Depth=0.00"
Flow Length=116' Tc=13.8 min CN=33 Runoff=0.00 cfs 0 cf

SubcatchmentA2: SUB-A2 Runoff Area=66,059 sf 4.31% Impervious Runoff Depth=0.09"
Flow Length=840' Tc=15.9 min CN=48 Runoff=0.02 cfs 495 cf

Pond A: POI-A Inflow=0.00 cfs 0 cf
Primary=0.00 cfs 0 cf

Pond IB-1: IB-1 Peak Elev=229.00' Storage=3 cf Inflow=0.02 cfs 495 cf
Discarded=0.02 cfs 495 cf Primary=0.00 cfs 0 cf Outflow=0.02 cfs 495 cf

Total Runoff Area = 363,638 sf Runoff Volume = 495 cf Average Runoff Depth = 0.02"
98.07% Pervious = 356,636 sf 1.93% Impervious = 7,002 sf

Summary for Subcatchment A1: SUB-A1

Runoff = 0.00 cfs @ 1.00 hrs, Volume= 0 cf, Depth= 0.00"
Routed to Pond A : POI-A

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-Yr Rainfall=3.20"

	Area (sf)	CN	Description
	256,279	30	Woods, Good, HSG A
	30,079	39	>75% Grass cover, Good, HSG A
*	5,518	77	Bare soil, HSG A
*	3,916	98	Paved driveway, HSG A
*	1,547	76	Rip-rap, HSG A
	240	98	Roofs, HSG A
	297,579	33	Weighted Average
	293,423		98.60% Pervious Area
	4,156		1.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.8	50	0.0175	0.07		**Sheet Flow,** Woods: Light underbrush n= 0.400 P2= 3.30"
0.9	42	0.0240	0.77		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
0.1	24	0.3400	2.92		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
13.8	116	Total			

Subcatchment A1: SUB-A1

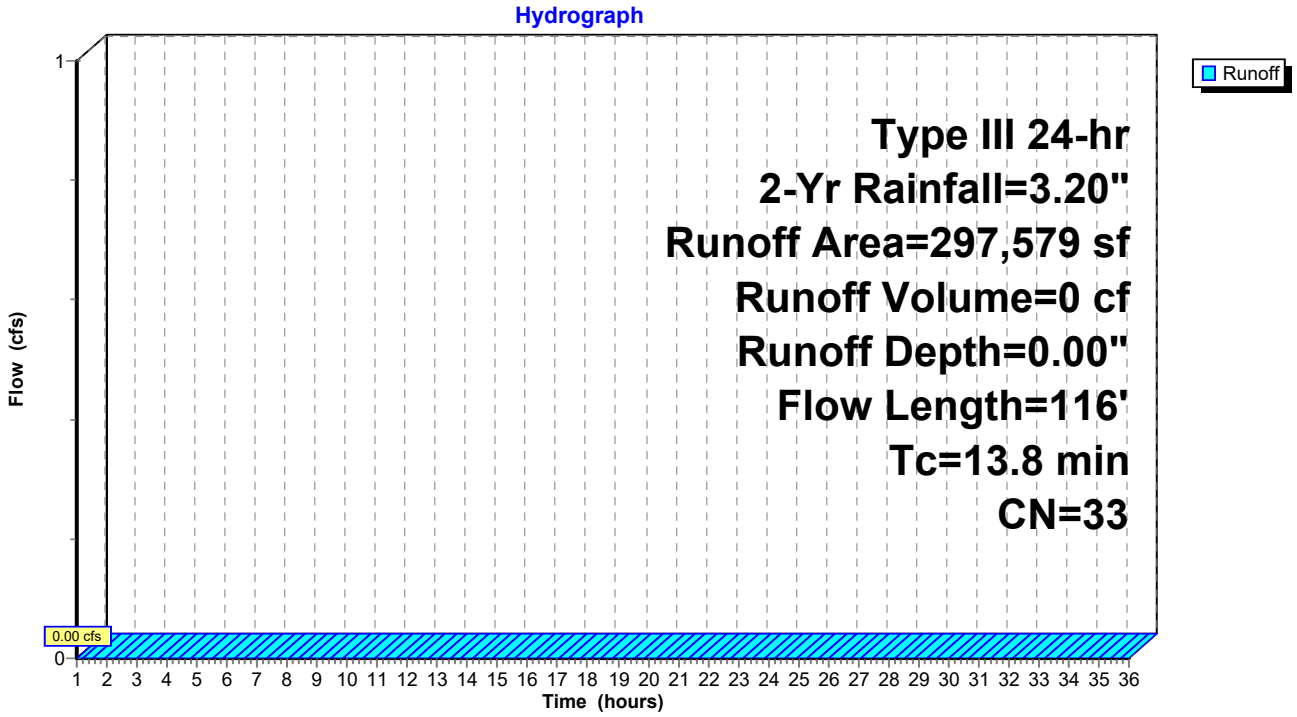

Summary for Subcatchment A2: SUB-A2

Runoff = 0.02 cfs @ 14.68 hrs, Volume= 495 cf, Depth= 0.09"
Routed to Pond IB-1 : IB-1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-Yr Rainfall=3.20"

	Area (sf)	CN	Description
	48,574	39	>75% Grass cover, Good, HSG A
*	11,455	76	Gravel driveway, HSG A
	2,963	30	Woods, Good, HSG A
*	2,846	98	Paved driveway, HSG A
*	221	76	Rip-rap, HSG A
	66,059	48	Weighted Average
	63,213		95.69% Pervious Area
	2,846		4.31% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.1	45	0.0200	0.15		**Sheet Flow,** Grass: Short n= 0.150 P2= 3.30"
10.8	795	0.0050	1.23	1.23	**Channel Flow,** Area= 1.0 sf Perim= 4.8' r= 0.21' n= 0.030 Earth, grassed & winding
15.9	840	Total			

Subcatchment A2: SUB-A2

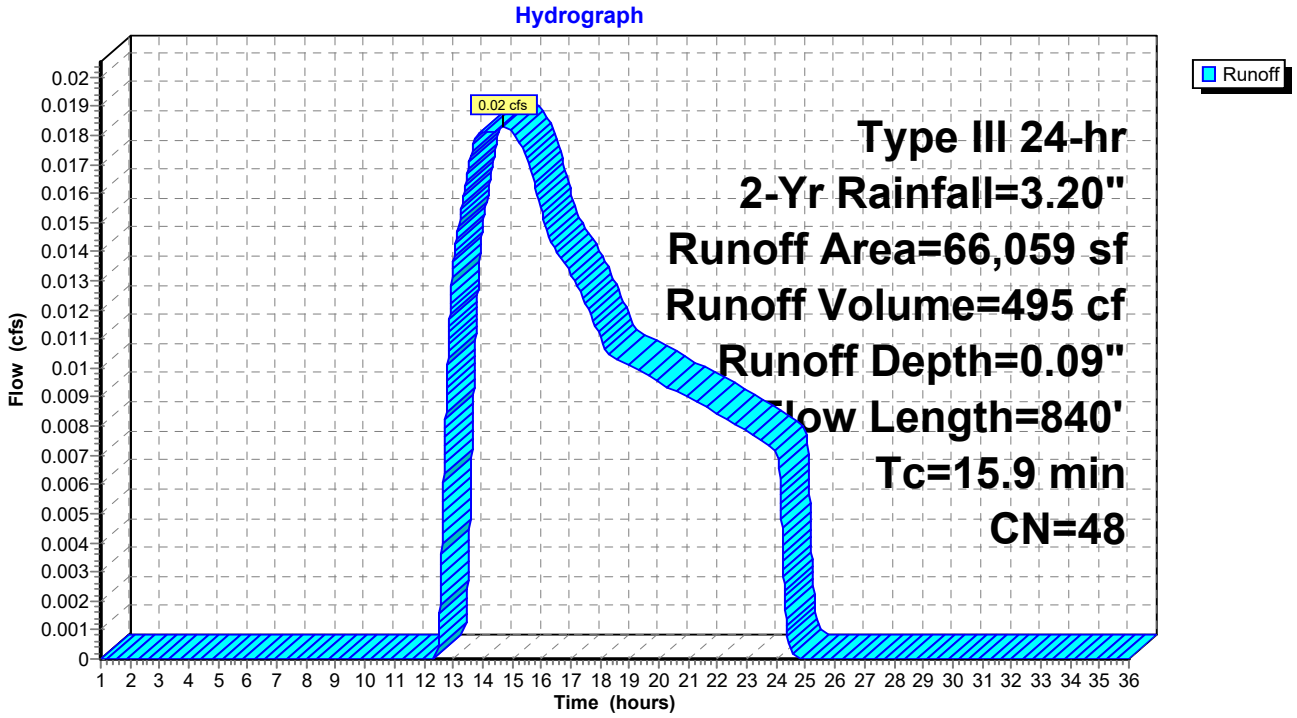

Summary for Pond A: POI-A

Inflow Area = 363,638 sf, 1.93% Impervious, Inflow Depth = 0.00" for 2-Yr event
Inflow = 0.00 cfs @ 1.00 hrs, Volume= 0 cf
Primary = 0.00 cfs @ 1.00 hrs, Volume= 0 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2

Pond A: POI-A

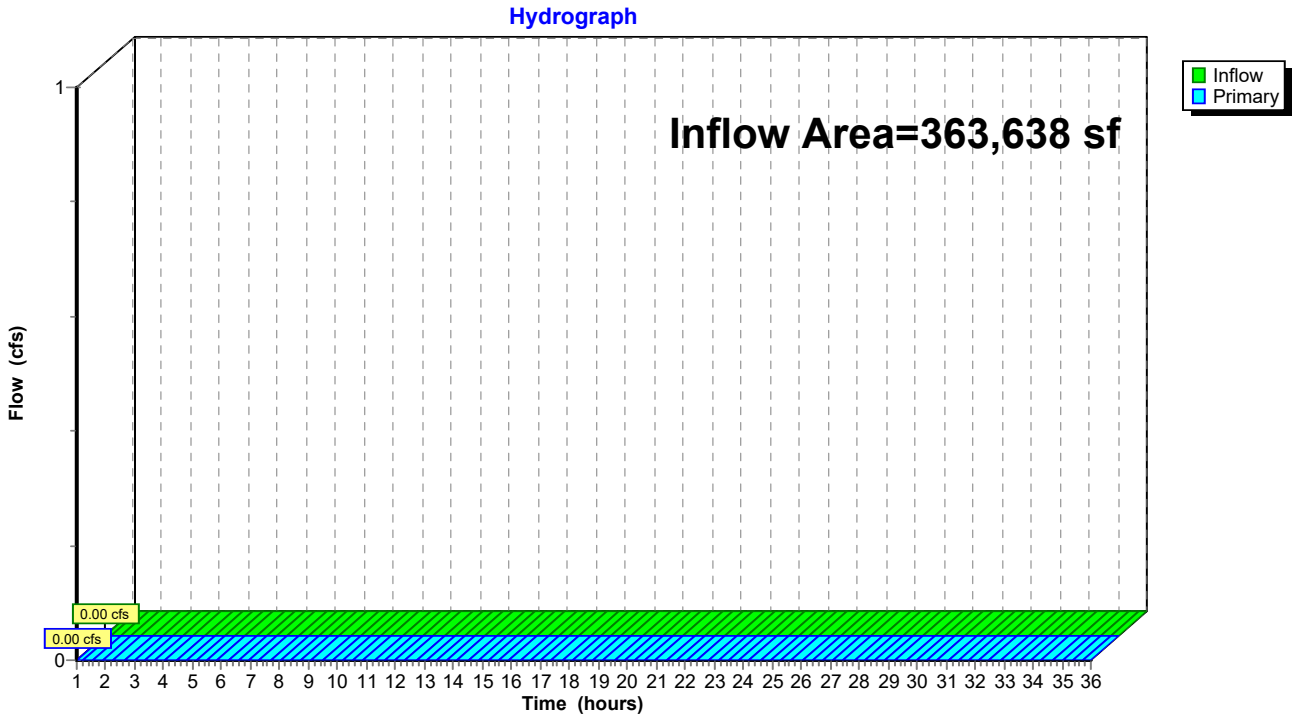

Summary for Pond IB-1: IB-1

Inflow Area = 66,059 sf, 4.31% Impervious, Inflow Depth = 0.09" for 2-Yr event
Inflow = 0.02 cfs @ 14.68 hrs, Volume= 495 cf
Outflow = 0.02 cfs @ 14.76 hrs, Volume= 495 cf, Atten= 0%, Lag= 4.7 min
Discarded = 0.02 cfs @ 14.76 hrs, Volume= 495 cf
Primary = 0.00 cfs @ 1.00 hrs, Volume= 0 cf
Routed to Pond A : POI-A

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2
Peak Elev= 229.00' @ 14.76 hrs Surf.Area= 1,711 sf Storage= 3 cf

Plug-Flow detention time= 3.0 min calculated for 495 cf (100% of inflow)
Center-of-Mass det. time= 3.0 min (1,053.8 - 1,050.8)

Volume	Invert	Avail.Storage	Storage Description
#1	229.00'	12,812 cf	**Custom Stage Data (Prismatic)** Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
229.00	1,710	0	0
230.00	2,426	2,068	2,068
231.00	3,173	2,800	4,868
232.00	3,963	3,568	8,436
233.00	4,789	4,376	12,812

Device	Routing	Invert	Outlet Devices
#1	Discarded	229.00'	**2.410 in/hr Exfiltration over Surface area** Phase-In= 0.01'
#2	Primary	231.85'	**20.0' long x 6.0' breadth Broad-Crested Rectangular Weir** Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.37 2.51 2.70 2.68 2.68 2.67 2.65 2.65 2.65 2.65 2.66 2.66 2.67 2.69 2.72 2.76 2.83

Discarded OutFlow Max=0.02 cfs @ 14.76 hrs HW=229.00' (Free Discharge)
↑—**1=Exfiltration** (Exfiltration Controls 0.02 cfs)

Primary OutFlow Max=0.00 cfs @ 1.00 hrs HW=229.00' TW=0.00' (Dynamic Tailwater)
↑—**2=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Pond IB-1: IB-1

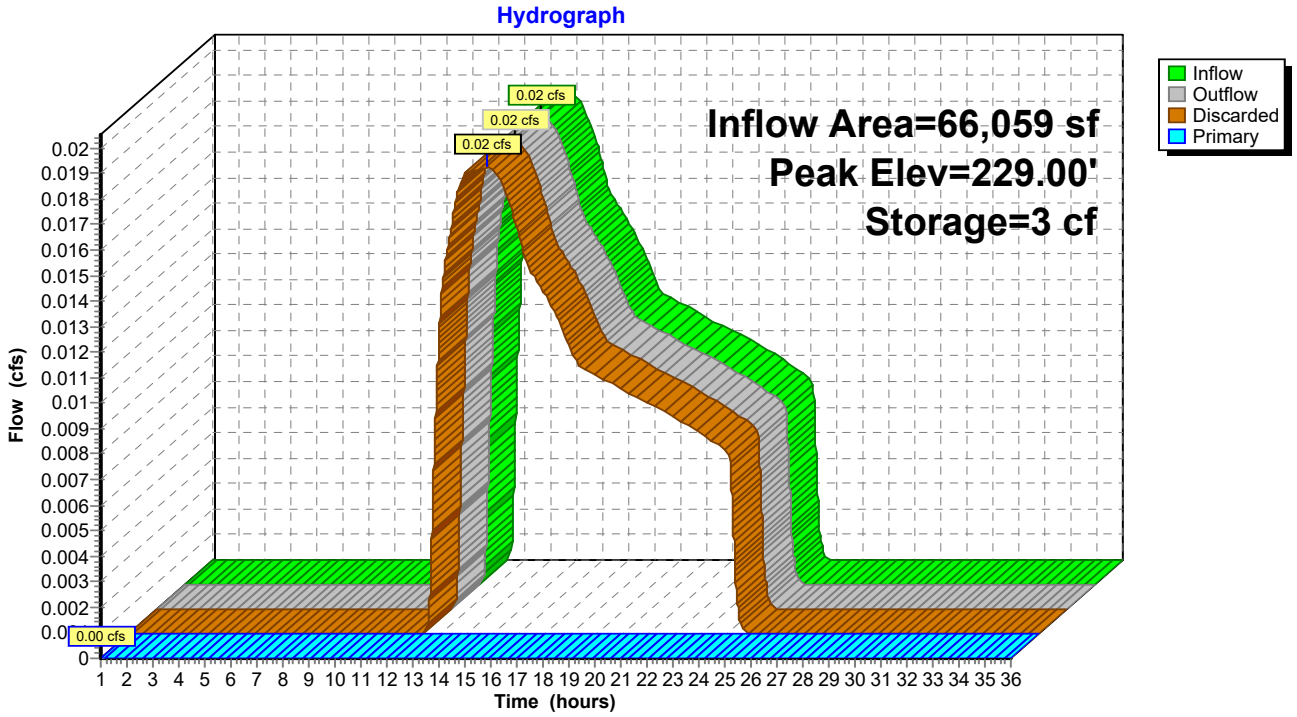
Hydrograph
Inflow Area=66,059 sf
Peak Elev=229.00'
Storage=3 cf
0.02 cfs
0.02 cfs
0.02 cfs
0.00 cfs
Inflow
Outflow
Discarded
Primary
Flow (cfs)
Time (hours)

Time span=1.00-36.00 hrs, dt=0.01 hrs, 3501 points x 2
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentA1: SUB-A1 Runoff Area=297,579 sf 1.40% Impervious Runoff Depth=0.04"
Flow Length=116' Tc=13.8 min CN=33 Runoff=0.03 cfs 885 cf

SubcatchmentA2: SUB-A2 Runoff Area=66,059 sf 4.31% Impervious Runoff Depth=0.56"
Flow Length=840' Tc=15.9 min CN=48 Runoff=0.41 cfs 3,092 cf

Pond A: POI-A Inflow=0.03 cfs 885 cf
Primary=0.03 cfs 885 cf

Pond IB-1: IB-1 Peak Elev=229.35' Storage=645 cf Inflow=0.41 cfs 3,092 cf
Discarded=0.11 cfs 3,092 cf Primary=0.00 cfs 0 cf Outflow=0.11 cfs 3,092 cf

Total Runoff Area = 363,638 sf Runoff Volume = 3,977 cf Average Runoff Depth = 0.13"
98.07% Pervious = 356,636 sf 1.93% Impervious = 7,002 sf

Summary for Subcatchment A1: SUB-A1

Runoff = 0.03 cfs @ 17.22 hrs, Volume= 885 cf, Depth= 0.04"
Routed to Pond A : POI-A

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-Yr Rainfall=4.93"

	Area (sf)	CN	Description
	256,279	30	Woods, Good, HSG A
	30,079	39	>75% Grass cover, Good, HSG A
*	5,518	77	Bare soil, HSG A
*	3,916	98	Paved driveway, HSG A
*	1,547	76	Rip-rap, HSG A
	240	98	Roofs, HSG A
	297,579	33	Weighted Average
	293,423		98.60% Pervious Area
	4,156		1.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.8	50	0.0175	0.07		**Sheet Flow,** Woods: Light underbrush n= 0.400 P2= 3.30"
0.9	42	0.0240	0.77		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
0.1	24	0.3400	2.92		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
13.8	116	Total			

Subcatchment A1: SUB-A1

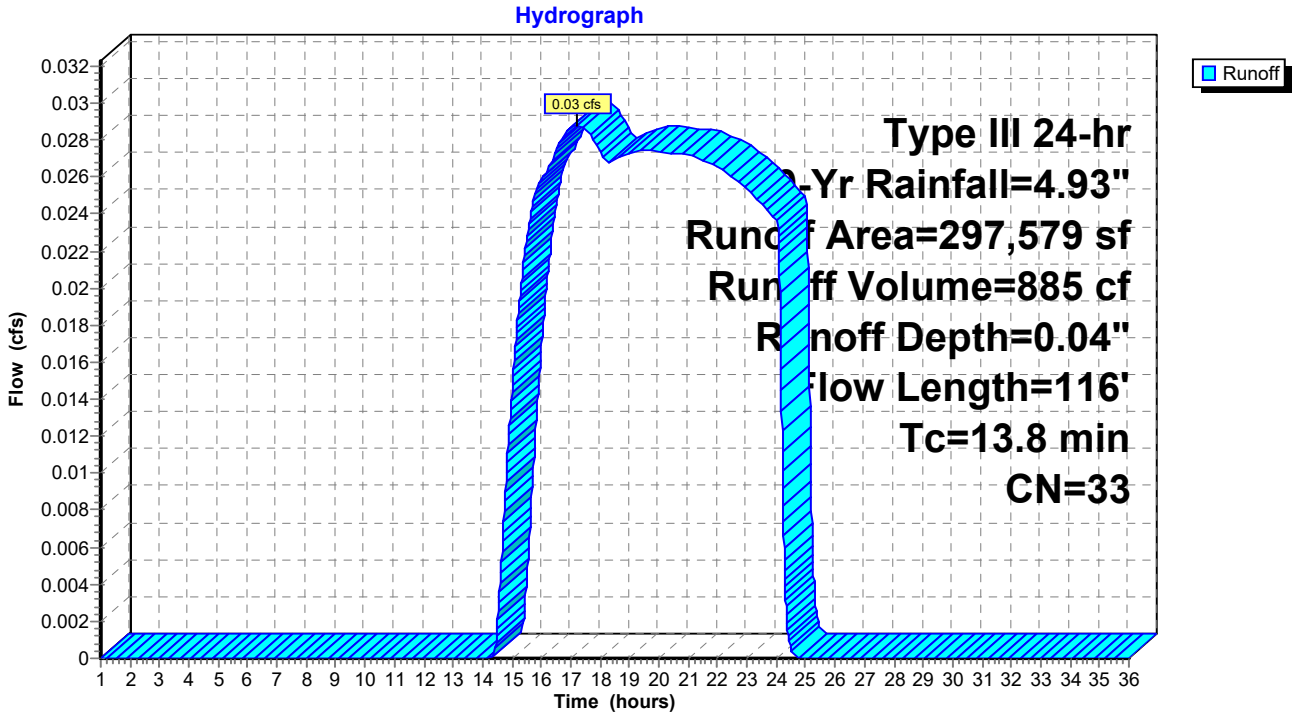

Summary for Subcatchment A2: SUB-A2

Runoff = 0.41 cfs @ 12.39 hrs, Volume= 3,092 cf, Depth= 0.56"
Routed to Pond IB-1 : IB-1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-Yr Rainfall=4.93"

	Area (sf)	CN	Description
	48,574	39	>75% Grass cover, Good, HSG A
*	11,455	76	Gravel driveway, HSG A
	2,963	30	Woods, Good, HSG A
*	2,846	98	Paved driveway, HSG A
*	221	76	Rip-rap, HSG A
	66,059	48	Weighted Average
	63,213		95.69% Pervious Area
	2,846		4.31% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.1	45	0.0200	0.15		**Sheet Flow,** Grass: Short n= 0.150 P2= 3.30"
10.8	795	0.0050	1.23	1.23	**Channel Flow,** Area= 1.0 sf Perim= 4.8' r= 0.21' n= 0.030 Earth, grassed & winding
15.9	840	Total			

Subcatchment A2: SUB-A2

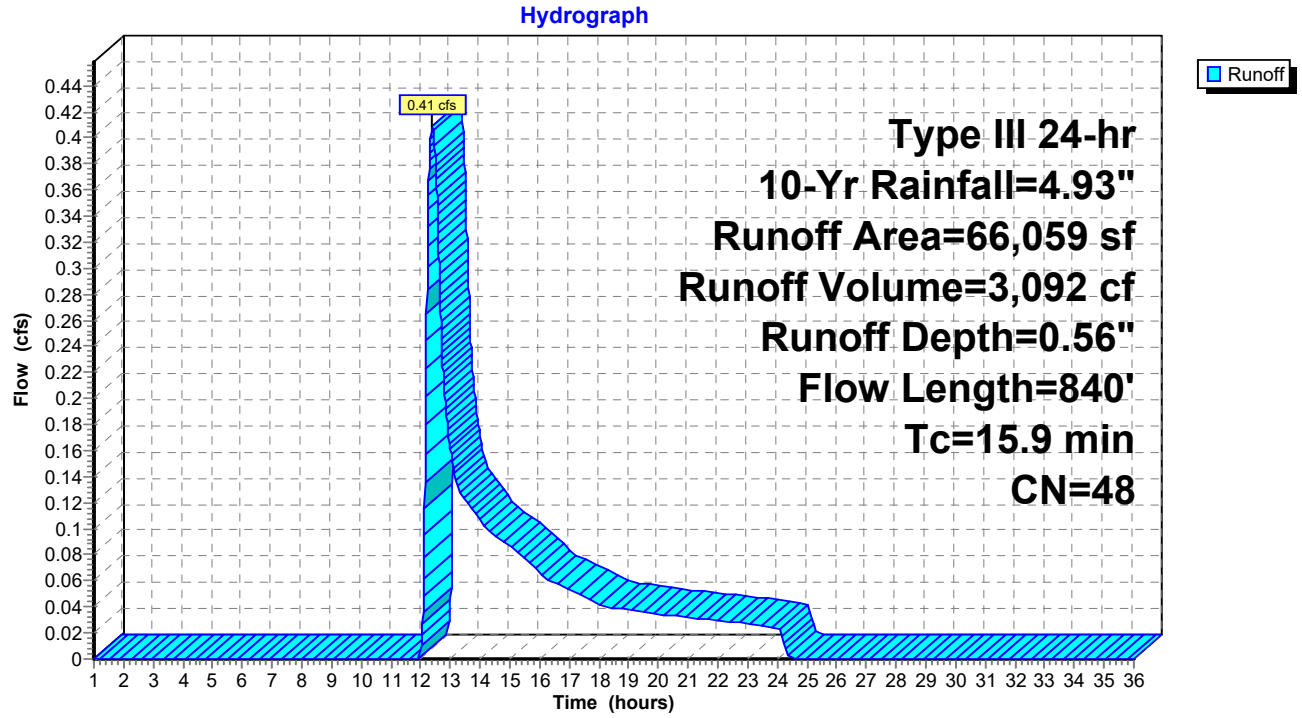

Summary for Pond A: POI-A

Inflow Area = 363,638 sf, 1.93% Impervious, Inflow Depth = 0.03" for 10-Yr event
Inflow = 0.03 cfs @ 17.22 hrs, Volume= 885 cf
Primary = 0.03 cfs @ 17.22 hrs, Volume= 885 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2

Pond A: POI-A

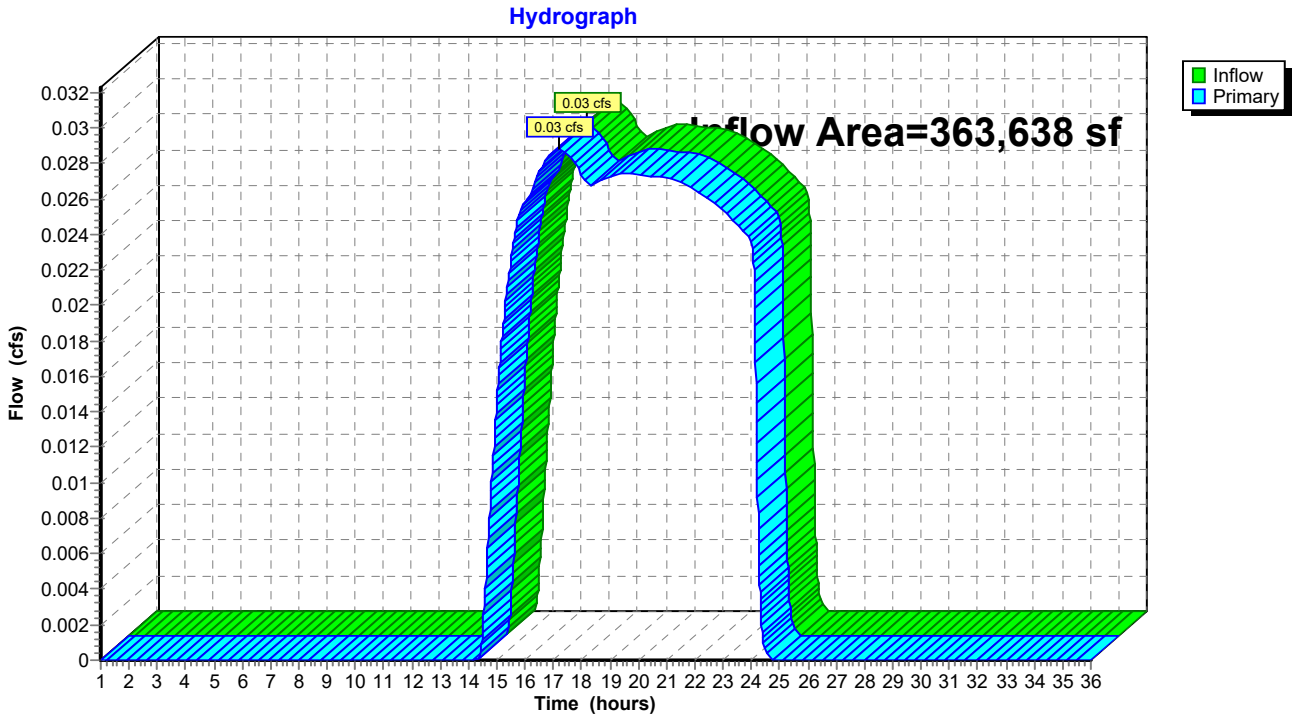

Summary for Pond IB-1: IB-1

Inflow Area = 66,059 sf, 4.31% Impervious, Inflow Depth = 0.56" for 10-Yr event
Inflow = 0.41 cfs @ 12.39 hrs, Volume= 3,092 cf
Outflow = 0.11 cfs @ 13.95 hrs, Volume= 3,092 cf, Atten= 73%, Lag= 93.9 min
Discarded = 0.11 cfs @ 13.95 hrs, Volume= 3,092 cf
Primary = 0.00 cfs @ 1.00 hrs, Volume= 0 cf
Routed to Pond A : POI-A

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2
Peak Elev= 229.35' @ 13.95 hrs Surf.Area= 1,962 sf Storage= 645 cf

Plug-Flow detention time= 54.9 min calculated for 3,091 cf (100% of inflow)
Center-of-Mass det. time= 54.9 min (992.3 - 937.3)

Volume	Invert	Avail.Storage	Storage Description
#1	229.00'	12,812 cf	**Custom Stage Data (Prismatic)** Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
229.00	1,710	0	0
230.00	2,426	2,068	2,068
231.00	3,173	2,800	4,868
232.00	3,963	3,568	8,436
233.00	4,789	4,376	12,812

Device	Routing	Invert	Outlet Devices
#1	Discarded	229.00'	**2.410 in/hr Exfiltration over Surface area** Phase-In= 0.01'
#2	Primary	231.85'	**20.0' long x 6.0' breadth Broad-Crested Rectangular Weir** Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.37 2.51 2.70 2.68 2.68 2.67 2.65 2.65 2.65 2.65 2.66 2.66 2.67 2.69 2.72 2.76 2.83

Discarded OutFlow Max=0.11 cfs @ 13.95 hrs HW=229.35' (Free Discharge)
↑—**1=Exfiltration** (Exfiltration Controls 0.11 cfs)

Primary OutFlow Max=0.00 cfs @ 1.00 hrs HW=229.00' TW=0.00' (Dynamic Tailwater)
↑—**2=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Pond IB-1: IB-1

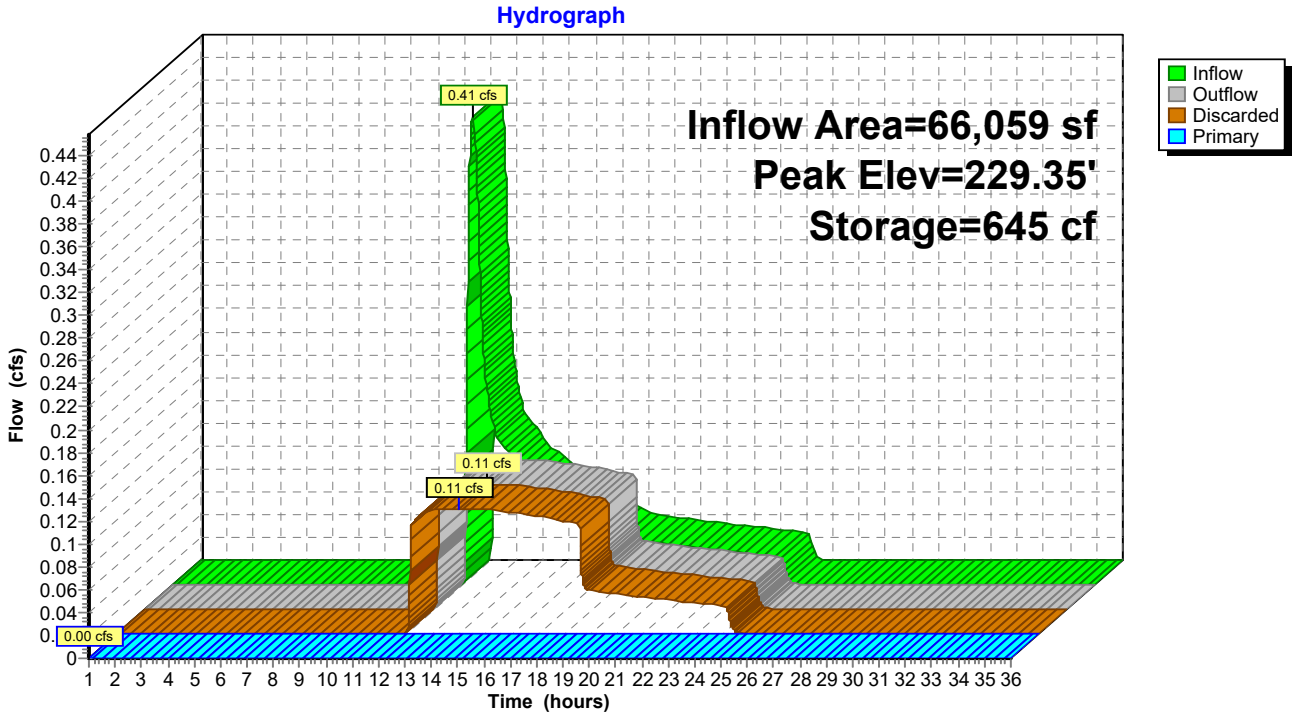
Hydrograph
Inflow Area=66,059 sf
Peak Elev=229.35'
Storage=645 cf
Inflow
Outflow
Discarded
Primary
0.41 cfs
0.11 cfs
0.11 cfs
0.00 cfs
Flow (cfs)
Time (hours)

Time span=1.00-36.00 hrs, dt=0.01 hrs, 3501 points x 2
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentA1: SUB-A1 Runoff Area=297,579 sf 1.40% Impervious Runoff Depth=0.17"
Flow Length=116' Tc=13.8 min CN=33 Runoff=0.16 cfs 4,235 cf

SubcatchmentA2: SUB-A2 Runoff Area=66,059 sf 4.31% Impervious Runoff Depth=1.01"
Flow Length=840' Tc=15.9 min CN=48 Runoff=0.96 cfs 5,540 cf

Pond A: POI-A Inflow=0.16 cfs 4,235 cf
Primary=0.16 cfs 4,235 cf

Pond IB-1: IB-1 Peak Elev=229.98' Storage=2,025 cf Inflow=0.96 cfs 5,540 cf
Discarded=0.13 cfs 5,540 cf Primary=0.00 cfs 0 cf Outflow=0.13 cfs 5,540 cf

Total Runoff Area = 363,638 sf Runoff Volume = 9,775 cf Average Runoff Depth = 0.32"
98.07% Pervious = 356,636 sf 1.93% Impervious = 7,002 sf

Summary for Subcatchment A1: SUB-A1

Runoff = 0.16 cfs @ 14.64 hrs, Volume= 4,235 cf, Depth= 0.17"
Routed to Pond A : POI-A

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-Yr Rainfall=6.01"

	Area (sf)	CN	Description
	256,279	30	Woods, Good, HSG A
	30,079	39	>75% Grass cover, Good, HSG A
*	5,518	77	Bare soil, HSG A
*	3,916	98	Paved driveway, HSG A
*	1,547	76	Rip-rap, HSG A
	240	98	Roofs, HSG A
	297,579	33	Weighted Average
	293,423		98.60% Pervious Area
	4,156		1.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.8	50	0.0175	0.07		**Sheet Flow,** Woods: Light underbrush n= 0.400 P2= 3.30"
0.9	42	0.0240	0.77		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
0.1	24	0.3400	2.92		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
13.8	116	Total			

Subcatchment A1: SUB-A1

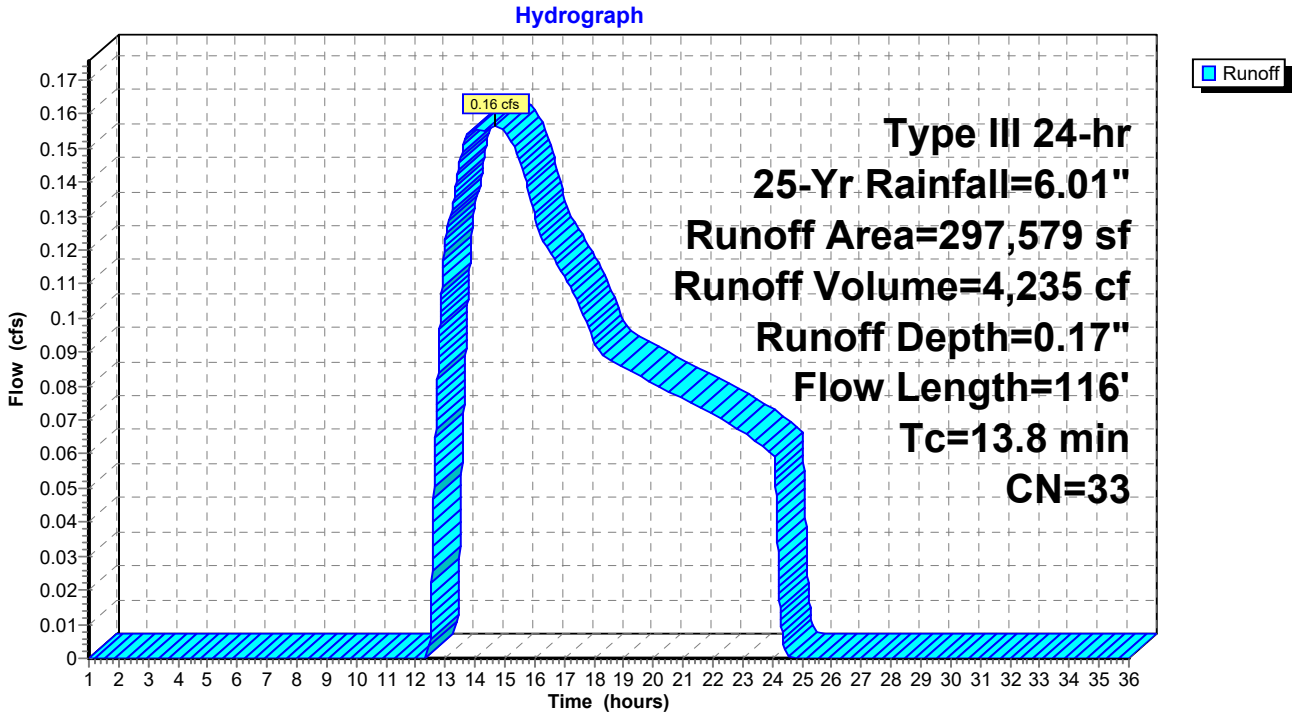

Summary for Subcatchment A2: SUB-A2

Runoff = 0.96 cfs @ 12.28 hrs, Volume= 5,540 cf, Depth= 1.01"
Routed to Pond IB-1 : IB-1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-Yr Rainfall=6.01"

	Area (sf)	CN	Description
	48,574	39	>75% Grass cover, Good, HSG A
*	11,455	76	Gravel driveway, HSG A
	2,963	30	Woods, Good, HSG A
*	2,846	98	Paved driveway, HSG A
*	221	76	Rip-rap, HSG A
	66,059	48	Weighted Average
	63,213		95.69% Pervious Area
	2,846		4.31% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.1	45	0.0200	0.15		**Sheet Flow,** Grass: Short n= 0.150 P2= 3.30"
10.8	795	0.0050	1.23	1.23	**Channel Flow,** Area= 1.0 sf Perim= 4.8' r= 0.21' n= 0.030 Earth, grassed & winding
15.9	840	Total			

Subcatchment A2: SUB-A2

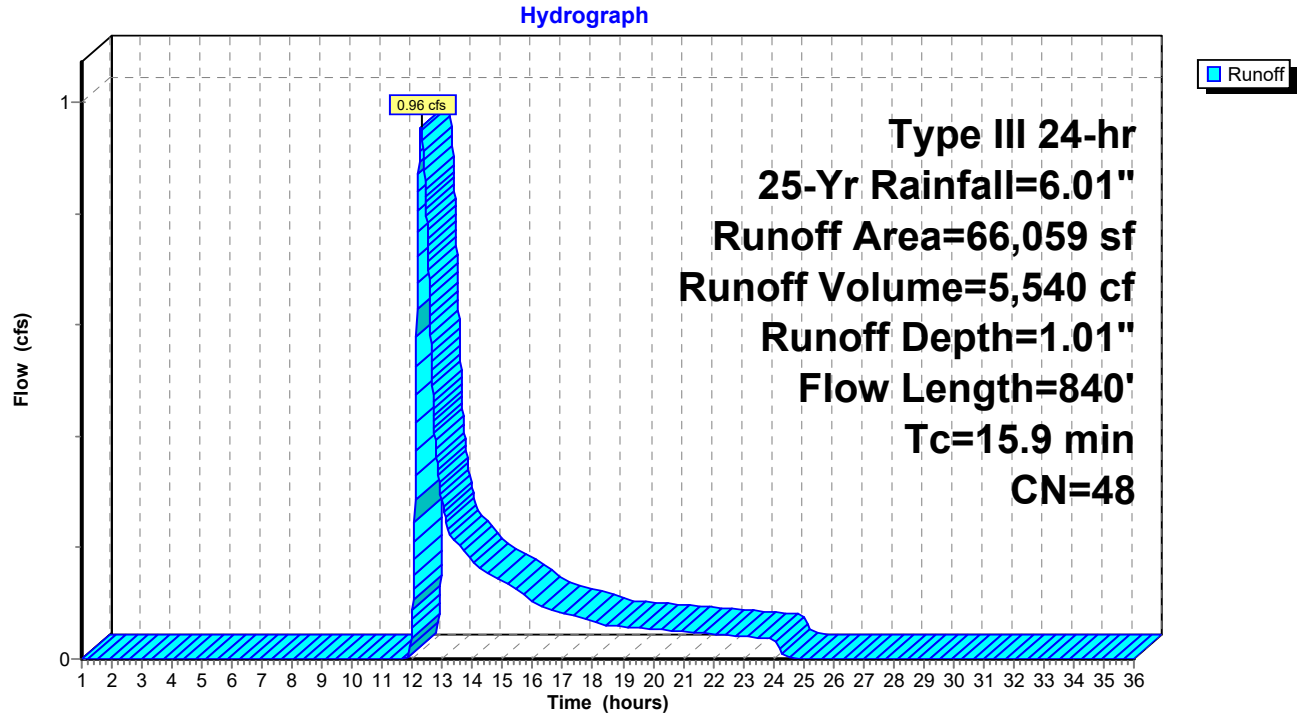

Summary for Pond A: POI-A

Inflow Area = 363,638 sf, 1.93% Impervious, Inflow Depth = 0.14" for 25-Yr event
Inflow = 0.16 cfs @ 14.64 hrs, Volume= 4,235 cf
Primary = 0.16 cfs @ 14.64 hrs, Volume= 4,235 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2

Pond A: POI-A

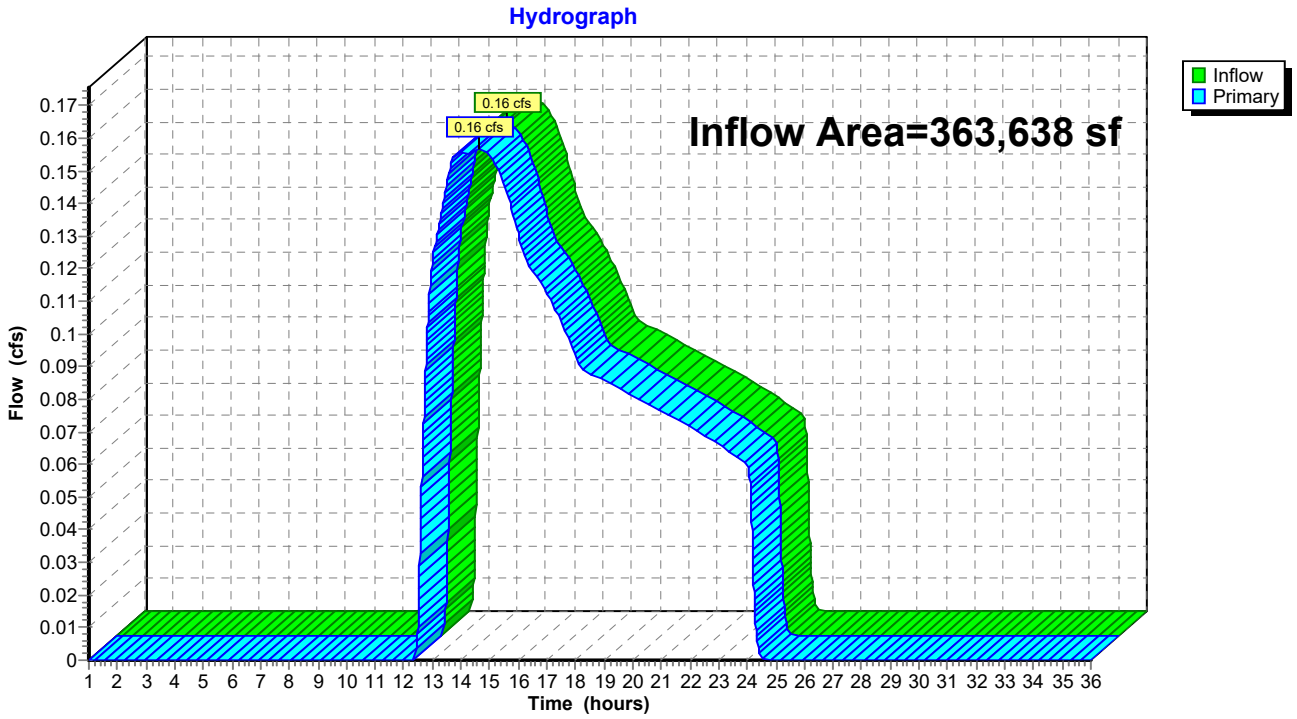

Summary for Pond IB-1: IB-1

Inflow Area = 66,059 sf, 4.31% Impervious, Inflow Depth = 1.01" for 25-Yr event
Inflow = 0.96 cfs @ 12.28 hrs, Volume= 5,540 cf
Outflow = 0.13 cfs @ 15.17 hrs, Volume= 5,540 cf, Atten= 86%, Lag= 173.6 min
Discarded = 0.13 cfs @ 15.17 hrs, Volume= 5,540 cf
Primary = 0.00 cfs @ 1.00 hrs, Volume= 0 cf
Routed to Pond A : POI-A

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2
Peak Elev= 229.98' @ 15.17 hrs Surf.Area= 2,413 sf Storage= 2,025 cf

Plug-Flow detention time= 174.7 min calculated for 5,539 cf (100% of inflow)
Center-of-Mass det. time= 174.6 min (1,086.3 - 911.7)

Volume	Invert	Avail.Storage	Storage Description
#1	229.00'	12,812 cf	**Custom Stage Data (Prismatic)** Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
229.00	1,710	0	0
230.00	2,426	2,068	2,068
231.00	3,173	2,800	4,868
232.00	3,963	3,568	8,436
233.00	4,789	4,376	12,812

Device	Routing	Invert	Outlet Devices
#1	Discarded	229.00'	**2.410 in/hr Exfiltration over Surface area** Phase-In= 0.01'
#2	Primary	231.85'	**20.0' long x 6.0' breadth Broad-Crested Rectangular Weir** Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.37 2.51 2.70 2.68 2.68 2.67 2.65 2.65 2.65 2.65 2.66 2.66 2.67 2.69 2.72 2.76 2.83

Discarded OutFlow Max=0.13 cfs @ 15.17 hrs HW=229.98' (Free Discharge)
↑—**1=Exfiltration** (Exfiltration Controls 0.13 cfs)

Primary OutFlow Max=0.00 cfs @ 1.00 hrs HW=229.00' TW=0.00' (Dynamic Tailwater)
↑—**2=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Pond IB-1: IB-1

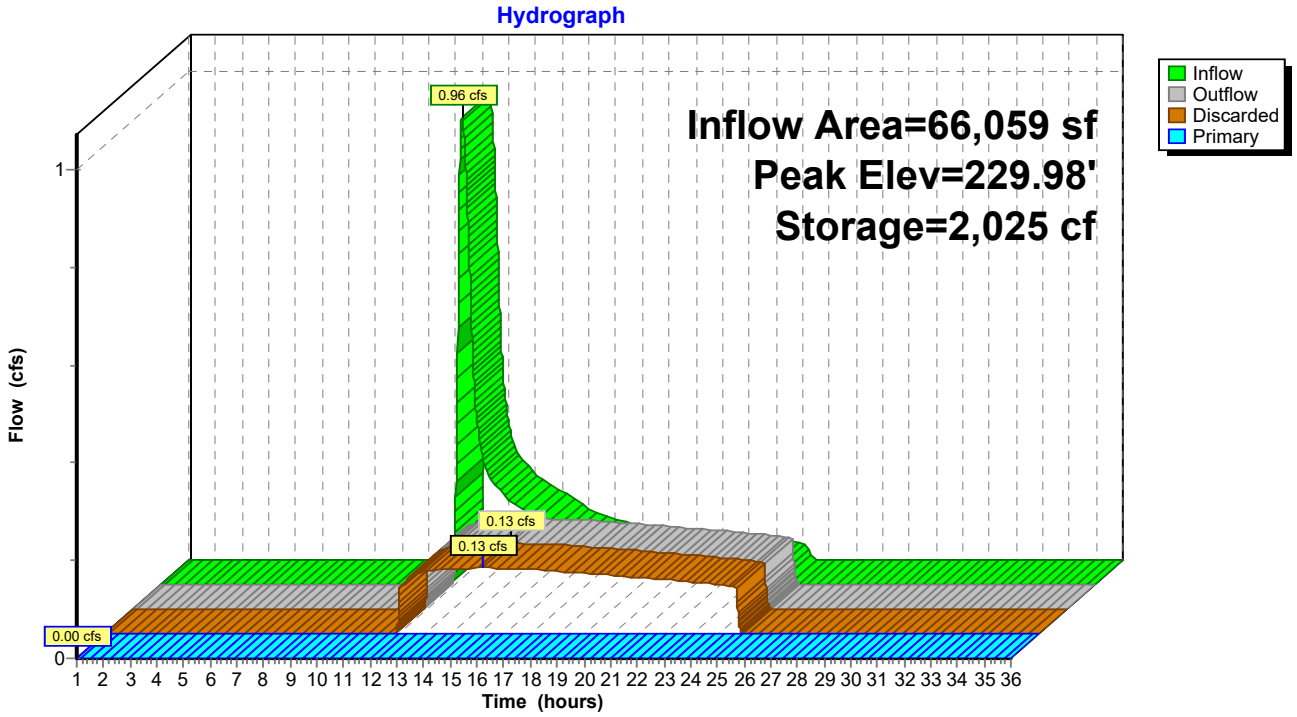
Hydrograph
Inflow Area=66,059 sf
Peak Elev=229.98'
Storage=2,025 cf
Inflow
Outflow
Discarded
Primary
0.96 cfs
0.13 cfs
0.13 cfs
0.00 cfs
Flow (cfs)
0
1
1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36
Time (hours)

Time span=1.00-36.00 hrs, dt=0.01 hrs, 3501 points x 2
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentA1: SUB-A1 Runoff Area=297,579 sf 1.40% Impervious Runoff Depth=0.33"
Flow Length=116' Tc=13.8 min CN=33 Runoff=0.50 cfs 8,132 cf

SubcatchmentA2: SUB-A2 Runoff Area=66,059 sf 4.31% Impervious Runoff Depth=1.39"
Flow Length=840' Tc=15.9 min CN=48 Runoff=1.48 cfs 7,669 cf

Pond A: POI-A Inflow=0.50 cfs 8,132 cf
Primary=0.50 cfs 8,132 cf

Pond IB-1: IB-1 Peak Elev=230.49' Storage=3,352 cf Inflow=1.48 cfs 7,669 cf
Discarded=0.16 cfs 7,669 cf Primary=0.00 cfs 0 cf Outflow=0.16 cfs 7,669 cf

Total Runoff Area = 363,638 sf Runoff Volume = 15,801 cf Average Runoff Depth = 0.52"
98.07% Pervious = 356,636 sf 1.93% Impervious = 7,002 sf

Summary for Subcatchment A1: SUB-A1

Runoff = 0.50 cfs @ 12.56 hrs, Volume= 8,132 cf, Depth= 0.33"
Routed to Pond A : POI-A

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-Yr Rainfall=6.81"

	Area (sf)	CN	Description
	256,279	30	Woods, Good, HSG A
	30,079	39	>75% Grass cover, Good, HSG A
*	5,518	77	Bare soil, HSG A
*	3,916	98	Paved driveway, HSG A
*	1,547	76	Rip-rap, HSG A
	240	98	Roofs, HSG A
	297,579	33	Weighted Average
	293,423		98.60% Pervious Area
	4,156		1.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.8	50	0.0175	0.07		**Sheet Flow,** Woods: Light underbrush n= 0.400 P2= 3.30"
0.9	42	0.0240	0.77		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
0.1	24	0.3400	2.92		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
13.8	116	Total			

Subcatchment A1: SUB-A1

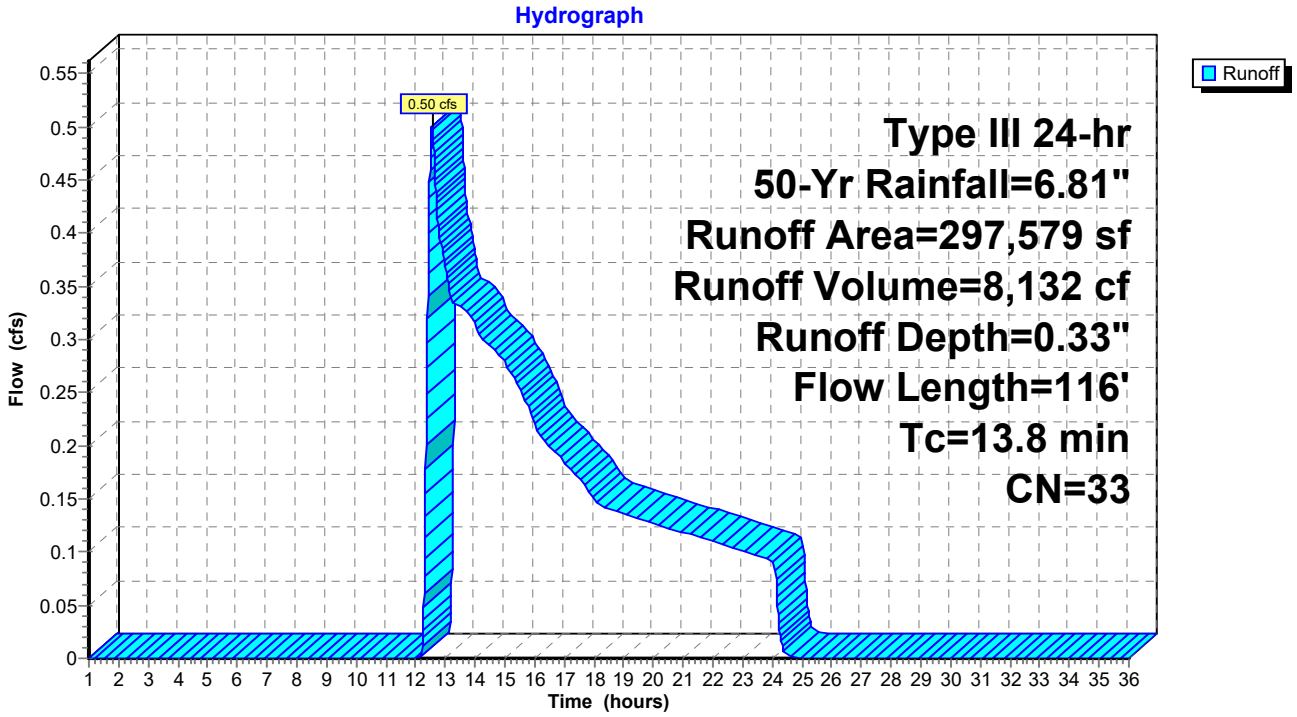

Summary for Subcatchment A2: SUB-A2

Runoff = 1.48 cfs @ 12.26 hrs, Volume= 7,669 cf, Depth= 1.39"
Routed to Pond IB-1 : IB-1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-Yr Rainfall=6.81"

	Area (sf)	CN	Description
	48,574	39	>75% Grass cover, Good, HSG A
*	11,455	76	Gravel driveway, HSG A
	2,963	30	Woods, Good, HSG A
*	2,846	98	Paved driveway, HSG A
*	221	76	Rip-rap, HSG A
	66,059	48	Weighted Average
	63,213		95.69% Pervious Area
	2,846		4.31% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.1	45	0.0200	0.15		**Sheet Flow,** Grass: Short n= 0.150 P2= 3.30"
10.8	795	0.0050	1.23	1.23	**Channel Flow,** Area= 1.0 sf Perim= 4.8' r= 0.21' n= 0.030 Earth, grassed & winding
15.9	840	Total			

Subcatchment A2: SUB-A2

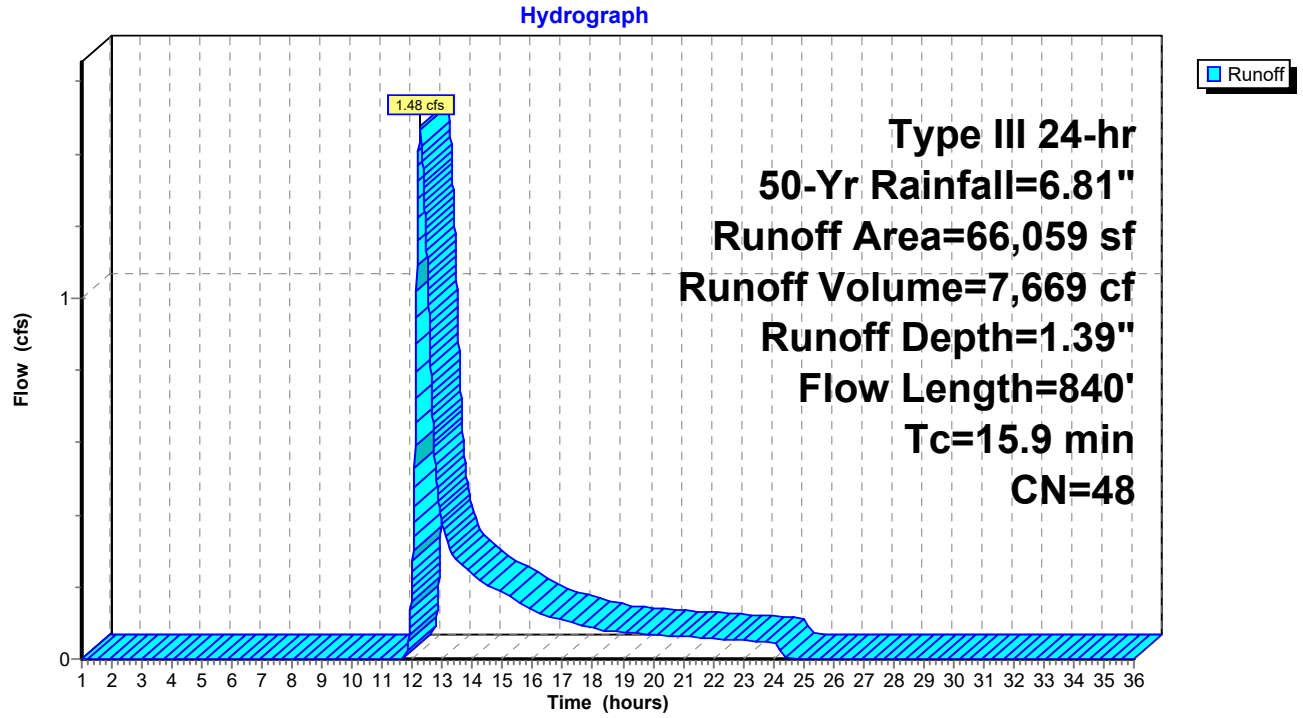

Summary for Pond A: POI-A

Inflow Area = 363,638 sf, 1.93% Impervious, Inflow Depth = 0.27" for 50-Yr event
Inflow = 0.50 cfs @ 12.56 hrs, Volume= 8,132 cf
Primary = 0.50 cfs @ 12.56 hrs, Volume= 8,132 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2

Pond A: POI-A

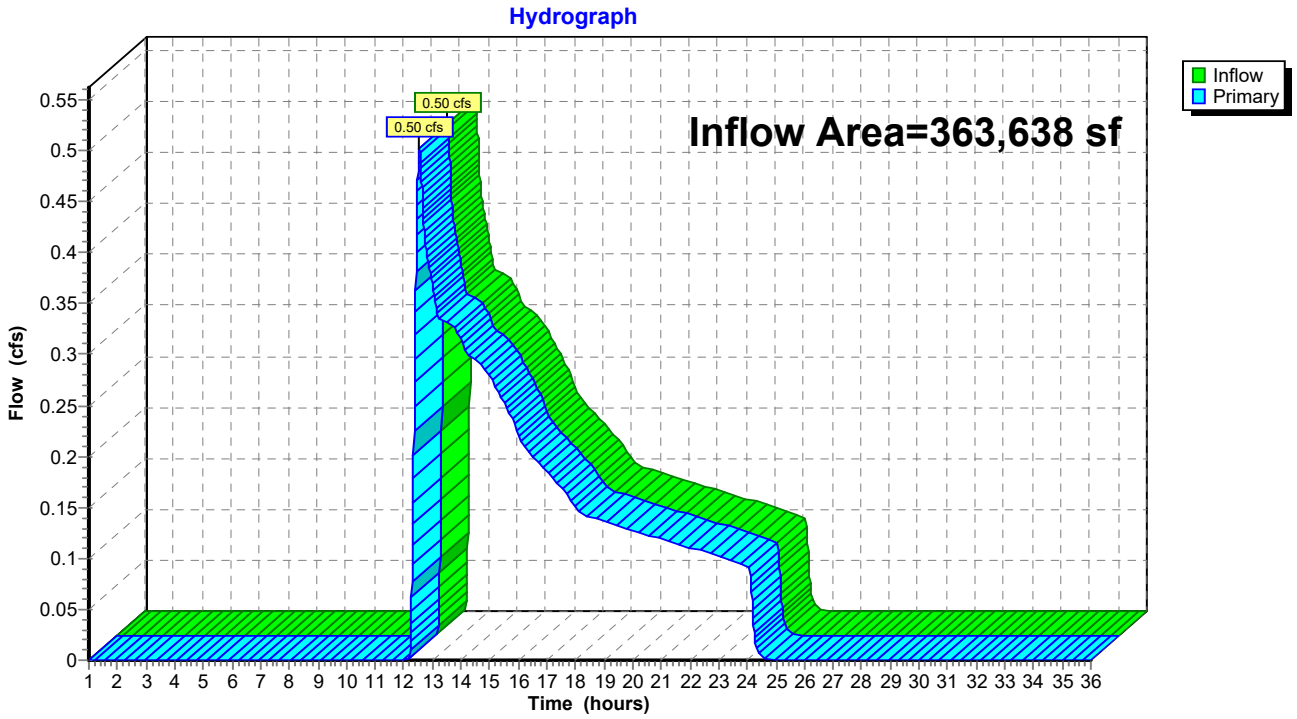

Summary for Pond IB-1: IB-1

Inflow Area = 66,059 sf, 4.31% Impervious, Inflow Depth = 1.39" for 50-Yr event
Inflow = 1.48 cfs @ 12.26 hrs, Volume= 7,669 cf
Outflow = 0.16 cfs @ 15.60 hrs, Volume= 7,669 cf, Atten= 89%, Lag= 200.1 min
Discarded = 0.16 cfs @ 15.60 hrs, Volume= 7,669 cf
Primary = 0.00 cfs @ 1.00 hrs, Volume= 0 cf
Routed to Pond A : POI-A

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2
Peak Elev= 230.49' @ 15.60 hrs Surf.Area= 2,794 sf Storage= 3,352 cf

Plug-Flow detention time= 260.7 min calculated for 7,667 cf (100% of inflow)
Center-of-Mass det. time= 260.7 min (1,159.9 - 899.2)

Volume	Invert	Avail.Storage	Storage Description
#1	229.00'	12,812 cf	**Custom Stage Data (Prismatic)** Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
229.00	1,710	0	0
230.00	2,426	2,068	2,068
231.00	3,173	2,800	4,868
232.00	3,963	3,568	8,436
233.00	4,789	4,376	12,812

Device	Routing	Invert	Outlet Devices
#1	Discarded	229.00'	**2.410 in/hr Exfiltration over Surface area** Phase-In= 0.01'
#2	Primary	231.85'	**20.0' long x 6.0' breadth Broad-Crested Rectangular Weir** Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.37 2.51 2.70 2.68 2.68 2.67 2.65 2.65 2.65 2.65 2.66 2.66 2.67 2.69 2.72 2.76 2.83

Discarded OutFlow Max=0.16 cfs @ 15.60 hrs HW=230.49' (Free Discharge)
↑—**1=Exfiltration** (Exfiltration Controls 0.16 cfs)

Primary OutFlow Max=0.00 cfs @ 1.00 hrs HW=229.00' TW=0.00' (Dynamic Tailwater)
↑—**2=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Pond IB-1: IB-1

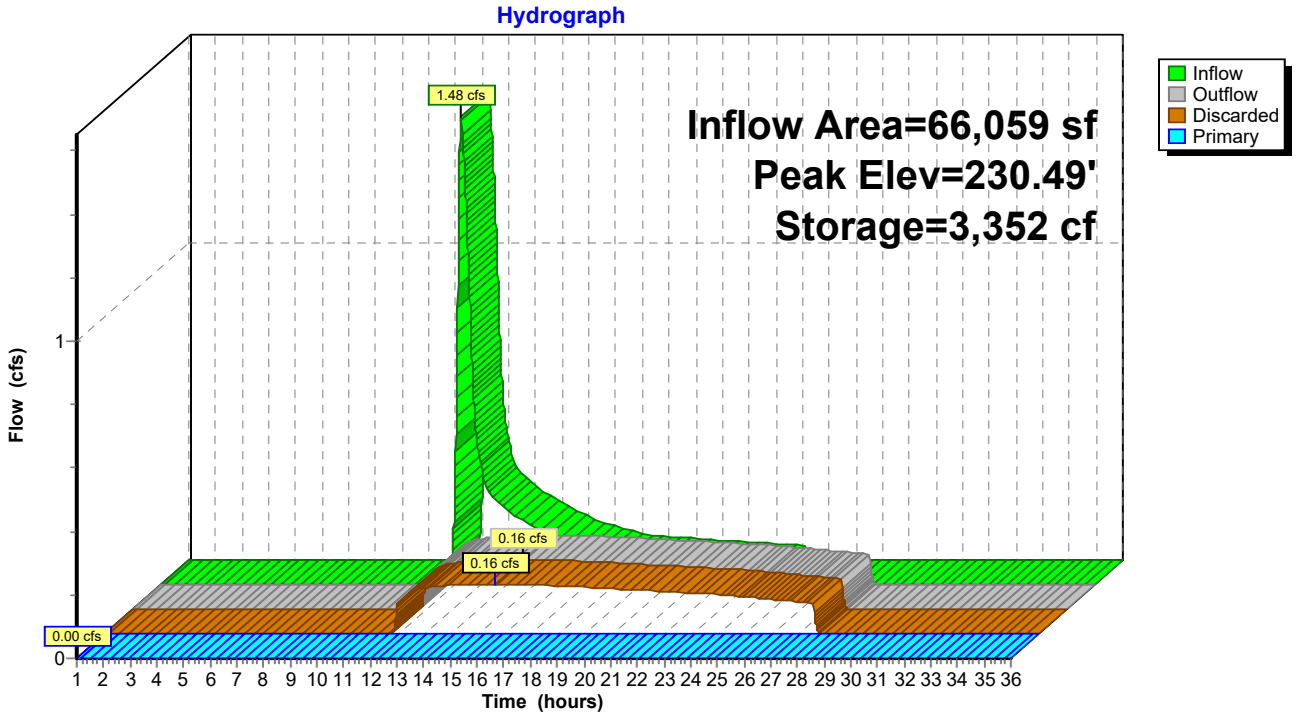
Hydrograph
Inflow Area=66,059 sf
Peak Elev=230.49'
Storage=3,352 cf
Inflow
Outflow
Discarded
Primary
1.48 cfs
0.16 cfs
0.16 cfs
0.00 cfs
Flow (cfs)
0
1
1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36
Time (hours)

Time span=1.00-36.00 hrs, dt=0.01 hrs, 3501 points x 2
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Dyn-Stor-Ind method - Pond routing by Dyn-Stor-Ind method

SubcatchmentA1: SUB-A1 Runoff Area=297,579 sf 1.40% Impervious Runoff Depth=0.55"
Flow Length=116' Tc=13.8 min CN=33 Runoff=1.32 cfs 13,580 cf

SubcatchmentA2: SUB-A2 Runoff Area=66,059 sf 4.31% Impervious Runoff Depth=1.86"
Flow Length=840' Tc=15.9 min CN=48 Runoff=2.11 cfs 10,236 cf

Pond A: POI-A Inflow=1.32 cfs 13,580 cf
Primary=1.32 cfs 13,580 cf

Pond IB-1: IB-1 Peak Elev=231.05' Storage=5,028 cf Inflow=2.11 cfs 10,236 cf
Discarded=0.18 cfs 10,236 cf Primary=0.00 cfs 0 cf Outflow=0.18 cfs 10,236 cf

Total Runoff Area = 363,638 sf Runoff Volume = 23,816 cf Average Runoff Depth = 0.79"
98.07% Pervious = 356,636 sf 1.93% Impervious = 7,002 sf

Summary for Subcatchment A1: SUB-A1

Runoff = 1.32 cfs @ 12.47 hrs, Volume= 13,580 cf, Depth= 0.55"
Routed to Pond A : POI-A

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-Yr Rainfall=7.68"

	Area (sf)	CN	Description
	256,279	30	Woods, Good, HSG A
	30,079	39	>75% Grass cover, Good, HSG A
*	5,518	77	Bare soil, HSG A
*	3,916	98	Paved driveway, HSG A
*	1,547	76	Rip-rap, HSG A
	240	98	Roofs, HSG A
	297,579	33	Weighted Average
	293,423		98.60% Pervious Area
	4,156		1.40% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
12.8	50	0.0175	0.07		**Sheet Flow,** Woods: Light underbrush n= 0.400 P2= 3.30"
0.9	42	0.0240	0.77		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
0.1	24	0.3400	2.92		**Shallow Concentrated Flow,** Woodland Kv= 5.0 fps
13.8	116	Total			

Subcatchment A1: SUB-A1

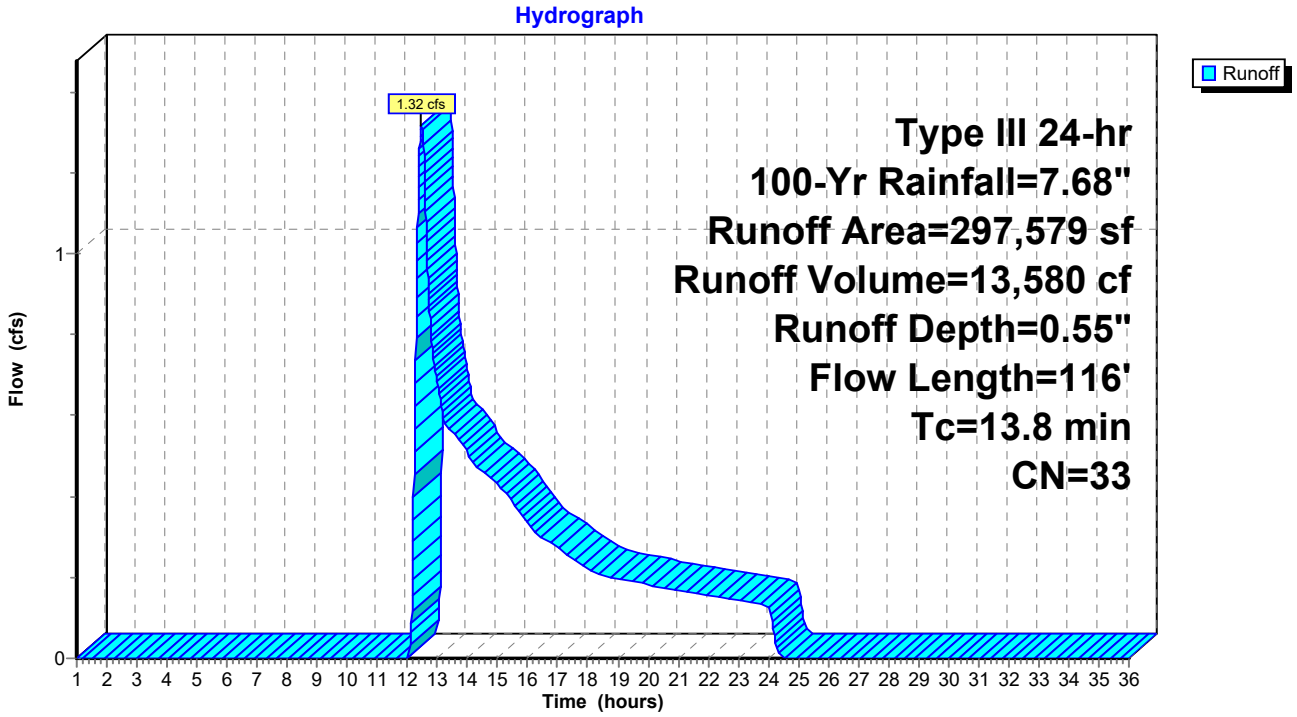

Summary for Subcatchment A2: SUB-A2

Runoff = 2.11 cfs @ 12.25 hrs, Volume= 10,236 cf, Depth= 1.86"
Routed to Pond IB-1 : IB-1

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-Yr Rainfall=7.68"

	Area (sf)	CN	Description
	48,574	39	>75% Grass cover, Good, HSG A
*	11,455	76	Gravel driveway, HSG A
	2,963	30	Woods, Good, HSG A
*	2,846	98	Paved driveway, HSG A
*	221	76	Rip-rap, HSG A
	66,059	48	Weighted Average
	63,213		95.69% Pervious Area
	2,846		4.31% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
5.1	45	0.0200	0.15		**Sheet Flow,** Grass: Short n= 0.150 P2= 3.30"
10.8	795	0.0050	1.23	1.23	**Channel Flow,** Area= 1.0 sf Perim= 4.8' r= 0.21' n= 0.030 Earth, grassed & winding
15.9	840	Total			

Subcatchment A2: SUB-A2

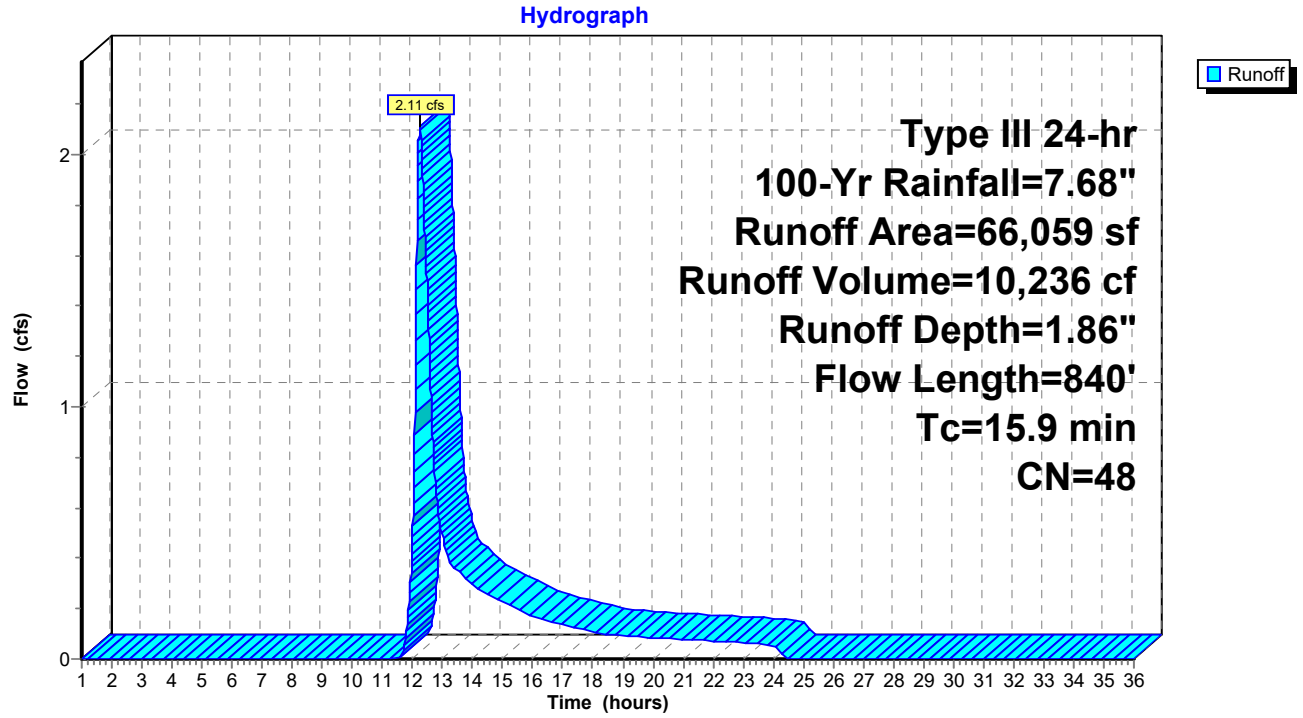

Summary for Pond A: POI-A

Inflow Area = 363,638 sf, 1.93% Impervious, Inflow Depth = 0.45" for 100-Yr event
Inflow = 1.32 cfs @ 12.47 hrs, Volume= 13,580 cf
Primary = 1.32 cfs @ 12.47 hrs, Volume= 13,580 cf, Atten= 0%, Lag= 0.0 min

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2

Pond A: POI-A

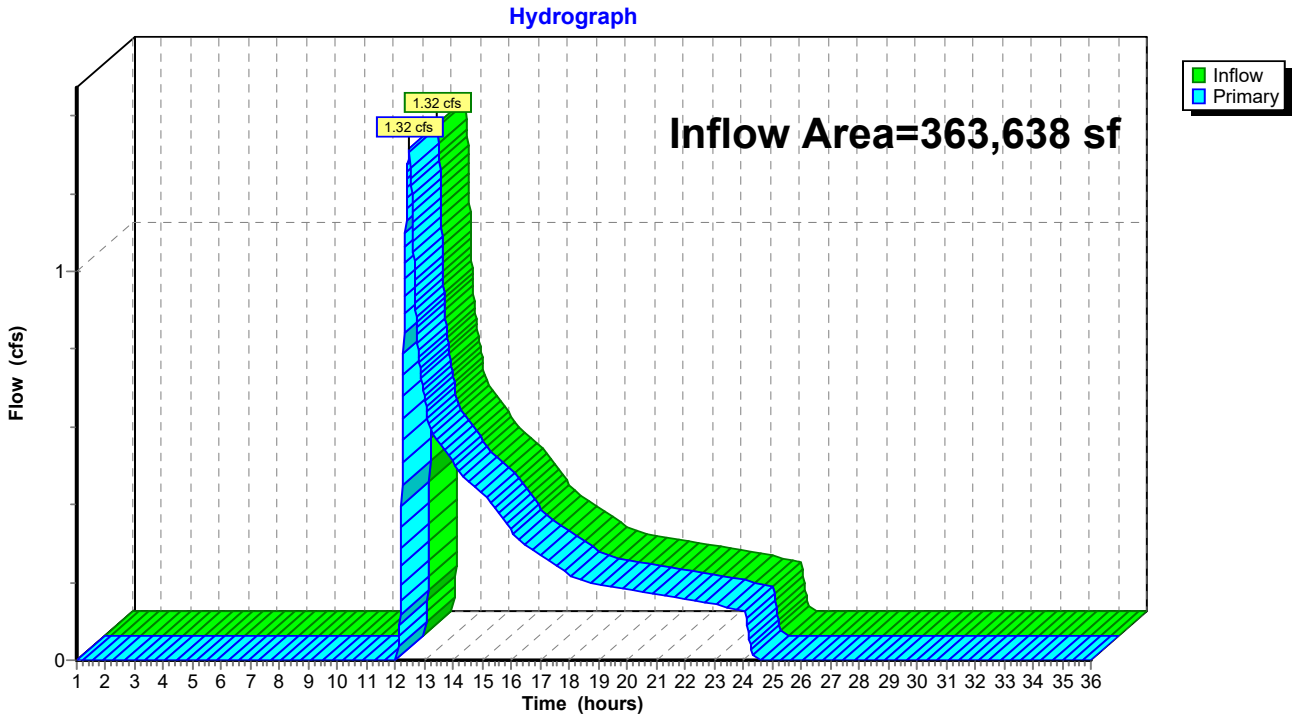

Summary for Pond IB-1: IB-1

Inflow Area = 66,059 sf, 4.31% Impervious, Inflow Depth = 1.86" for 100-Yr event
Inflow = 2.11 cfs @ 12.25 hrs, Volume= 10,236 cf
Outflow = 0.18 cfs @ 15.88 hrs, Volume= 10,236 cf, Atten= 92%, Lag= 217.8 min
Discarded = 0.18 cfs @ 15.88 hrs, Volume= 10,236 cf
Primary = 0.00 cfs @ 1.00 hrs, Volume= 0 cf
Routed to Pond A : POI-A

Routing by Dyn-Stor-Ind method, Time Span= 1.00-36.00 hrs, dt= 0.01 hrs / 2
Peak Elev= 231.05' @ 15.88 hrs Surf.Area= 3,213 sf Storage= 5,028 cf

Plug-Flow detention time= 343.9 min calculated for 10,236 cf (100% of inflow)
Center-of-Mass det. time= 343.9 min (1,232.9 - 888.9)

Volume	Invert	Avail.Storage	Storage Description
#1	229.00'	12,812 cf	**Custom Stage Data (Prismatic)** Listed below (Recalc)

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
229.00	1,710	0	0
230.00	2,426	2,068	2,068
231.00	3,173	2,800	4,868
232.00	3,963	3,568	8,436
233.00	4,789	4,376	12,812

Device	Routing	Invert	Outlet Devices
#1	Discarded	229.00'	**2.410 in/hr Exfiltration over Surface area** Phase-In= 0.01'
#2	Primary	231.85'	**20.0' long x 6.0' breadth Broad-Crested Rectangular Weir** Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.37 2.51 2.70 2.68 2.68 2.67 2.65 2.65 2.65 2.65 2.66 2.66 2.67 2.69 2.72 2.76 2.83

Discarded OutFlow Max=0.18 cfs @ 15.88 hrs HW=231.05' (Free Discharge)
↑—**1=Exfiltration** (Exfiltration Controls 0.18 cfs)

Primary OutFlow Max=0.00 cfs @ 1.00 hrs HW=229.00' TW=0.00' (Dynamic Tailwater)
↑—**2=Broad-Crested Rectangular Weir** (Controls 0.00 cfs)

Pond IB-1: IB-1

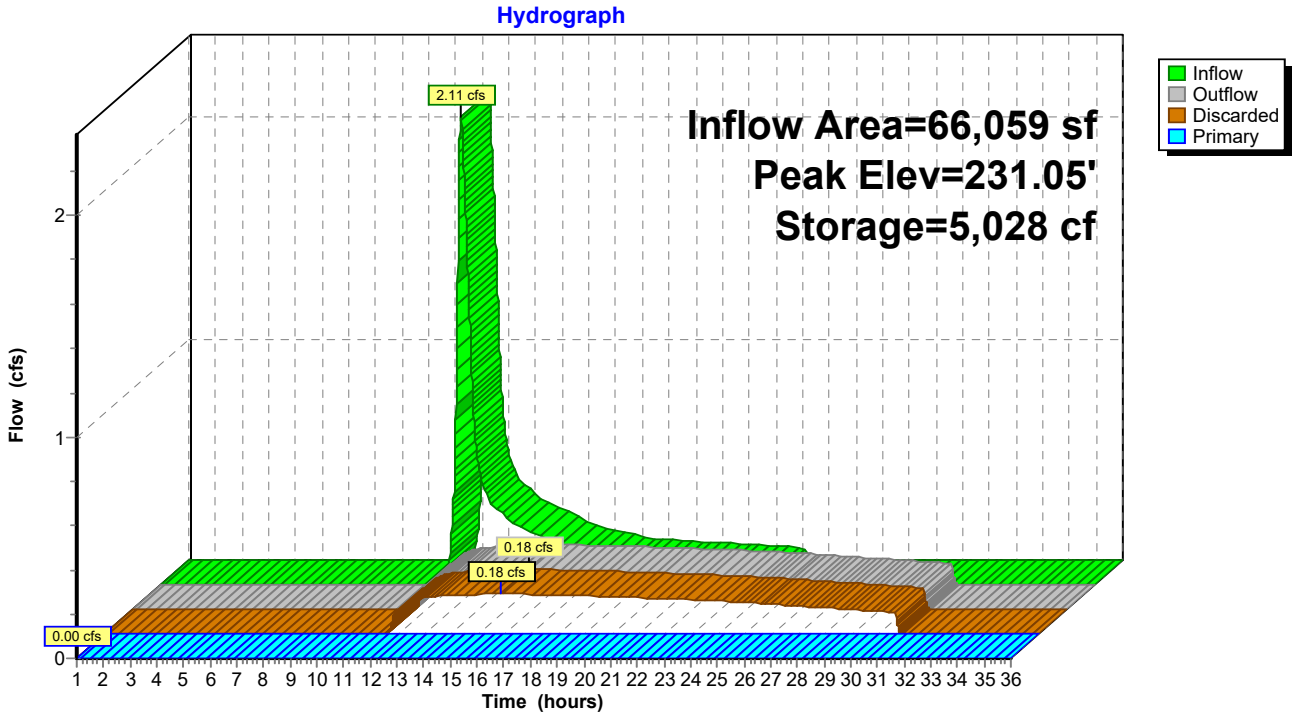
Hydrograph
Inflow Area=66,059 sf
Peak Elev=231.05'
Storage=5,028 cf
Inflow
Outflow
Discarded
Primary
2.11 cfs
0.18 cfs
0.18 cfs
0.00 cfs
Flow (cfs)
0
1
2
1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36
Time (hours)

Attachment E - Calculations

INSTRUCTIONS:

1. In BMP Column, click on Blue Cell to Activate Drop Down Menu
2. Select BMP from Drop Down Menu
3. After BMP is selected, TSS Removal and other Columns are automatically completed.

Version 1, Automated: Mar. 4, 2008

Location: Infiltration Basin with Sediment Forebay

TSS Removal Calculation Worksheet

B BMP[1]	C TSS Removal Rate[1]	D Starting TSS Load*	E Amount Removed (C*D)	F Remaining Load (D-E)
Grass Channel	0.50	1.00	0.50	0.50
Infiltration Basin	0.80	0.50	0.40	0.10
	0.00	0.10	0.00	0.10
	0.00	0.10	0.00	0.10
	0.00	0.10	0.00	0.10

Total TSS Removal = 90%

Separate Form Needs to be Completed for Each Outlet or BMP Train

Project: Taylor Street Well and Raw Water Supply, Littleton MA

Prepared By: Aaron Guazzaloca

Date: 10/16/2023

*Equals remaining load from previous BMP (E) which enters the BMP

Non-automated TSS Calculation Sheet must be used if Proprietary BMP Proposed

1. From MassDEP Stormwater Handbook Vol. 1

Recharge Volume Calculations (Static Method)

Taylor Street Well and Raw Water Main
Littleton, MA
October 16, 2023

Infiltration Basin Required Recharge Volume Hydrologic Soils Group:	A	B	C	D	Total	
Total Proposed Impervious Area:	2,846	0	0	0	2,846	(SF)
Target Factor:	0.60	0.35	0.25	0.10		
Recharge Volume:	142	0	0	0	142	(CF)
Adjusted Recharge Volume*:					370	(CF)

* 2,846-SF out of 7,002-SF of proposed impervious area will be captured by the recharge BMP

Provided Recharge Volume		
Elevation of Lowest Invert:	231.85	(FT)
Volume Below Lowest Outlet:	7,850	(CF)

Drawdown Time		
Saturated Hydraulic Conductivity (Rawls Rate):	2.41	(IN/HR)
Bottom Area of Infiltration Basin:	1,710	(SF)
Drawdown Time:	22.9	(HRS)

Water Quality Volume Calculations

Taylor Street Well and Raw Water Main
Littleton, MA
October 16, 2023

Required Water Quality Storage Calculation

Proposed Impervious Area (SF) x 1-IN x 1-FT/12-IN = Required WQV

Location	Area (SF)	Required WQV (CF)	Provided WQV (CF)	BMP Description
Roadway Basin	2,846	237	7,850	Infiltration Basin

Stage-Area-Storage for Pond IB-1: IB-1 (continued)

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
231.08	3,236	5,124
231.09	3,244	5,156
231.10	3,252	5,189
231.11	3,260	5,221
231.12	3,268	5,254
231.13	3,276	5,287
231.14	3,284	5,319
231.15	3,292	5,352
231.16	3,299	5,385
231.17	3,307	5,418
231.18	3,315	5,451
231.19	3,323	5,485
231.20	3,331	5,518
231.21	3,339	5,551
231.22	3,347	5,585
231.23	3,355	5,618
231.24	3,363	5,652
231.25	3,371	5,685
231.26	3,378	5,719
231.27	3,386	5,753
231.28	3,394	5,787
231.29	3,402	5,821
231.30	3,410	5,855
231.31	3,418	5,889
231.32	3,426	5,923
231.33	3,434	5,958
231.34	3,442	5,992
231.35	3,449	6,026
231.36	3,457	6,061
231.37	3,465	6,096
231.38	3,473	6,130
231.39	3,481	6,165
231.40	3,489	6,200
231.41	3,497	6,235
231.42	3,505	6,270
231.43	3,513	6,305
231.44	3,521	6,340
231.45	3,528	6,375
231.46	3,536	6,411
231.47	3,544	6,446
231.48	3,552	6,482
231.49	3,560	6,517
231.50	3,568	6,553
231.51	3,576	6,588
231.52	3,584	6,624
231.53	3,592	6,660
231.54	3,600	6,696
231.55	3,608	6,732
231.56	3,615	6,768
231.57	3,623	6,804
231.58	3,631	6,841
231.59	3,639	6,877
231.60	3,647	6,913
231.61	3,655	6,950
231.62	3,663	6,987
231.63	3,671	7,023
231.64	3,679	7,060
231.65	3,687	7,097
231.66	3,694	7,134
231.67	3,702	7,171
231.68	3,710	7,208
231.69	3,718	7,245
231.70	3,726	7,282
231.71	3,734	7,319
231.72	3,742	7,357
231.73	3,750	7,394
231.74	3,758	7,432
231.75	3,766	7,469
231.76	3,773	7,507
231.77	3,781	7,545
231.78	3,789	7,583
231.79	3,797	7,621
231.80	3,805	7,659
231.81	3,813	7,697
231.82	3,821	7,735
231.83	3,829	7,773
231.84	3,837	7,812
231.85	3,844	7,850
231.86	3,852	7,888
231.87	3,860	7,927
231.88	3,868	7,966
231.89	3,876	8,004
231.90	3,884	8,043
231.91	3,892	8,082
231.92	3,900	8,121
231.93	3,908	8,160
231.94	3,916	8,199
231.95	3,923	8,238
231.96	3,931	8,278
231.97	3,939	8,317
231.98	3,947	8,356
231.99	3,955	8,396
232.00	3,963	8,436
232.01	3,971	8,475
232.02	3,980	8,515
232.03	3,988	8,555
232.04	3,996	8,595
232.05	4,004	8,635
232.06	4,013	8,675
232.07	4,021	8,715
232.08	4,029	8,755
232.09	4,037	8,796
232.10	4,046	8,836
232.11	4,054	8,876

VOLUME BELOW LOWEST OUTLET

Sediment Forebay Sizing Calculations

Taylor Street Well and Raw Water Main
Littleton, MA
October 16, 2023

Forebay Volume:

Minimum Required Volume = 0.1-IN x Impervious Area

Impervious Area:	2,846	(SF)
Volume Required:	24	(CF)
Volume Provided:	61	(CF)

Volume Calculation			
Elevation (FT)	**Area (SF)**	**Incremental Volume (CF)**	**Cumulative Volume (CF)**
229	25	0	0
230	97	61	**61**

Attachment F - Long Term Pollution Prevention Plan

Long Term Pollution Prevention Plan

To meet the requirements of Standard 4 of the Massachusetts Stormwater Handbook, this Long Term Pollution Prevention Plan is provided to identify the proper procedures of practices for source control and pollution prevention.

Storage and Handling of Oil and other Hazardous Materials

Any hazardous materials that will be used ancillary to the site will be stored inside, or off site.

Spill Prevention/Response

Spill kits will be kept at a local Town facility, and spills shall be cleaned up immediately. Spills of any hazardous material over 10 gallons will be reported to the Massachusetts Department of Environmental Protection within 24 hours.

Operation and Maintenance of Stormwater Control Structures

Included in Attachment H of this appendix is the Operation and Maintenance plan for this site, which includes periodic cleaning of stormwater infrastructure. The Littleton Water Department (LWD) will be responsible for the implementation of the plan.

Landscaping

Maintenance of landscaped areas shall be the responsibility of the LWD. Use of fertilizers, herbicides, and pesticides shall not be allowed on site.

Septic System

There will be no onsite septic facilities.

Vehicle Washing

Vehicle washing shall not be performed on site. Vehicles can be rinsed with a high volume of water at low pressure. This is considered dust water by the DEP and accounts for what may be rinsed off the vehicle when it rains.

Non-Hazardous Waste Management/Good Housekeeping Practices

All non-hazardous waste shall be stored in designated trash or recycling containers onsite for periodic collection by the local trash collector. The LWD shall have maintenance staff who monitor the site for the accumulation of trash. Any trash that is seen onsite shall immediately be collected and placed into designated trash or recycling containers.

Prohibition of Illicit Discharges

Illicit discharges to the onsite stormwater management system shall be strictly prohibited. Illicit discharges are defined as any direct or indirect non-stormwater discharge to the onsite stormwater system. Requirements related to Illicit Discharges are further detailed in the attached Illicit Discharge Compliance Statement in Attachment I.

De-icing & Snow Disposal

Salt and sand shall not be used to treat the existing paved surfaces of the site during snow and ice events. Snow will be temporarily stored within peripheral areas of the site and allowed to melt and drain back to onsite stormwater systems. When needed, snow shall be removed from the site and disposed of in accordance with all local, state, and federal regulations. Snow storage shall be prohibited within all wetlands.

Emergency Contact Information

Owner/Operator:
Littleton Water Department
Corey Godfrey
Water & Sewer Superintendent
39 Ayer Road, Littleton, MA 01460
cgodfrey@lelwd.com
978-540-2222

Engineer:
James Pearson, P.E.
Weston & Sampson, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978-532-1900

Attachment G - Construction Period Pollution and Erosion and Sedimentation Control Plan

Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan

SECTION 1: Introduction

The Littleton Electric Light & Water Department proposes to develop a new drinking water well at a Town owned parcel located off Taylor Street to augment the Town's active water supply sources. Access to the site will be provided through an easement located on abutting property owned by Amazon. Work involved with this project will include the construction of a 1,200-foot± access road, with approximately 800-feet constructed of gravel and 400-feet of asphalt, a well building, a raw water main, and stormwater management infrastructure. Other work will include grading, landscaping, and utilities in support of the well building.

As part of this project, this "Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan" has been created to ensure that onsite erosion is prevented and sediment is controlled to prevent it from leaving the site.

SECTION 2: Construction Period Pollution Prevention Measures

Best Management Practices (BMPs) will be utilized as Construction Period Pollution Prevention Measures to reduce potential pollutants and prevent any off-site discharge. The objectives of the BMPs for construction activity are to minimize the disturbed areas, stabilize any disturbed areas, control the site perimeter and retain sediment. Both erosion and sedimentation controls and non-stormwater best management measures will be used to minimize site disturbance and ensure compliance with the performance standards of the WPA and Stormwater Standards. Measures will be taken to minimize the area disturbed by construction activities to reduce the potential for soil erosion and stormwater pollution problems. All pollution prevention and erosion control measures which are required on the site plans and in the SWPPP shall be followed along with the guidance in this document. In addition, good housekeeping measures will be followed for the day-to-day operation of the construction site under the control of the contractor to minimize the impact of construction. This section describes the control practices that will be in place during construction activities. All recommended control practices will comply with the standards set in the MA DEP Stormwater Policy Handbook.

2.1 Minimize Disturbed Area and Protect Natural Features and Soil

In order to minimize disturbed areas all work will be completed within well-defined work limits. These work limits are shown on the construction plans. The Contractor shall not disturb native vegetation in the undisturbed wooded area without prior

approval from the Engineer. The Contractor will be responsible to make sure that all workers know the proper work limits and do not extend their work into the undisturbed areas. The protective measures are described in more detail in the following sections.

2.2 Control Stormwater Flowing onto and through the project

All construction areas adjacent to drainage features will be lined with compost filter tubes and silt fence. The tubes and silt fence will be inspected daily and accumulated silt will be removed as appropriate. In addition, any storage of material will require a second level of protection by surrounding the areas with another row of compost filter tubes. A stabilized construction entrance/exit is proposed so that equipment visiting the site can remove any accumulated dirt and mud from vehicles to prevent tracking the mud onto public roads.

2.3 Stabilize Soils

The Contractor shall limit the area of land which is exposed and free from vegetation during construction. In areas where the period of exposure will be greater than two (2) months, mulching, the use of erosion control mats, or other protective measures shall be provided as specified.

The Contractor shall take account of the conditions of the soil where erosion control seeding will take place to ensure that materials used for re-vegetation are adaptive to the sediment control.

Following the completion of construction, embankment areas will be finished with topsoil and seed. Slopes in excess of 3H:1V will be stabilized with erosion matting to prevent erosion during the interim period in which vegetation is being established. The overland areas of the proposed construction staging areas will also be re-seeded.

2.4 Proper storage and cover of any stockpiles

The location of the Contractor's storage areas for equipment and/or materials shall be upon cleared portions of the job site or areas to be cleared as a part of this project and shall require written approval of the Engineer.

Adequate measures for erosion and sediment control such as the placement of compost filter tubes around the downstream perimeter of stockpiles shall be employed to protect any downstream areas from siltation.

The Engineer may designate a particular area or areas where the Contractor may store materials used in his operations.

2.5 Perimeter Controls and Sediment Barriers

Erosion control lines as described in Section 5 will be utilized to ensure that no

sedimentation occurs outside the perimeter of the work area.

2.6 Storm Drain Inlet Protection

Storm drain inlets will be protected from sediment.

2.7 Retain Sediment On-Site

The Contractor will be responsible to monitor all erosion control measures. Whenever necessary the Contractor will clear all sediment from the compost filter tubes and silt fence that have been silted up during construction. Daily monitoring should be conducted using the attached Monitoring Form.

The following good housekeeping practices will be followed on-site during the construction project.

2.8 Material Handling and Waste Management

All materials stored on-site will be stored in a neat, orderly manner in appropriate containers. All materials will be kept in their original containers with the original manufacturer's label. Substances will not be mixed with one another unless recommended by the manufacturer.

All waste materials will be collected and stored in a securely lidded metal container from a licensed management company. The waste and any construction debris from the site will be hauled off-site daily and disposed of properly. The contractor will be responsible for all waste removal. Manufacturer's recommendations for proper use and disposal will be followed for all materials. Sanitary waste will be collected from the portable units a minimum of once a week, by a licensed sanitary waste management contractor.

2.9 Designated Washout Areas

The Contractor shall perform washout into contained areas designated for that purpose to prevent cement-laden water from leaving the site.

2.10 Proper Equipment/Vehicle Fueling and Maintenance Practices

On-site vehicles will be monitored for leaks and receive regular preventative maintenance to reduce the risk of leakage. To ensure that leaks on stored equipment do not contaminate the site, oil-absorbing mats will be placed under all equipment during storage. Regular fueling and service of the equipment may be performed using approved methods and with care taken to minimize chance of spills. Any petroleum products will be stored in tightly sealed containers that are clearly labeled.

2.11 Equipment/Vehicle Washing

The Contractor will be responsible to ensure that no equipment is washed on-site.

SECTION 3: Spill Prevention and Control Plan

The Contractor will be responsible for preventing spills in accordance with the project specifications and applicable federal, state, and local regulations. The Contractor will identify a properly trained site employee, involved with the day-to-day site operations to be the spill prevention and cleanup coordinator. The name(s) of the responsible spill personnel will be posted on-site. Each employee will be instructed that all spills are to be reported to the spill prevention and cleanup coordinator.

3.1 Spill Control Equipment

Spill control/containment equipment will be kept in the Work Area. Materials and equipment necessary for spill cleanup will be kept either in the Work Area or in an otherwise accessible on-site location. Equipment and materials will include, but not be limited to, absorbent booms/mats, brooms, dust pans, mops, rags, gloves, goggles, sand, plastic and metal containers specifically for this purpose. It is the responsibility of the Contractor to ensure the inventory will be readily accessible and maintained.

3.2 Notification

All workers will be directed to inform the on-site supervisor of a spill event. The supervisor will assess the incident and initiate proper containment and response procedures immediately upon notification. Workers should avoid direct contact with spilled materials during the containment procedures. Primary notification of a spill should be made to the local Fire Department and Police Departments. Secondary Notification will be to the certified cleanup contractor if deemed necessary by Fire and/or Police personnel. The third level of notification is to the DEP. The specific cleanup contractor to be used will be identified by the Contractor prior to commencement of construction activities.

3.3 Spill Containment and Clean-Up Measures

Spills will be contained with granular sorbent material, sand, sorbent pads, booms or all of the above to prevent spreading. Certified cleanup contractors should complete spill cleanup. The material manufacturer's recommended methods for spill cleanup will be clearly posted and on-site personnel will be made aware of the procedures and the location of the information and cleanup supplies.

3.4 Hazardous Materials Spill Report

The Contractor will report and record any spill. The spill report will present a description of the release, including the quantity and type of material, date of the spill, circumstances leading to the release, location of spill, response actions and personnel, documentation of notifications and corrective measures implemented

to prevent reoccurrence.

This document does not relieve the Contractor of the Federal reporting requirements of 40 CFR Part 110, 40 CFR Part 117, 40 CFR Part 302 and the State requirements specified under the Massachusetts Contingency Plan (M.C.P) relating to spills or other releases of oils or hazardous substances. Where a release containing a hazardous substance or oil in an amount equal to or in excess of a reportable quantity established under either 40 CFR Part 110, 40 CFR Part 117 or 40 CFR Part 302, occurs during a twenty-four (24) hour period, the Contractor is required to comply with the response requirements of the above mentioned regulations. Spills of oil or hazardous material in excess of the reportable quantity will be reported to the National Response Center (NRC).

SECTION 4: Contact Information/Responsible Parties

Owner/Operator:
Littleton Water Department
Corey Godfrey
Water & Sewer Superintendent
39 Ayer Road, Littleton, MA 01460
cgodfrey@lelwd.com
978-540-2222

Engineer:
James Pearson, P.E.
Weston & Sampson, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978-532-1900

Site Inspector:
TBD

Contractor:
TBD

SECTION 5: Erosion and Sedimentation Control

Erosion and Sedimentation Controls are shown on the project plans. A Stormwater Pollution Prevention Plan (SWPPP) will be required for this project in accordance with EPA regulations. The contractor shall refer to the SWPPP for additional requirements.

SECTION 6: Site Development Plans

A full set of site development plans are included with this submittal.

SECTION 7: Operation and Maintenance of Erosion Control

If there is a failure to the controls the Contractor, under the supervision of the Engineer, will be required to stop work until the failure is repaired.

Periodically throughout the work, whenever the Engineer deems it necessary, the sediment that has been deposited against the controls will be removed to ensure that the controls are working properly.

SECTION 8: Inspection Schedule

During construction the erosion and sedimentation controls will be inspected daily. Once the Contractor is selected, an on-site inspector will be selected to work closely with the Engineer to insure that all erosion and sedimentation controls are in place and working properly. An Inspection Form is included.

Inspection Form

Inspected By: _____ Date: _____ Time: _____

YES	NO	DOES NOT APPLY	ITEM
			Do any erosion/siltation control measures require repair or clean out to maintain adequate function?
			Is there any evidence that sediment is leaving the site and entering the wetlands?
			Are any temporary soil stockpiles or construction materials located in non-approved areas?
			Are on-site construction traffic routes, parking, and storage of equipment and supplies located in areas not specifically designed for them?
			Is there any evidence that sediment is entering stormwater management systems?

Specific location, current weather conditions, and action to be taken:

_____

_____

_____

_____

_____

_____

Other Comments:

_____

_____

_____

Pending the actions noted above I certify that the site is in compliance with the Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan.

Signature: _____ Date: _____

Attachment H - Operations and Maintenance Plan

Operations & Maintenance Plan

1.0 Introduction

The following document has been written to comply with the stormwater guidelines set forth by the Massachusetts Department of Environmental Protection (MassDEP). The intent of these guidelines is to encourage Low Impact Development techniques to improve the quality of the stormwater runoff. These techniques, also known as Best Management Practices (BMPs) collect, store, and treat the runoff before discharging to adjacent environmental resources.

2.0 Purpose

This Operations & Maintenance Plan (O&M Plan) is intended to provide a mechanism for the consistent inspection and maintenance of each BMP installed on the project site. Included in this O&M Plan is a description of the BMP type and an inspection form for the BMP. The Littleton Water Department (LWD) is the owner and operator of the system and is responsible for its upkeep and maintenance. This work will be funded on an annual basis through the owner's operating budget.

In the event the Owner sells the property, it is the Owner's responsibility to transfer this plan as well as the past operation and maintenance records to the new property owner.

3.0 BMP Descriptions

3.1 Infiltration Basins

Infiltration basins are used to provide stormwater treatment, detention, and groundwater recharge to mitigate peak stormwater discharges and remove total suspended solids from the stormwater runoff.

3.2 Sediment Forebays

Sediment forebays are designed to allow temporary ponding of stormwater runoff which allows sedimentation of total suspended solids. The bay is typically lined with stone riprap but can also be grassed and contains a stone check dam to release retained water.

3.3 Grassed Swales

Grassed swales treat stormwater runoff by providing long retention times for the water travelling through it so that total suspended solids are allowed

to settle. The swales also contains stone check dams to increase retention time.

4.0 Inspection, Maintenance Checklist, and Schedule

4.1 Infiltration Basins

Infiltration basins shall be inspected every three months during the first year, and annually thereafter. Inspection shall include all items noted below.

All accumulated sediment and debris in the stormwater infiltration basins should be removed and disposed of according to local, state, and federal regulations. The basin bottom and side slopes shall be mowed as needed, and at least twice a year at a minimum. Any grassed areas of the basin, which are near any paved areas that use salt in deicing applications should be re-seeded in the spring. Vegetation in infiltration basin bottoms shall likewise be inspected for degradation. Any accumulated sediment shall be removed, and bare spots should be re-seeded as needed.

Pipe inlets and outfalls from stormwater infiltration basins shall be inspected for plugging or damage and cleaned or repaired immediately. Any vegetation, soil or debris that forms a barrier to flow shall be removed. If any soil erosion is noted, erosion shall be repaired, and bare spots shall be armored with stone riprap. Embankments, spillways, and swales that affect the operation of the basin shall likewise be inspected for blockage or damage. Any accumulated debris that may impede stormwater flow shall be removed, and any noted erosion shall be repaired with stone riprap.

4.2 Sediment Forebays

Sediment forebays shall be inspected on a monthly basis and shall be cleaned four times per year. Check the sediment forebay for accumulated trash and debris at least once per month and remove by hand. Sediment shall be removed as needed and at least four times per year by hand or by using a vacuum truck. Check for signs of erosion and rilling in the forebay when removing sediments, and repair with stone riprap, or re-seed as needed.

4.3 Grassed Swales

Grassed swales must be inspected at least once a year for signs of erosion, sediment accumulation, vegetation loss and for the presence of invasive species. Any debris or sedimentation must be removed, and all areas of vegetation loss must be repaired. Periodic mowing of the swales is also required and at least 4-IN of grass must be maintained in the bottom of the swale. Repair check dams with stone as needed.

4.4 Inspections and Record Keeping

- An inspection form should be filled out each, and every time maintenance work is performed.
- A binder should be kept that contains all of the completed inspection forms and any other related materials.
- A review of Operation & Maintenance actions should take place annually such that the Stormwater BMPs are being taken care of in the manner illustrated in this Operation & Maintenance Plan.
- Operation & Maintenance log forms for the last three years, at a minimum, shall be kept on site.
- The inspection and maintenance schedule may be refined in the future based on the findings and results of this Operation & Maintenance program or policy.

5.0 Stormwater Management System Owner/Responsible Party

The stormwater management system shall be owned and maintained by the following party or its future designee/assigns:

Littleton Water Department
Corey Godfrey
Water & Sewer Superintendent
39 Ayer Road, Littleton, MA 01460
cgodfrey@lelwd.com
978-540-2222

This operation and Maintenance Plan will be recorded with the registry of deeds so that current and future owners are aware of the requirement for proper operation and maintenance of the onsite stormwater system.

6.0 General Good Housekeeping Practices

All non-hazardous waste shall be stored in designated trash or recycling containers onsite for periodic collection by the local trash collector. The owner shall have maintenance staff who monitor the site for the accumulation of trash. Any trash that is seen onsite shall immediately be collected and placed into designated trash or recycling containers.

7.0 Estimated Operations and Maintenance Budget

The estimated budget for annual operations and maintenance of this stormwater system is $1,000 per year.

Infiltration Basins

Frequency: Inspect every three months during the first year and annually thereafter. Mow basins at least twice a year at a minimum.

Structure Number: _____

Inspected By: _____ Date: _____

Observations: _____
_____
_____

Actions Taken: _____
_____
_____

Instructions: Inspect grassed area. Mow grass as needed in infiltration basins. Remove accumulated trash and debris. Remove sediment and re-seed bare spots as needed, including in basin bottom. Inspect pipe inlets/outfalls for damage, erosion, or blockage, remove blockage as needed, repair erosion with riprap. Inspect embankments, spillways and swales for erosion or blockage. Repair erosion with riprap, remove blockage as needed. All trash, debris, and sediments should be disposed of in accordance with local, state, and federal regulations.

Sediment Forebays

Frequency: Inspect monthly for trash and debris accumulation, remove as needed. Four times a year at a minimum, remove sediments.

Structure Number: _____

Inspected By: _____ Date: _____

Observations: _____
_____
_____

Actions Taken: _____
_____
_____

Instructions: Check for accumulation of sediment, trash, and debris monthly and remove trash and debris as needed. Every three months, remove sediments from forebay by hand or with a vacuum truck. Remove any vegetative growth or debris that restricts flow through the check dam. Check for signs of erosion and repair or replace any lost stone in the forebay or check dam with 4-6” riprap.

Grassed Swales

Frequency: Inspect quarterly in the first year and then annually during the spring each year after.

Structure Number: _____

Inspected By: _____ Date: _____

Observations: _____
_____
_____

Actions Taken: _____
_____
_____

Instructions: Check for accumulation of sediment, signs of erosion and loss of vegetation. Remove sediment and debris that restricts flow. Mow as needed to maintain a minimum of 4-IN of grass in the swale and repair any areas of vegetation loss. Repair any check dams with stone as needed. All trash, debris, and sediments should be disposed of in accordance with local, state, and federal regulations.

Attachment I – Illicit Discharge Compliance Statement

Illicit Discharge Compliance Statement

Section I – Purpose/Intent

The purpose of this document is to provide for the health, safety, and general welfare of the citizens of Massachusetts through the regulation of non-stormwater discharges into existing outstanding resource areas near the site to the maximum extent practicable, as required by federal and state law. To the best of our knowledge and belief, there are no illicit discharges occurring under existing conditions on this site within the meaning expressed under Standard 10 of the Massachusetts Stormwater Handbook. This document establishes methods for controlling the introduction of pollutants into existing outstanding resource areas to comply with requirements of the National Pollutant Discharge Elimination System (NPDES) permit process.

Section II - Definitions

For the purposes of this statement, the following shall mean:

Best Management Practices (BMPs): Schedules of activities, prohibitions of practices, general good housekeeping practices, pollution prevention and educational practices, maintenance procedures, and other management practices to prevent or reduce the discharge of pollutants directly or indirectly to stormwater, receiving waters, or stormwater conveyance systems. BMPs also include treatment practices, operating procedures, and practices to control site runoff, spillage or leaks, sludge or water disposal, or drainage from raw materials storage.

Clean Water Act: The federal Water Pollution Control Act (33 U.S.C § 1251 et seq.), and any subsequent amendments thereto.

Construction Activity: Activities subject to the Massachusetts Erosion and Sedimentation Control Act or NPDES Construction Permits. Such activities include but are not limited to clearing and grubbing, grading, excavating, and demolition.

Hazardous Materials: Any material, including any substance, waste, or combination thereof, which because of its quantity, concentration, or physical, chemical, or infectious characteristics may cause, or significantly contribute to, a substantial present or potential hazard to human health, safety, property, or the environment when improperly treated, stored, transported, disposed of, or otherwise managed.

Illegal Connection: An illegal connection is defined as either of the following:

a. Any pipe, open channel, drain or conveyance, whether on the surface or subsurface, which allows an illicit discharge to enter the outstanding resource area including but not limited to any conveyances which allow any non-stormwater

discharge including sewage, process wastewater, and wash water, regardless of whether said drain or connection has been previously allowed, permitted, or approved by an authorized enforcement agency; or

b. Any pipe, open channel, drain or conveyance connected to the Town of Littleton storm water treatment system which has not been documented in plans, maps, or equivalent records and approved by an authorized enforcement agency.

Illicit Discharge: Any direct or indirect non-stormwater discharge to the Town of Littleton stormwater treatment system, except as exempted in Section III of this ordinance.

Industrial Activity: Activities subject to NPDES Industrial Permits as defined in 40CFR, Section 122.26 (b) (14).

National Pollutant Discharge Elimination System (NPDES) Stormwater Discharge Permit: A permit issued by MassDEP under authority delegated pursuant to 33 USC § 1342 (b) that authorizes the discharge of pollutants to waters of the United States, whether the permit is applicable on an individual, group, or general area-wide basis.

Town of Littleton Stormwater Treatment System: Any facility, owned or maintained by the Town of Littleton, designed or used for collecting and/or conveying stormwater, including but not limited to roads with drainage systems, Town of Littleton streets, curbs, gutters, inlets, catch basins, piped storm drains, pumping facilities, infiltration, retention and detention basins, natural and man-made or altered drainage channels, reservoirs, and other drainage structures.

Non-Stormwater Discharge: Any discharge to the storm drain system that is not composed entirely of stormwater.

Person: Any individual, association, organization, partnership, firm, joint venture, public or private corporation, trust, estate, commission, board, public or private institution, utility, cooperative, city, county or other political subdivision of the State, interstate body, or any other legal entity.

Pollutant: Anything which causes or contributes to pollution. Pollutants may include, but are not limited to: paints, varnishes, and solvents; petroleum hydrocarbons; automotive fluids; cooking grease; detergents (biodegradable or otherwise); degreasers; cleaning chemicals; non-hazardous liquid and solid wastes; refuse, rubbish, garbage, litter, or other discarded or abandoned objects and accumulations, so that same may cause or contribute to pollution; floatables; pesticides, herbicides, and fertilizers; liquid and solid wastes; sewage, fecal coliform and pathogens; dissolved and particulate metals; animal wastes; wastes and residues that result from constructing a building or structure; concrete and cement; and noxious or offensive matter of any kind.

Pollution: Contamination or other alteration of any water's physical, chemical, or biological properties by addition of any constituent including but not limited to a change in temperature, taste, color, turbidity, or odor of such waters, or the discharge of any liquid,

gaseous, solid, radioactive, or other substance into any such waters as will or is likely to create a nuisance or render such waters harmful, detrimental, or injurious to the public health, safety, welfare, or environment, or to domestic, commercial, industrial, agricultural, recreational, or other legitimate beneficial uses, or to livestock, wild animals, birds, fish or other aquatic life.

Premises: Any building, lot, parcel of land, or portion of land whether improved or unimproved including adjacent sidewalks and parking strips.

Stormwater: Any surface flow, runoff, and drainage consisting entirely of water from any form of natural precipitation and resulting from such precipitation.

Wastewater: Any water or other liquid discharged from a facility, that has been used, as for washing, flushing, or in a manufacturing process, and so contains waste products.

Section III - Prohibitions

Prohibition of Illicit Discharges:

No person shall throw, drain, or otherwise discharge, cause or allow others under its control to throw, drain, or otherwise discharge into the Town of Littleton stormwater treatment system or watercourses any materials, including but not limited to, any pollutants or waters containing any pollutants, other than stormwater. It is to the best knowledge and belief of the project proponent that no illicit discharges currently exist at the project site. The commencement, conduct or continuance of any illicit discharge to the storm drain system is prohibited except as described as follows:

1. Water line flushing performed by a government agency, other potable water sources, landscape irrigation or lawn watering, diverted stream flows, rising ground water, ground water infiltration to storm drains, uncontaminated pumped ground water, foundation or footing drains (not including active groundwater dewatering systems), crawl space pumps, air conditioning condensation, springs, natural riparian habitat or wetland flows, and any other water source not containing pollutants;

2. Discharges or flows from fire fighting, and other discharges specified in writing by the Town of Littleton as being necessary to protect public health and safety;

3. Dye testing is an allowable discharge, but requires notification to the Town of Littleton prior to the time of the test;

4. Any non-stormwater discharge permitted under an NPDES permit, waiver, or waste discharge order issued to the discharger and administered under the authority of the Federal Environmental Protection Agency, provided that the discharger is in full compliance with all requirements of the permit, waiver, or order and other applicable laws and regulations, and provided that written approval has been granted for a discharge to the Town of Littleton stormwater treatment system.

Section IV - Industrial or Construction Activity Discharges

Any person subject to an industrial or construction activity NPDES stormwater discharge permit shall comply with all provisions of such permit. Proof of compliance with said permit may be required in a form acceptable to the Town of Littleton prior to allowing discharges to the Town of Littleton stormwater treatment system.

Section V - Notification of Spills and Accidental Discharges

Notwithstanding other requirements of law, as soon as any person responsible for a facility, activity or operation, or responsible for emergency response for a facility, activity or operation has information of any known or suspected release of pollutants or non-stormwater discharges from that facility, activity, or operation which are resulting or may result in illicit discharges or pollutants discharging into stormwater, the Town of Littleton stormwater treatment system, State Waters, or Waters of the U.S., said person shall take all necessary steps to ensure the discovery, containment, and cleanup of such release so as to minimize the effects of the discharge. In the event of such a release of hazardous materials, said person shall immediately notify emergency response agencies of the occurrence via emergency dispatch services. In the event of a release of non-hazardous materials, said person shall notify the Town of Littleton DPW in person or by phone no later than the next business day, including the nature, quantity and time of occurrence of the discharge. Notifications in person or by phone shall be confirmed by written notice, via certified mail return receipt requested addressed to the Town of Littleton DPW within three (3) business days of the initial notice. If the discharge of prohibited materials emanates from a commercial or industrial establishment, the owner or operator of such establishment shall also retain an on-site written record of the discharge and the actions taken to prevent its recurrence. Such records shall be retained for at least three years.

IN WITNESS WHEREOF the parties hereto have executed copies of this Agreement on the _____ day of _____, _____.

_____

Appendix D
Maps

Path: \\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\NOI Littleton\Appendix D maps\Locus - new source raw main only.mxd **User:** Foulds, Jordan **Saved:** 9/14/2023 9:33:07 AM **Opened:** 9/14/2023 9:33:17 AM

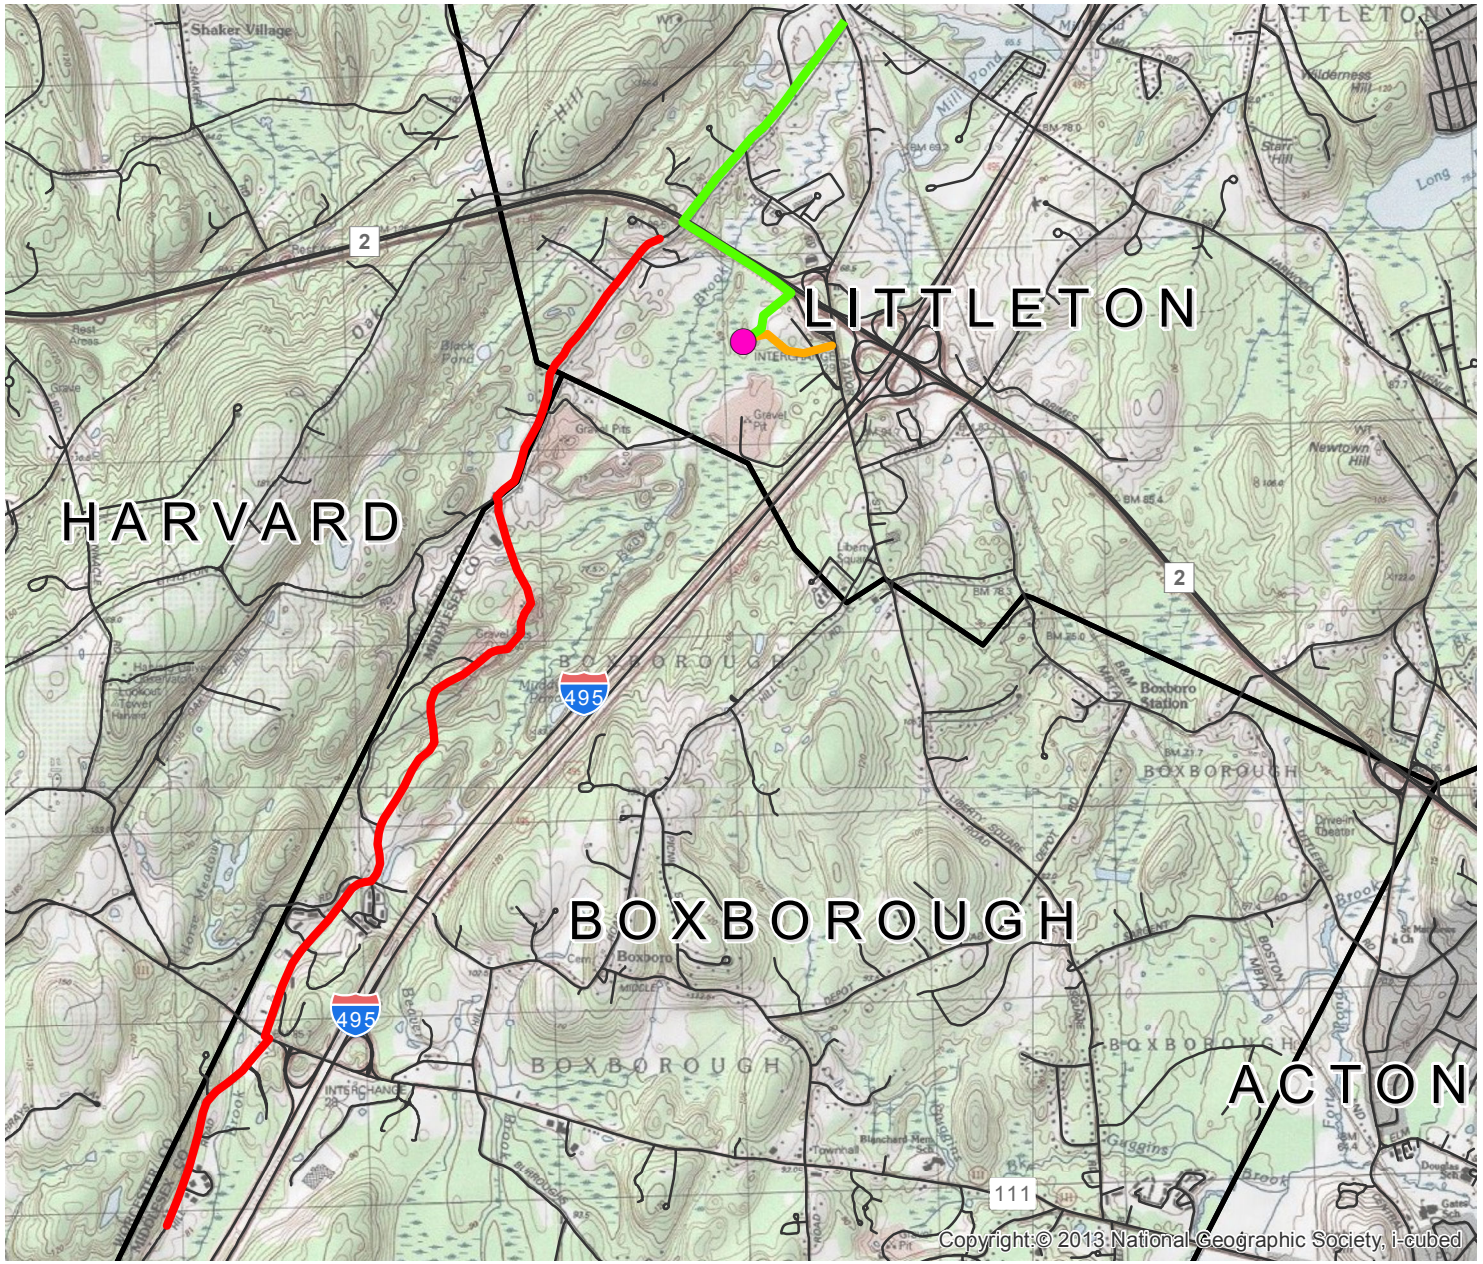

N
W E
S
6,000 3,000 0 6,000
Feet

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Well Site
- Finish Extension
- Raw Extension
- Access Road

FIGURE 1

New Source and Raw Water Main
Finished Water Ext.

Littleton & Boxborough, MA

Weston & Sampson

Path: \\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\NOI Littleton\Appendix D maps\Environmental receptors- new source raw main only.mxd **User:** Foulds.Jordan **Saved:** 9/14/2023 9:56:36 AM **Opened:** 9/14/2023 9:56:43 AM

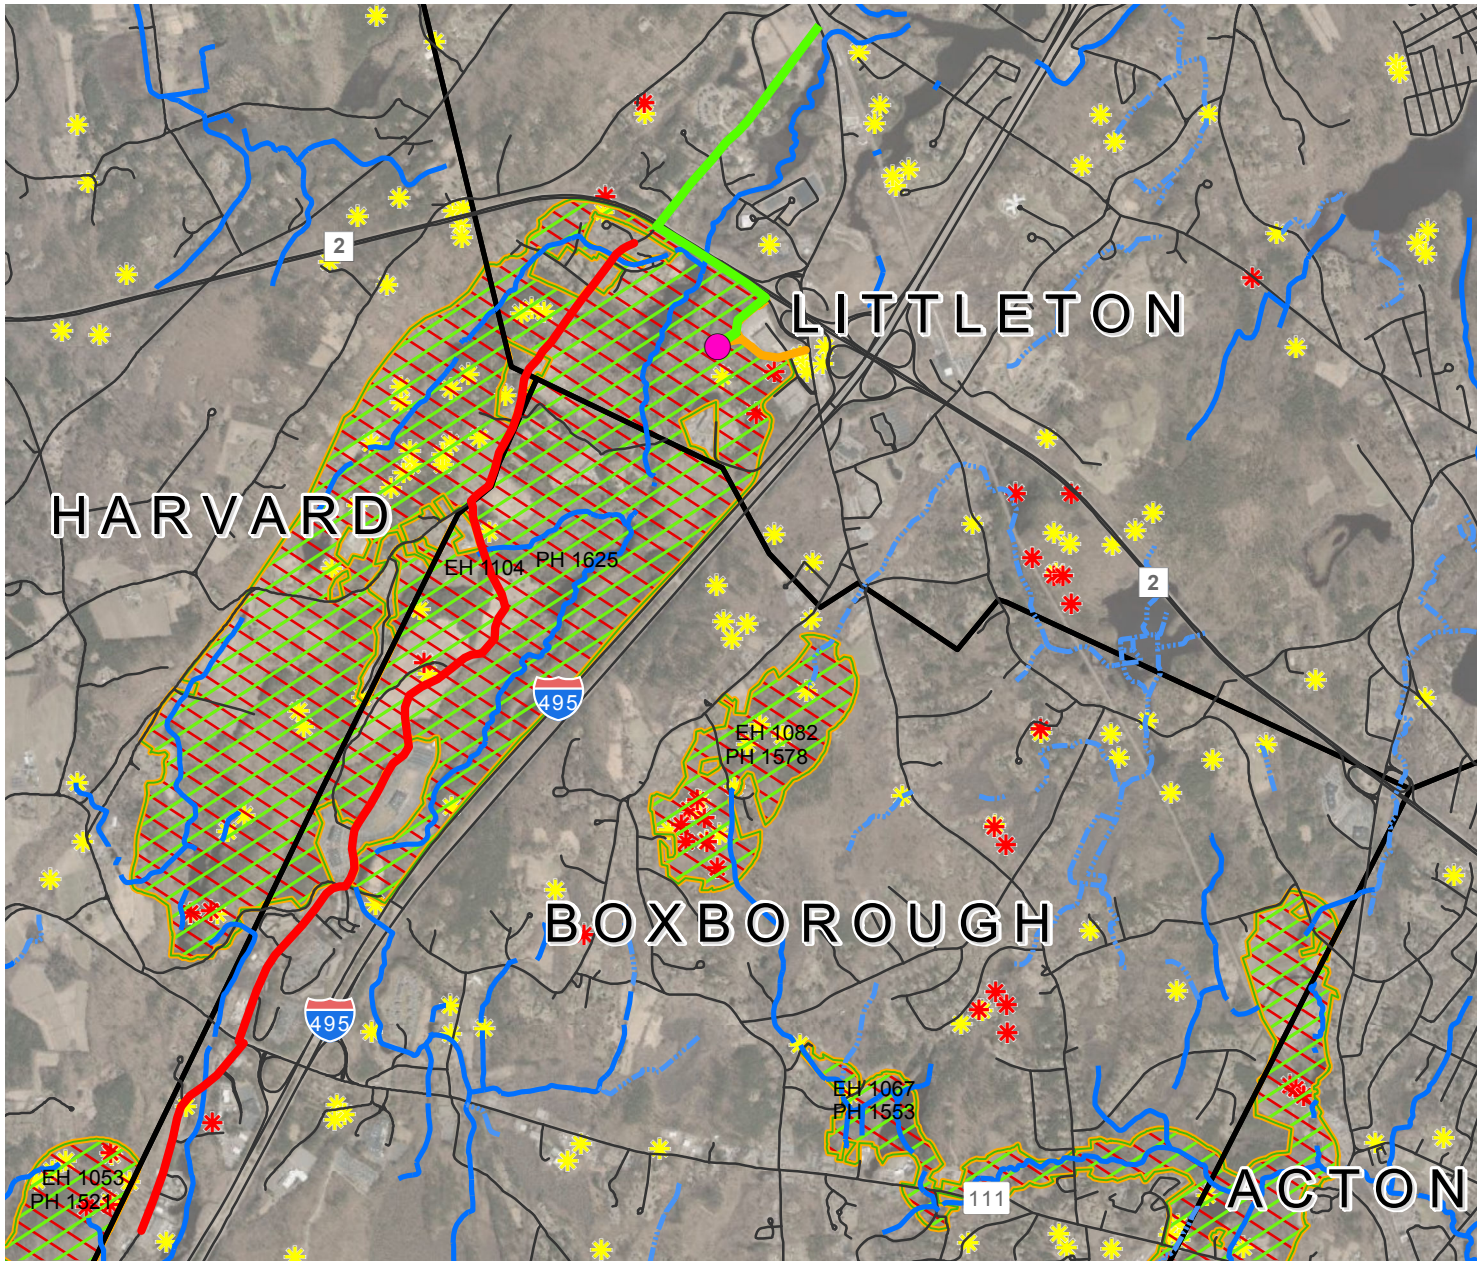

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Well Site
- Finish Extension
- Raw Extension
- Access Road
- Perennial Stream
- Intermittent Stream

ACECs

- ACECs

NHESP Habitats

- NHESP Estimated Habitats of Rare Wildlife
- NHESP Priority Habitats of Rare Species
- NHESP Certified Vernal Pools
- NHESP Potential Vernal Pools

FIGURE 2

New Source and Raw Water Main
Finished Water Ext.

Littleton & Boxborough, MA

Weston & Sampson

Path: \\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\NOI Littleton\Appendix D maps\Flood new source raw main only.mxd **User:** Foulds.Jordan **Saved:** 9/14/2023 9:56:15 AM **Opened:** 9/14/2023 9:56:26 AM

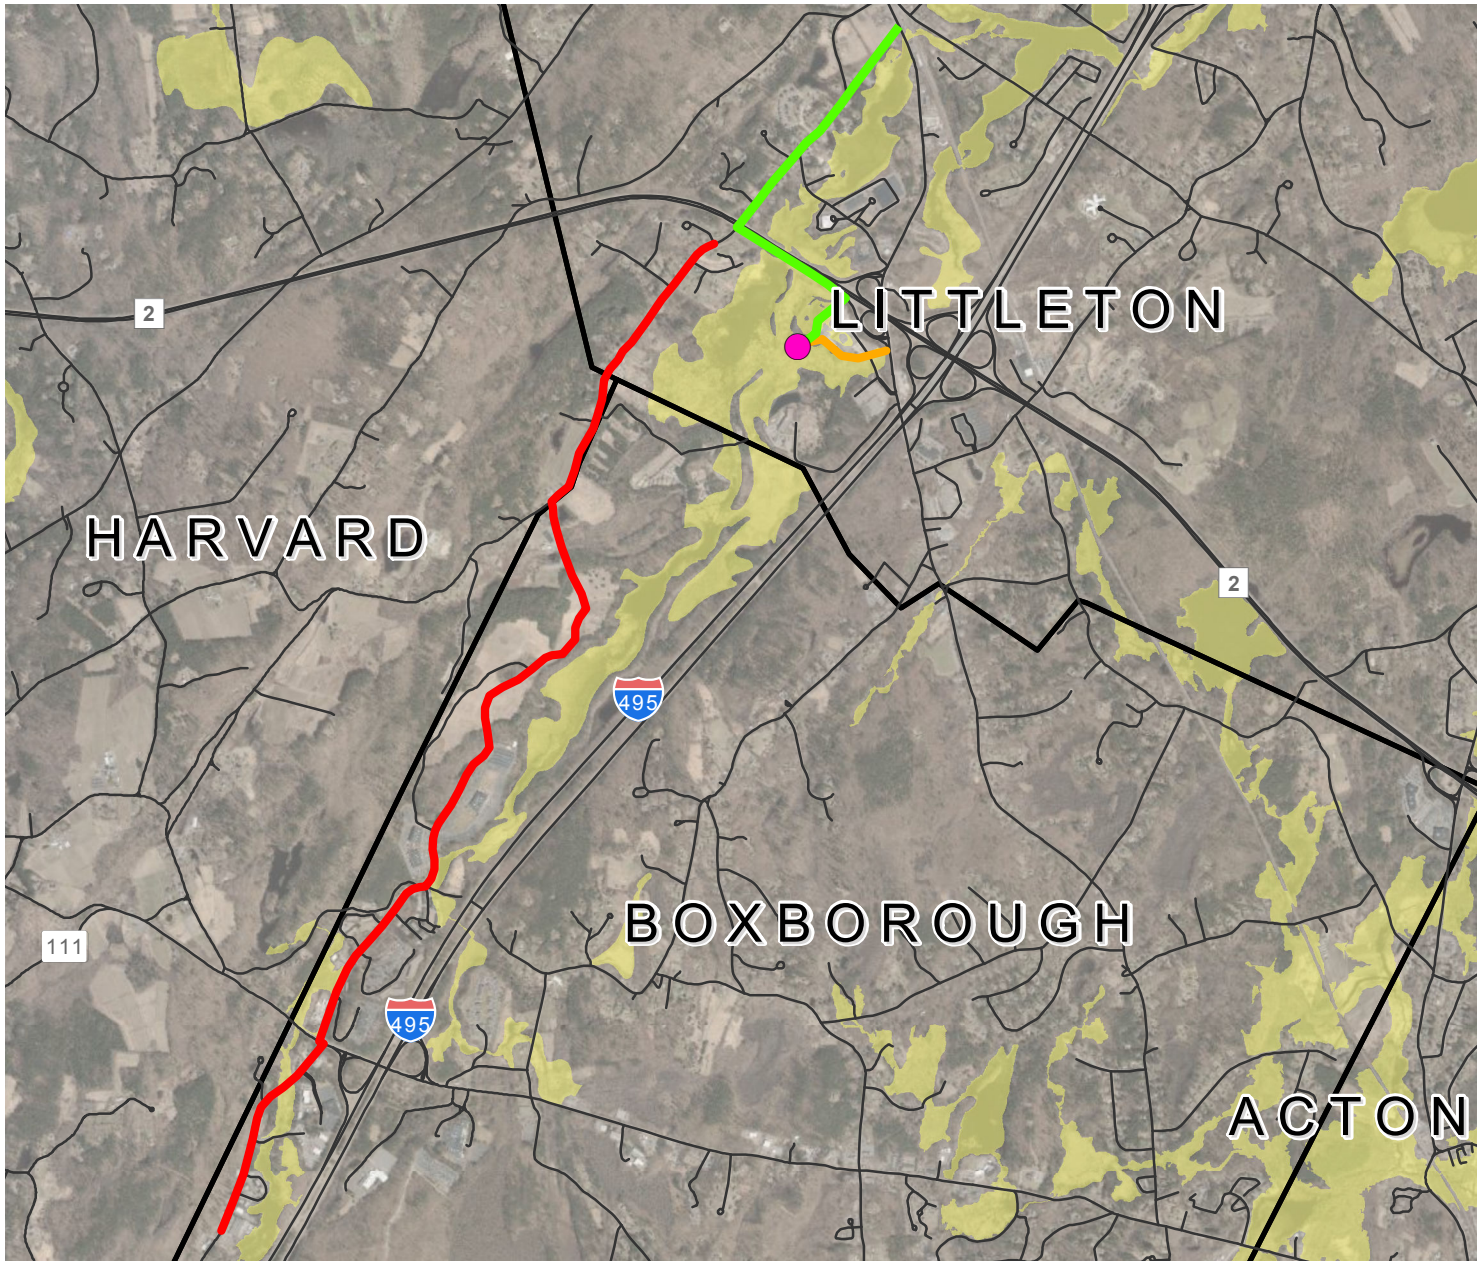

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Well Site
- Finish Extension
- Raw Extension
- Access Road

100-Year Flood Zone

- 100-Year Flood Zone

FIGURE 3

New Source and Raw Water Main
Finsihed Water Ext.

Littleton & Boxborough, MA

Weston & Sampson

Appendix E
Applicable Technical Specifications

SECTION 01562

DUST CONTROL

PART 1 - GENERAL

1.01 DESCRIPTION:

This section of the specification covers the control of dust via water, complete.

PART 2 - PRODUCTS

2.01 WATER:

A. Water shall not be brackish and shall be free from oil, acid, and injurious alkali or vegetable matter.

PART 3 - EXECUTION

3.01 APPLICATION:

A. Water may be sprinkler applied with equipment including a tank with gauge-equipped pressure pump and a nozzle-equipped spray bar.

B. Water shall be dispersed through the nozzle under a minimum pressure of 20 pounds per square inch, gauge pressure.

END OF SECTION

\\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\NOI Boxborough\Appendix E Specs\SECTION 01562-Dust Control.docx

SECTION 01570

ENVIRONMENTAL PROTECTION

PART 1 – GENERAL

1.01 DESCRIPTION:

A. The work covered by this section of the specifications consists of furnishing all labor, materials, tools and equipment and performing all work required for the prevention of environmental pollution during and as a result of construction operations under this contract.

B. The requirements set forth in this section of the specifications apply to construction in and adjacent to wetlands, unless otherwise specifically stated.

C. All work under this Contract shall be in accordance with the Conservation Commissions' Orders of Conditions as well as any conditional requirements applied, all of which are attached to Section 00890, PERMITS.

D. Prior to commencement of work, the Contractor shall meet with representatives of the Engineer to develop mutual understandings relative to compliance of the environmental protection program.

1.02 SUBMITTALS:

A. The Contractor shall submit for approval six sets of details and literature fully describing environmental protection methods to be employed in carrying out construction activities within 100 feet of wetlands or across areas designated as wetlands.

PART 2 - PRODUCTS

2.01 SILT FENCE:

A. The silt fence shall consist of a 3-foot wide continuous length sediment control fabric, stitched to a mesh backing, and stapled to preweathered oak posts installed as shown on the drawings. The oak posts shall be 1-1/4-inches by 1-1/4-inches (Minimum Dimension) by 48-inches and shall be tapered. The bottom edge of the silt fence shall be buried as shown on the drawings.

B. The silt fence shall be DOT Silt Fence PPDM3611, as manufactured by U.S. Silt & Site Supply/Getsco, Concord, NH, or approved equal.

C. Silt fence properties:

Physical Properties	Test Method	Minimum Value
Grab Strength, lbs.	ASTM-D-4632	124
Grab Elongation, %	ASTM-D-4632	15

Mullen burst, psi	ASTM-D-3786	300
Puncture, lbs.	ASTM-D-4833	65
Trapezoidal Tear, lbs.	ASTM-D-4833	65
UV Resistance2, %3	ASTM-D-4355	80@500 hrs.
AOS, US Sieve No.	ASTM-D-4751	30
Flow Rate, gal/min/sq ft	ASTM-D-4491	10
Permittivity, (1/sec) gal/min/sq ft	ASTM-D-4491	0.05 sec^{-1}

2.05 CATCH BASIN PROTECTION:

A. To trap sediment and to prevent sediment from clogging drainage systems, catch basin protection in the form of a siltation sack (Siltsack as manufactured by ACF Environmental, Inc. or approved equal) shall be provided as approved by the Engineer.

2.06 COMPOST FILTER TUBES:

A. Silt socks shall be a tubular filter sock of mesh fabric. The fabric will have openings of between 1/8" to ¼" diameter. The mesh material will either photo degrade within one year or be made of nylon with a life expectancy of 24 months. The sock shall be filled with a mix of composted leaf mulch, bark mulch and wood chips that have been composted for at least one year. The sock will have a minimum diameter of 12-inches.

PART 3- EXECUTION

3.01 NOTIFICATION AND STOPPAGE OF WORK:

A. The Engineer will notify the Contractor in writing of any non-compliance with the provisions of the Order of Conditions. The Contractor shall, after receipt of such notice, immediately take corrective action. Such notice, when delivered to the Contractor or his authorized representative at the site of the work, shall be deemed sufficient for the purpose. If the Contractor fails to act promptly, the Owner may order stoppage of all or part of the work through the Engineer until satisfactory corrective action has been taken. No claim for an extension of time or for excess costs or damage incurred by the Contractor as a result of time lost due to any stop work orders shall be made unless it was later determined that the Contractor was in compliance.

3.02 AREA OF CONSTRUCTION ACTIVITY:

A. Insofar as possible, the Contractor shall confine his construction activities to those areas defined by the plans and specifications. All land resources within the project boundaries and outside the limits of permanent work performed under this contract shall be preserved in their present condition or be restored to a condition after completion of construction at least equal to that which existed prior to work under this contract.

3.03 PROTECTION OF WATER RESOURCES:

A. The Contractor shall not pollute streams, lakes or reservoirs with fuels, oils, bitumens,

calcium chloride, acids or other harmful materials. It is the Contractor's responsibility to comply with all applicable Federal, State, County and Municipal laws regarding pollution of rivers and streams.

B. Special measures should be taken to insure against spillage of any pollutants into public waters.

3.05 PROTECTING AND MINIMIZING EXPOSED AREAS:

A. The Contractor shall limit the area of land which is exposed and free from vegetation during construction. In areas where the period of exposure will be greater than two (2) months, temporary vegetation, mulching or other protective measures shall be provided as specified.

B. The Contractor shall take account of the conditions of the soil where temporary cover crop will be used to insure that materials used for temporary vegetation are adaptive to the sediment control. Materials to be used for temporary vegetation shall be approved by the Engineer.

3.06 LOCATION OF STORAGE AREAS:

A. The location of the Contractor's storage areas for equipment and/or materials shall be upon cleared portions of the job site or areas to be cleared as a part of this project, and shall require written approval of the Engineer. Plans showing storage facilities for equipment and materials shall be submitted for approval of the Engineer.

B. No excavated materials or materials used in backfill operations shall be deposited within a minimum distance of one hundred (100) feet of any watercourse or any drainage facility. Adequate measures for erosion and sediment control such as the placement of baled straw or line of straw wattles or compost filter tubes around the downstream perimeter of stockpiles shall be employed to protect any downstream areas from siltation.

C. There shall be no storage of equipment or materials in areas designated as wetlands.

D. The Engineer may designate a particular area or areas where the Contractor may store materials used in his operations.

3.07 PROTECTION OF LANDSCAPE:

A. The Contractor shall not deface, injure, or destroy trees or shrubs nor remove or cut them without written authority from the Owner. No ropes, cables, or guys shall be fastened to or attached to any existing nearby trees for anchorages unless specifically authorized by the Engineer. Excavating machinery and cranes shall be of suitable type and be operated with care to prevent injury to trees which are not to be removed, particularly overhanging branches and limbs. The Contractor shall, in any event, be responsible for any damage resulting from such use.

B. Branches, limbs, and roots shall not be cut except by permission of the Engineer. All cutting shall be smoothly and neatly done without splitting or crushing. When there is unavoidable injury to branches, limbs and trunks of trees, the injured portions shall be neatly trimmed and covered with an application of grafting wax or tree healing paint as directed.

C. Where, in the opinion of the Engineer, trees may possibly be defaced, bruised, injured, or otherwise damaged by the Contractor's equipment or by his blasting or other operations, the Engineer may require the Contractor to adequately protect such trees by placing boards, planks, poles or fencing around them. Any trees or landscape feature scarred or damaged by the Contractor's equipment or operations shall be restored as nearly as possible to its original condition at the expense of the Contractor. The Engineer will decide what method of restoration shall be used, and whether damaged trees shall be treated and healed or removed and disposed of under the provisions of Section 02230, CLEARING AND GRUBBING.

D. Cultivated hedges, shrubs, and plants which could be injured by the Contractor's operations shall be protected by suitable means or shall be dug up, balled and temporarily replanted and maintained. After construction operations have been substantially completed, they shall be replanted in their original positions and cared for until growth is re-established. If cultivated hedges, shrubs, and plants are injured to such a degree as to affect their growth or diminish their beauty or usefulness, they shall be replaced by items of a kind and quality at least equal to that existing at the start of the work.

END OF SECTION

SECTION 01740

CLEANING UP

PART 1 - GENERAL

1.01 DESCRIPTION:

The Contractor must employ at all times during the progress of its work adequate cleanup measures and safety precautions to prevent injuries to persons or damage to property. The Contractor shall immediately, upon request by the Engineer provide adequate material, equipment and labor to cleanup and make safe any and all areas deemed necessary by the Engineer.

1.02 RELATED WORK:

A. Section 00700 GENERAL CONDITIONS

B. Section 01110 CONTROL OF WORK AND MATERIALS

C. Section 01140 SPECIAL PROVISIONS

D. Section 01570 ENVIRONMENTAL PROTECTION

PART 2 - PRODUCTS

Not applicable

PART 3 - EXECUTION

3.01 DAILY CLEANUP:

A. The Contractor shall clean up, at least daily, all refuse, rubbish, scrap and surplus material, debris and unneeded construction equipment resulting from the construction operations and sweep the area. The site of the work and the adjacent areas affected thereby shall at all times present a neat, orderly and workmanlike appearance.

B. Upon written notification by the Engineer, the Contractor shall within 24 hours clean up those areas, which in the Engineer's opinion are in violation of this section and the above referenced sections of the specifications.

C. If in the opinion of the Engineer, the referenced areas are not satisfactorily cleaned up, all other work on the project shall stop until the cleanup is satisfactory.

3.02 MATERIAL OR DEBRIS IN DRAINAGE FACILITIES:

A. Where material or debris has washed or flowed into or has been placed in existing watercourses, ditches, gutters, drains, pipes, structures, such material or debris shall be

entirely removed and satisfactorily disposed of during progress of the work, and the ditches, channels, drains, pipes, structures, and work shall, upon completion of the work, be left in a clean and neat condition.

3.03 REMOVAL OF TEMPORARY BUILDINGS, STRUCTURES AND EQUIPMENT:

A. On or before completion of the work, the Contractor shall, unless otherwise specifically required or permitted in writing, tear down and remove all temporary buildings and structures it built; shall remove all temporary works, tools and machinery or other construction equipment it furnished; shall remove all rubbish from any grounds which it has occupied; shall remove silt fences and hay bales used for trapping sediment; and shall leave the roads and all parts of the property and adjacent property affected by its operations in a neat and satisfactory condition.

3.04 RESTORATION OF DAMAGED PROPERTY:

A. The Contractor shall restore or replace, when and as required, any property damaged by its work, equipment or employees, to a condition at least equal to that existing immediately prior to the beginning of operations. To this end the Contractor shall do as required all necessary highway or driveway, walk and landscaping work. Materials, equipment, and methods for such restoration shall be as approved by the Engineer.

3.05 FINAL CLEANUP:

A. Before acceptance by the Owner, the Contractor shall perform a final cleanup to bring the construction site to its original or specified condition. This cleanup shall include removing all trash and debris off of the premises. Before acceptance, the Engineer shall approve the condition of the site.

END OF SECTION

\\Wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\NOI Boxborough\Appendix E Specs\SECTION 01740-Cleaning Up.docx

Appendix F
Abutter Information

AFFIDAVIT OF SERVICE

Under the Massachusetts Wetlands Protection Act

I, Alexandra Gaspar, hereby certify under the Pains and Penalties of Perjury that on October 31, 2023 I gave notification to abutters in compliance with the second paragraph of Massachusetts General Laws, Chapter 131, Section 40, and the DEP Guide to Abutter Notification dated, April 8, 1994, in connection with the following matter:

> A Notice of Intent has been filed under the Massachusetts Wetlands Protection Act by the Littleton Electric Light & Water Company with the Littleton Conservation Commission on October 31, 2023 for property located at multiple streets in Littleton (Whitcomb Avenue and Taylor Street).

The completed notification and a list of the abutters to whom it was given and their addresses, are attached to this Affidavit of Service.

October 31, 2023

Name: Alexandra Gaspar DATE
Title: Environmental Scientist III
Organization: Weston & Sampson Engineers, Inc

NOTIFICATION TO ABUTTERS

Modified for Covid-19 Emergency Response

Notice of Intent or abbreviated Notice of Resource Area Delineation

Under MA Wetlands Protection Act and Littleton Wetlands Protection ByLaw (Chapter 171), this form must be completed and mailed, certified mail return receipt requested, to all abutters at their mailing addresses shown on the most recent Town Assessor's records as well as the owner (if not applicant).

In accordance with the MA Wetlands Protection Act and Littleton Wetlands Protection ByLaw Chapter 171-2D, you are hearby notified of a public hearing on the matter described below:

A. The applicant has filed a Notice of Intent with the Littleton Conservation Commission for work in an area subject to protection under the Massachusetts Wetlands Protection Act and Littleton Wetlands Protection ByLaw.

B. The name of the applicant is Littleton Electric Light & Water Department

C. The address of the land where the activity is proposed is multiple streets (Whitcomb Avenue & Taylor Street)

D. The work proposed is Construction and connection of a new water supply well to a WTP via a raw water transmission main, construction of access road to new water supply well and construction of a finished water main from the LELWD system to bring a treated water supply to the Town of Boxborough.

E. Due to the Commonwealth and Town of Littleton's Covid-19 Emergency Response, it is anticipated that paper copies of the Notice of Intent will not be available for inspection. Copies of the Notice of Intent may be examined at the Conservation Commission webpage at https://www.littletonma.org/conservation, under "Conservation Calendar" at least 48 hours before the meeting. If you click on the day of the meeting in the Calendar, you will be lead to a link showing posted project information. If you have questions you can contact the Littleton Conservation Commission (contact information at the end of this notice).

F. Due to the Commonwealth and Town of Littleton's Covid-19 Emergency Response, it is anticipated that paper copies of the Notice of Intent will not be available for distribution. Copies of the Notice of Intent may be obtained electronically from (check one) the ____applicant or _X_ the applicant's representative by calling 978-222-2475 during the following times: gaspara@wseinc.com Mon.-Fri. 8 am - 4pm.

G. The public hearing will be held on 11/14/23 Information regarding the date and time of the public hearing may be obtained from the Littleton Conservation Commission (see contact info at the end of this notice).

H. Notice of the public hearing, including date, will be published at least five business days in advance in a paper of local circulation. The agenda, noting times will be posted at Town Hall and at https://www.littletonma.org/conservation under "Conservation Calendar" at least 48 hours in advance of the meeting. It is currently anticipated that this meeting will be held entirely remotely, pursuant to Governor Baker's March 12, 2020 Order Suspending Certain Provisions of the Open Meeting Law and Governor Baker's March 15, 2020 Order imposing strict limitations on the number of people that may gather in one place. If the meeting is held remotely, instructions for remote viewing of, and participation in, the meeting will be included in the agenda and may also be obtained from the Littleton Conservation Commission.

You may contact the Littleton Conservation Commission Coordinator (Amy Green; agreen@littletonma.org; 978-540-2428), or the Massachusetts Department of Environmental Protection/ Central Region (508-792-7650) at 8 New Bond Street, Worcester, MA 01606) for information about this application

TOWN OF LITTLETON
BOARD OF ASSESSORS
P.O. BOX 1305
LITTLETON, MA 01460
(978) 540-2410 FAX: (978) 952-2321

Date: October 25, 2023

Re: Certified List of Abutters for Planning Board (300 feet - public hearings, special permits)

Applicant: Littleton Electric Light & Water Departments Name of Firm: Weston & Sampson
Mailing Address 39 Ayer Road P.O. Box 2406, Littleton, MA

Subject Parcel Location: A section of Whitcomb Ave and Route 2, as shown on map
Subject Owner: Littleton Electric Light and Water Departments
Subject Parcel ID: N/A

M.G.L. Chapter 40A, Section 11. "In all cases where notice of a public hearing is required notice shall be given by publication in a newspaper of general circulation in the city or town once in each of two successive weeks, the first publication to be not less than fourteen days before the day of the hearing and by posting such notice in a conspicuous place in the city or town hall for a period of not less than fourteen days before the day of such hearing. In all cases where notice to individuals or specific boards or other agencies is required, notice shall be sent by mail, postage prepaid. **"Parties in interest" as used in this chapter shall mean the petitioner, abutters, owners of land directly opposite on any public or private street or way, and abutters to the abutters within three hundred feet of the property line of the petitioner as they appear on the most recent applicable tax list, notwithstanding that the land of any such owner is located in another city or town, the planning board of the city or town, and the planning board of every abutting city or town.** The assessors maintaining any applicable tax list shall certify to the permit granting authority or special permit granting authority the **names and addresses of parties in interest and such certification shall be conclusive for all purposes.** The permit granting authority or special permit granting authority may accept a waiver of notice from or an affidavit of actual notice to any party in interest or, in his stead, any successor owner of record who may not have received a notice by mail, and may order special notice to any such person, giving not less than five nor more than ten additional days to reply." .....

I hereby certify the attached list of abutter(s) as stated in the M.G.L. Chapter 40A, Section 11.

Number of Abutter(s) **140** including the subject parcels + **1** Applicant Requesting Abutter's List.

Certified by:

Hanna Axon, Office Assistant

153 TAYLOR ST — R10 14 0
LUC: 930
LITTLETON WATER DEPARTMENT
39 AYER RD
LITTLETON, MA 01460

151 TAYLOR ST — R10 14 1
LUC: 401
LML LITTLETON LLC
401 EDGEWATER PLACE, SUITE 265
WAKEFIELD, MA 01880

1 MONARCH DR — R10 16 0
LUC: 402
CDK REALTY VENTURE ONE LLC
410 BOSTON POST RD STE 28
SUDBURY, MA 01776-3034

2 MONARCH DR — R10 16 A
LUC: 440
VMD INDUSTRIAL V LLC
733 TURNPIKE ST, ROUTE 114
NORTH ANDOVER, MA 01845

MONARCH DR — R10 16 B
LUC: 440
VMD INDUSTRIAL V LLC
733 TURNPIKE ST, ROUTE 114
NORTH ANDOVER, MA 01845

200 TAYLOR ST — R10 18 0
LUC: 410
FLETCHER JOHN L /JAMES L TR
FLETCHER TRUST NO 1
192 DEPOT RD
PO BOX 401
EAST TEMPLETON, MA 01438-0401

150 TAYLOR ST — R11 30 0
LUC: 950
NEW ENGLAND FORESTRY FNDTN INC
PO BOX 1346
LITTLETON, MA 01460

15 PORTER RD — R12 11 0
LUC: 101
BENOIT BENJAMIN K
BENOIT ROBIN M
15 PORTER RD
LITTLETON, MA 01460

12 PORTER RD — R12 12 0
LUC: 101
KIM BU SUK
KIM SOON HYUN
12 PORTER RD
LITTLETON, MA 01460

8 PORTER RD — R12 13 0
LUC: 101
MAGNANI CHRISTINA J
8 PORTER RD
LITTLETON, MA 01460

116 WHITCOMB AV — R12 14 0
LUC: 101
COREY ELLIS M
CHRISTOPHERSEN MONIQUE S
116 WHITCOMB AV
LITTLETON, MA 01460

120 WHITCOMB AV — R12 15 0
LUC: 101
NICHOLLS DOUGLAS E TRUSTEE
120 WHITCOMB AVE REALTY TRUST
120 WHITCOMB AV
LITTLETON, MA 01460

124 WHITCOMB AV — R12 16 0
LUC: 101
MCCOWN ROBERT
DIVOLL MARTHA
124 WHITCOMB AVE
LITTLETON, MA 01460

128 WHITCOMB AV — R12 17 0
LUC: 101
LIGHT BRANDON
LIGHT AMANDA SHELLEY
128 WHITCOMB AV
LITTLETON, MA 01460

130 WHITCOMB AV — R12 18 0
LUC: 101
NIKODEMUS MERLIN
NIKODEMUS TATIANA
130 WHITCOMB AVE
LITTLETON, MA 01460

134 WHITCOMB AV — R12 18 1
LUC: 101
ANDERSON KARL R
ANDERSON JANET
134 WHITCOMB AV
LITTLETON, MA 01460

WHITCOMB AV — R12 18 2
LUC: 130
PETER ANDERSON INVESTMENT TRST
TRUSTEE ANDERSON PETER O
15 DIANNE RD
MEDFORD, MA 02155

142 WHITCOMB AV — R12 19 0
LUC: 101
MEJIA EDITA
MEJIA EDWIN A
142 WHITCOMB AV
LITTLETON, MA 01460

141 WHITCOMB AV — R12 20 0
LUC: 101
MORGAN WAYNE L
MORGAN DIANE L
141 WHITCOMB AV
LITTLETON, MA 01460

139 WHITCOMB AV — R12 20 1
LUC: 101
HALLOCK ALEXANDER
PLOWS FIONA
139 WHITCOMB AV
LITTLETON, MA 01460

151 WHITCOMB AV — R12 20 6
LUC: 016
GASSIRARO MICHAEL
GASSIRARO JENNIFER
151 WHITCOMB AVE
LITTLETON, MA 01460

145 WHITCOMB AV — R12 20 A
LUC: 101
DOYLE JOHN C
DOYLE ANN M
145 WHITCOMB AV
LITTLETON, MA 01460

137 WHITCOMB AV — R12 21 0
LUC: 104
GUO HONG
WANG HONGJU
137 WHITCOMB AV
LITTLETON, MA 01460

133 WHITCOMB AV — R12 22 0
LUC: 101
LANZA KURT J
P.O. BOX 2178
LITTLETON, MA 01460

129 WHITCOMB AV — R12 23 0
LUC: 101
MASCARLI LLC
171 NEWTOWN RD
ACTON, MA 01720

125 WHITCOMB AV — R12 24 0
LUC: 101
KHARKWAL HIMANSHU
SHARMA SHALU
125 WHITCOMB AV
LITTLETON, MA 01460

110 WHITCOMB AV — R12 25 0
LUC: 101
CAHILL THOMAS JOSEPH IV
COLBY JENNIFER ANITA
110 WHITCOMB AV
LITTLETON, MA 01460

6 PORTER RD — R12 25 2
LUC: 101
CHEMUTURI NAGENDRA
CHEMUTURI SARADA
6 PORTER RD
LITTLETON, MA 01460

4 PORTER RD — R12 25 3
LUC: 101
JACKSON DAVID A
JACKSON SYBIL C
4 PORTER RD
LITTLETON, MA 01460

108 WHITCOMB AV — R12 26 0
LUC: 101
WEISE STEVEN B
WEISE ULLA
108 WHITCOMB AV
LITTLETON, MA 01460

102 WHITCOMB AV — R12 27 0
LUC: 101
MICHAEL L CURRY DECLARATION OF
CURRY MICHAEL L, TRUSTEE
102 WHITCOMB AVE
LITTLETON, MA 01460

100 WHITCOMB AV — R12 28 0
LUC: 101
ROURKE CRAIG E
ROURKE CLIO V
100 WHITCOMB AV
LITTLETON, MA 01460

SANDERSON RD — R12 29 0
LUC: 713
OAK HILL ROAD TRUST
SANDERSON G&E,ANDERSEN M TRS
C/O D SANDERSON - 4 OAK HILL RD
LITTLETON, MA 01460

1 ALLEN DR — R12 30 11
LUC: 713
OAK HILL ROAD TRUST
DAVID SANDERSON REV TR OF 2018
C/O D SANDERSON - 4 OAK HILL RD
LITTLETON, MA 01460

3 ALLEN DR — R12 30 12
LUC: 713
OAK HILL ROAD TRUST
DAVID SANDERSON REV TR OF 2018
C/O D SANDERSON - 4 OAK HILL RD
LITTLETON, MA 01460

5 ALLEN DR — R12 30 13
LUC: 713
OAK HILL ROAD TRUST
DAVID SANDERSON REV TR OF 2018
C/O D SANDERSON - 4 OAK HILL RD
LITTLETON, MA 01460

85 WHITCOMB AV — R12 30 14
LUC: 101
BENDER EDWARD A
BENDER EMILY Z
85 WHITCOMB AVE
LITTLETON, MA 01460

SANDERSON RD — R12 31 0
LUC: 713
OAK HILL ROAD TRUST
SANDERSON G&E, ANDERSEN M TRS
C/O D SANDERSON - 4 OAK HILL RD
LITTLETON, MA 01460

OAK HILL RD — R12 33 0
LUC: 932
LITTLETON TOWN OF
CONSERVATION COMM
P.O. BOX 1305
LITTLETON, MA 01460

117 WHITCOMB AV — R12 33 1
LUC: 101
117 WHITCOMB AV NOM. REALTY TR
TRUSTEE TESZ GREGORY J
117 WHITCOMB AVE
LITTLETON, MA 01460

5 EDWARD DR — R12 33 14
LUC: 101
PARIKH MANTHAN
SHAH NISHA
5 EDWARD DR
LITTLETON, MA 01460

3 EDWARD DR — R12 33 15
LUC: 101
3 EDWARD DRIVE REALTY TR
GULLA DAVID R & WENDY L TRS
3 EDWARD DR
LITTLETON, MA 01460

1 EDWARD DR — R12 33 16
LUC: 101
SHAH URMIL
SHAH NILU
1 EDWARD DR
LITTLETON, MA 01460

26 EDWARD DR — R12 33 17
LUC: 101
MARCOTTE JONATHAN P
MARCOTTE COREY M
26 EDWARD DR
LITTLETON, MA 01460

95 WHITCOMB AV — R12 33 2
LUC: 101
CREED WILLIAM F
CREED CATHERINE E
95 WHITCOMB AVE
LITTLETON, MA 01460

2 EDWARD DR — R12 33 23
LUC: 101
LAGE GUSTAVO
2 EDWARD DR
LITTLETON, MA 01460

27 EDWARD DR — R12 33 3
LUC: 101
ALDEN NICHOLAS PRESTON
RAY SARBAJITA
27 EDWARD DR
LITTLETON, MA 01460

123 WHITCOMB AV — R12 34 1
LUC: 101
NEDS WAY TRUST
PAGACIK IVAN G - TRUSTEE
123 WHITCOMB AV
LITTLETON, MA 01460

3 OLD ORCHARD LN — R12 34 10
LUC: 101
MCGUIRE DENNIS F FAMILY TRUST
MCGUIRE PATRICIA F FAMILY TRST
3 OLD ORCHARD LN
LITTLETON, MA 01460

1 OLD ORCHARD LN — R12 34 11
LUC: 101
PUDASAINI ANUBHAB
PUDASAINI PRIYA BADWAIK
1 OLD ORCHARD LANE
LITTLETON, MA 01460

121 WHITCOMB AV — R12 34 2
LUC: 101
BLAIR KENNETH E
DEREMIAN ROSE V
121 WHITCOMB AV
LITTLETON, MA 01460

119 WHITCOMB AV — R12 34 3
LUC: 101
PETERSON CORNELIUS IX
PETERSON PAMELA J
119 WHITCOMB AVENUE
LITTLETON, MA 01460

2 OLD ORCHARD LN — R12 34 4
LUC: 101
APPLETON JOHN C
APPLETON ANN L
2 OLD ORCHARD LN
LITTLETON, MA 01460

4 OLD ORCHARD LN — R12 34 5
LUC: 101
CLEARY DONALD E
CLEARY JEAN E L
4 OLD ORCHARD LANE
LITTLETON, MA 01460

59 PORTER RD — R12 4 0
LUC: 404
SPOUND DEVELOPMENT ASSCS LLC
238 LITTLETON RD - SUITE 203
WESTFORD, MA 01886

25 PORTER RD — R12 8 0
LUC: 402
HANSCOM FEDERAL CREDIT UNION
ATTN: KIMBERLY HOULE
25 PORTER RD
LITTLETON, MA 01460

PORTER RD — R12 8 A
LUC: 950
LITTLETON CONSERVATION TRUST
P O BOX 594
LITTLETON, MA 01460

221 WHITCOMB AV — R13 10 0
LUC: 101
FARNSWORTH WILLIAM S + NANCY C
TRS OF FARNSWORTH FAMILY TRUST
221 WHITCOMB AV
LITTLETON, MA 01460

219 WHITCOMB AV — R13 10 A
LUC: 101
RECCO MARK P TRUSTEE
RECCO ELISSA E TRUSTEE
219 WHITCOMB AVENUE
LITTLETON, MA 01460

215 WHITCOMB AV — R13 10 B
LUC: 101
FOLEY KATHLEEN ANN
10 SARAH DOUBLET ROAD
LITTLETON, MA 01460

211 WHITCOMB AV R13 10 C
LUC: 101

CORMIER JEROME
CORMIER CHERYL
211 WHITCOMB AVENUE
LITTLETON, MA 01460

0 WHITCOMB AV R13 10 D
LUC: 132

CORMIER JEROME
CORMIER CHERYL
211 WHITCOMB AVENUE
LITTLETON, MA 01460

0 WHITCOMB AV R13 10 E
LUC: 132

FOLEY KATHLEEN ANN
10 SARAH DOUBLET ROAD
LITTLETON, MA 01460

OFF WHITCOMB AV R13 13 0
LUC: 601

HARVARD SPORTSMENS CLUB INC
P.O. BOX 114
HARVARD, MA 01451

161 WHITCOMB AV R13 2 0
LUC: 101

ELLIS J SCOTT
ELLIS BETH ANN
161 WHITCOMB AVE
LITTLETON, MA 01460

3 NANCY`S WY R13 2 2
LUC: 101

SWEENEY JOHN J
SWEENEY JODI C
3 NANCY`S WAY
LITTLETON, MA 01460

8 NANCY`S WY R13 2 4
LUC: 101

O`CONNELL JAMES
O'CONNELL MARIE
8 NANCY`S WY
LITTLETON, MA 01460

4 NANCY`S WY R13 2 6
LUC: 101

SHUPE ALAN MICHAEL
SHUPE JENNY WANG-YUANZHEN
4 NANCY`S WAY
LITTLETON, MA 01460

155 WHITCOMB AV R13 2 A
LUC: 101

ARIZA MIGUEL
MEE WON
155 WHITCOMB AVE
LITTLETON, MA 01460

169 WHITCOMB AV R13 2 C
LUC: 101

MURRAY DAVID L
MURRAY SANDRA L
169 WHITCOMB AV
LITTLETON, MA 01460

171 WHITCOMB AV R13 2 D
LUC: 101

TAFT JAMES M
TAFT HEATHER N
171 WHITCOMB AV
LITTLETON, MA 01460

173 WHITCOMB AV R13 2 E
LUC: 101

DOHERTY ANDREW JOSEPH
DOHERTY RENEE MARIE
173 WHITCOMB AV
LITTLETON, MA 01460

175 WHITCOMB AV R13 2 F
LUC: 101

PERRY SAM
PERRY RACHAEL D
175 WHITCOMB AV
LITTLETON, MA 01460

177 WHITCOMB AV R13 2 G
LUC: 101

WHITCOMB AVE 2021 REALTY TRUST
TRUSTEE O`CONNELL KEVIN D
177 WHITCOMB AVE
LITTLETON, MA 01460

11 MOORE LN R13 2 H
LUC: 101

HASTINGS BENJAMIN W
HASTINGS ALLISON R
11 MOORE LN
LITTLETON, MA 01460

172 WHITCOMB AV R13 3 1
LUC: 101

COTNAM DALE R
COTNAM SUSAN M
172 WHITCOMB AVE
LITTLETON, MA 01460

154 WHITCOMB AV R13 3 10
LUC: 101

BURACZYNSKI PAUL D
BURACZYNSKI CYNTHIA R
154 WHITCOMB AVENUE
LITTLETON, MA 01460

152 WHITCOMB AV R13 3 11
LUC: 101

DOUCETTE TED P
DOUCETTE LAURA L
152 WHITCOMB AVENUE
LITTLETON, MA 01460

150 WHITCOMB AV R13 3 12
LUC: 101

LEONARD MARK D
LEONARD VIRGINIA B
150 WHITCOMB AV
LITTLETON, MA 01460

148 WHITCOMB AV R13 3 13
LUC: 101

FISKE BARTON C
FISKE SUZANNE E
148 WHITCOMB AVENUE
LITTLETON, MA 01460

146 WHITCOMB AV R13 3 14
LUC: 101

HEVENOR KEITH
HEVENOR KRISTINA
146 WHITCOMB AVENUE
LITTLETON, MA 01460

OFF WHITCOMB AV R13 3 15
LUC: 930

LITTLETON TOWN OF
P O BOX 1305
LITTLETON, MA 01460

170 WHITCOMB AV R13 3 2
LUC: 101

SUSAN C RUSCAK INVESTMENT TRST
TRUSTEE RUSCAK SUSAN C
170 WHITCOMB AVENUE
LITTLETON, MA 01460

168 WHITCOMB AV R13 3 3
LUC: 101

GALLAGHER JOSEPH R
GALLAGHER JUDITH R W
168 WHITCOMB AVENUE
LITTLETON, MA 01460

166 WHITCOMB AV R13 3 4
LUC: 101

CURRY ROBERT
CURRY LISA A
166 WHITCOMB AVENUE
LITTLETON, MA 01460

164 WHITCOMB AV R13 3 5
LUC: 101

VENUTI FAMILY TRUST
TRUSTEES VENUTI STEVEN & MARY
164 WHITCOMB AVENUE
LITTLETON, MA 01460

162 WHITCOMB AV R13 3 6
LUC: 101

AUSTIN GARY E
AUSTIN LAURIE J
162 WHITCOMB AVE
LITTLETON, MA 01460

160 WHITCOMB AV R13 3 7
LUC: 101

MEEHAN BRENDAN P
MEEHAN LINDSAY C
160 WHITCOMB AVE
LITTLETON, MA 01460

158 WHITCOMB AV R13 3 8
LUC: 101

MURRAY STUART S
MURRAY CHRISTINA F
158 WHITCOMB AVE
LITTLETON, MA 01460

156 WHITCOMB AV R13 3 9
LUC: 101

WHITE KEITH J
WHITE KATHLEEN MARIE
156 WHITCOMB AVENUE
LITTLETON, MA 01460

181 WHITCOMB AV R13 4 1
LUC: 101

GAIBL MARTHA A
GAIBL KARL A
181 WHITCOMB AV
LITTLETON, MA 01460

8 MOORE LN R13 4 2
LUC: 101

FARACI CHARLES J+HARDY-FARACI
CHERYL L TRS OF FARACI INVT TR
8 MOORE LN
LITTLETON, MA 01460

12 MOORE LN R13 4 3
LUC: 101

GAFFNEY JOSEPH F
GAFFNEY GERINA A
12 MOORE LN
LITTLETON, MA 01460

WHITCOMB AV R13 5 0
LUC: 950

SUDBURY VALLEY TRUSTEES INC
18 WOLBACH RD
SUDBURY, MA 01776

WHITCOMB AV R13 5 1
LUC: 132

WALSH JESSE
WALSH KAEDRA
11 COLOMBIA ST
GLOUCESTER, MA 01930

OFF WHITCOMB AV R13 5 A
LUC: 950

LITTLETON CONSERVATION TRUST
P O BOX 594
LITTLETON, MA 01460

WHITCOMB AV R13 6 0
LUC: 950

SUDBURY VALLEY TRUSTEES INC
18 WOLBACH RD
SUDBURY, MA 01776

189 WHITCOMB AV R13 6 1
LUC: 101

WALSH JESSE
WALSH KAEDRA
11 COLOMBIA ST
GLOUCESTER, MA 01930

WHITCOMB AV R13 7 0
LUC: 950

SUDBURY VALLEY TRUSTEES INC
18 WOLBACH RD
SUDBURY, MA 01776

WHITCOMB AV R13 7 1
LUC: 106

SCHRAMM MARTIN
120 HAYDEN ROWE ST
HOPKINTON, MA 01748

OFF WHITCOMB AV R13 7 A
LUC: 950

LITTLETON CONSERVATION TRUST
PO BOX 594
LITTLETON, MA 01460

199 WHITCOMB AV R13 8 0
LUC: 950

SUDBURY VALLEY TRUSTEES INC
18 WOLBACH RD
SUDBURY, MA 01776

WHITCOMB AV R13 9 0
LUC: 130

DUFOUR LORRAINE
C/O KRISTEN FERRANTE
200 WHITCOMB AVE
LITTLETON, MA 01460

210 WHITCOMB AV R13 9 1
LUC: 101

FERRANTE KRISTEN
REARDON KIMBERLY
200 WHITCOMB AVE
LITTLETON, MA 01460

200 WHITCOMB AV R13 9 2
LUC: 101

FERRANTE CARLO H
FERRANTE KRISTEN M
200 WHITCOMB AV
LITTLETON, MA 01460

76 WHITCOMB AV U40 14 0
LUC: 971

LITTLETON TOWN OF
ELECTRIC + WATER DEPT
PO BOX 1305
LITTLETON, MA 01460

74 WHITCOMB AV U40 15 0
LUC: 930

LITTLETON TOWN OF
HIGHWAY DEPT
PO BOX 1305
LITTLETON, MA 01460

78 WHITCOMB AV U40 16 0
LUC: 101

GOGUEN WAYNE R
GOGUEN CATHY L
78 WHITCOMB AVE
LITTLETON, MA 01460

82 WHITCOMB AV U40 16 1
LUC: 101

BEAUDET STEPHEN P
BEAUDET BONNIE
82 WHITCOMB AV
LITTLETON, MA 01460

86 WHITCOMB AV U40 17 0
LUC: 101

ALEXANDER MARK A
86 WHITCOMB AV
LITTLETON, MA 01460

92 WHITCOMB AV U40 18 0
LUC: 101

TIERNEY KELLY BRYNN
BARTKUS THEODORE O
92 WHITCOMB AV
LITTLETON, MA 01460

90 WHITCOMB AV U40 18 A
LUC: 101

THE DJM TRUST
TRUSTEE MURPHY DANIEL J
90 WHITCOMB AVE
LITTLETON, MA 01460

93 WHITCOMB AV U40 19 0
LUC: 101

GALLAGAN ERIN
GUDELSKI JONATHAN
93 WHITCOMB AVE
LITTLETON, MA 01460

89 WHITCOMB AV U40 20 0
LUC: 101

FEMINO TRUST
FEMINO PAUL J
17 BLANCHARD RD
HARVARD, MA 01451

83 SANDERSON RD U40 21 0
LUC: 101

ZIMMERMAN JR ROBERT L
ZIMMERMAN KATHLEEN DEMPSEY
83 SANDERSON RD
LITTLETON, MA 01460

60 SANDERSON RD U40 22 0
LUC: 101

DOUGLAS DIANE M
60 SANDERSON RD
LITTLETON, MA 01460

WHITCOMB AV U40 23 0
LUC: 132

OAK HILL ROAD TRUST
DAVID SANDERSON REV TR OF 2018
C/O D SANDERSON - 4 OAK HILL RD
LITTLETON, MA 01460

57 WHITCOMB AV U40 24 0
LUC: 101

O`GRADY JOSHUA PATRICK
WILLIAMS EMMA ELIZABETH
57 WHITCOMB AV
LITTLETON, MA 01460

53 WHITCOMB AV U40 24 A
LUC: 959

BRIDGEWELL INC
10 DEARBORN RD
PEABODY, MA 01960

WHITCOMB AV U40 25 0
LUC: 132

OAK HILL ROAD TRUST
SANDERSON G&E, ANDERSEN M TRS
C/O DSANDERSON - 4 OAK HILL RD
LITTLETON, MA 01460

35 HARWOOD AV U41 21 0
LUC: 101
QUINN FAMILY IRREVOCABLE TRUST
QUINN R J &GOULD S R - TRS
PO BOX 2006
LITTLETON, MA 01460

HARWOOD AV U41 21 1
LUC: 132
QUINN FAMILY IRREVOCABLE TRUST
QUINN R J & GOULD S R - TRS
PO BOX 2006
LITTLETON, MA 01460

29 HARWOOD AV U41 22 0
LUC: 101
CAIL RICHARD P
CAIL ELISABETH SHERMAN
29 HARWOOD AVE
LITTLETON, MA 01460

1 HARWOOD AV U41 23 0
LUC: 901
BOSTON & MAINE RAILROAD
C/O GUILFORD TRANSPORTATION
IRON HORSE PARK
67 HIGH ST
NO BILLERICA, MA 01862

2 TAYLOR ST U41 24 0
LUC: 325
ERICKSON DAVID R
P.O. BOX 2275/2 TAYLOR ST
LITTLETON, MA 01460

TAYLOR ST U41 25 1
LUC: 441
ERICKSON DAVID TRUSTEE OF
DEPOT REALTY TRUST
P.O. BOX 2275
LITTLETON, MA 01460

20 TAYLOR ST U41 25 2
LUC: 340
TAYLOR STREET TRUST
DUHIGG M & KIRKLAND D-TRS
20 TAYLOR ST
LITTLETON, MA 01460

30 TAYLOR ST U41 26 0
LUC: 316
AMAC HOLDINGS LLC
53 MIDLAND DRIVE
WALTHAM, MA 02451-1329

47 TAYLOR ST U41 32 0
LUC: 101
BARKOVIC JAMES R AND
DOLL RHONDA F
47 TAYLOR ST
LITTLETON, MA 01460

6 WHITCOMB AV U41 33 0
LUC: 101
MAGURN FRANCIS B II
COLEMAN JOANNE R
6 WHITCOMB AV
LITTLETON, MA 01460

8 WHITCOMB AV U41 34 0
LUC: 101
OTTO ROBERT
PO BOX 2758
ACTON, MA 01720-6758

WHITCOMB AV U41 35 0
LUC: 974
LITTLETON TOWN OF
WATER DEPARTMENT
PO BOX 1305
LITTLETON, MA 01460

WHITCOMB AV U41 36 0
LUC: 974
LITTLETON TOWN OF
WATER DEPARTMENT
PO BOX 1305
LITTLETON, MA 01460

WHITCOMB AV U41 37 0
LUC: 930
LITTLETON TOWN OF
P.O. BOX 1305
LITTLETON, MA 01460

15 WHITCOMB AV U41 38 0
LUC: 974
LITTLETON TOWN OF
WATER DEPARTMENT
PO BOX 1305
LITTLETON, MA 01460

21 TAYLOR ST U41 39 0
LUC: 954
LITTLETON VFW POST #6556 INC
21 TAYLOR ST
LITTLETON, MA 01460

17 19 TAYLOR ST U41 40 0
LUC: 031
KC TAYLOR STREET LLC
19 TAYLOR ST
LITTLETON, MA 01460

11 15 TAYLOR ST U41 41 0
LUC: 104
MULBERRY FUND LLC
PO BOX 21
EAST WINDSOR HILL, CT 06028

12 HARWOOD AV U41 48 0
LUC: 101
DOUGLAS ELLEN
A/K/A ARAUJO ELLEN
12 HARWOOD AV
LITTLETON, MA 01460

18 HARWOOD AV U41 49 0
LUC: 101
LAWRENCE ANN
LAWRENCE PHILIP A
P.O. BOX 2314
LITTLETON, MA 01460

Path: \\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\NOI Littleton\Appendix D maps\Locus - new source raw main only.mxd User: Foulds, Jordan Saved: 9/14/2023 9:33:07 AM Opened: 9/14/2023 9:33:17 AM

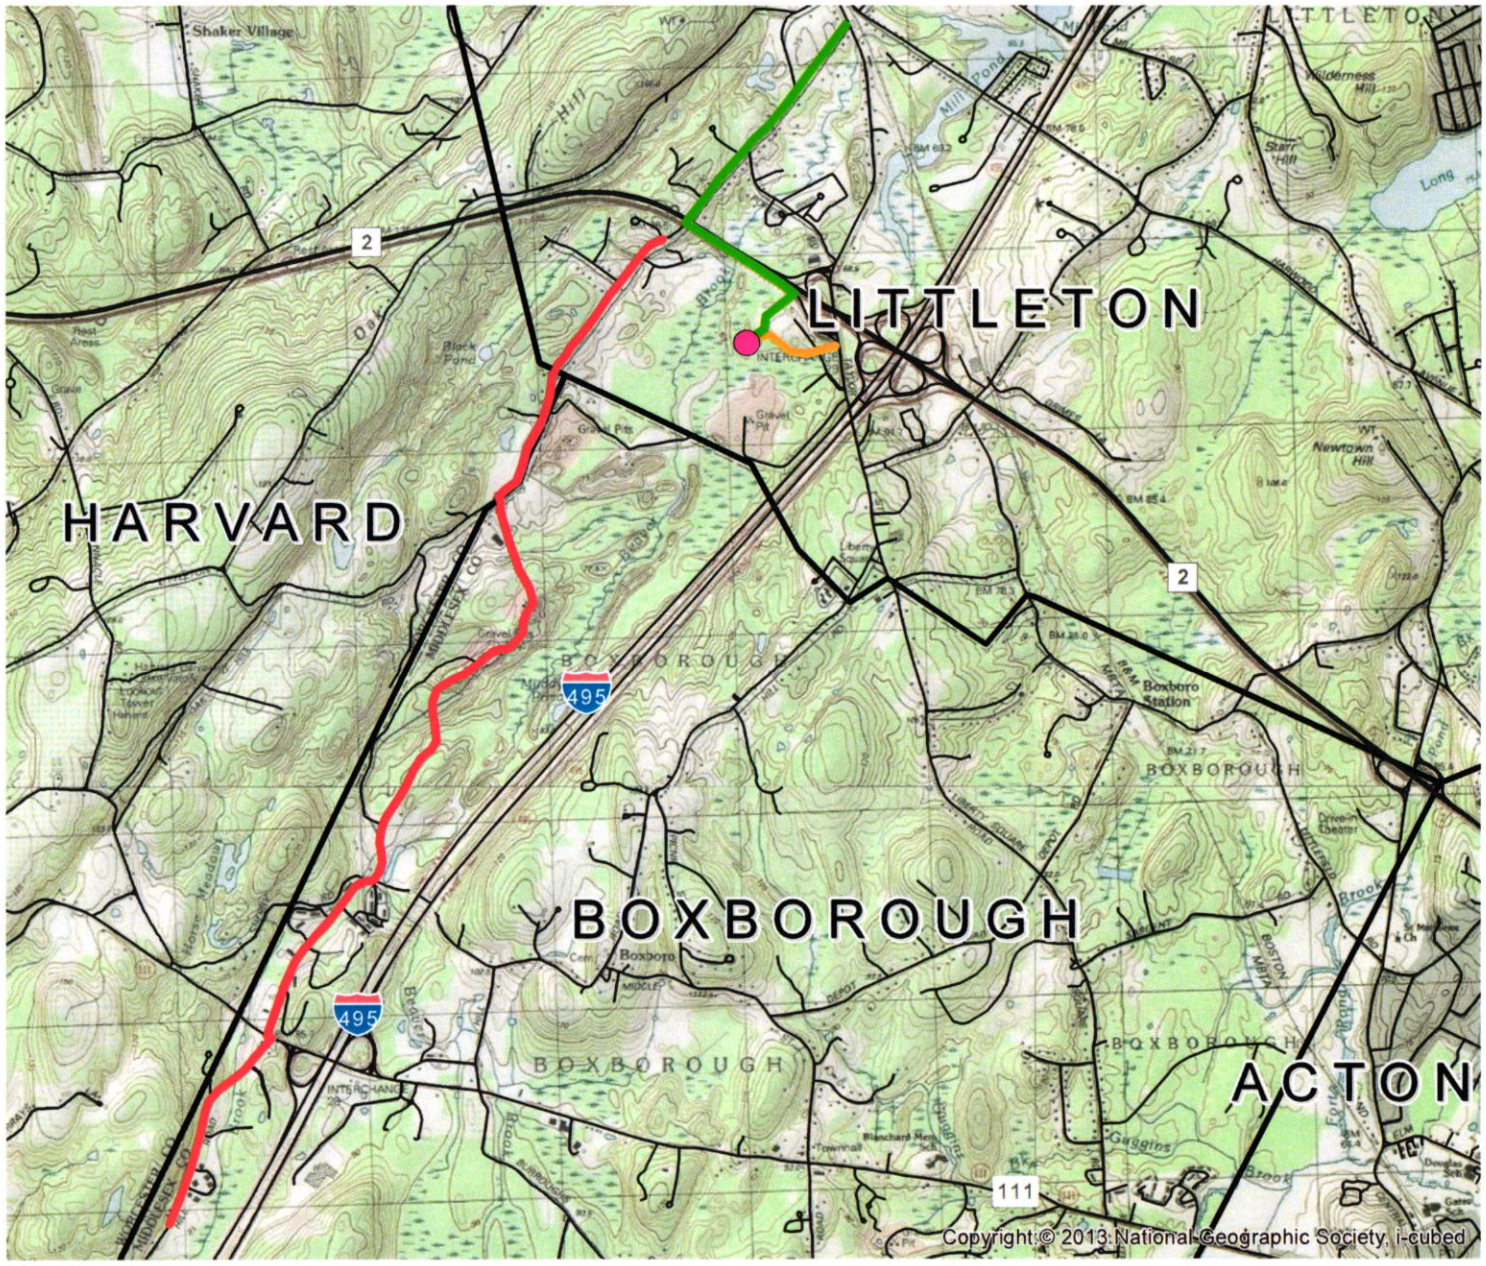

N
W E
S
6,000 3,000 0 6,000
Feet

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Well Site
- Finish Extension
- Raw Extension
- Access Road

FIGURE 1

New Source and Raw Water Main
Finished Water Ext.

Littleton & Boxborough, MA

Weston & Sampson

Appendix G
Wetlands Delineation Memo

Weston & Sampson

westonandsampson.com

55 Walkers Brook Drive, Suite 100
Reading, MA 01867
tel: 978.532.1900

Wetland Delineation Report

August 2023

Littleton, Harvard, & Boxborough
Massachusetts
Project # ENG22-0411

New Source Approval & New Water Supply
Littleton, Harvard, & Boxborough, MA

Wetland Delineation Conducted By:
Devin Herrick, CWS, & Hailey Page on 12/5/22, 12/6/22, 12/21/22, 1/5/23, 1/18/23, & 8/17/23.

Delineation Report Reviewed By:
Mel Higgins, PWS

TABLE OF CONTENTS

Page

1.0 SITE DESCRIPTION....1-1

2.0 DELINEATION OF WETLAND RESOURCES....2-1
2.1 Site Observations....2-1
2.2 Wetland Delineation Methodology....2-1
2.3 Bordering Vegetated Wetlands (BVW)....2-2
2.4 Isolated Vegetated Wetland (IW)....2-4
2.5 Bank....2-6
2.6 Other Protected Areas....2-9

3.0 SUMMARY....3-1

4.0 REFERENCES....4-1

FIGURES

Figure 1....Wetlands Field Map
Figure 2....USGS Topographic Map
Figure 3....FEMA FIRM Map
Figure 4....Environmental Resources Map

APPENDICES

Appendix A ....ACOE Wetland Determination Data Forms
Appendix B ....Site Photographs

1.0 SITE DESCRIPTION

On December 5th, 6th, & 21st, 2022, January 5th & 18th, and August 17th, 2023, the presence of wetland resources was investigated starting along 53 Taylor Street in Littleton, MA and continuing along approximately 5 miles following the roadway along Whitcomb Avenue, Littleton County Road, continuing onto Beaver Brook Road, Swansea Road, and ending along Codman Hill Road. The proposed extensions fall into the towns of Littleton, Harvard, and Boxborough, MA. Please see Figure 1.0-Figure 1.6 (Wetlands Field Map) and Figure 2 (USGS Topographic Map) of this report for the investigation area.

Wetland resource areas including 32 bordering vegetated wetlands, 8 isolated vegetated wetlands, 6 perennial streams, 3 intermittent streams, and 4 ponds were identified and flagged in the field using pink flagging by a Weston & Sampson employee who is trained in the wetland delineation process using the Massachusetts Department of Environmental Protection (MassDEP) and the US Army Corps of Engineers methodology. Further descriptions of these wetland resource areas are presented in the following sections.

2.0 DELINEATION OF WETLAND RESOURCES

2.1 Site Observations

The Weston & Sampson wetland scientist, trained in the ACOE Wetland Delineation Manual and Massachusetts Department of Environmental Protection (MassDEP) Delineating Bordering Vegetated Wetlands Under the Massachusetts Wetland Protection Act guidance document, observed the following protected wetland resources at the site:

- Bordering Vegetated Wetlands (BVW)
- Isolated Vegetated Wetland (IW)
- Bank – Perennial Stream
- Bank – Intermittent Stream
- Bank – Pond

Field data were recorded on US Army Corps of Engineers (ACOE) Wetland Determination Data Forms. See Appendix A for completed data forms and Appendix B for site photographs.

2.2 Wetland Delineation Methodology

A wetland delineation assessment was conducted in accordance with the Massachusetts Wetland Protection Act Regulations (310 CMR 10.55(2)(c)), Massachusetts Department of Environmental Protection (MassDEP) Delineating Bordering Vegetated Wetlands Under the Massachusetts Protection Act (March 1995), and ACOE Wetland Manual (Technical Report Y-87-1).

The bordering vegetated wetlands (BVW) delineation methodology included the characterization of vegetation, soil and hydrologic conditions in both wetland and upland areas to identify the transitional area, which was used as the wetland limit. Pink flags with distinct flag numbers were left in the field to show wetland resource area limits.

Vegetation, hydrology and soils were assessed in both wetland and upland areas to accurately place the wetland limits at each site. The percentage of vegetative species was estimated by creating sample plots. Sample plot radius for trees, saplings, shrubs, groundcover and woody vine strata was 30', 15', 15', 5' and 30', respectively. After creating the sample plot areas, the percent basal area coverage of

each species within the monitoring plot was recorded. Using these field observations, the percent dominance of each species within its stratum was calculated. The 50/20 Rule was then used to determine dominance. Dominant species were considered the most abundant plant species (when ranked in descending order of abundance and cumulatively totaled) that immediately exceeds 50% of the total dominance measure (basal area) for the stratum, plus any additional species comprising 20% or more of the total dominance measure for the stratum. Once the dominant species were determined, they were treated equally to determine the presence of hydrophytic vegetation. If the number of dominant species with a Wetland Indicator Status of FAC (excluding FAC-), FACW or OBL is greater than, or equal to, the number of remaining dominant species, the area was considered a jurisdictional wetland resource area based on vegetation.

A soil sample from each wetland sample plot were also taken. Each soil sample goes to a depth of at least 12-24 inches. The soil was characterized to determine if the soil sample was considered a hydric (wetland) soil. Soil samples, including mottles, were characterized based on color using Munsell Soil-Color charts as a color reference.

The general area was then assessed for hydrologic conditions, including, but not limited to, site inundation, depth to free water, depth of soil saturation, water marks, drift lines, sediment deposits, water stained leaves.

2.3 Bordering Vegetated Wetlands (BVW)

Twenty-nine (29) BVW series were delineated at the site. These BVWs are located adjacent to various perennial and intermittent streams and pond resource areas. The limit of the BVW resource areas were determined by locating the transitional area between wetland and upland vegetation, soils and hydrologic conditions. Wetland flags left in the field included:

- BVW A 1 – BVW A 136 connects to BVW 1 – BVW 62 connects to BVW DD1 - BVW DD38 (BVW "A" Series)
- BVW B1 – BVW B17 (BVW "B" Series)
- BVW C1 – BVW C4 (BVW "C" Series)
- BVW D1 – BVW D 5 (BVW "D" Series)
- BVW E1 – BVW E25 (BVW "E" Series)

- BVW F1 – BVW F9 (BVW "F" Series)
- BVW G1 – BVW G6 (BVW "G" Series)
- BVW H1 – BVW H5 (BVW "H" Series)
- BVW I1 – BVW I11 (BVW "I" Series)
- BVW J1 – BVW J6 (BVW "J" Series)
- BVW K1 – BVW K 24 (BVW "K" Series)
- BVW L1 – BVW L10 (BVW "L" Series)
- BVW M1 – BVW M4 (BVW "M" Series)
- BVW N1 – BVW N25 (BVW "N" Series)
- BVW O1 – BVW O9 (BVW "O" Series)
- BVW P1 – BVW P4 (BVW "P" Series)
- BVW Q1 – BVW Q20 (BVW "Q" Series)
- BVW R1 – BVW R14 (BVW "R" Series)
- BVW S1 – BVW S4 (BVW "S" Series)
- BVWT1 – BVW T17 (BVW "T" Series)
- BVW U1 – BVW U15 (BVW "U" Series)
- BVW V1 – BVW V8 (BVW "V" Series)
- BVW W1 – BVW W8 (BVW "W" Series)
- BVW X1 – BVW X13 (BVW "X" Series)
- BVW Y1 – BVW Y13 (BVW "Y" Series)
- BVW Z1 – BVW Z6 (BVW "Z" Series)
- BVW AA1 – BVW AA8 (BVW "AA" Series)
- BVW BB1 –BVW BB8 (BVW "BB" Series)
- BVW CC1 – BVW CC18 (BVW "CC" Series)
- BVW EE1 – BVW EE18 (BVW "EE" Series)
- BVW FF1 – BVW FF5 (BVW "FF" Series)
- BVW GG1 – BVW GG14 (BVW "GG" Series)

Dominant vegetation within the wetland resource area included red maple (*Acer rubrum*), coastal sweet pepper bush (*Clethra alnifolia*), woolgrass (*Scirpus cyperinus*), button bush (*Cephalanthus occidentalis*), reed canary grass (*Phalaris arundinacea*), sensitive fern (*Onoclea sensibilis*), Bladder sedge (*Carex intumescens*), American elm (*Ulmus americana*), devil's beggerticks (*Bidens frondose*), red osier

dogwood (*Swida sericea*), highbush blueberry (*Vaccinium corymbosum*), tussock sedge (*Carex stricta*), eastern white pine (*Pinus strobus*), cinnamon fern (*Osmundastrum cinnamomeum*), skunk cabbage (*Symplocarpus foetidus*), buckthorn (*Rhamnus cathartica*), speckled alder (*Alnus incana*), intermediate woodfern (*Dryopteris intermedia*), common reed (*Phragmites australis*), cattail (*Typha*), winterberry (*Ilex verticillate*), Japanese stilt grass (*Microstegium vimineum*), purple loosestrife (*Lythrum salicaria*), and Japanese knotweed (*Fallopia japonica*) species that generally thrive in wet conditions. Soils within the BVW's were generally composed of fine sandy loam with redoximorphic features. Other indicators of wetland hydrology included surface water, highwater table and saturation.

Dominant upland vegetation in the area included red maple (*Acer rubrum*), eastern white pine (*Pinus strobus*), coastal sweet pepper bush (*Clethra alnifolia*), flat-top goldenrod (Euthamia graminifolia), multiflora rose (*Rosa multiflora*), bitternut hickory (*Carya cordiformis*), bristly dewberry (*Rubus hispidus*), oriental bittersweet (*Celastrus orbiculatus*), cleavers (*Galium aparine*), reed canary grass (*Phalaris arundinacea*), garlic mustard (*Alliaria petiolate*), American elm (*Ulmus americana*), burning bush (*Euonymus alatus*), eastern hemlock (*Tsuga canadensis*), white oak (*Quercus alba*), princess pine (*Lycopodium obscurum*), Pennsylvania sedge (*Carex pensylvanica*), intermediate woodfern (*Dryopteris intermedia*), red oak (*Quercus rubra*), *Sumac* species, river-bank grape (*Vitis riparia*), willow oak (*Quercus phellos*), buckthorn (*Rhamnus cathartica*), perennial rye grass (*Lolium perenne*), bracken fern (*Pteridium aquilinum*), poison ivy (*Toxicodendron radicans*), and Japanese knotweed (*Fallopia japonica*). Soils within the upland were generally composed of fine sandy loam with cobbles, with no evidence of mottling or hydrology within the top 12 inches.

BVWs are subject to a 100-foot buffer under the Massachusetts Wetland Protection Act per 310 CMR 10.02(2)(b). The Town of Littleton Wetland Protection Regulations places an additional 50 foot no disturbance area around BVW. It is stated in section 4.2 (2)(a) of the regulations "any area within the BVW or Bank and the first 50 feet of the Buffer Zone from BVW or Bank. No activities or work is permitted other than passive (foot or non-motorized vehicle) passage and removal of invasive vegetation if done in compliance with these Regulations".

2.4 Isolated Vegetated Wetland (IW)

Eight Isolated Vegetated Wetland (IW) series was delineated at the site. The limit of the IW resource area was determined by locating the transitional area between wetland and upland vegetation, soils and

hydrologic conditions. Vegetation, hydrology and soils were assessed in the same manner as described above for identifying BVW.

Wetland flags left in the field included:

- IW A1–IW A9 (IW "A" Series)
- IW B1–IW B6 (IW "B" Series)
- IW C1–IW C15 (IW "C" Series)
- IW D1–IW D26 (IW "D" Series)
- IW E1–IW E9 (IW "E" Series)
- IW F1–IW F7 (IW "F" Series)
- IW G1–IW G14 (IW "G" Series)
- IW H1–IW H7 (IW "H" Series)

Dominant vegetation within the IW included red maple (*Acer rubrum*), elderberry (*Sambucus*), winterberry (*Ilex verticillate*), black willow (*Salix nigra*), soft rush (Juncus effusus), Canadian goldenrod (*Solidago canadensis*), Morrow's honeysuckle (*Lonicera morrowii*), glossy buckthorn (*Frangula alnus*), sensitive fern (*Onoclea sensibilis*), multiflora rose (*Rosa multiflora*), cinnamon fern (*Osmundastrum cinnamomeum*), purple loosestrife (*Lythrum salicaria*), red oak (*Quercus rubra*), eastern white pine (*Pinus strobus*), highbush blueberry (*Vaccinium corymbosum*), and Japanese stilt grass (*Microstegium vimineum*) species commonly thrives in hydric conditions. The soils were generally composed of fine sandy loam with 2% redoximorphic features appearing 12 inches below the soil surface. Other indicators of wetland hydrology included surface water, highwater table and saturation.

The adjacent upland vegetation was dominated by red oak (*Quercus rubra*), eastern white pine (*Pinus strobus*), intermediate woodfern (*Dryopteris intermedia*), Pennsylvania sedge (*Carex pensylvanica*), gray birch (*Betula populifolia*), silky dogwood (*Cornus amomum*), sweet fern (*Comptonia peregrina*), field crown grass (*Paspalum leave*), red maple (*Acer rubrum*), eastern hemlock (*Tsuga canadensis*), poison ivy (*Toxicodendron radicans*), and white oak (*Quercus alba*). Soils were generally composed of fine sandy loam. No indicators of wetland hydrology were observed.

The Massachusetts Wetland Protection Act does not protect isolated vegetated wetlands. However, certain individual communities have chosen to extend protection to these isolated wetlands within their local bylaws, including Boxborough. Per the Boxborough Wetland Bylaws, the Boxborough Commission has jurisdiction over all projects within 100 feet of isolated wetlands. Yet the town of Littleton does not place protection over isolated wetlands.

2.5 Bank

Water bodies, including perennial streams, intermittent streams, ponds and lakes, have banks which are protected by the Massachusetts Wetland Protection Act. Bank is a wetland resource area defined by 310 CMR 10.54(2)(a) as "the portion of land surface which normally abuts and confines a water body. It occurs between a waterbody and a vegetated bordering wetland and adjacent floodplain, or, in absence of these, it occurs between a waterbody and an upland." Vegetated banks provide valuable functions such as flood control, stormwater prevention, fisheries protection, and water quality protection. The limit of this resource area is identified by Top of Bank (TOB) which is located at the first observable break in slope or the Mean Annual Flood Level (MAFL), whichever is lower. TOB is easily identified in the field so that indicator was utilized for this wetland delineation.

Perennial Stream Banks

Seven perennial streams were identified within the investigation area. The boundary of the perennial stream was identified in the field utilizing Top of Bank (TOB). These streams are shown as perennial on the current United States Geographical Survey (USGS) map and has a watershed size greater than one square mile in size according to USGS Stream Stats which classifies the stream as perennial per 310 CMR 10.58 (2)(a)(1)(b-c). The boundary of the perennial stream was identified in the field by the first observable break in slope (TOB). Wetland flags left in the field included:

- TOB A1–TOB A24 (Perennial Stream Bank "A" Series)
- TOB B1–TOB B9 (Perennial Stream Bank "B" Series)
- TOB D1– TOB D9 (Perennial Stream Bank "D" Series)
- TOB E1–TOB E5 (Perennial Stream Bank "E" Series)
- TOB F1– TOB F6 (Perennial Stream Bank "F" Series)
- TOB G1–TOB G6 (Perennial Stream Bank "G" Series)
- TOB R1 – TOB R4 (Perennial Stream Bank "R" Series)

- TOB S1 – TOB S20 (Perennial Stream Bank "S" Series)
- TOB T1– TOB T19 (Perennial Stream Bank "T" Series)

Perennial streams are subject to a 200-foot Riverfront Area under the Massachusetts Wetland Protection Act per 301 CMR 10.58(2)(a)(2)(c). The Town of Littleton Wetland Protection Regulations places an additional 50 foot no disturbance area off of banks. It is stated in section 4.2 (2)(a) "any area within the BVW or Bank and the first 50 feet of the Buffer Zone from BVW or Bank. No activities or work is permitted other than passive (foot or non-motorized vehicle) passage and removal of invasive vegetation if done in compliance with these Regulations".

Intermittent Stream Banks

Three intermittent streams were delineated on site is. The unnamed streams are shown as intermittent on the current United States Geographical Survey (USGS) map and has a watershed size less than 0.5 square miles in size according to USGS Stream Stats which classifies the stream as intermittent per 310 CMR 10.58 (2)(a)(1)(b-c). The boundary of the intermittent stream was identified in the field by the first observable break in slope (TOB). Wetland flags left in the field included:

- TOB H1 – TOB H10 (Intermittent Stream Bank "H" Series)
- TOB I1 –TOB I10 (Intermittent Stream Bank "I" Series)
- TOB M1 – TOB M8 (Intermittent Stream Bank "M" Series)
- TOB N1 -TOB N15 (Intermittent Stream Bank "N" Series)
- TOB S1-TOB S4 (Intermittent Stream Bank "S" Series)
- TOB T1 – TOB T4 (Intermittent Stream Bank "T" Series)

Intermittent stream banks are subject to a 100-foot buffer under the Massachusetts Wetland Protection Act per 301 CMR 10.02(2)(b). The Town of Littleton Wetland Protection Regulations places an additional 50 foot no disturbance area off of banks. It is stated in section 4.2 (2)(a) "any area within the BVW or Bank and the first 50 feet of the Buffer Zone from BVW or Bank. No activities or work is permitted other than passive (foot or non-motorized vehicle) passage and removal of invasive vegetation if done in compliance with these Regulations".

Pond Bank

Four un-named ponds were found along the investigation area. Due to their size, all four bodies of water were classified as ponds. According to the Massachusetts Wetland Protection Act a pond is defined as "any body of fresh water with a surface area observed or recorded within the last ten years of at least 10,000 square feet". Wetland flags left in the field included:

- TOB J1 – TOB J5 (Pond Bank "J" Series)
- TOB O1 – TOB O23 (Pond Bank "O" Series)
- TOB P1 –TOB P20 (Pond Bank "P" Series)
- TOB Q1 – TOB Q21 (Pond Bank "Q" Series)

Pond banks are subject to a 100-foot buffer under the Massachusetts Wetland Protection Act per 310 CMR 10.02(2)(b). The Town of Littleton Wetland Protection Regulations places an additional 50 foot no disturbance area off of banks. It is stated in section 4.2 (2)(a) "any area within the BVW or Bank and the first 50 feet of the Buffer Zone from BVW or Bank. No activities or work is permitted other than passive (foot or non-motorized vehicle) passage and removal of invasive vegetation if done in compliance with these Regulations".

2.6 Other Protected Areas

Weston & Sampson created environmental resources maps (see Figure 4) of the site to determine the presence of other protected areas. The data source of these map layers was the Massachusetts Geographic Information System (MassGIS). These areas included:

- NHESP Priority Habitats of Rare Species
- NHESP Estimated Habitats of Rare Wildlife
- NHESP Certified and Potential Vernal Pools (2 potential)
- Areas of Critical Environmental Concern (ACEC)
- Outstanding Resource Waters (ORW)
- Coldwater Fisheries

Wetland resources identified in the field were also added to these maps. Based on the MassGIS information, portions of the investigation area are located within a NHESP Priority Habitats of Rare Species, and NHESP Estimated Habitat of Rare Wildlife, along with two potential certified vernal pools.

FEMA Flood Insurance Rate Maps (FIRM) were created online from the FEMA website to determine if there is a 100-year flood zone at the site. See Figure 3 for FIRM map. Based on FEMA flood maps, portions of the investigation area are within the 100-year flood zone.

3.0 SUMMARY

On December 5th, 6th, & 21st, 2022, January 5th & 18th, and August 17th, 2023, the presence of wetland resources was investigated starting along 53 Taylor Street in Littleton, MA and continuing along the proposed water line extension following approximately 5 miles following the roadway along Whitcomb Avenue, Littleton County Road, continuing on Beaver Brook Road, Swansea Road, and ending along Codman Hill Road. The proposed extensions fall into the towns of Littleton, Harvard, and Boxborough, MA. 32 bordering vegetated wetlands, 8 isolated vegetated wetlands and 6 perennial streams, 3 intermittent streams, and 4 ponds were identified and flagged at site.

Additional environmental mapping was conducted using MassGIS data layers and FEMA FIRM mapping. This additional mapping indicates portions of the investigation area are located within a NHESP Priority Habitats of Rare Species, and NHESP Estimated Habitat of Rare Wildlife, along with two potential certified vernal pools, and the 100-year flood zone.

This Wetlands Delineation Report has been reviewed and approved by a Professional Wetland Scientist PWS.

4.0 REFERENCES

Jackson, Scott. 1995. "Delineating Bordering Vegetated Wetlands Under the Massachusetts Wetlands Protection Act." Massachusetts Department of Environmental Protection.

Massachusetts Division of Fisheries and Wildlife, Natural Heritage and Endangered Species Program. Massachusetts Natural Heritage Atlas, 13th Edition with 2017 web updates. Accessed on 2/6/2023.

Massachusetts Geographic Information System. January 2009. Outstanding Resource Waters. Massachusetts Department of Environmental Protection. Accessed on 2/6/2023.

Massachusetts Geographic Information System. December 2003. Areas of Critical Environmental Concern. Massachusetts Department of Environmental Protection. Accessed on 2/6/2023.

Newcomb, Lawrence. 1977. Newcomb's Wildflower Guide. Little, Brown and Company.

Web Soil Survey of Middlesex County, Massachusetts. United States Department of Agriculture, Soil Conservation Service, in cooperation with Massachusetts Agricultural Experiment Station

United States Department of Agriculture, Natural Resources Conservation Service. *2018. Field Indicators of Hydric Soils in the United States, Version 8.2.* L. M. Vasilas, G. W. Hurt, and J.F. Berkowitz (eds.). USDA, NRCS, in cooperation with the National Technical Committee for Hydric Soils.

USACOE, January 1987, Corps of Engineers Wetlands Delineation Manuel, Wetlands Research Program Technical Report Y-87-1.

FEMA Flood Map Service Center, online at msc.fema.gov/portal Assessed on 2/6/2023.
Tiner, Jr., Ralph W., 2005, Field Guide to Nontidal Wetland Identification

Tiner, Jr., Ralph W, 2009, Field Guide to Tidal Wetland Plants of the Northeastern United States and Neighboring Canada.

Wojtec, Michael, Bard – A field Guide to Trees of the Northeast.

New England Hydric Soils Technical Committee, 2019, Version 4, *Field Indicator of Identifying Hydric Soils in New England*. New England Interstate Water Pollution Control Commission, Lowell, MA.

.

Path: \\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\Wetland Delineation Report\Wetland Delineation Report\GIS\Maps\Wetland Flags Fig 1.0.mxd **User:** Page.Hailey **Saved:** 2/6/2023 10:50:54 AM **Opened:** 2/6/2023 10:51:23 AM

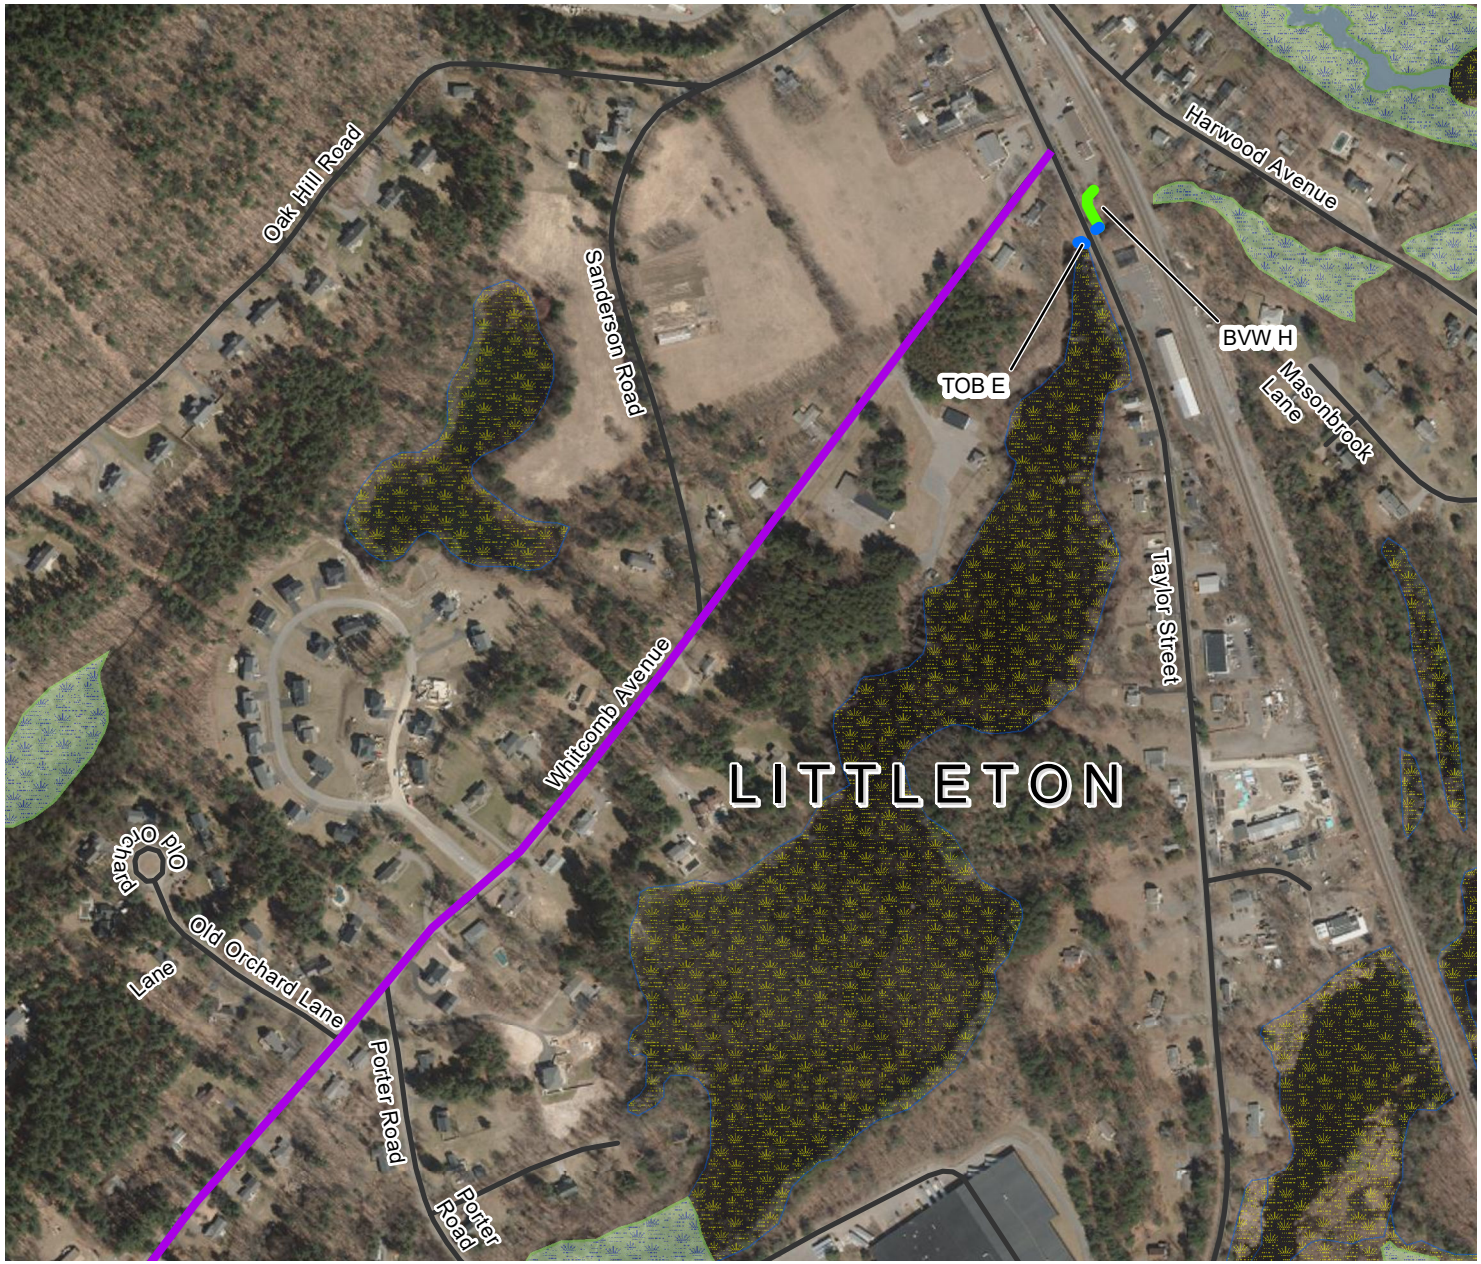

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- Bank-Pond
- Approximate Upland Island
- Bank - Intermittent Stream
- Bank -Perennial Stream
- Isolated Vegetated Wetland
- Bordering Vegetated Wetland
- MassDOT Roads
- Marsh/Bog
- Wooded marsh
- Cranberry Bog
- Salt Marsh
- Open Water
- Reservoir (with PWSID)
- Tidal Flats
- Beach/Dune
- MA Towns

FIGURE 1.0

Well and Water Main Extension
Littleton, MA

Wetlands Field Map

Weston & Sampson

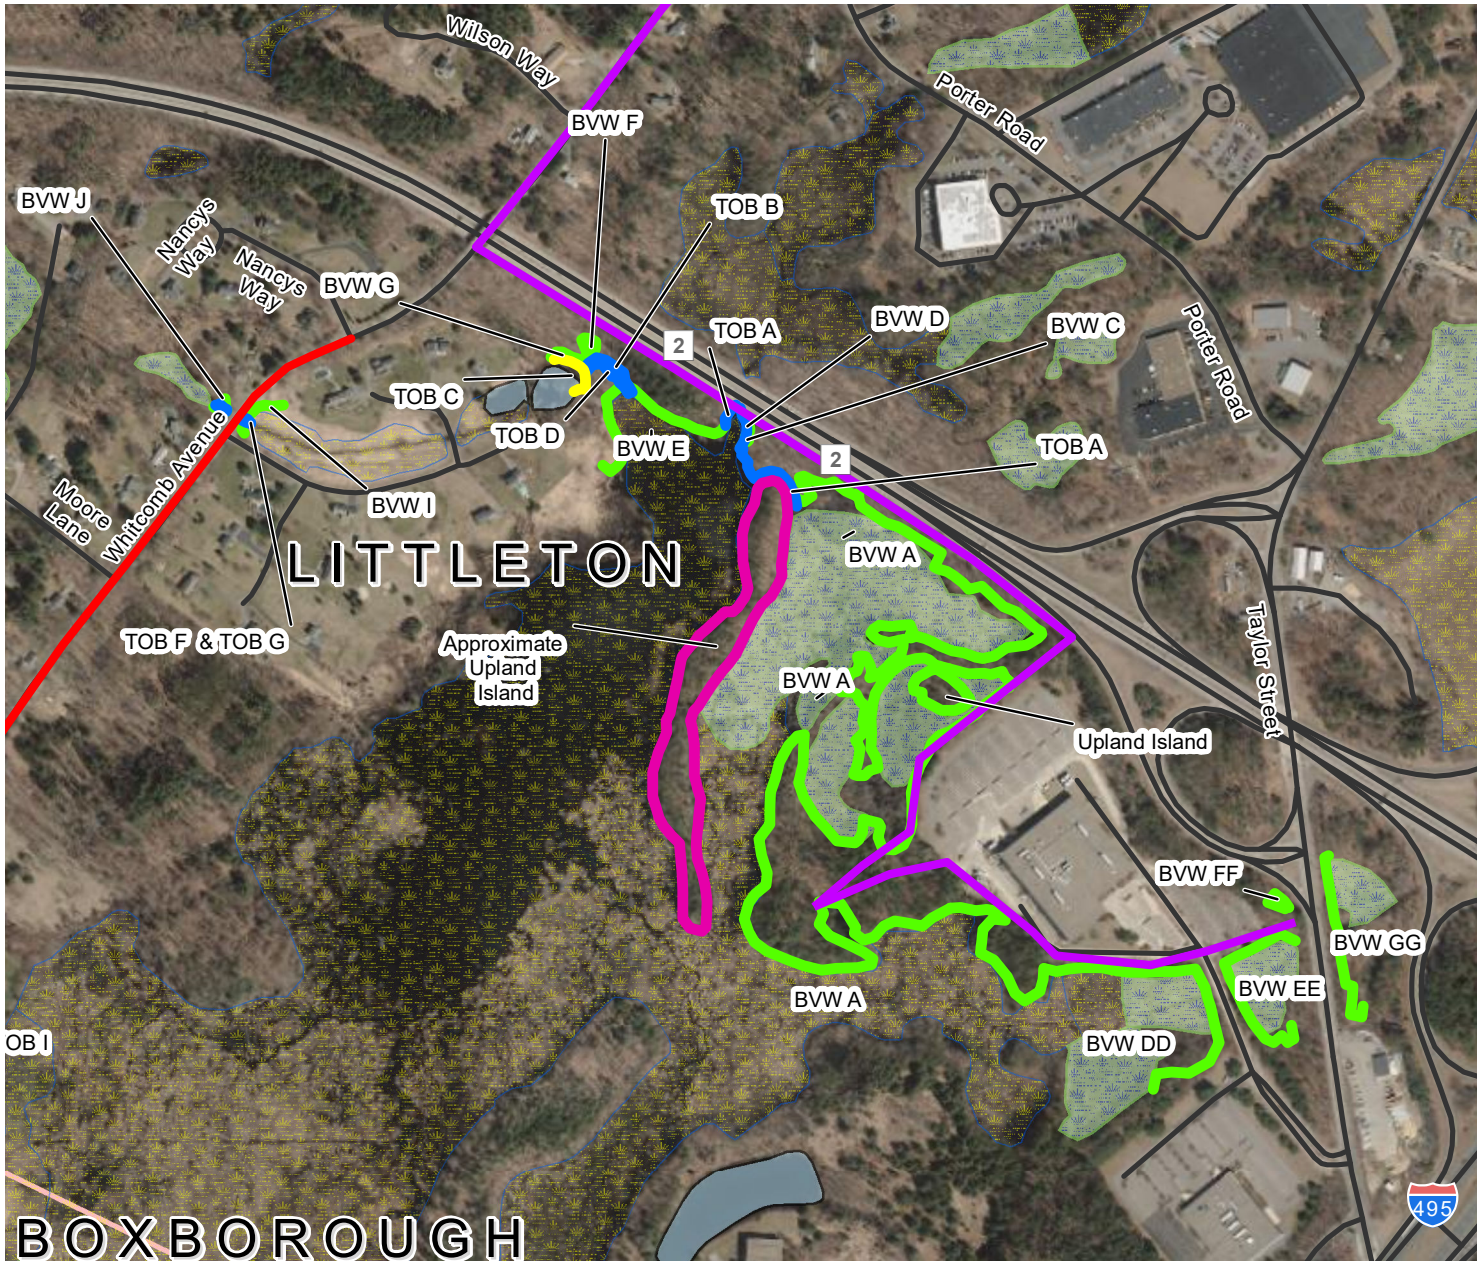

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- Bank-Pond
- Approximate Upland Island
- Bank - Intermittent Stream
- Bank -Perennial Stream
- Isolated Vegetated Wetland
- Bordering Vegetated Wetland
- MassDOT Roads
- Marsh/Bog
- Wooded marsh
- Cranberry Bog
- Salt Marsh
- Open Water
- Reservoir (with PWSID)
- Tidal Flats
- Beach/Dune
- MA Towns

FIGURE 1.1

Well and Water Main Extension
Littleton, MA

Wetlands Field Map

Weston & Sampson

Path: \\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\Wetland Delineation Report\Wetland Delineation Report\GIS\Maps\Wetland Flags Fig 1.2.mxd **User:** Page.Hailey **Saved:** 2/6/2023 11:17:19 AM **Opened:** 2/6/2023 11:17:48 AM

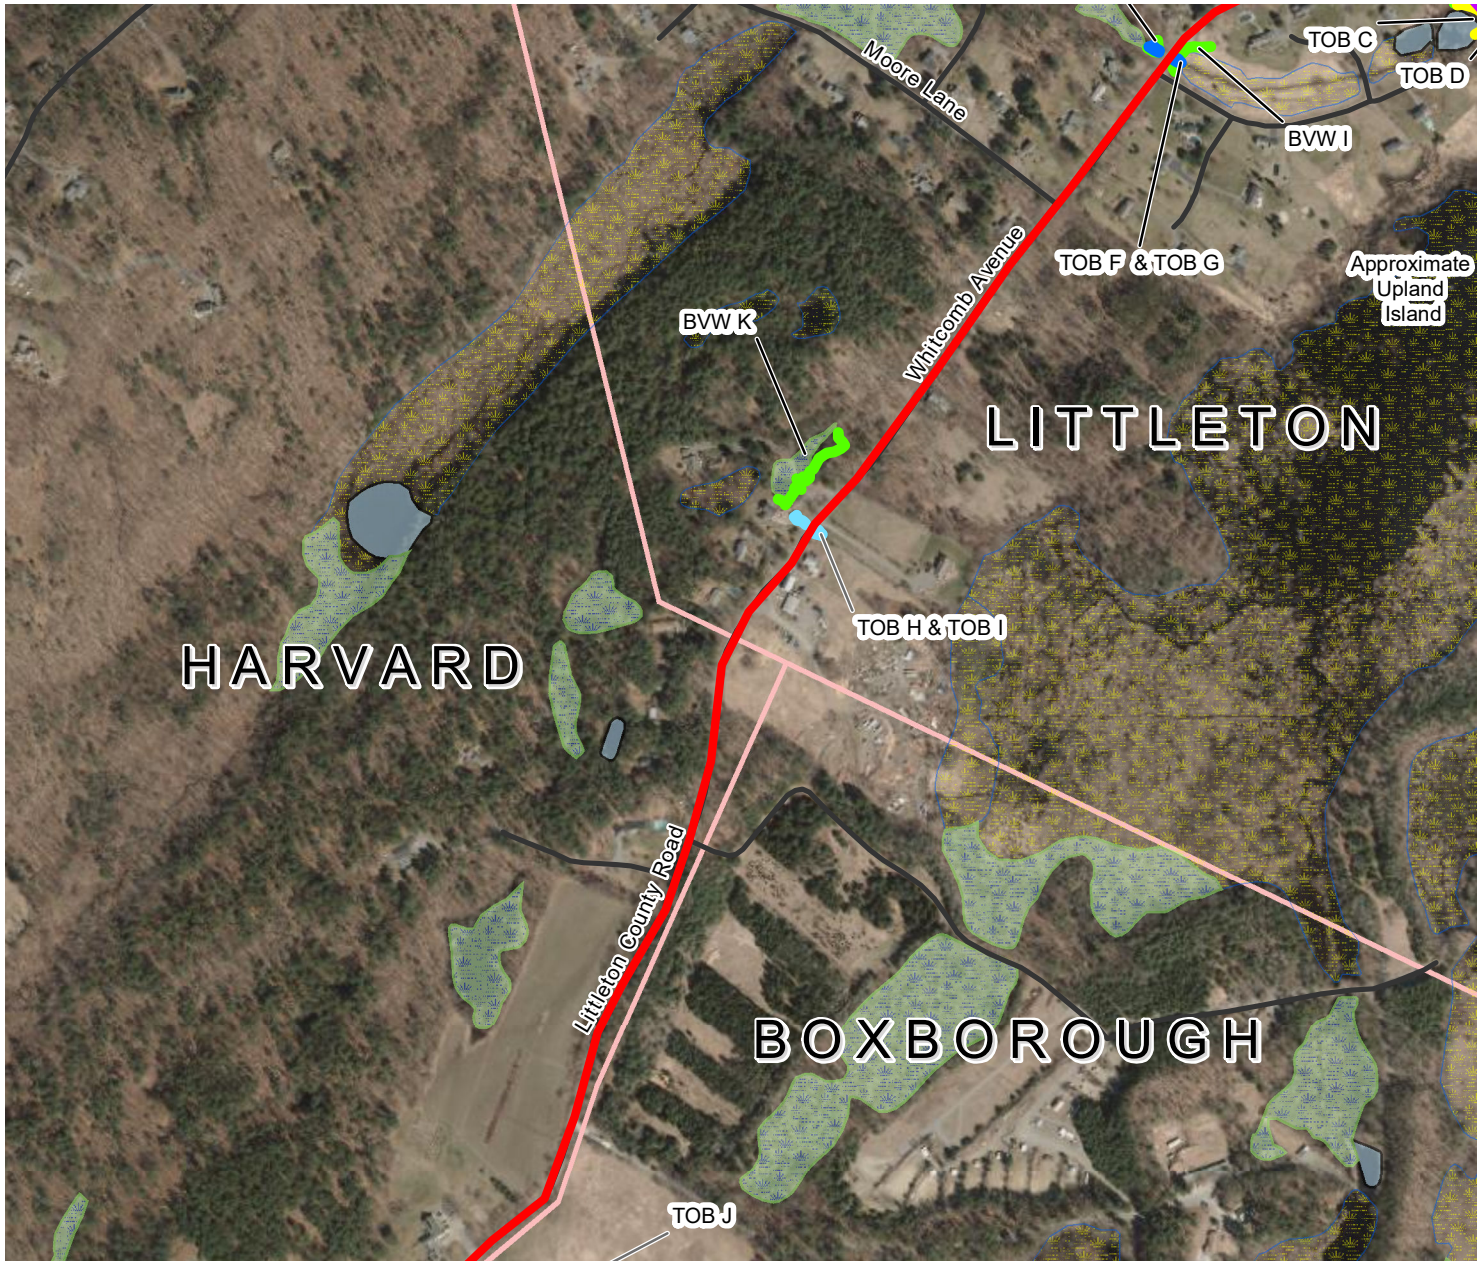

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- Bank-Pond
- Approximate Upland Island
- Bank - Intermittent Stream
- Bank -Perennial Stream
- Isolated Vegetated Wetland
- Bordering Vegetated Wetland
- MassDOT Roads
- Marsh/Bog
- Wooded marsh
- Cranberry Bog
- Salt Marsh
- Open Water
- Reservoir (with PWSID)
- Tidal Flats
- Beach/Dune
- MA Towns

FIGURE 1.2

Well and Water Main Extension
Littleton & Harvard, MA

Wetlands Field Map

Weston & Sampson

Path: \\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\Wetland Delineation Report\Wetland Delineation Report\GIS\Maps\Wetland Flags Fig 1.3.mxd **User:** Page.Hailey **Saved:** 2/6/2023 11:19:56 AM **Opened:** 2/6/2023 11:20:22 AM

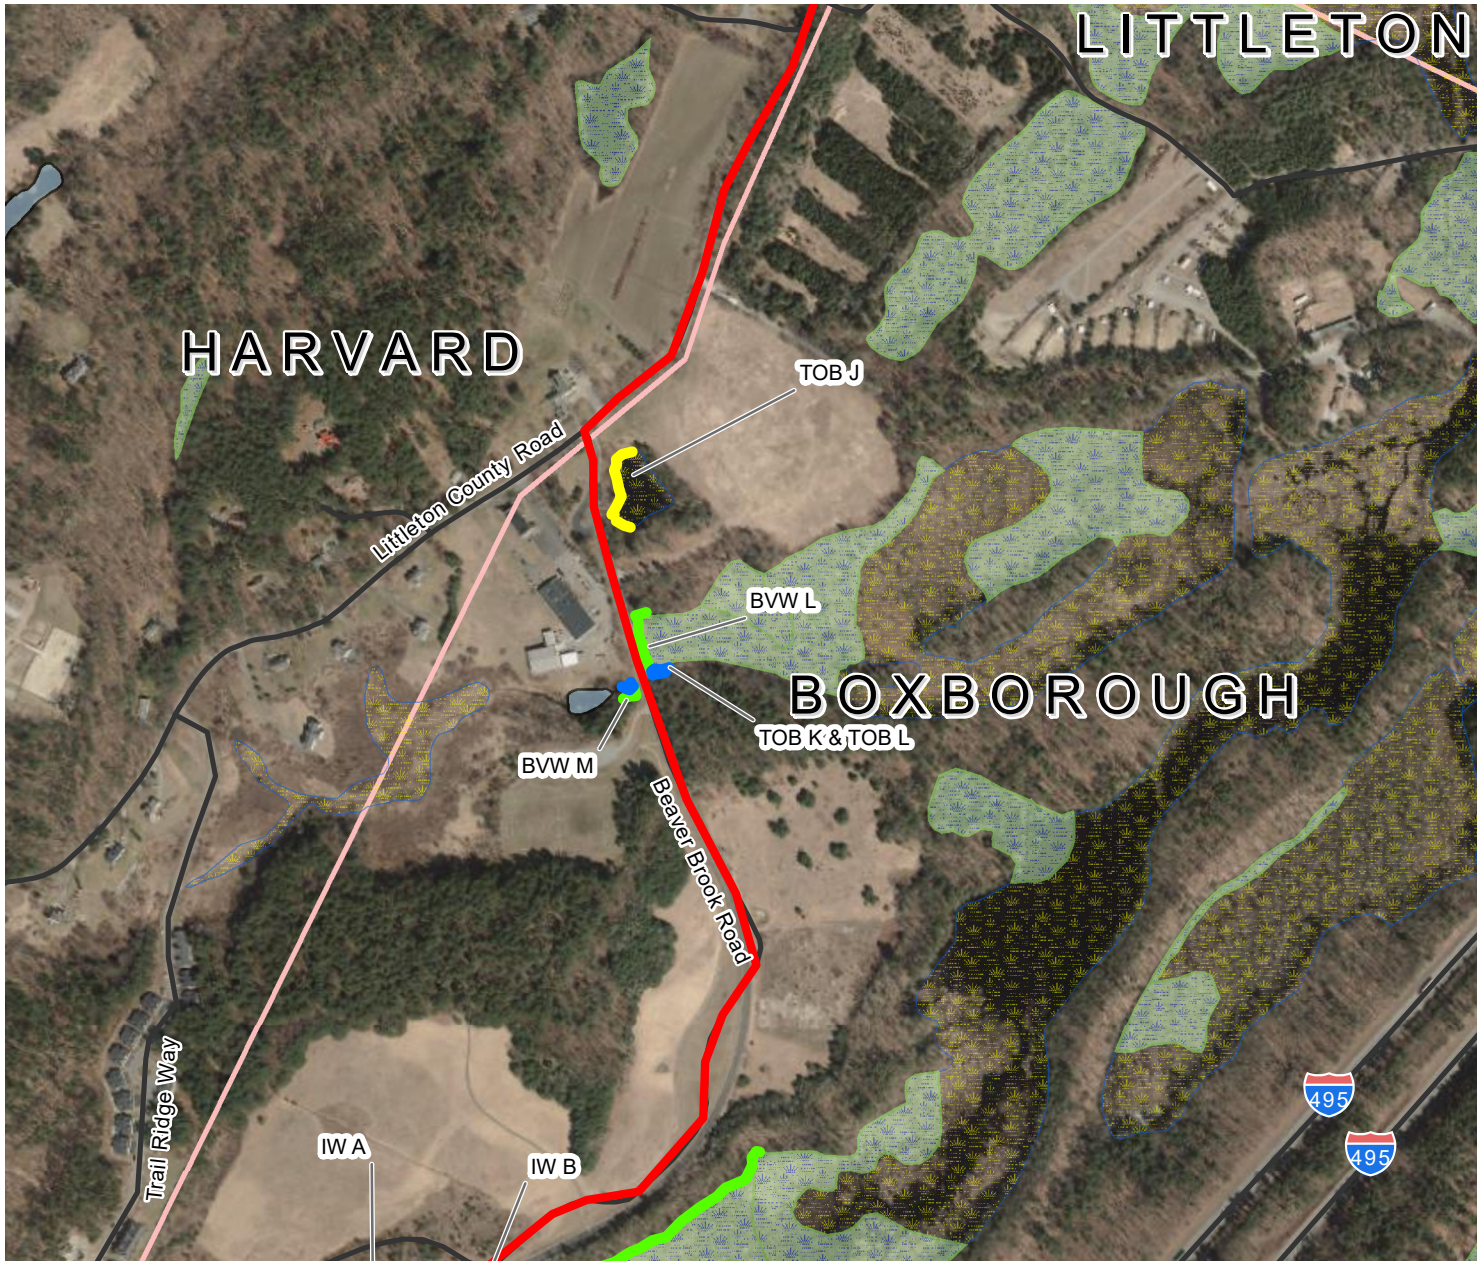

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- Bank-Pond
- Approximate Upland Island
- Bank - Intermittent Stream
- Bank -Perennial Stream
- Isolated Vegetated Wetland
- Bordering Vegetated Wetland
- MassDOT Roads
- Marsh/Bog
- Wooded marsh
- Cranberry Bog
- Salt Marsh
- Open Water
- Reservoir (with PWSID)
- Tidal Flats
- Beach/Dune
- MA Towns

FIGURE 1.3

Well and Water Main Extension
Harvard & Boxborough, MA

Wetlands Field Map

Weston & Sampson

Path: \\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\Wetland Delineation Report\Wetland Delineation Report\GIS\Maps\Wetland Flags Fig 1.4.mxd **User:** Page.Hailey **Saved:** 2/6/2023 11:21:22 AM **Opened:** 2/6/2023 11:26:46 AM

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- Bank-Pond
- Approximate Upland Island
- Bank - Intermittent Stream
- Bank -Perennial Stream
- Isolated Vegetated Wetland
- Bordering Vegetated Wetland
- MassDOT Roads
- Marsh/Bog
- Wooded marsh
- Cranberry Bog
- Salt Marsh
- Open Water
- Reservoir (with PWSID)
- Tidal Flats
- Beach/Dune
- MA Towns

FIGURE 1.4

Well and Water Main Extension
Harvard & Boxborough, MA

Wetlands Field Map

Weston & Sampson

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- Bank-Pond
- Approximate Upland Island
- Bank - Intermittent Stream
- Bank -Perennial Stream
- Isolated Vegetated Wetland
- Bordering Vegetated Wetland
- MassDOT Roads
- Marsh/Bog
- Wooded marsh
- Cranberry Bog
- Salt Marsh
- Open Water
- Reservoir (with PWSID)
- Tidal Flats
- Beach/Dune
- MA Towns

FIGURE 1.5

Well and Water Main Extension
Harvard & Boxborough, MA

Wetlands Field Map

Weston & Sampson

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- Bank-Pond
- Approximate Upland Island
- Bank - Intermittent Stream
- Bank -Perennial Stream
- Isolated Vegetated Wetland
- Bordering Vegetated Wetland
- MassDOT Roads
- Marsh/Bog
- Wooded marsh
- Cranberry Bog
- Salt Marsh
- Open Water
- Reservoir (with PWSID)
- Tidal Flats
- Beach/Dune
- MA Towns

FIGURE 1.6

Well and Water Main Extension
Harvard & Boxborough, MA

Wetlands Field Map

Weston & Sampson

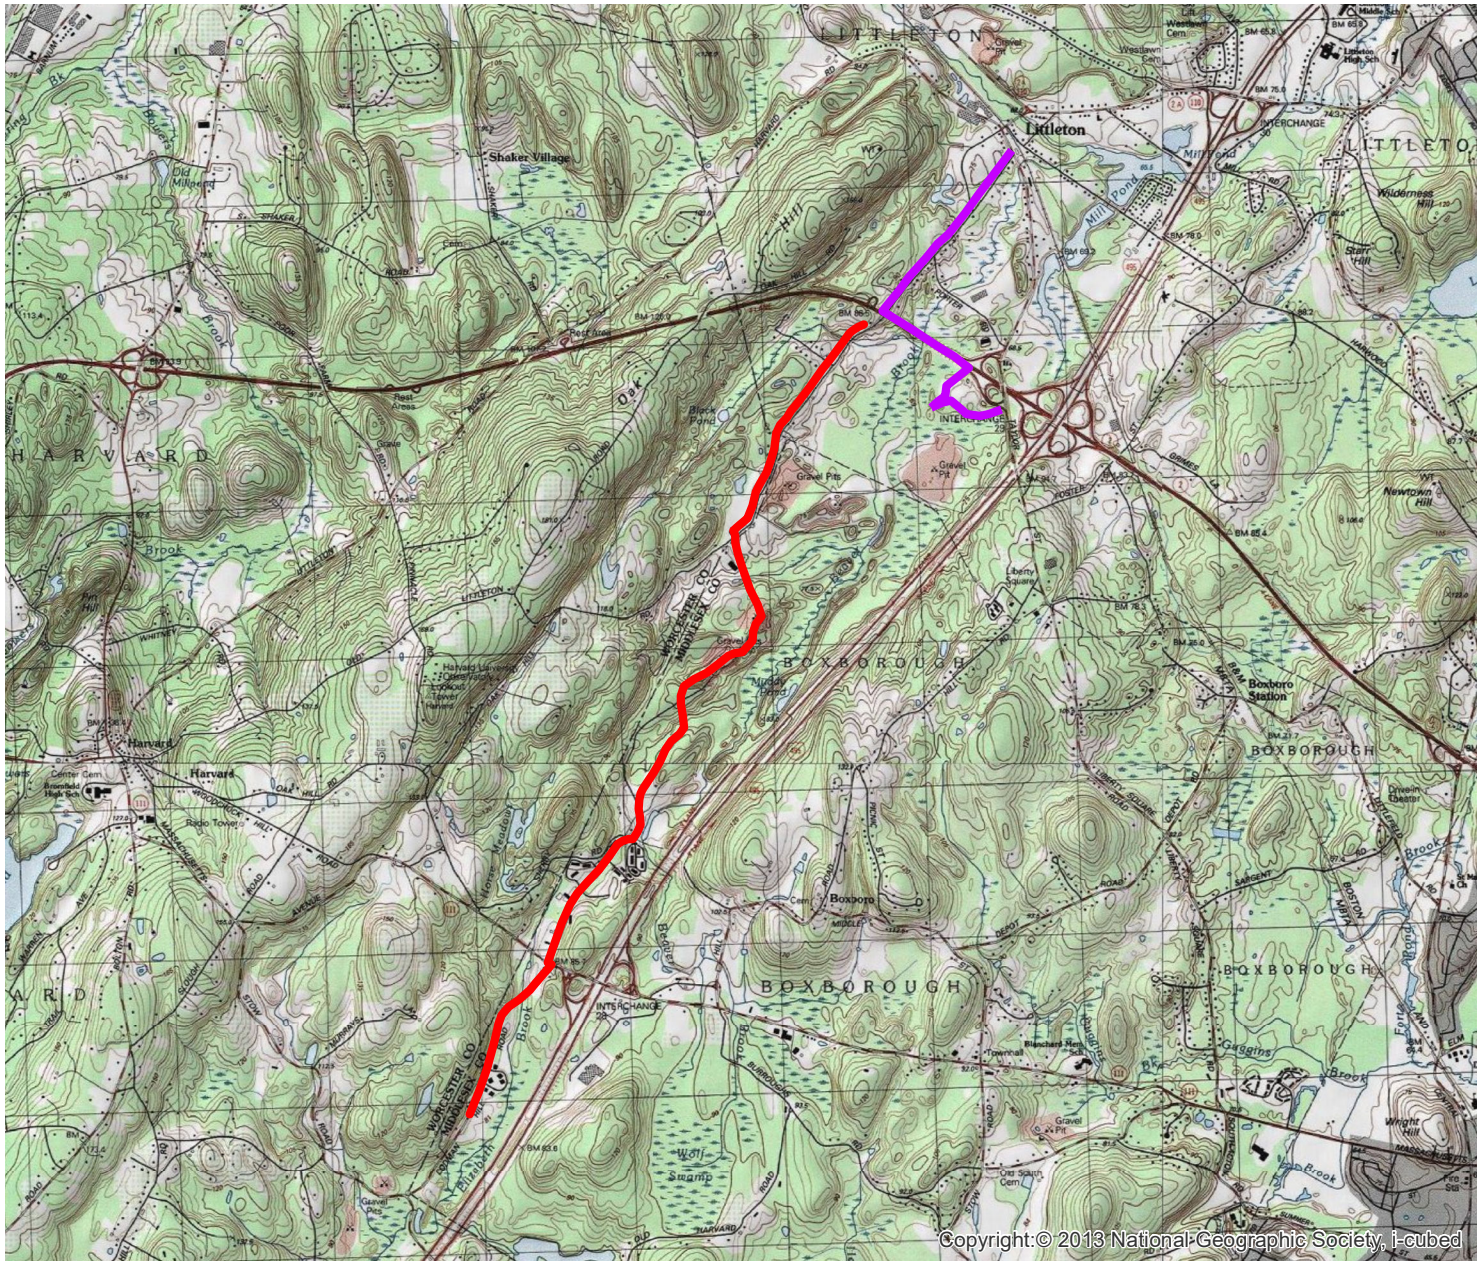

N
W E
S

1,500750 0 1,500
Feet

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

Raw Extension

Finish Extension

FIGURE 2

Well and Water Main Extension
Littleton, Boxborough,
& Harvard, MA

USGS Topographic Map

Weston & Sampson

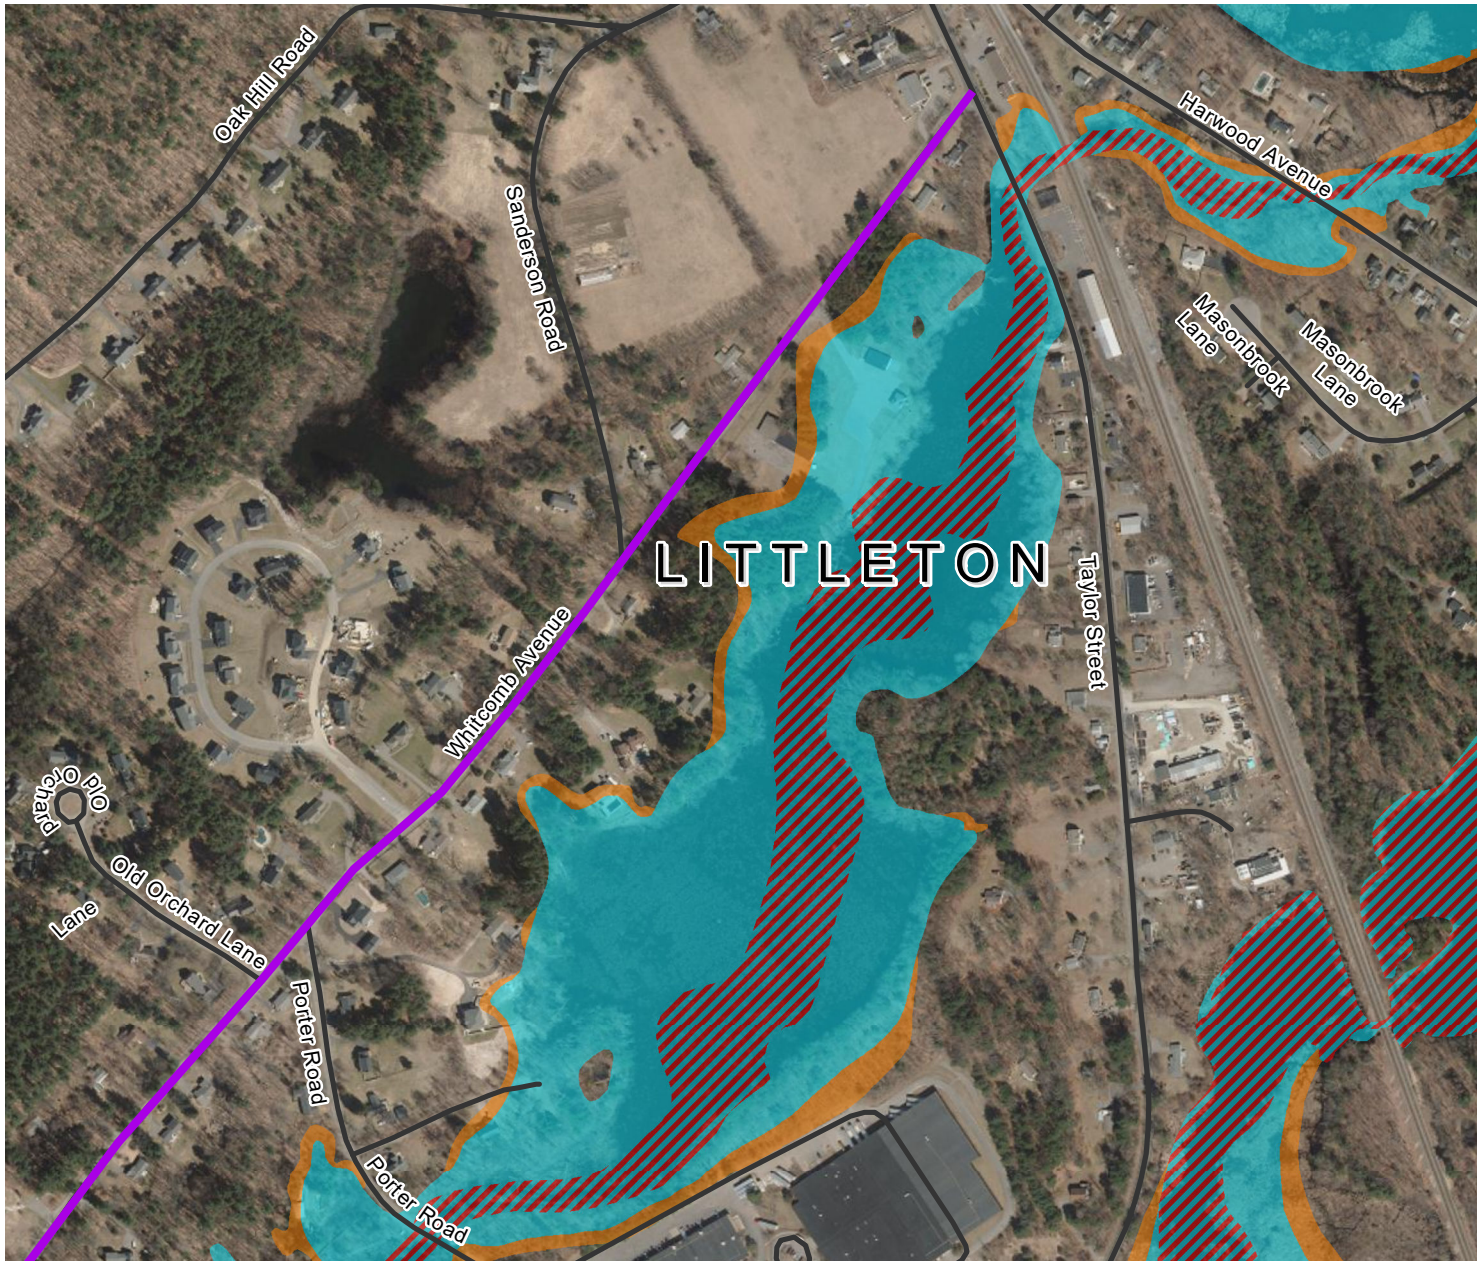

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- MassDOT Roads
- MA Towns

FEMA National Flood Hazard Layer

Flood Zone Designations

- A: 1% Annual Chance of Flooding, no BFE
- AE: 1% Annual Chance of Flooding, with BFE
- AE: Regulatory Floodway
- AH: 1% Annual Chance of 1-3ft Ponding, with BFE
- AO: 1% Annual Chance of 1-3ft Sheet Flow Flooding, with Depth
- VE: High Risk Coastal Area
- D: Possible But Undetermined Hazard
- X: 0.2% Annual Chance of Flooding
- X: Reduced Flood Risk due to Levee
- Area Not Included
- Area with no DFIRM - Paper FIRMs in Effect

FIGURE 3.0

Well and Water Main Extension
Littleton, MA

FEMA Firmette Map

Weston & Sampson

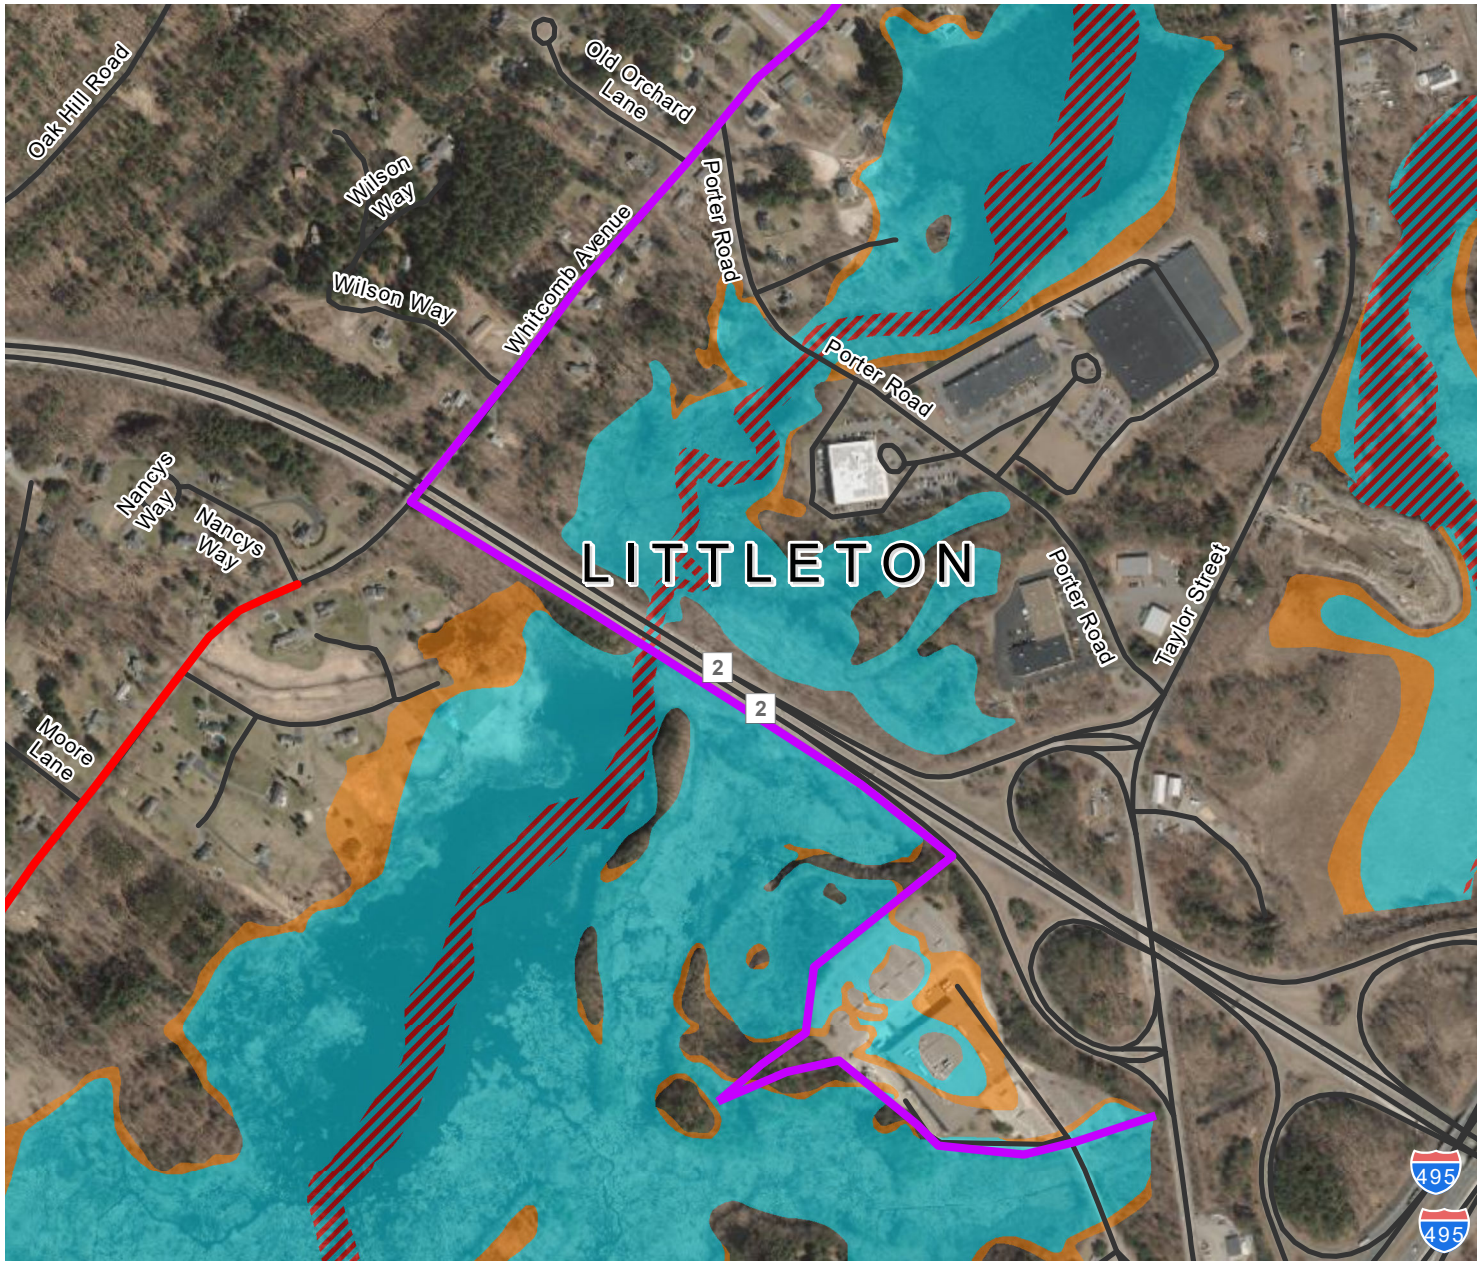

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- MassDOT Roads
- MA Towns

FEMA National Flood Hazard Layer

Flood Zone Designations

- A: 1% Annual Chance of Flooding, no BFE
- AE: 1% Annual Chance of Flooding, with BFE
- AE: Regulatory Floodway
- AH: 1% Annual Chance of 1-3ft Ponding, with BFE
- AO: 1% Annual Chance of 1-3ft Sheet Flow Flooding, with Depth
- VE: High Risk Coastal Area
- D: Possible But Undetermined Hazard
- X: 0.2% Annual Chance of Flooding
- X: Reduced Flood Risk due to Levee
- Area Not Included
- Area with no DFIRM - Paper FIRMs in Effect

FIGURE 3.1

Well and Water Main Extension
Littleton, MA

Environmental Receptors Map

Weston & Sampson

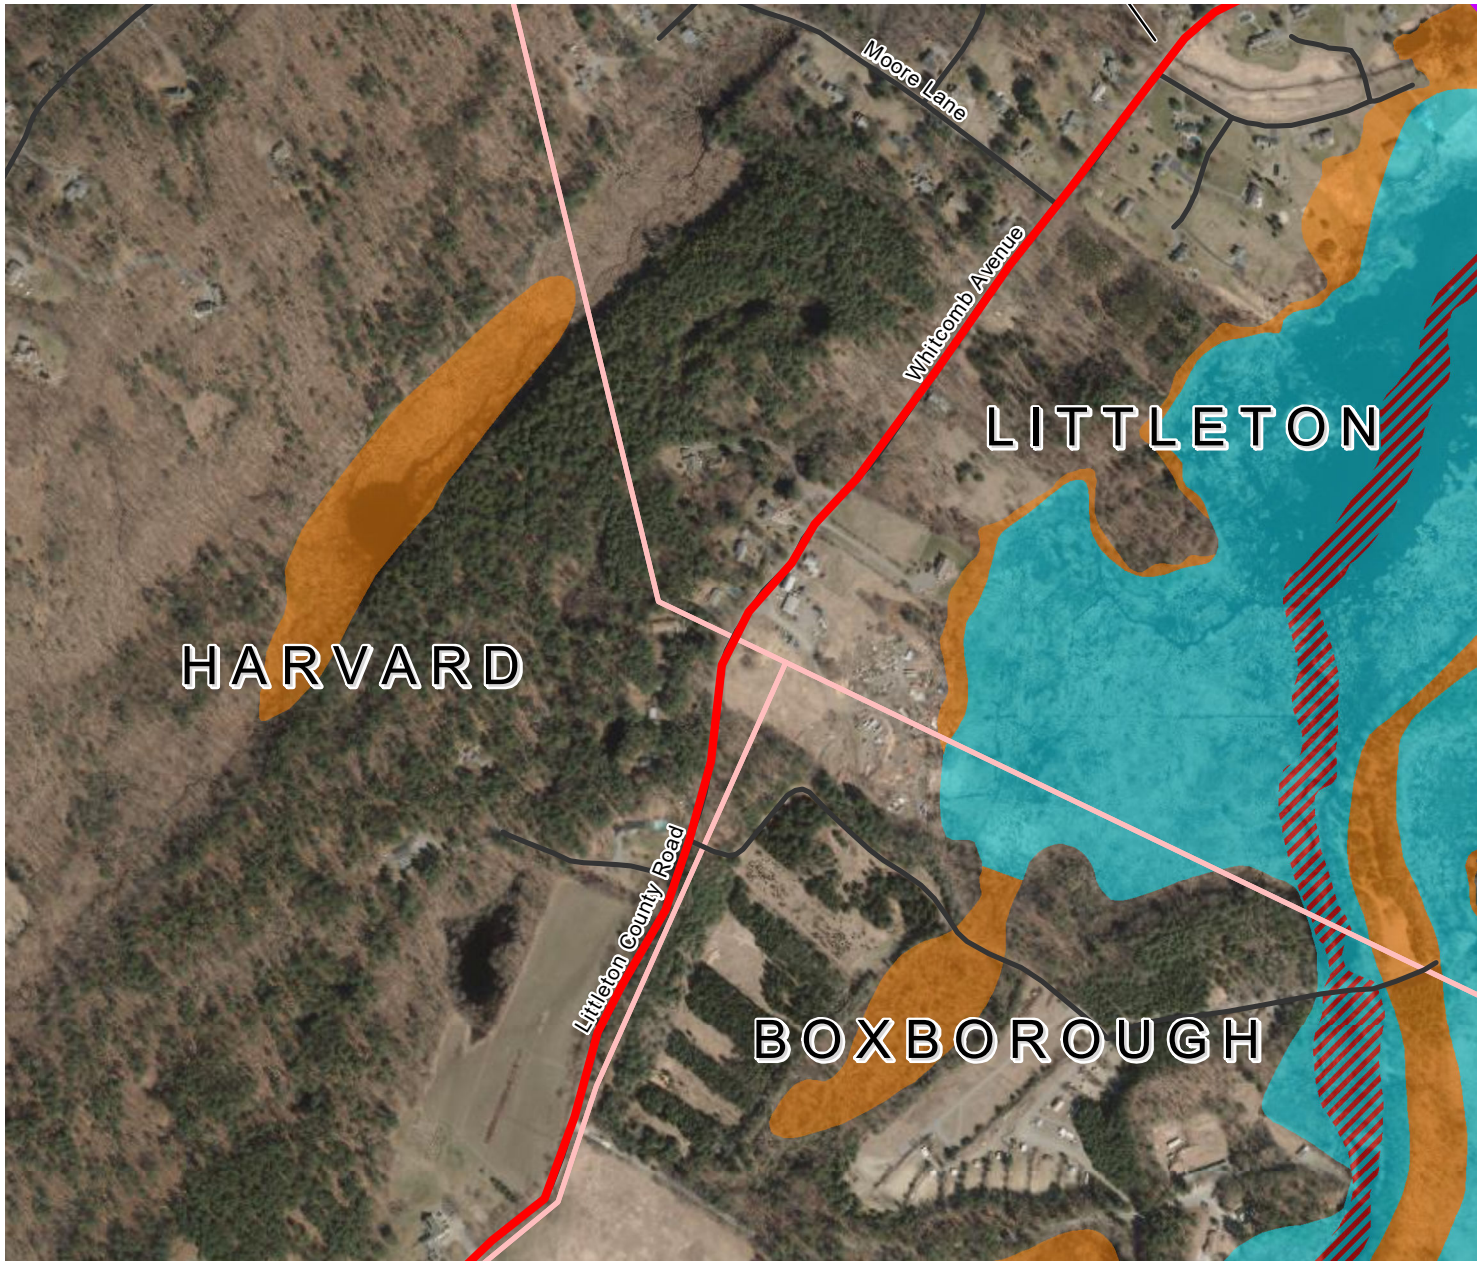

Legend

- Raw Extension
- Finish Extension
- MassDOT Roads
- MA Towns

FEMA National Flood Hazard Layer

Flood Zone Designations

- A: 1% Annual Chance of Flooding, no BFE
- AE: 1% Annual Chance of Flooding, with BFE
- AE: Regulatory Floodway
- AH: 1% Annual Chance of 1-3ft Ponding, with BFE
- AO: 1% Annual Chance of 1-3ft Sheet Flow Flooding, with Depth
- VE: High Risk Coastal Area
- D: Possible But Undetermined Hazard
- X: 0.2% Annual Chance of Flooding
- X: Reduced Flood Risk due to Levee
- Area Not Included
- Area with no DFIRM - Paper FIRMs in Effect

N W E S

500 250 0 500 Feet

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

FIGURE 3.2

Well and Water Main Extension
Littleton & Harvard, MA

FEMA Firmette Map

Weston & Sampson

Path: \\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\Wetland Delineation Report\Wetland Delineation Report\GIS\Maps\FEMA Fig 3.3.mxd **User:** Page.Hailey **Saved:** 2/6/2023 1:15:32 PM **Opened:** 2/6/2023 1:17:43 PM

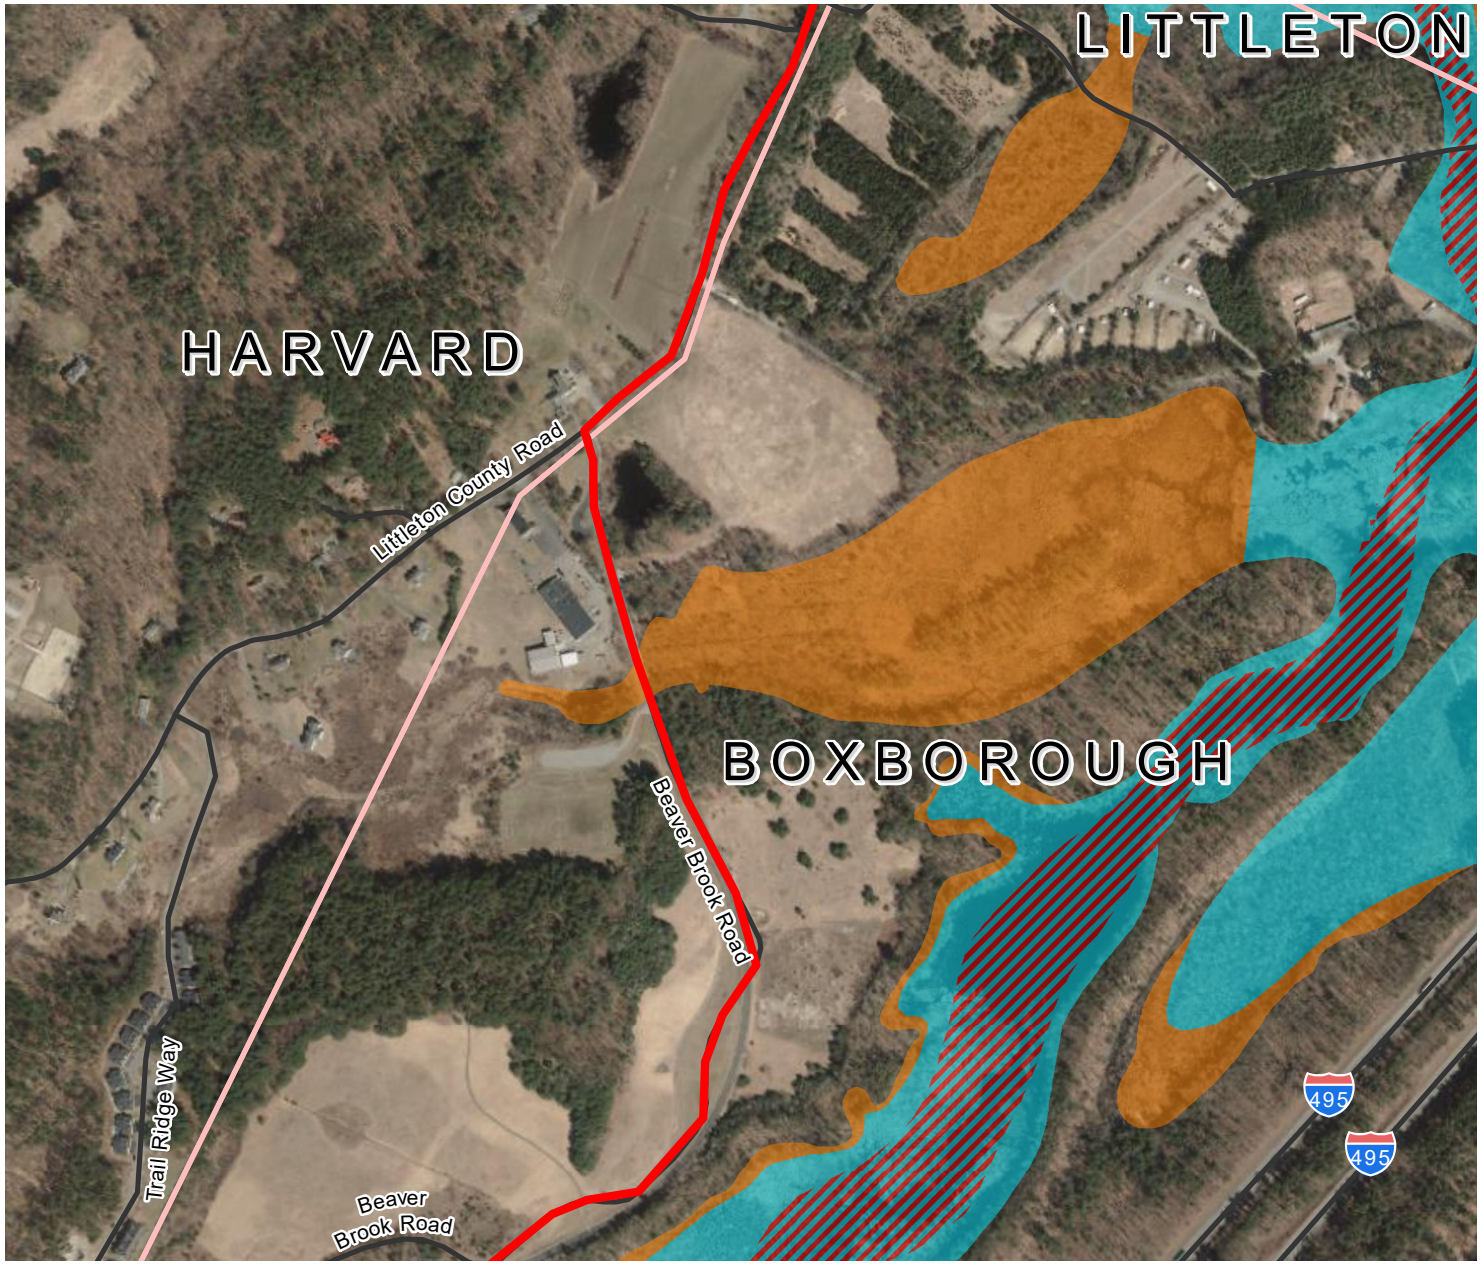

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- MassDOT Roads
- MA Towns

FEMA National Flood Hazard Layer

Flood Zone Designations

- A: 1% Annual Chance of Flooding, no BFE
- AE: 1% Annual Chance of Flooding, with BFE
- AE: Regulatory Floodway
- AH: 1% Annual Chance of 1-3ft Ponding, with BFE
- AO: 1% Annual Chance of 1-3ft Sheet Flow Flooding, with Depth
- VE: High Risk Coastal Area
- D: Possible But Undetermined Hazard
- X: 0.2% Annual Chance of Flooding
- X: Reduced Flood Risk due to Levee
- Area Not Included
- Area with no DFIRM - Paper FIRMs in Effect

FIGURE 3.3

Well and Water Main Extension
Harvard & Boxborough, MA

FEMA Firmette Map

Weston & Sampson

N
W E
S

500 250 0 500
Feet

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- MassDOT Roads
- MA Towns

FEMA National Flood Hazard Layer

Flood Zone Designations

- A: 1% Annual Chance of Flooding, no BFE
- AE: 1% Annual Chance of Flooding, with BFE
- AE: Regulatory Floodway
- AH: 1% Annual Chance of 1-3ft Ponding, with BFE
- AO: 1% Annual Chance of 1-3ft Sheet Flow Flooding, with Depth
- VE: High Risk Coastal Area
- D: Possible But Undetermined Hazard
- X: 0.2% Annual Chance of Flooding
- X: Reduced Flood Risk due to Levee
- Area Not Included
- Area with no DFIRM - Paper FIRMs in Effect

FIGURE 3.4

Well and Water Main Extension
Harvard & Boxborough, MA

FEMA Firmette Map

Weston & Sampson

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- MassDOT Roads
- MA Towns

FEMA National Flood Hazard Layer

Flood Zone Designations

- A: 1% Annual Chance of Flooding, no BFE
- AE: 1% Annual Chance of Flooding, with BFE
- AE: Regulatory Floodway
- AH: 1% Annual Chance of 1-3ft Ponding, with BFE
- AO: 1% Annual Chance of 1-3ft Sheet Flow Flooding, with Depth
- VE: High Risk Coastal Area
- D: Possible But Undetermined Hazard
- X: 0.2% Annual Chance of Flooding
- X: Reduced Flood Risk due to Levee
- Area Not Included
- Area with no DFIRM - Paper FIRMs in Effect

FIGURE 3.5

Well and Water Main Extension
Harvard & Boxborough, MA

FEMA Firmette Map

Weston & Sampson

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- MassDOT Roads
- MA Towns

FEMA National Flood Hazard Layer

Flood Zone Designations

- A: 1% Annual Chance of Flooding, no BFE
- AE: 1% Annual Chance of Flooding, with BFE
- AE: Regulatory Floodway
- AH: 1% Annual Chance of 1-3ft Ponding, with BFE
- AO: 1% Annual Chance of 1-3ft Sheet Flow Flooding, with Depth
- VE: High Risk Coastal Area
- D: Possible But Undetermined Hazard
- X: 0.2% Annual Chance of Flooding
- X: Reduced Flood Risk due to Levee
- Area Not Included
- Area with no DFIRM - Paper FIRMs in Effect

FIGURE 3.6

Well and Water Main Extension
Harvard & Boxborough, MA

FEMA Firmette Map

Weston & Sampson

Path: \\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\Wetland Delineation Report\Wetland Delineation Report\GIS\Maps\Environmental Receptor Fig 4.0.mxd **User:** Page.Hailey **Saved:** 2/6/2023 11:42:47 AM **Opened:** 2/6/2023 12:35:44 PM

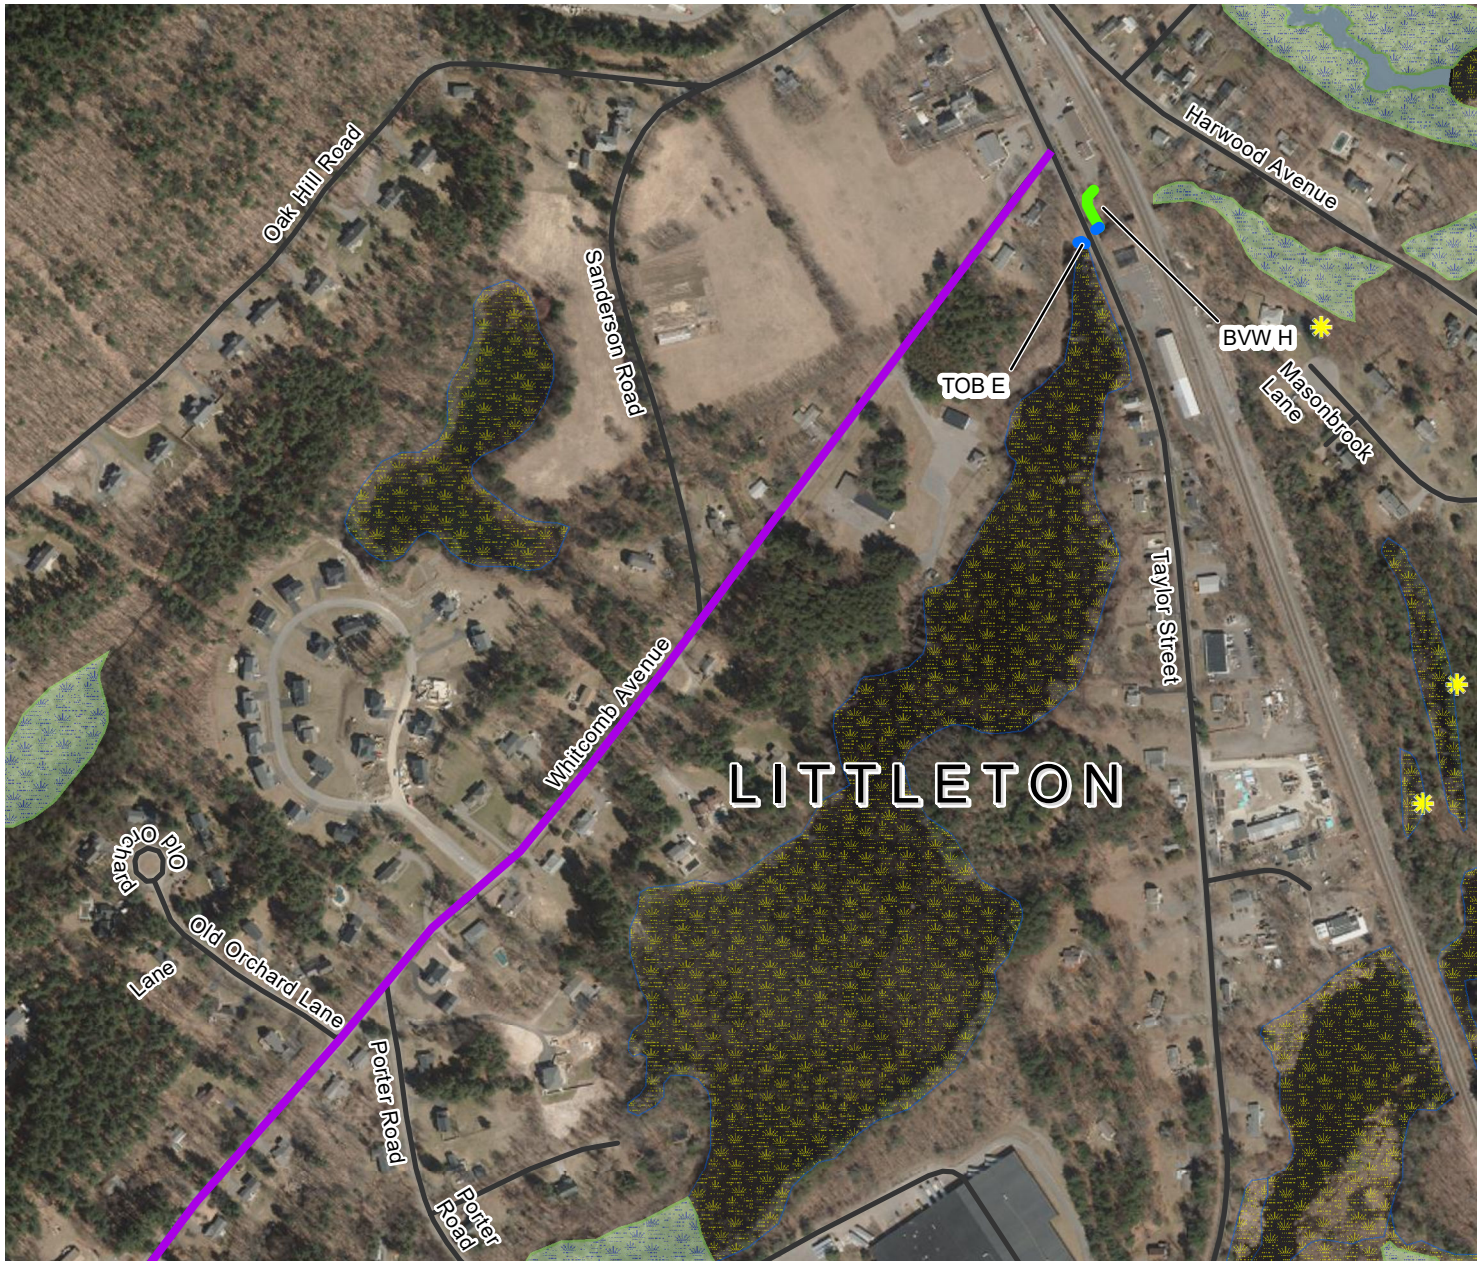

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- Bank-Pond
- Approximate Upland Island
- Bank - Intermittent Stream
- Bank -Perennial Stream
- Isolated Vegetated Wetland
- Bordering Vegetated Wetland
- MassDOT Roads
- Marsh/Bog
- Wooded marsh
- Cranberry Bog
- Salt Marsh
- Open Water
- Reservoir (with PWSID)
- Tidal Flats
- Beach/Dune
- MA Towns
- ACECs
- NHESP Estimated Habitats of Rare Wildlife
- NHESP Priority Habitats of Rare Species
- NHESP Certified Vernal Pools
- NHESP Potential Vernal Pools
- Cold Water Fisheries
- Public Water Supply Contributor
- ORW for ACEC
- ORW for both Water Supply and Other

FIGURE 4.0

Well and Water Main Extension
Littleton, MA

Environmental Receptors Map

Weston & Sampson

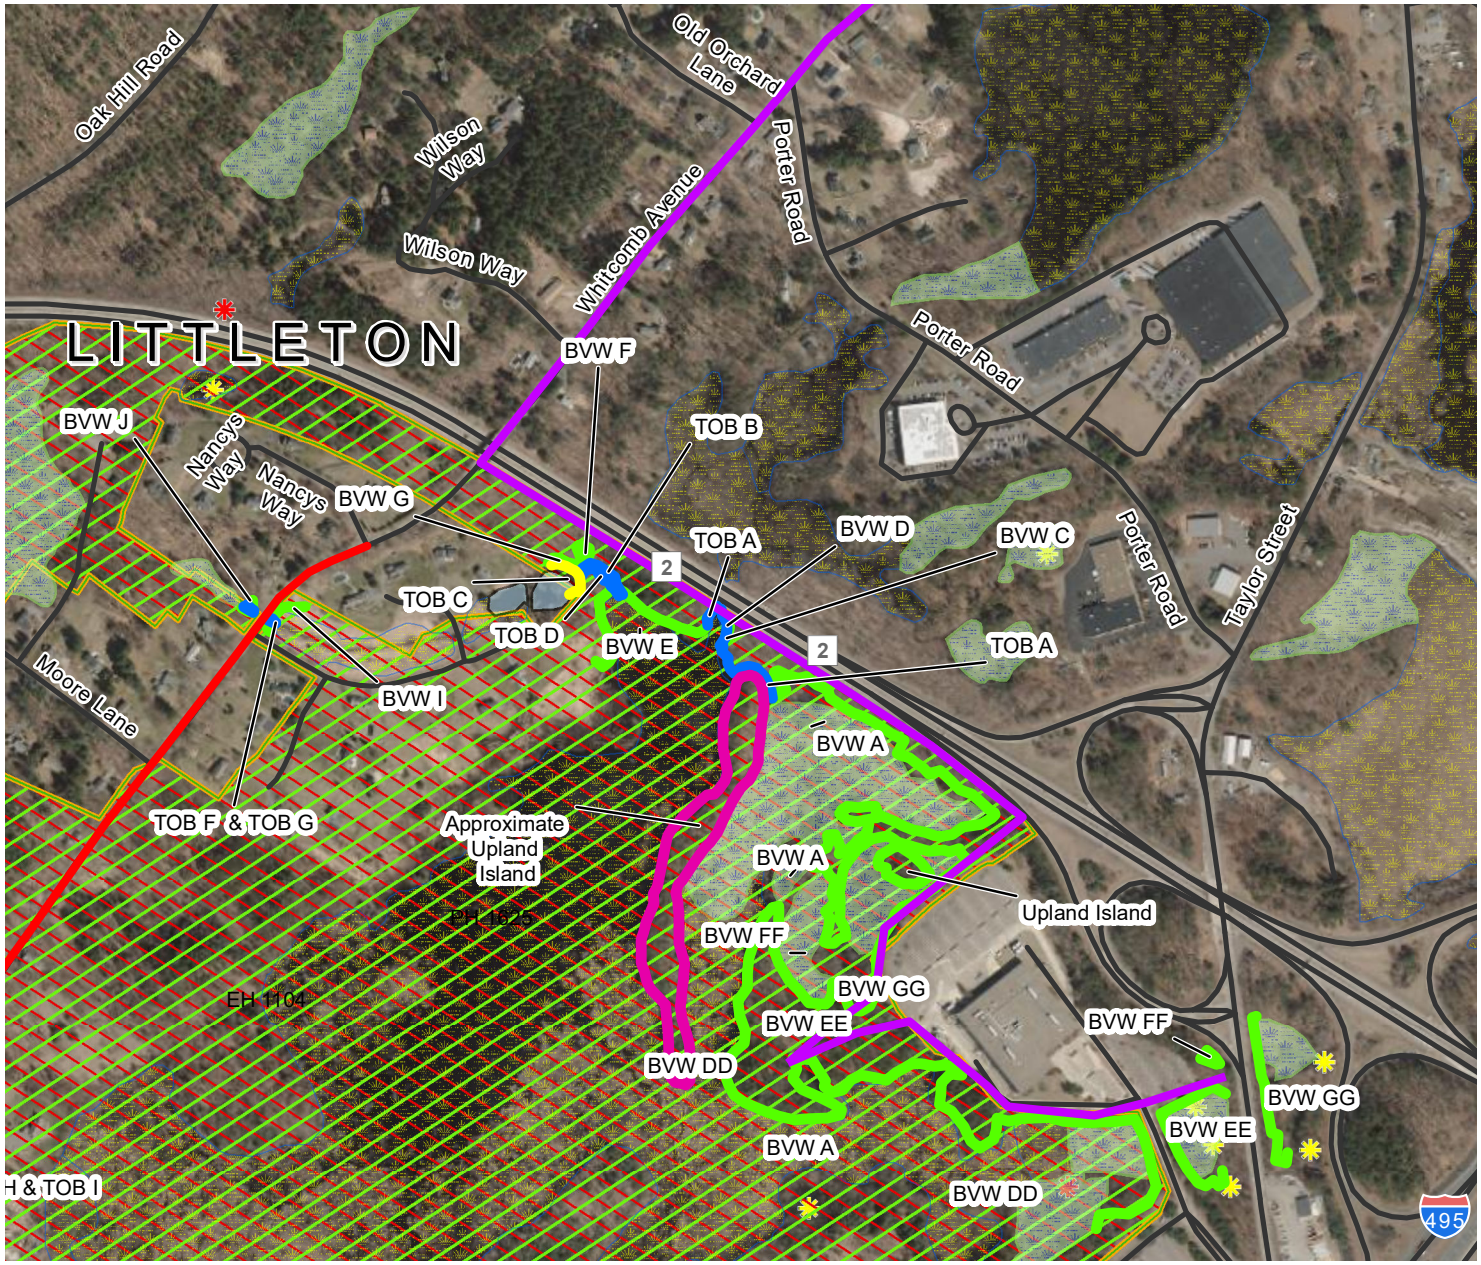

N
W E
S

500 250 0 500 Feet

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- Bank-Pond
- Approximate Upland Island
- Bank - Intermittent Stream
- Bank -Perennial Stream
- Isolated Vegetated Wetland
- Bordering Vegetated Wetland
- MassDOT Roads
- Marsh/Bog
- Wooded marsh
- Cranberry Bog
- Salt Marsh
- Open Water
- Reservoir (with PWSID)
- Tidal Flats
- Beach/Dune
- MA Towns
- ACECs
- NHESP Estimated Habitats of Rare Wildlife
- NHESP Priority Habitats of Rare Species
- NHESP Certified Vernal Pools
- NHESP Potential Vernal Pools
- Cold Water Fisheries
- Public Water Supply Contributor
- ORW for ACEC
- ORW for both Water Supply and Other

FIGURE 4.1

Well and Water Main Extension
Littleton, MA

Environmental Receptors Map

Weston & Sampson

Path: \\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\Wetland Delineation Report\Wetland Delineation Report\GIS\Maps\Environmental Receptor Fig 4.2.mxd **User:** Page.Hailey **Saved:** 2/6/2023 11:49:15 AM **Opened:** 2/6/2023 12:30:39 PM

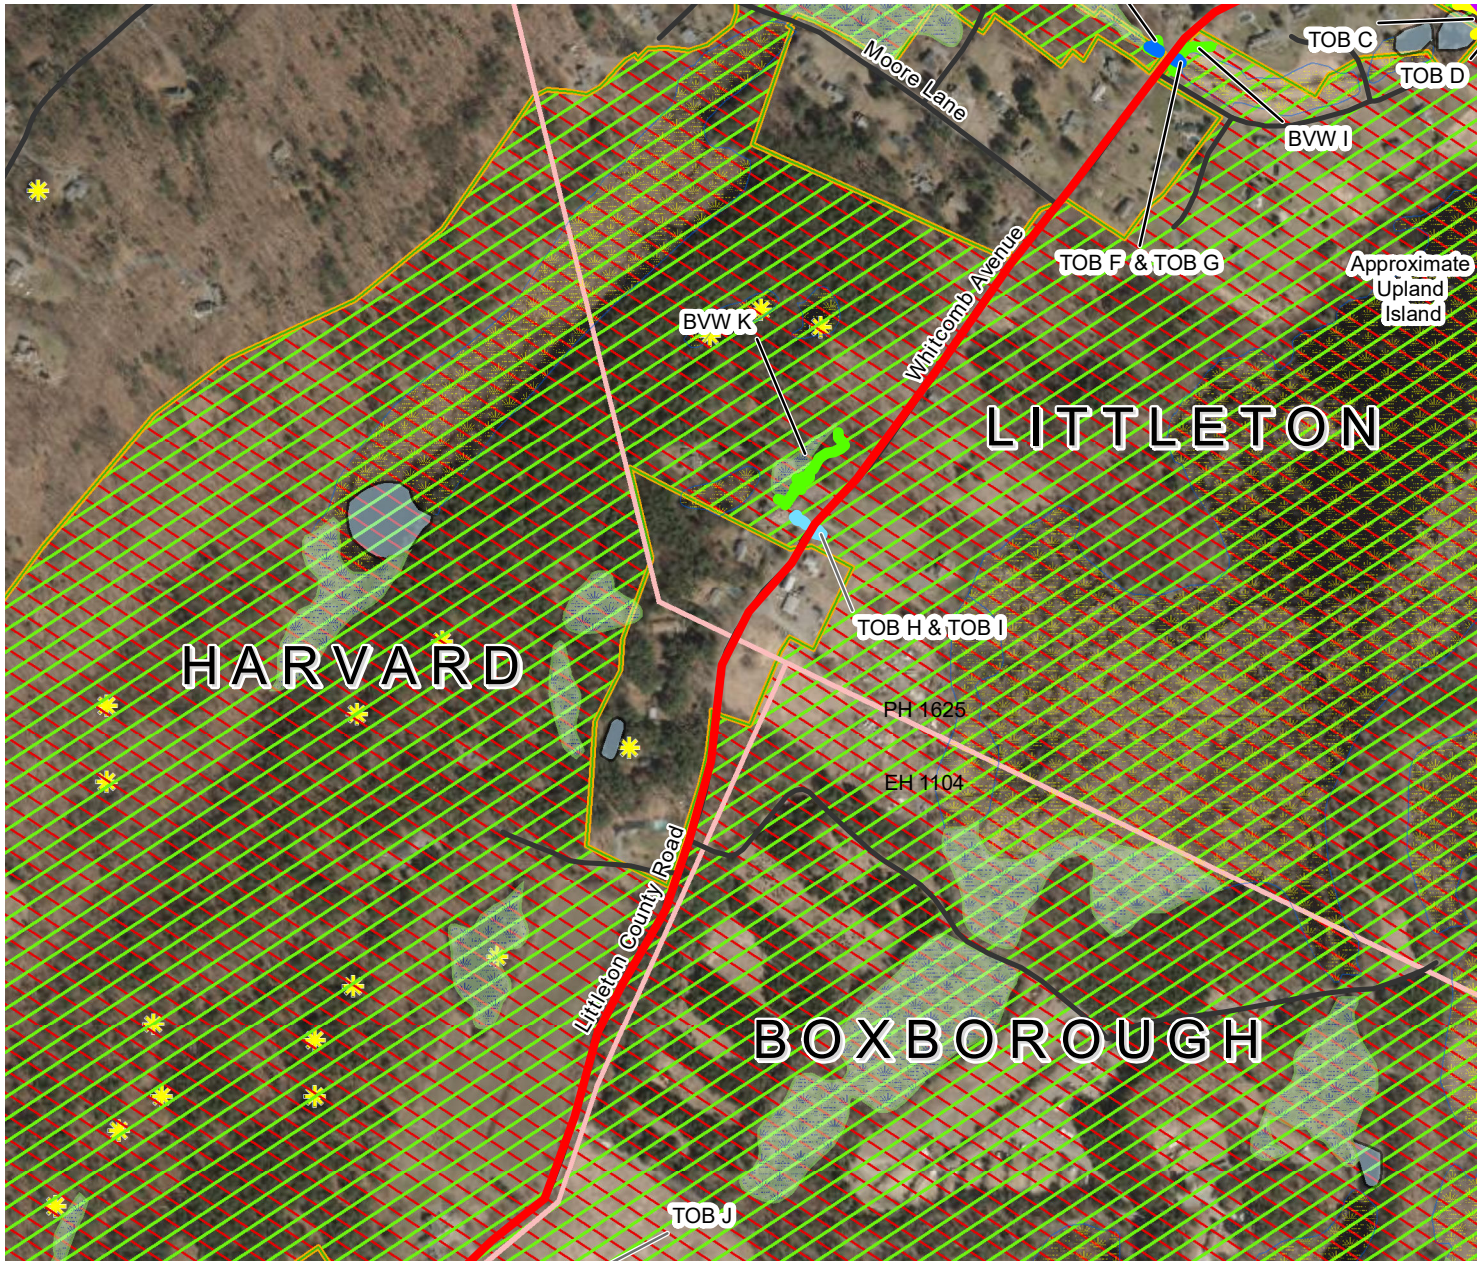

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- Bank-Pond
- Approximate Upland Island
- Bank - Intermittent Stream
- Bank -Perennial Stream
- Isolated Vegetated Wetland
- Bordering Vegetated Wetland
- MassDOT Roads
- Marsh/Bog
- Wooded marsh
- Cranberry Bog
- Salt Marsh
- Open Water
- Reservoir (with PWSID)
- Tidal Flats
- Beach/Dune
- MA Towns
- ACECs
- NHESP Estimated Habitats of Rare Wildlife
- NHESP Priority Habitats of Rare Species
- NHESP Certified Vernal Pools
- NHESP Potential Vernal Pools
- Cold Water Fisheries
- Public Water Supply Contributor
- ORW for ACEC
- ORW for both Water Supply and Other

FIGURE 4.2

Well and Water Main Extension
Littleton & Harvard, MA

Environmental Receptors Map

Weston & Sampson

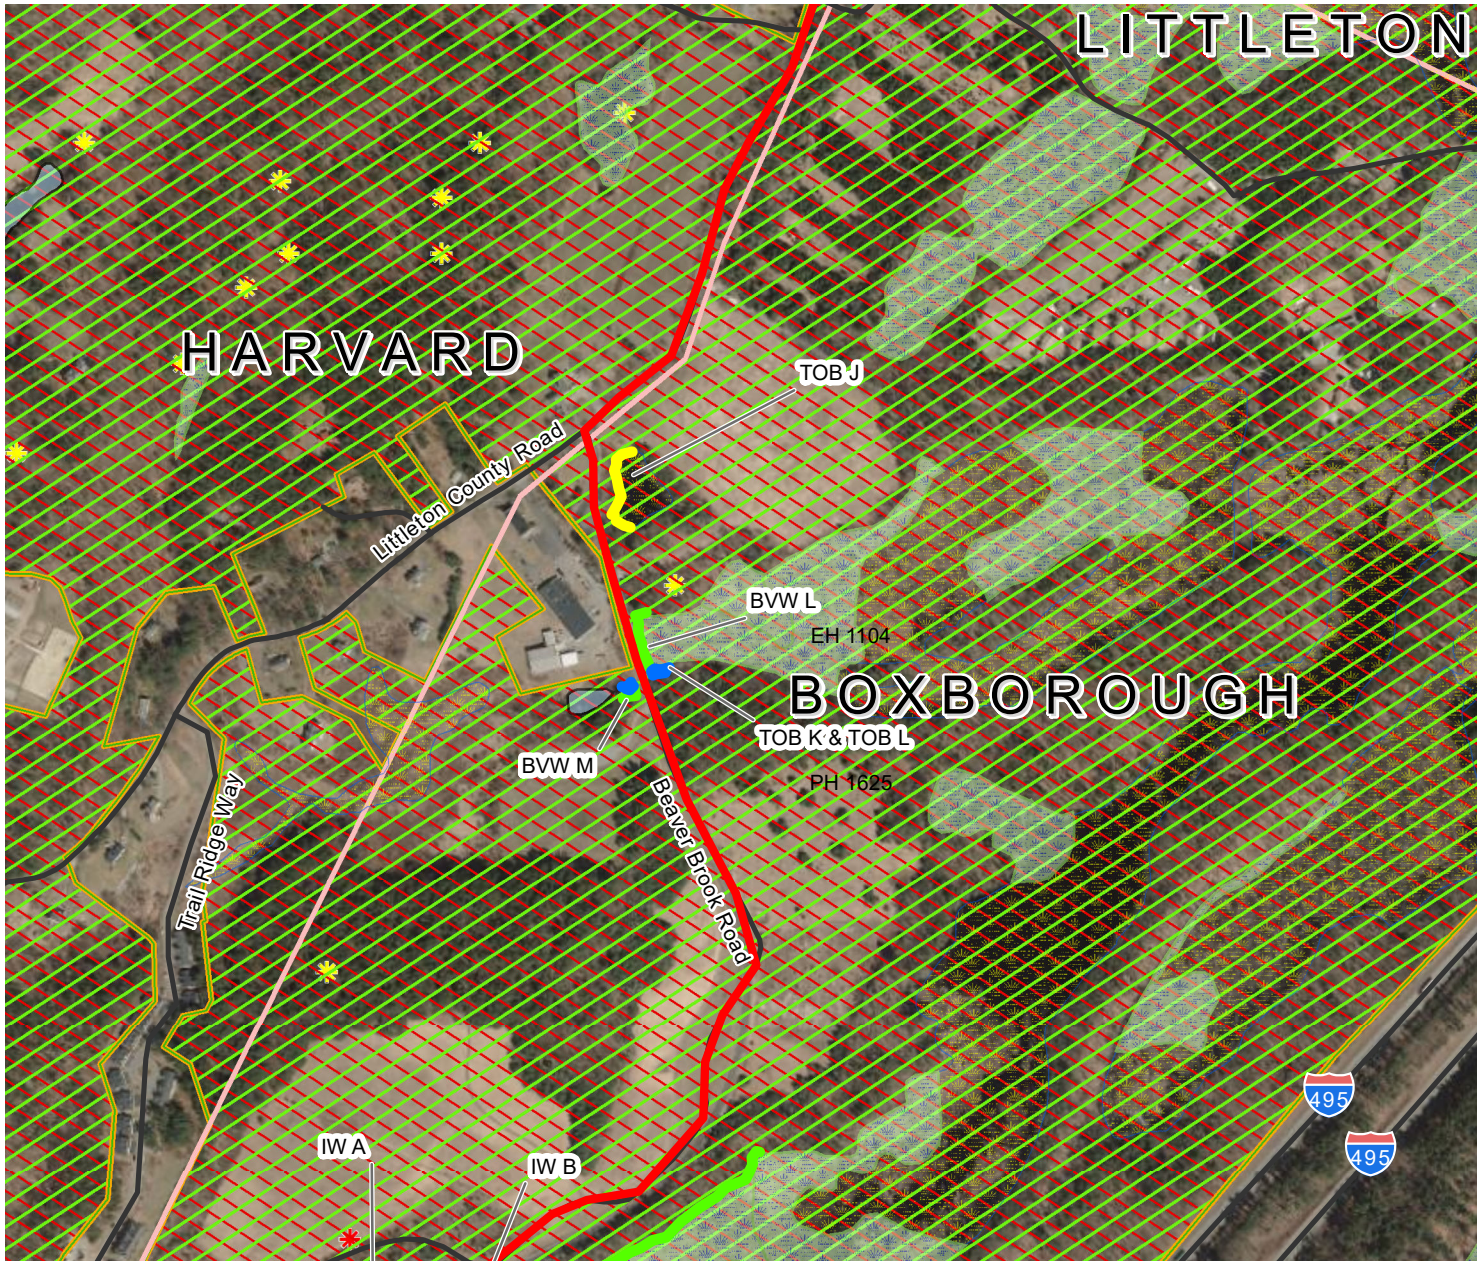

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- Bank-Pond
- Approximate Upland Island
- Bank - Intermittent Stream
- Bank -Perennial Stream
- Isolated Vegetated Wetland
- Bordering Vegetated Wetland
- MassDOT Roads
- Marsh/Bog
- Wooded marsh
- Cranberry Bog
- Salt Marsh
- Open Water
- Reservoir (with PWSID)
- Tidal Flats
- Beach/Dune
- MA Towns
- ACECs
- NHESP Estimated Habitats of Rare Wildlife
- NHESP Priority Habitats of Rare Species
- NHESP Certified Vernal Pools
- NHESP Potential Vernal Pools
- Cold Water Fisheries
- Public Water Supply Contributor
- ORW for ACEC
- ORW for both Water Supply and Other

FIGURE 4.3

Well and Water Main Extension
Harvard & Boxborough, MA

Environmental Receptors Map

Weston & Sampson

Path: \\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\Wetland Delineation Report\Wetland Delineation Report\GIS\Maps\Environmental Receptor Fig 4.4.mxd **User:** Page.Hailey **Saved:** 2/6/2023 12:28:14 PM **Opened:** 2/6/2023 12:28:47 PM

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- Bank-Pond
- Approximate Upland Island
- Bank - Intermittent Stream
- Bank -Perennial Stream
- Isolated Vegetated Wetland
- Bordering Vegetated Wetland
- MassDOT Roads
- Marsh/Bog
- Wooded marsh
- Cranberry Bog
- Salt Marsh
- Open Water
- Reservoir (with PWSID)
- Tidal Flats
- Beach/Dune
- MA Towns
- ACECs
- NHESP Estimated Habitats of Rare Wildlife
- NHESP Priority Habitats of Rare Species
- NHESP Certified Vernal Pools
- NHESP Potential Vernal Pools
- Cold Water Fisheries
- Public Water Supply Contributor
- ORW for ACEC
- ORW for both Water Supply and Other

FIGURE 4.4

Well and Water Main Extension
Harvard & Boxborough, MA

Environmental Receptors Map

Weston & Sampson

Path: \\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\Wetland Delineation Report\Wetland Delineation Report\GIS\Maps\Environmental Receptor Fig 1.5.mxd **User:** Page.Hailey **Saved:** 2/6/2023 12:00:57 PM **Opened:** 2/6/2023 12:02:40 PM

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- Bank-Pond
- Approximate Upland Island
- Bank - Intermittent Stream
- Bank -Perennial Stream
- Isolated Vegetated Wetland
- Bordering Vegetated Wetland
- MassDOT Roads
- Marsh/Bog
- Wooded marsh
- Cranberry Bog
- Salt Marsh
- Open Water
- Reservoir (with PWSID)
- Tidal Flats
- Beach/Dune
- MA Towns
- ACECs
- NHESP Estimated Habitats of Rare Wildlife
- NHESP Priority Habitats of Rare Species
- NHESP Certified Vernal Pools
- NHESP Potential Vernal Pools
- Cold Water Fisheries
- Public Water Supply Contributor
- ORW for ACEC
- ORW for both Water Supply and Other

FIGURE 4.5

Well and Water Main Extension
Harvard & Boxborough, MA

Environmental Receptors Map

Weston & Sampson

Path: \\wse03.local\WSE\Projects\MA\Littleton MA\Digital Property New Source Approval\008 Permitting\Wetland Delineation Report\Wetland Delineation Report\GIS\Maps\Environmental Receptor Fig 4.6.mxd **User:** Page.Hailey **Saved:** 2/8/2023 2:05:55 PM **Opened:** 2/8/2023 2:06:18 PM

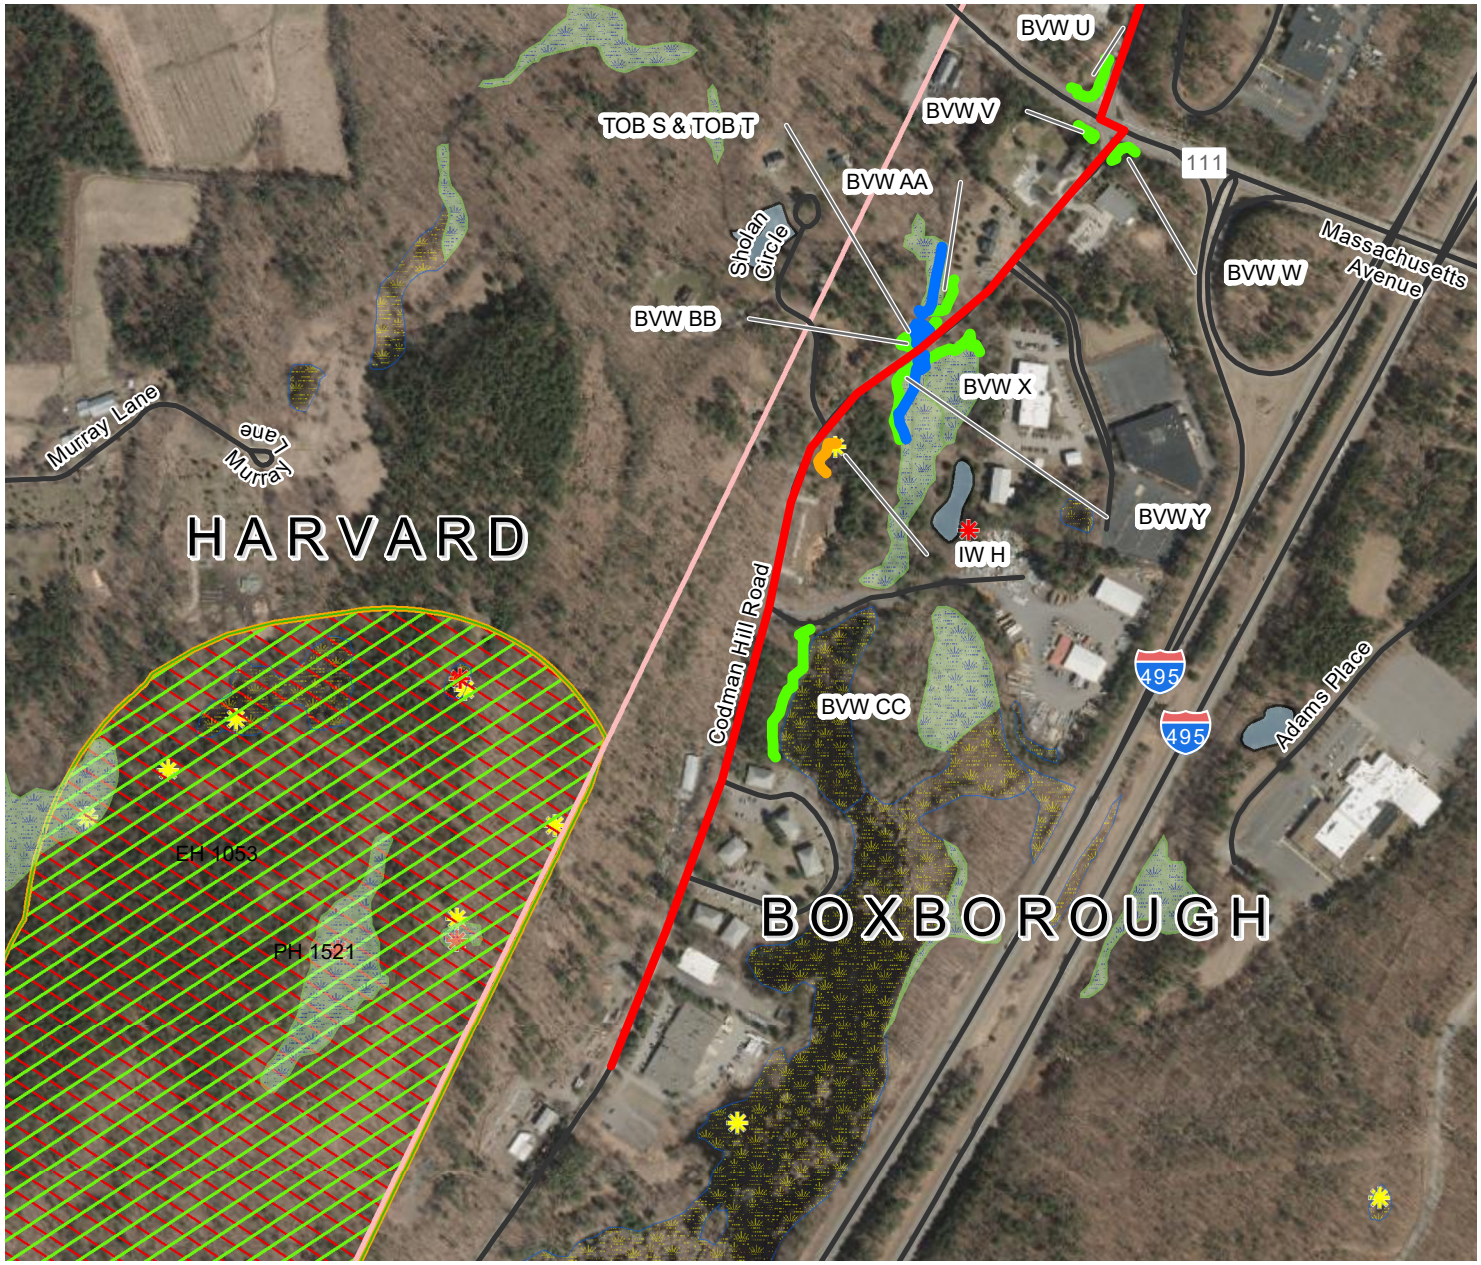

Data Source: Office of Geographic and Environmental Information (MassGIS), Commonwealth of Massachusetts Executive Office of Environmental Affairs

Legend

- Raw Extension
- Finish Extension
- Bank-Pond
- Approximate Upland Island
- Bank - Intermittent Stream
- Bank -Perennial Stream
- Isolated Vegetated Wetland
- Bordering Vegetated Wetland
- MassDOT Roads
- Marsh/Bog
- Wooded marsh
- Cranberry Bog
- Salt Marsh
- Open Water
- Reservoir (with PWSID)
- Tidal Flats
- Beach/Dune
- MA Towns
- ACECs
- NHESP Estimated Habitats of Rare Wildlife
- NHESP Priority Habitats of Rare Species
- NHESP Certified Vernal Pools
- NHESP Potential Vernal Pools
- Cold Water Fisheries
- Public Water Supply Contributor
- ORW for ACEC
- ORW for both Water Supply and Other

FIGURE 4.6

Well and Water Main Extension
Harvard & Boxborough, MA

Environmental Receptors Map

Weston & Sampson

APPENDIX A

ACOE Wetland Determination Data Forms

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW A Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Quonset sandy loam NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: BVW A Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	10	Yes	FAC
2. *Pinus strobus*	10	Yes	FACU
3. *Ulmus americana*	5	No	FACW
4. *Quercus alba*	1	No	FACU
5.			
6.			
7.			
	26	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Pinus strobus*	5	Yes	FACU
2. *Quercus alba*	1	No	FACU
3. *Clethra alnifolia*	5	Yes	FAC
4.			
5.			
6.			
7.			
	11	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Carex pensylvanica*	1	No	UPL
2. *Euthamia graminifolia*	5	Yes	FAC
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	6	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 60.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW A Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-4	10YR 3/2	100					Sandy	FSL
4-14	10YR 4/6	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW A WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X	No	Depth (inches): 0	
Water Table Present?	Yes X	No	Depth (inches): 0	
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0	**Wetland Hydrology Present?** **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW A WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	15	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	15	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Clethra alnifolia*	25	Yes	FAC
2. *Acer rubrum*	5	No	FAC
3. *Vaccinium corymbosum*	5	No	FACW
4. Rosa multiflora	5	No	FACU
5.			
6.			
7.			
	40	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Scirpus cyperinus*	50	Yes	OBL
2. *Onoclea sensibilis*	10	No	FACW
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	60	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW A WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	%	Redox Features Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
16-0	10YR 2/1	100					Muck	Organic

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- X Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/18/2023

Applicant/Owner: State: MA Sampling Point: BVW AA Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-15

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hollis-Rock Outcrop Charlton Complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW AA Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	10	Yes	FACU
2. *Quercus rubra*	25	Yes	FACU
3. *Carya cordiformis*	1	No	FAC
4.			
5.			
6.			
7.			
	36	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Fagus grandifolia*	5	Yes	FACU
2. *Viburnum acerifolium*	1	No	UPL
3.			
4.			
5.			
6.			
7.			
	6	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Carex pensylvanica*	5	Yes	FACU
2. *Toxicodendron radicans*	5	Yes	FACU
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	10	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 0 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 0.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	1	x 3 =	3
FACU species	40	x 4 =	160
UPL species	1	x 5 =	5
Column Totals:	42 (A)		168 (B)

Prevalence Index = B/A = 4.00

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW AA Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-10	10YR 3/2	100					Sandy	FSL
10-12	10YR 4/3	100					Sandy	FSL
12-16	10YR 4/4	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ____ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/18/2023

Applicant/Owner: State: MA Sampling Point: BVW AA WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PFO1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes X	No	**within a Wetland?** **Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches): 0	
Water Table Present?	Yes X	No	Depth (inches): 4	
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0	**Wetland Hydrology Present?** **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW AA WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Onoclea sensibilis*	50	Yes	FACW
2. *Osmundastrum cinnamomeum*	25	Yes	FACW
3. *Solidago canadensis*	25	Yes	FACU
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	100 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 66.7% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW AA WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	Matrix %	Redox Features Color (moist)	Redox Features %	Redox Features Type[1]	Redox Features Loc[2]	Texture	Remarks
24-0	10YR 2/1	100					Mucky Peat	Organic: Fibric

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- X Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx) .

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW B Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Quonset sandy loam NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW B Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	10	Yes	FAC
2. *Pinus strobus*	10	Yes	FACU
3. *Ulmus americana*	5	No	FACW
4. *Quercus alba*	1	No	FACU
5.			
6.			
7.			
	26	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Pinus strobus*	5	Yes	FACU
2. *Quercus alba*	1	No	FACU
3. *Clethra alnifolia*	5	Yes	FAC
4.			
5.			
6.			
7.			
	11	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Carex pensylvanica*	1	No	UPL
2. *Euthamia graminifolia*	5	Yes	FAC
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	6	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 60.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	5	x 2 =	10
FAC species	20	x 3 =	60
FACU species	17	x 4 =	68
UPL species	1	x 5 =	5
Column Totals:	43 (A)		143 (B)

Prevalence Index = B/A = 3.33

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW B Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-4	10YR 3/2	100					Sandy	FSL
4-14	10YR 4/6	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW B WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X No	Depth (inches):	0
Water Table Present?	Yes X No	Depth (inches):	0
Saturation Present? (includes capillary fringe)	Yes X No	Depth (inches):	0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW B WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	15	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	15	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Clethra alnifolia*	25	Yes	FAC
2. *Acer rubrum*	5	No	FAC
3. *Vaccinium corymbosum*	5	No	FACW
4. Rosa multiflora	5	No	FACU
5.			
6.			
7.			
	40	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Scirpus cyperinus*	50	Yes	OBL
2. *Onoclea sensibilis*	10	No	FACW
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	60	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW B WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	Matrix %	Redox Features Color (moist)	Redox Features %	Redox Features Type[1]	Redox Features Loc[2]	Texture	Remarks
16-0	10YR 2/1	100					Muck	Organic

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/18/2023

Applicant/Owner: State: MA Sampling Point: BVW BB Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-15

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hollis-Rock Outcrop Charlton Complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: BVW BB Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	10	Yes	FAC
2. *Pinus strobus*	15	Yes	FACU
3. *Quercus robur*	10	Yes	UPL
4.			
5.			
6.			
7.			
	35	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Lonicera morrowii*	5	Yes	FACU
2. *Fagus grandifolia*	5	Yes	FACU
3. *Pinus strobus*	1	No	FACU
4.			
5.			
6.			
7.			
	11	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Carex pensylvanica*	5	Yes	FACU
2. *Toxicodendron radicans*	5	Yes	FAC
3. *Chimaphila maculata*	1	No	UPL
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	11	=Total Cover	
Woody Vine Stratum (Plot size: 30 ft radius)			
1. *Toxicodendron radicans*	5	Yes	FAC
2.			
3.			
4.			
	5	=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 8 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 25.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	15	x 3 =	45
FACU species	26	x 4 =	104
UPL species	11	x 5 =	55
Column Totals:	52 (A)		204 (B)

Prevalence Index = B/A = 3.92

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW BB Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-10	10YR 3/2	100					Sandy	FSL
10-12	10YR 4/3	100					Sandy	FSL
12-16	10YR 4/4	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ____ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/18/2023

Applicant/Owner: State: MA Sampling Point: BVW BB WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PFO1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X No	Depth (inches):	0
Water Table Present?	Yes X No	Depth (inches):	0
Saturation Present? (includes capillary fringe)	Yes X No	Depth (inches):	0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW BB WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	5	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	5	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Viburnum nudum*	5	Yes	FACW
2. *Cornus sericea*	5	Yes	FACW
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Osmundastrum cinnamomeum*	25	Yes	OBL
2. *Toxicodendron radicans*	15	Yes	OBL
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	40	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 5 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW BB WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
3-0	10YR 2/1	100					Mucky Peat	Organic: Fibric
0-8	10YR 2/1	100					Sandy	FSL
8-12	10YR 3/1	95	10YR 3/6	5			Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx) .

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW C Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Quonset sandy loam NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW C Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	25	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	25	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Rosa multiflora*	10	Yes	FACU
2. *Acer rubrum*	5	Yes	FAC
3. *Carya cordiformis*	5	Yes	FAC
4. *Berberis thunbergii*	1	No	FACU
5.			
6.			
7.			
	21	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Carex pensylvanica*	10	Yes	FACW
2. *Euthamia graminifolia*	10	Yes	FAC
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	20	=Total Cover	
Woody Vine Stratum (Plot size:)			
1. *Celastrus orbiculatus*	5	Yes	UPL
2.			
3.			
4.			
	5	=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 5 (A)

Total Number of Dominant Species Across All Strata: 7 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 71.4% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	10	x 2 =	20
FAC species	45	x 3 =	135
FACU species	11	x 4 =	44
UPL species	5	x 5 =	25
Column Totals:	71 (A)		224 (B)

Prevalence Index = B/A = 3.15

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW C Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 3/2	100					Sandy	FSL
8-18	10YR 4/6	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW C WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X No	Depth (inches):	2
Water Table Present?	Yes X No	Depth (inches):	2
Saturation Present? (includes capillary fringe)	Yes X No	Depth (inches):	0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW C WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Clethra alnifolia*	5	Yes	FAC
2. *Cephalanthus occidentalis*	5	Yes	OBL
3.			
4.			
5.			
6.			
7.			
	10 =Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Phalaris arundinacea*	20	Yes	OBL
2. *Solidago canadensis*	1	No	FACU
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	21 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW C WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
6-0	10YR 2/1	100					Muck	Organic
0-6	10YR 2/1	100					Sandy	FSL
6-18	2.5Y 4/2	95	10YR 4/6	5			Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/18/2023

Applicant/Owner: State: MA Sampling Point: BVW CC Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 8-15

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hinckley Loamy Sand NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW CC Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	5	No	FAC
2. *Pinus strobus*	50	Yes	FACU
3.			
4.			
5.			
6.			
7.			
	55	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Euonymus alatus*	5	Yes	
2. *Frangula alnus*	5	Yes	FAC
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Mitchella repens*	1	No	FACU
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	1	=Total Cover	
Woody Vine Stratum (Plot size: 30 ft radius)			
1. *Toxicodendron radicans*	5	Yes	FAC
2.			
3.			
4.			
	5	=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 50.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	15	x 3 =	45
FACU species	51	x 4 =	204
UPL species	0	x 5 =	0
Column Totals:	66 (A)		249 (B)

Prevalence Index = B/A = 3.77

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW CC Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-2	10YR 3/2	100					Sandy	FSL
12-14	10YR 3/3	100					Sandy	FSL
14-16	10YR 3/6	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/18/2023

Applicant/Owner: State: MA Sampling Point: BVW CC WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PFO1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X	No	Depth (inches): 0	
Water Table Present?	Yes X	No	Depth (inches): 0	
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0	**Wetland Hydrology Present?** **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:
The area was impacted by beaver activities. The area was delineated as a marsh due to standing vegetation interspersed with open water and no evidence of channelized flow.

VEGETATION – Use scientific names of plants.

Sampling Point: BVW CC WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Typha latifolia*	50	Yes	OBL
2. *Ilex verticillata*	1	No	FACW
3. *Triumfetta semitriloba*	20	Yes	
4.			
5.			
6.			
7.			
	71 =Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Osmundastrum cinnamomeum*	25	Yes	OBL
2. *Toxicodendron radicans*	15	Yes	OBL
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	40 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 75.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW CC WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	%	Redox Features Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
24-0	10YR 2/1	100					Mucky Peat	Organic: Fibric

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx) .

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW D Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 15-25

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hinckley loamy sand NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW D Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	25	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	25	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Rosa multiflora*	10	Yes	FACU
2. *Acer rubrum*	10	Yes	FAC
3. *Carya cordiformis*	5	No	FAC
4. *Berberis thunbergii*	1	No	FACU
5.			
6.			
7.			
	26	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Carex pensylvanica*	10	Yes	FACW
2. *Euthamia graminifolia*	10	Yes	FAC
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	20	=Total Cover	
Woody Vine Stratum (Plot size:)			
1. *Celastrus orbiculatus*	5	Yes	UPL
2.			
3.			
4.			
	5	=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 4 (A)

Total Number of Dominant Species Across All Strata: 6 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 66.7% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	10	x 2 =	20
FAC species	50	x 3 =	150
FACU species	11	x 4 =	44
UPL species	5	x 5 =	25
Column Totals:	76 (A)		239 (B)

Prevalence Index = B/A = 3.14

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW D Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-10	10YR 3/2	100					Sandy	FSL
10-20	10YR 4/6	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

SOIL

Sampling Point: BVW D WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
7-0	10YR 2/1	100					Muck	Organic
0-8	10YR 2/1	100					Sandy	FSL
8-20	2.5Y 4/2	95	10YR 4/6	5			Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW E Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hinckley loamy sand NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW E Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	10	Yes	FAC
2. *Pinus strobus*	10	Yes	FACU
3. *Ulmus americana*	5	No	FACW
4. *Quercus alba*	1	No	FACU
5.			
6.			
7.			
	26	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Pinus strobus*	5	Yes	FACU
2. *Quercus alba*	1	No	FACU
3. *Clethra alnifolia*	5	Yes	FAC
4.			
5.			
6.			
7.			
	11	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Carex pensylvanica*	1	No	UPL
2. *Euthamia graminifolia*	5	Yes	FAC
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	6	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 60.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	5	x 2 =	10
FAC species	20	x 3 =	60
FACU species	17	x 4 =	68
UPL species	1	x 5 =	5
Column Totals:	43	(A)	143 (B)

Prevalence Index = B/A = 3.33

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW E Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-4	10YR 3/2	100					Sandy	FSL
4-14	10YR 4/6	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW E WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-5

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Wareham loamy fine sand NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X No	Depth (inches):	0
Water Table Present?	Yes X No	Depth (inches):	0
Saturation Present? (includes capillary fringe)	Yes X No	Depth (inches):	0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW E WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	15	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	15	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Clethra alnifolia*	25	Yes	FAC
2. *Acer rubrum*	5	No	FAC
3. *Vaccinium corymbosum*	5	No	FACW
4. Rosa multiflora	5	No	FACU
5.			
6.			
7.			
	40	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Scirpus cyperinus*	50	Yes	OBL
2. *Onoclea sensibilis*	10	No	FACW
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	60	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW E WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
16-0	10YR 2/1	100					Muck	Organic

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW F Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 15-25

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hinckley loamy sand NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: BVW F Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	15	Yes	FAC
2. *Ulmus americana*	10	Yes	FACW
3.			
4.			
5.			
6.			
7.			
	25	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Rosa multiflora*	10	Yes	FACU
2.			
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Galium aparine*	5	Yes	FACW
2. *Euthamia graminifolia*	1	No	FAC
3. *Alliaria petiolata*	1	No	FACU
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	7	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 75.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW F Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 3/2	100					Sandy	FSL
8-16	10YR 4/4	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW F WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-5

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Wareham loamy fine sand NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- X Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X	No	Depth (inches):	8
Water Table Present?	Yes X	No	Depth (inches):	8
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches):	2

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW F WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Rosa multiflora*	1	No	FACU
2.			
3.			
4.			
5.			
6.			
7.			
	1 =Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Onoclea sensibilis*	5	Yes	OBL
2. *Carex intumescens5*	5	Yes	FACW
3. *Rubus hispidus*	1	No	FACW
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	11 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 2 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW F WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-4	10YR 2/1	100					Muck	Organic
4-10	10YR 2/1	95	10YR 4/6	5			Sandy	FSL
10-18	2.5Y 4/2	95	10YR 4/6	5			Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW G Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hinckley loamy sand NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW G Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	15	Yes	FAC
2. *Ulmus americana*	10	Yes	FACW
3.			
4.			
5.			
6.			
7.			
	25	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Rosa multiflora*	10	Yes	FACU
2.			
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Galium aparine*	5	Yes	FACW
2. *Euthamia graminifolia*	1	No	FAC
3. *Alliaria petiolata*	1	No	FACU
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	7	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 75.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW G Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 3/2	100					Sandy	FSL
8-16	10YR 4/6	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW G WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Wareham loamy fine sand NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes X	No	**within a Wetland?** **Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- X Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X	No	Depth (inches): 8
Water Table Present?	Yes X	No	Depth (inches): 8
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 3

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW G WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	10	Yes	FAC
2. *Ulmus americana*	5	Yes	FACW
3.			
4.			
5.			
6.			
7.			
	15	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
		=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Onoclea sensibilis*	10	No	OBL
2. *Bidens frondosa*	50	Yes	FACW
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	60	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW G WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-3	10YR 2/1	100					Muck	Organic
3-8	10YR 2/1	95	10YR 4/6	5			Sandy	FSL
8-16	2.5Y 4/2	95	10YR 4/6	5			Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/7/2022

Applicant/Owner: State: MA Sampling Point: BVW I Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-15

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hollis-Rock outcrop-Charlton complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: BVW I Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	5	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	5	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
		=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Phalaris arundinacea*	15	Yes	FACW
2. *Alliaria petiolata*	25	Yes	FACU
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	40	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 66.7% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	15	x 2 =	30
FAC species	5	x 3 =	15
FACU species	25	x 4 =	100
UPL species	0	x 5 =	0
Column Totals:	45 (A)		145 (B)

Prevalence Index = B/A = 3.22

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW I Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 3/2	100					Sandy	FSL
8-12	10YR 4/6	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: impermeable

Depth (inches): 12

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/7/2022

Applicant/Owner: State: MA Sampling Point: BVW I WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Swansea muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- X Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- X Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):	
Water Table Present?	Yes	No X	Depth (inches):	
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 6	

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW I WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Onoclea sensibilis*	75	Yes	OBL
2. Barbarea vulgaris	15	No	FAC
3. *Galium aparine*	10	No	FACU
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	100 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 1 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW I WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-6	10YR 3/2	100					Sandy	FSL
6-12	10YR 3/2	95	10YR 4/6	5			Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: impermeable

Depth (inches): 12

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/7/2022

Applicant/Owner: State: MA Sampling Point: BVW J Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-15

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hollis-Rock outcrop-Charlton complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW J Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Ulmus americana*	10	Yes	FACW
2.			
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Euonymus alatus*	15	Yes	UPL
2.			
3.			
4.			
5.			
6.			
7.			
	15	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
		=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 2 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 50.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	10	x 2 =	20
FAC species	0	x 3 =	0
FACU species	0	x 4 =	0
UPL species	15	x 5 =	75
Column Totals:	25	(A)	95 (B)

Prevalence Index = B/A = 3.80

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW J Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-4	10YR 3/2	100					Sandy	FSL
4-8	10YR 3/3	100					Sandy	FSL
8-16	10YR 3/4	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/7/2022

Applicant/Owner: State: MA Sampling Point: BVW J WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-5

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Wareham loamy fine sand NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X No	Depth (inches):	2
Water Table Present?	Yes X No	Depth (inches):	2
Saturation Present? (includes capillary fringe)	Yes X No	Depth (inches):	0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW J WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	5	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	5	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Swida sericea*	25	Yes	FACW
2. *Rosa multiflora*	5	No	FACU
3.			
4.			
5.			
6.			
7.			
	30	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Onoclea sensibilis*	25	Yes	OBL
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	25	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW J WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-6	10YR 2/1	100					Sandy	FSL
6-9	10YR 3/1	95	10YR 3/6	5			Sandy	FSL
9-16	2.5Y 4/2	95	10YR 4/6	5			Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW K Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-15

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hollis-Rock outcrop-Charlton complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW K Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	15	Yes	FACU
2. *Tsuga canadensis*	5	Yes	FACU
3. *Quercus alba*	1	No	FACU
4.			
5.			
6.			
7.			
	21	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Quercus alba*	5	Yes	FACU
2. *Tsuga canadensis*	1	No	FACU
3.			
4.			
5.			
6.			
7.			
	6	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Veronica officinalis*	1	No	OBL
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	1	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 0 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 0.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	1	x 1 =	1
FACW species	0	x 2 =	0
FAC species	0	x 3 =	0
FACU species	27	x 4 =	108
UPL species	0	x 5 =	0
Column Totals:	28	(A)	109 (B)

Prevalence Index = B/A = 3.89

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW K Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-10	10YR 3/2	100					Sandy	FSL
10-14	10YR 4/6	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ____ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW K WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-15

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hollis-Rock outcrop-Charlton complex NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X No	Depth (inches):	0
Water Table Present?	Yes X No	Depth (inches):	0
Saturation Present? (includes capillary fringe)	Yes X No	Depth (inches):	0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW K WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	5	Yes	FAC
2. *Ulmus americana*	1	No	FACW
3.			
4.			
5.			
6.			
7.			
	6	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Vaccinium corymbosum*	15	Yes	FACW
2. *Acer rubrum*	1	No	FAC
3. *Lindera benzoin*	1	No	FACW
4.			
5.			
6.			
7.			
	17	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Onoclea sensibilis*	10	Yes	OBL
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	10	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW K WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	Matrix %	Redox Features Color (moist)	Redox Features %	Redox Features Type[1]	Redox Features Loc[2]	Texture	Remarks
15-0	10YR 2/1	100					Mucky Peat	Organic

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW L Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 8-15

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Charlton-Hollis-Rock outcrop complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**		
Hydric Soil Present?	Yes	No X	**within a Wetland?**	**Yes**	**No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:		

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: BVW L Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	25	Yes	FACU
2. *Betula papyrifera*	1	No	FACU
3. *Quercus alba*	20	Yes	FACU
4.			
5.			
6.			
7.			
	46	=Total Cover	

Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Quercus alba*	5	Yes	FACU
2.			
3.			
4.			
5.			
6.			
7.			
	5	=Total Cover	

Herb Stratum (Plot size: 5 ft radius)			
1. *Lycopodium obscurum*	5	Yes	OBL
2. *Carex pensylvanica*	5	Yes	UPL
3. *Mitchella repens*	1	No	FACU
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	11	=Total Cover	

Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 20.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	5	x 1 =	5
FACW species	0	x 2 =	0
FAC species	0	x 3 =	0
FACU species	52	x 4 =	208
UPL species	5	x 5 =	25
Column Totals:	62	(A)	238 (B)

Prevalence Index = B/A = 3.84

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW L Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-6	10YR 3/3	100					Sandy	FSL
6-9	10YR 4/4	100					Sandy	FSL
9-14	10YR 5/6	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW L WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):	
Water Table Present?	Yes X	No	Depth (inches):	8
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches):	0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW L WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	5	Yes	FAC
2. *Ulmus americana*	1	No	FACW
3. *Pinus strobus*	5	Yes	FACU
4.			
5.			
6.			
7.			
	11	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Vaccinium corymbosum*	5	Yes	FACW
2. *Ilex verticillata*	1	No	FACW
3.			
4.			
5.			
6.			
7.			
	6	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Onoclea sensibilis*	10	Yes	OBL
2. *Osmundastrum cinnamomeum*	5	Yes	FACW
3. *Symplocarpus foetidus*	5	Yes	OBL
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	20	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 5 (A)

Total Number of Dominant Species Across All Strata: 6 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 83.3% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW L WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	%	Redox Features Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
24-0	10YR 2/1	100					Mucky Peat	Organic

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW M Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 8-15

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Paxton fine sandy loam NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW M Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	25	Yes	FACU
2. *Quercus alba*	10	Yes	FACU
3.			
4.			
5.			
6.			
7.			
	35	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Pinus strobus*	5	Yes	FACU
2.			
3.			
4.			
5.			
6.			
7.			
	5	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Dryopteris intermedia*	5	Yes	FAC
2. *Carex pensylvanica*	10	Yes	UPL
3. *Mitchella repens*	1	No	FACU
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	16	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 0 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 0.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	0	x 3 =	0
FACU species	41	x 4 =	164
UPL species	10	x 5 =	50
Column Totals:	51	(A)	214 (B)

Prevalence Index = B/A = 4.20

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW M Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 3/2	100					Sandy	FSL
8-16	10YR 4/6	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW M WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- X Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 8

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW M WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	1	No	FACU
2. *Ulmus americana*	1	No	FACW
3.			
4.			
5.			
6.			
7.			
	2	=Total Cover	

Sapling/Shrub Stratum (Plot size: 15 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Rhamnus cathartica*	5	Yes	FACW
2. *Alnus incana*	5	Yes	FACW
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	

Herb Stratum (Plot size: 5 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Dryopteris intermedia*	10	Yes	FAC
2. *Symplocarpus foetidus*	5	Yes	OBL
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	15	=Total Cover	

Woody Vine Stratum (Plot size:)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 75.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW M WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
16-0	10YR 2/1	100					Mucky Peat	Organic
0-4	2.5Y 4/1	98	10YR 3/6	2			Sandy	Sand

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- X Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW N Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hinckley loamy sand NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW N Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	20	Yes	FACU
2. *Quercus alba*	30	Yes	FACU
3. *Betula papyrifera*	5	No	FACU
4.			
5.			
6.			
7.			
	55	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Pinus strobus*	1	No	FACU
2.			
3.			
4.			
5.			
6.			
7.			
	1	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Dryopteris intermedia*	5	Yes	FACU
2. *Carex pensylvanica*	5	Yes	UPL
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	10	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 0 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 0.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	0	x 3 =	0
FACU species	61	x 4 =	244
UPL species	5	x 5 =	25
Column Totals:	66	(A)	269 (B)

Prevalence Index = B/A = 4.08

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW N Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-6	10YR 3/2	100					Sandy	FSL
6-10	10YR 4/4	100					Sandy	FSL
10-16	10YR 4/6	100					Sandy	LFS

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW N WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X No	Depth (inches):	0
Water Table Present?	Yes X No	Depth (inches):	0
Saturation Present? (includes capillary fringe)	Yes X No	Depth (inches):	0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW N WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Phragmites australis*	50	Yes	FAC
2. *Typha*	30	Yes	OBL
3. *Carex stricta*	20	Yes	OBL
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	100 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 66.7% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW N WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	%	Redox Features Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
24-0	10YR 2/1	100					Mucky Peat	Organic

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW O&P Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Windsor loamy sand NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW O&P Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	25	Yes	FACU
2. *Acer rubrum*	5	No	FAC
3. *Quercus rubra*	10	Yes	FACU
4.			
5.			
6.			
7.			
	40	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Pinus strobus*	1	No	FACU
2. *Quercus alba*	5	Yes	FACU
3.			
4.			
5.			
6.			
7.			
	6	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Dryopteris intermedia*	5	Yes	FAC
2. *Carex pensylvanica*	5	Yes	UPL
3. *Chimaphila maculata*	1	No	UPL
4. *Lycopodium obscurum*	5	Yes	FACU
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	16	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 6 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 16.7% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	10	x 3 =	30
FACU species	46	x 4 =	184
UPL species	6	x 5 =	30
Column Totals:	62 (A)		244 (B)

Prevalence Index = B/A = 3.94

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW O&P Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-3	10YR 3/2	100					Sandy	FSL
3-10	10YR 4/3	100					Sandy	FSL
10-14	10YR 4/4	100					Sandy	LFS

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ____ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: BVW O&P WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- X Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 4

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW O&P WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	15	Yes	FAC
2. *Pinus strobus*	1	No	FACU
3. *Ulmus americana*	5	Yes	FACW
4.			
5.			
6.			
7.			
	21	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Ilex verticillata*	25	Yes	FACW
2. *Vaccinium corymbosum*	5	No	FACW
3. *Pinus strobus*	1	No	FACU
4.			
5.			
6.			
7.			
	31	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Osmundastrum cinnamomeum*	5	Yes	FACW
2. *Dryopteris intermedia*	5	Yes	FAC
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	10	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 60.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW O&P WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	%	Redox Features Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
12-0	10YR 2/1	100					Mucky Peat	Organic

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- X Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: Impermeable

Depth (inches): 12

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/21/2022

Applicant/Owner: State: MA Sampling Point: BVW Q Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Windsor loamy sand NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW Q Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	5	Yes	FACU
2. *Acer rubrum*	5	Yes	FAC
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Sumac*	10	Yes	FACU
2.			
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Dryopteris intermedia*	5	Yes	FAC
2. *Rubus hispidoides*	1	No	FACW
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	6	=Total Cover	
Woody Vine Stratum (Plot size:)			
1. *Vitis riparia*	5	Yes	FAC
2. *Celastrus orbiculatus*	1	No	UPL
3.			
4.			
	6	=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 60.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	1	x 2 =	2
FAC species	15	x 3 =	45
FACU species	15	x 4 =	60
UPL species	1	x 5 =	5
Column Totals:	32 (A)		112 (B)

Prevalence Index = B/A = 3.50

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW Q Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-6	10YR 3/2	100					Sandy	FSL
6-8	10YR 3/3	100					Sandy	FSL
8-16	10YR 4/3	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/21/2022

Applicant/Owner: State: MA Sampling Point: BVW Q WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X No	Depth (inches):	0
Water Table Present?	Yes X No	Depth (inches):	0
Saturation Present? (includes capillary fringe)	Yes X No	Depth (inches):	0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW Q WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	25	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	25	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Ilex verticillata*	10	Yes	FACW
2. *Acer rubrum*	5	Yes	FAC
3.			
4.			
5.			
6.			
7.			
	15	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Osmundastrum cinnamomeum*	15	Yes	FACW
2. *Symplocarpus foetidus*	5	Yes	FAC
3. *Onoclea sensibilis*	5	Yes	FACW
4. *Carex stricta*	5	Yes	OBL
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	30	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 4 (A)

Total Number of Dominant Species Across All Strata: 7 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 57.1% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW Q WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	%	Redox Features Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
24-0	10YR 2/1	100					Mucky Peat	Organic

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- X Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/21/2022

Applicant/Owner: State: MA Sampling Point: BVW R Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Windsor loamy sand NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW R Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Quercus rubra*	10	Yes	FACU
2. *Acer rubrum*	5	Yes	FAC
3. *Quercus phellos*	10	Yes	FACW
4.			
5.			
6.			
7.			
	25	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Rhamnus cathartica*	10	Yes	FACU
2.			
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Lolium perenne*	25	Yes	FACU
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	25	=Total Cover	
Woody Vine Stratum (Plot size:)			
1. *Vitis riparia*	5	Yes	FAC
2. *Celastrus orbiculatus*	1	No	UPL
3.			
4.			
	6	=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 6 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 50.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	10	x 2 =	20
FAC species	10	x 3 =	30
FACU species	45	x 4 =	180
UPL species	1	x 5 =	5
Column Totals:	66 (A)		235 (B)

Prevalence Index = B/A = 3.56

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW R Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-16	10YR 3/3	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ____ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

Located in a roadway embankment.

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/21/2022

Applicant/Owner: State: MA Sampling Point: BVW R WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- X Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW R WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	50	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	50	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Ilex verticillata*	15	Yes	FACW
2. *Acer rubrum*	5	Yes	FAC
3. *Quercus alba*	1	No	FACU
4.			
5.			
6.			
7.			
	21	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Osmundastrum cinnamomeum*	15	Yes	FACW
2. *Juncus effusus*	5	No	OBL
3. *Onoclea sensibilis*	10	Yes	FACW
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	30	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 60.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW R WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	%	Redox Features Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
24-0	10YR 2/1	100					Mucky Peat	Organic

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/21/2022

Applicant/Owner: State: MA Sampling Point: BVW S Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%):

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Udorthents-Urban land complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: BVW S Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	50	Yes	FACU
2. *Quercus rubra*	5	No	FACU
3.			
4.			
5.			
6.			
7.			
	55	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Quercus alba*	5	Yes	FACU
2. *Rhamnus cathartica*	10	Yes	FAC
3.			
4.			
5.			
6.			
7.			
	15	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Pteridium aquilinum*	5	Yes	FACU
2. *Solidago canadensis*	1	No	FACU
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	6	=Total Cover	
Woody Vine Stratum (Plot size:)			
1. *Vitis riparia*	2	No	FAC
2. *Celastrus orbiculatus*	2	No	UPL
3.			
4.			
	4	=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 0 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 0.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	2	x 3 =	6
FACU species	61	x 4 =	244
UPL species	2	x 5 =	10
Column Totals:	65	(A)	260 (B)

Prevalence Index = B/A = 4.00

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW S Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-6	10YR 3/3	100					Sandy	FSL
6-12	10YR 4/3	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/21/2022

Applicant/Owner: State: MA Sampling Point: BVW S WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Swansea muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- X Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW S WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Rhamnus cathartica*	1	No	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	1 =Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Microstegium vimineum*	50	Yes	FAC
2. *Bidens discoidea*	5	No	FACW
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	55 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 1 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)
Prevalence Index = B/A =	

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW S WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	%	Redox Features Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
24-0	10YR 2/1	100					Mucky Peat	Organic

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/5/2023

Applicant/Owner: State: MA Sampling Point: BVW T Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%):

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Udorthents-Urban land complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: BVW T Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	1	No	FACU
2. *Quercus rubra*	25	Yes	FACU
3.			
4.			
5.			
6.			
7.			
	26	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Quercus alba*	5	Yes	FACU
2. *Pinus strobus*	5	Yes	FACU
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Toxicodendron radicans*	10	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	10	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 25.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	10	x 3 =	30
FACU species	36	x 4 =	144
UPL species	0	x 5 =	0
Column Totals:	46 (A)		174 (B)

Prevalence Index = B/A = 3.78

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW T Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-5	10YR 3/3	100					Sandy	FSL
5-12	10YR 4/3	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/5/2023

Applicant/Owner: State: MA Sampling Point: BVW T WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X	No	Depth (inches): 0	
Water Table Present?	Yes X	No	Depth (inches): 0	
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0	**Wetland Hydrology Present?** **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW T WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	20	Yes	FAC
2. *Pinus strobus*	5	Yes	FACU
3.			
4.			
5.			
6.			
7.			
	25	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Ilex verticillata*	15	Yes	FACW
2. *Vaccinium corymbosum*	15	Yes	FACW
3. *Acer rubrum*	5	No	FAC
4. *Rosa multiflora*	1	No	FACU
5.			
6.			
7.			
	36	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Onoclea sensibilis*	25	Yes	FAC
2. *Toxicodendron radicans*	5	No	FAC
3. *Juncus effusus*	10	Yes	OBL
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	40	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 6 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 50.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	10	x 1 =	10
FACW species	0	x 2 =	0
FAC species	55	x 3 =	165
FACU species	6	x 4 =	24
UPL species	0	x 5 =	0
Column Totals:	71	(A)	199 (B)

Prevalence Index = B/A = 2.80

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

X 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW T WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 3/2	100					Sandy	FSL
8-14	10YR 3/2	95	10YR 4/6	5			Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/5/2023

Applicant/Owner: State: MA Sampling Point: BVW U Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%):

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Udorthents-Urban land complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: BVW U Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Toxicodendron radicans*	10	No	FAC
2. *Fallopia japonica*	50	Yes	FACU
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	60 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 0 (A)

Total Number of Dominant Species Across All Strata: 1 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 0.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	10	x 3 =	30
FACU species	50	x 4 =	200
UPL species	0	x 5 =	0
Column Totals:	60 (A)		230 (B)

Prevalence Index = B/A = 3.83

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)
Uplands are along the road edge and have riprap-covered slopes. (Road Shoulder).

SOIL

Sampling Point: BVW U Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-3	10YR 3/3	100					Sandy	FSL
3-12	10YR 4/3	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/5/2023

Applicant/Owner: State: MA Sampling Point: BVW U WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%):

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Udorthents-Urban land complex NWI classification: PFO1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X	No	Depth (inches): 0	
Water Table Present?	Yes X	No	Depth (inches): 0	
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0	**Wetland Hydrology Present?** **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW U WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Fallopia japonica*	25	Yes	FACU
2. *Typha*	50	Yes	OBL
3. *Lythrum salicaria*	25	Yes	OBL
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	100 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 66.7% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW U WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-6	10YR 3/2	100					Sandy	FSL
6-12	10YR 3/2	95	10YR 4/6	5			Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/5/2023

Applicant/Owner: State: MA Sampling Point: BVW V Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Merrimac Fine Sandy Loam NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW V Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Fallopia japonica*	50	Yes	FACU
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	50 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 0 (A)

Total Number of Dominant Species Across All Strata: 1 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 0.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	0	x 3 =	0
FACU species	0	x 4 =	0
UPL species	0	x 5 =	0
Column Totals:	0 (A)		0 (B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)
Rock Slope.

SOIL

Sampling Point: BVW V Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-3	10YR 3/3	100					Sandy	FSL
3-12	10YR 4/3	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/5/2023

Applicant/Owner: State: MA Sampling Point: BVW V WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Merrimac Fine Sandy Loam NWI classification: PFO1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X	No	Depth (inches): 0	
Water Table Present?	Yes X	No	Depth (inches): 0	
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0	**Wetland Hydrology Present?** **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW V WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Fallopia japonica*	10	Yes	FACU
2. *Phragmites australis*	20	Yes	OBL
3. *Lythrum salicaria*	5	No	OBL
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	35 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 2 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 50.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	25	x 1 =	25
FACW species	0	x 2 =	0
FAC species	0	x 3 =	0
FACU species	10	x 4 =	40
UPL species	0	x 5 =	0
Column Totals:	35 (A)		65 (B)

Prevalence Index = B/A = 1.86

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

X 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW V WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 3/2	100					Sandy	SL
8-16	10YR 3/2	95	10YR 4/6	5			Sandy	SL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx) . Soils had thick drainage sand present.

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/5/2023

Applicant/Owner: State: MA Sampling Point: BVW W Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Merrimac Fine Sandy Loam NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW W Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	50	Yes	FACU
2.			
3.			
4.			
5.			
6.			
7.			
	50	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Pinus strobus*	5	Yes	FACU
2.			
3.			
4.			
5.			
6.			
7.			
	5	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Fallopia japonica*	50	Yes	FACU
2. *Ilex verticillata*	5	No	FACW
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	55	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 0 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 0.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	5	x 2 =	10
FAC species	0	x 3 =	0
FACU species	55	x 4 =	220
UPL species	0	x 5 =	0
Column Totals:	60	(A)	230 (B)

Prevalence Index = B/A = 3.83

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)
Rock Slope.

SOIL

Sampling Point: BVW W Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-5	10YR 3/3	100					Sandy	FSL
5-10	10YR 4/3	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/5/2023

Applicant/Owner: State: MA Sampling Point: BVW W WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Merrimac Fine Sandy Loam NWI classification: PFO1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X	No	Depth (inches): 0	
Water Table Present?	Yes X	No	Depth (inches): 0	
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0	**Wetland Hydrology Present?** **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW W WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Fallopia japonica*	5	Yes	FACU
2. *Lythrum salicaria*	5	Yes	OBL
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	10 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 2 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 50.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	5	x 1 =	5
FACW species	0	x 2 =	0
FAC species	0	x 3 =	0
FACU species	5	x 4 =	20
UPL species	0	x 5 =	0
Column Totals:	10 (A)		25 (B)

Prevalence Index = B/A = 2.50

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

X 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW W WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 3/2	100					Sandy	SL
8-16	10YR 3/2	95	10YR 4/6	5			Sandy	SL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx) . Soils had thick drainage sand present.

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/18/2023

Applicant/Owner: State: MA Sampling Point: BVW X Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-15

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hollis-Rock Outcrop Charlton Complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW X Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	10	Yes	FACU
2. *Quercus rubra*	5	Yes	FACU
3.			
4.			
5.			
6.			
7.			
	15	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Ulmus americana*	5	Yes	FACU
2.			
3.			
4.			
5.			
6.			
7.			
	5	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Carex pensylvanica*	50	Yes	FACU
2. *Toxicodendron radicans*	5	No	FAC
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	55	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 0 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 0.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	0	x 3 =	0
FACU species	20	x 4 =	80
UPL species	0	x 5 =	0
Column Totals:	20	(A)	80 (B)

Prevalence Index = B/A = 4.00

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW X Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-10	10YR 3/2	100					Sandy	FSL
10-12	10YR 4/3	100					Sandy	FSL
12-16	10YR 4/4	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/18/2023

Applicant/Owner: State: MA Sampling Point: BVW X WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PFO1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes X	No	**within a Wetland?** **Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X	No	Depth (inches): 0
Water Table Present?	Yes X	No	Depth (inches): 0
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: BVW X WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	10	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Acer rubrum*	5	Yes	FAC
2. *Pinus strobus*	5	Yes	FACU
3. *Alnus incana*	5	Yes	FACW
4. *Cornus sericea*	5	Yes	FACW
5. *Lyonia ligustrina*	1	No	FACW
6.			
7.			
	21	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Spphagnum*	1	No	OBL
2. *Lythrum salicaria*	1	No	OBL
3. *Carex stricta*	25	Yes	OBL
4. *Onoclea sensibilis*	10	Yes	FACW
5. *Osmundastrum cinnamomeum*	10	Yes	FACW
6. *Symplocarpus foetidus*	5	No	OBL
7.			
8.			
9.			
10.			
11.			
12.			
	52	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 7 (A)

Total Number of Dominant Species Across All Strata: 8 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 87.5% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW X WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	%	Redox Features Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
24-0	10YR 2/1	100					Mucky Peat	Organic: Fibric

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- X Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx) .

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/18/2023

Applicant/Owner: State: MA Sampling Point: BVW Y Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-15

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hollis-Rock Outcrop Charlton Complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW Y Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	10	Yes	FACU
2. *Quercus rubra*	5	Yes	FACU
3.			
4.			
5.			
6.			
7.			
	15	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Ulmus americana*	5	Yes	FACU
2.			
3.			
4.			
5.			
6.			
7.			
	5	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Carex pensylvanica*	50	Yes	FACU
2. *Toxicodendron radicans*	5	No	FAC
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	55	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 0 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 0.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	0	x 3 =	0
FACU species	20	x 4 =	80
UPL species	0	x 5 =	0
Column Totals:	20 (A)		80 (B)

Prevalence Index = B/A = 4.00

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW Y Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 3/2	100					Sandy	FSL
8-10	10YR 4/3	100					Sandy	FSL
10-16	10YR 4/4	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/18/2023

Applicant/Owner: State: MA Sampling Point: BVW Y WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PFO1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X	No	Depth (inches): 0	
Water Table Present?	Yes X	No	Depth (inches): 0	
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0	**Wetland Hydrology Present?** **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW Y WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	10	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Acer rubrum*	5	Yes	FAC
2. *Pinus strobus*	5	Yes	FACU
3. *Alnus incana*	5	Yes	FACW
4. *Cornus sericea*	5	Yes	FACW
5. *Lyonia ligustrina*	1	No	FACW
6.			
7.			
	21	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Spphagnum*	1	No	OBL
2. *Lythrum salicaria*	1	No	OBL
3. *Carex stricta*	25	Yes	OBL
4. *Onoclea sensibilis*	10	Yes	FACW
5. *Osmundastrum cinnamomeum*	10	Yes	FACW
6. *Symplocarpus foetidus*	5	No	OBL
7.			
8.			
9.			
10.			
11.			
12.			
	52	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 7 (A)

Total Number of Dominant Species Across All Strata: 8 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 87.5% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW Y WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	Matrix %	Redox Features Color (moist)	Redox Features %	Redox Features Type[1]	Redox Features Loc[2]	Texture	Remarks
24-0	10YR 2/1	100					Mucky Peat	Organic: Fibric

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- X Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx) .

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/18/2023

Applicant/Owner: State: MA Sampling Point: BVW Z Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-5

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hollis-Rock Outcrop Charlton Complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: BVW Z Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	10	Yes	FAC
2. *Pinus strobus*	15	Yes	FACU
3. *Quercus robur*	10	Yes	UPL
4.			
5.			
6.			
7.			
	35	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Lonicera morrowii*	5	Yes	FACU
2. *Fagus grandifolia*	5	Yes	FACU
3. *Pinus strobus*	1	No	FACU
4.			
5.			
6.			
7.			
	11	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Carex pensylvanica*	5	Yes	FACU
2. *Toxicodendron radicans*	5	Yes	FAC
3. *Chimaphila maculata*	1	No	UPL
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	11	=Total Cover	
Woody Vine Stratum (Plot size: 30 ft radius)			
1. *Toxicodendron radicans*	5	Yes	FAC
2.			
3.			
4.			
	5	=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 8 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 25.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	15	x 3 =	45
FACU species	26	x 4 =	104
UPL species	11	x 5 =	55
Column Totals:	52 (A)		204 (B)

Prevalence Index = B/A = 3.92

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW Z Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-10	10YR 3/2	100					Sandy	FSL
10-12	10YR 4/3	100					Sandy	FSL
12-16	10YR 4/4	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/18/2023

Applicant/Owner: State: MA Sampling Point: BVW Z WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PFO1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X No	Depth (inches):	0
Water Table Present?	Yes X No	Depth (inches):	0
Saturation Present? (includes capillary fringe)	Yes X No	Depth (inches):	0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW Z WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	5	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	5	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Viburnum nudum*	5	Yes	FACW
2. *Cornus sericea*	5	Yes	FACW
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Osmundastrum cinnamomeum*	25	Yes	OBL
2. *Toxicodendron radicans*	15	Yes	OBL
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	40	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 5 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW Z WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
3-0	10YR 2/1	100					Mucky Peat	Organic: Fibric
0-8	10YR 2/1	100					Sandy	FSL
8-12	10YR 3/1	95	10YR 3/6	5			Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx) .

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 8/17/2023

Applicant/Owner: State: MA Sampling Point: BVW DD Up

Investigator(s): Hailey Page Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Quonset sandy loam NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW DD Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	10	Yes	FAC
2. *Pinus strobus*	10	Yes	FACU
3. *Ulmus americana*	5	No	FACW
4. *Quercus alba*	1	No	FACU
5.			
6.			
7.			
	26	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Pinus strobus*	5	Yes	FACU
2. *Quercus alba*	1	No	FACU
3. *Clethra alnifolia*	5	Yes	FAC
4.			
5.			
6.			
7.			
	11	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Carex pensylvanica*	1	No	UPL
2. *Euthamia graminifolia*	5	Yes	FAC
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	6	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 60.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW DD Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-4	10YR 3/2	100					Sandy	FSL
4-14	10YR 4/6	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 8/17/2023

Applicant/Owner: State: MA Sampling Point: BVW DD WET

Investigator(s): Hailey Page Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes X	No	**within a Wetland?** **Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X	No	Depth (inches): 0
Water Table Present?	Yes X	No	Depth (inches): 0
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW DD WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	15	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	15	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Clethra alnifolia*	25	Yes	FAC
2. *Acer rubrum*	5	No	FAC
3. *Vaccinium corymbosum*	5	No	FACW
4. Rosa multiflora	5	No	FACU
5.			
6.			
7.			
	40	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Scirpus cyperinus*	50	Yes	OBL
2. *Onoclea sensibilis*	10	No	FACW
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	60	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW DD WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth (inches)	Matrix Color (moist)	%	Redox Features Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
16-0	10YR 2/1	100					Muck	Organic

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- X Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 8/17/2023

Applicant/Owner: State: MA Sampling Point: BVW EE Up

Investigator(s): Hailey Page Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Quonset sandy loam NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: BVW EE Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	10	Yes	FAC
2. *Pinus strobus*	5	Yes	FACU
3. *Quercus rubra*	5	Yes	FACU
4.			
5.			
6.			
7.			
	20	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Elaeagnus umbellata*	5	Yes	UPL
2. *Tsuga canadensis*	1	No	FACU
3.			
4.			
5.			
6.			
7.			
	6	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Pteridium aquilinum*	10	Yes	FACU
2. *Toxicodendron radicans*	5	Yes	FAC
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	15	=Total Cover	
Woody Vine Stratum (Plot size:)			
1. *Vitis riparia*	10	Yes	FAC
2.			
3.			
4.			
	10	=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 7 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 42.9% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	25	x 3 =	75
FACU species	21	x 4 =	84
UPL species	5	x 5 =	25
Column Totals:	51 (A)		184 (B)

Prevalence Index = B/A = 3.61

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW EE Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-4	10YR 2/2	100					Sandy	FSL
4-19	10YR 3/4	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 8/17/2023

Applicant/Owner: State: MA Sampling Point: BVW EE WET

Investigator(s): Hailey Page Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- X Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- X Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):	
Water Table Present?	Yes X	No	Depth (inches):	0
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches):	2

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: BVW EE WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	40	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	40	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Rosa multiflora*	1	No	FACU
2. *Vaccinium corymbosum*	5	Yes	FACW
3.			
4.			
5.			
6.			
7.			
	6	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Impatiens capensis*	20	Yes	FACW
2. *Carex stricta*	30	Yes	OBL
3. *Boehmeria cylindrica*	10	No	OBL
4. *Symplocarpus foetidus*	5	No	OBL
5. *Dryopteris intermedia*	1	No	FAC
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	66	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 4 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW EE WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
24+-0	10YR 2/1	100					Muck	Organic (Sapric)

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- X Histosol (A1)
- X Histic Epipedon (A2)
- ___ Black Histic (A3)
- X Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 8/17/2023

Applicant/Owner: State: MA Sampling Point: BVW FF Up

Investigator(s): Hailey Page Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Quonset sandy loam NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: BVW FF Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	10	Yes	FAC
2. *Pinus strobus*	10	Yes	FACU
3. *Quercus macrocarpa*	5	Yes	FACU
4.			
5.			
6.			
7.			
	25	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Pinus strobus*	5	Yes	FACU
2. *Acer rubrum*	1	No	FAC
3.			
4.			
5.			
6.			
7.			
	6	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
		=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 25.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	11	x 3 =	33
FACU species	20	x 4 =	80
UPL species	0	x 5 =	0
Column Totals:	31 (A)		113 (B)

Prevalence Index = B/A = 3.65

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW FF Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-4	10YR 2/2	100					Sandy	FSL
4-19	10YR 3/4	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 8/17/2023

Applicant/Owner: State: MA Sampling Point: BVW FF WET

Investigator(s): Hailey Page Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- X Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:
BVW FF connects to BVW EE via a culvert.

VEGETATION – Use scientific names of plants. Sampling Point: BVW FF WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	40	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	40	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Acer rubrum*	5	Yes	FAC
2. *Vaccinium corymbosum*	1	No	FACW
3.			
4.			
5.			
6.			
7.			
	6	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Toxicodendron radicans*	1	No	FAC
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	1	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 2 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)
Prevalence Index = B/A =	

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW FF WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
6-0	10YR 2/1	100					Muck	Organic (Fibric)
0-14	10YR 4/6	95	10YR 5/6	5			Sandy	VFSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- X Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 8/17/2023

Applicant/Owner: State: MA Sampling Point: BVW GG Up

Investigator(s): Hailey Page Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 3-8

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Quonset sandy loam NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: BVW GG Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	10	Yes	FAC
2. *Pinus strobus*	5	Yes	FACU
3. *Quercus rubra*	10	Yes	FACU
4.			
5.			
6.			
7.			
	25	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Pinus strobus*	1	No	FACU
2.			
3.			
4.			
5.			
6.			
7.			
	1	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Maianthemum canadense*	10	Yes	FACU
2. *Toxicodendron radicans*	5	Yes	FAC
3. *Parthenocissus quinquefolia*	10	Yes	FACU
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	25	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			FAC
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 6 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 33.3% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	15	x 3 =	45
FACU species	36	x 4 =	144
UPL species	0	x 5 =	0
Column Totals:	51 (A)		189 (B)

Prevalence Index = B/A = 3.71

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW GG Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-4	10YR 2/2	100					Sandy	VFSL
4-20	10YR 3/4	100					Sandy	VFSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Littleton Sampling Date: 8/17/2023

Applicant/Owner: State: MA Sampling Point: BVW GG WET

Investigator(s): Hailey Page Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- X Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):	
Water Table Present?	Yes X	No	Depth (inches):	7
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches):	0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: BVW GG WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	40	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	40	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Rosa multiflora*	1	No	FACU
2. *Vaccinium corymbosum*	5	Yes	FACW
3.			
4.			
5.			
6.			
7.			
	6	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Impatiens capensis*	20	Yes	FACW
2. *Carex stricta*	30	Yes	OBL
3. *Boehmeria cylindrica*	10	No	OBL
4. *Symplocarpus foetidus*	5	No	OBL
5. *Dryopteris intermedia*	1	No	FAC
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	66	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 4 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: BVW GG WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-2	10YR 2/2	100					Muck	Organic (Fibric)
2-20+	10YR 3/2	95	10YR 4/6	5			Sandy	VFSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- X Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: IW A Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%):

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Pits, gravel NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**		
Hydric Soil Present?	Yes	No X	**within a Wetland?**	**Yes**	**No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:		

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):	
Water Table Present?	Yes	No X	Depth (inches):	
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):	

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: IW A Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	5	No	FACU
2. *Quercus alba*	1	No	FACU
3. *Quercus rubra*	20	Yes	FACU
4.			
5.			
6.			
7.			
	26	=Total Cover	

Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Pinus strobus*	5	Yes	FACU
2. *Quercus alba*	1	No	FACU
3.			
4.			
5.			
6.			
7.			
	6	=Total Cover	

Herb Stratum (Plot size: 5 ft radius)			
1. *Dryopteris intermedia*	5	Yes	FACU
2. *Carex pensylvanica*	5	Yes	UPL
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	10	=Total Cover	

Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 0 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 0.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	0	x 3 =	0
FACU species	37	x 4 =	148
UPL species	5	x 5 =	25
Column Totals:	42	(A)	173 (B)

Prevalence Index = B/A = 4.12

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: IW A Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-5	10YR 3/1	100					Sandy	FSL
5-10	10YR 2/2	100					Sandy	FSL
10-14	10YR 3/4	100					Sandy	FSL
14-16	10YR 4/6	100					Sandy	FS

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: IW A WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%):

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Pits, gravel NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):	
Water Table Present?	Yes X	No	Depth (inches):	2
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches):	0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: IW A WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	5	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	5	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Sambucus*	25	Yes	FACW
2. *Ilex verticillata*	25	Yes	FACW
3.			
4.			
5.			
6.			
7.			
	50	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
		=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 100.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: IW A WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
6-0	10YR 2/1	100					Mucky Peat	Organic
0-12	10YR 2/1	95	5YR 3/4	5			Sandy	SL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: IW B Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%):

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Pits, gravel NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: IW B Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	15	Yes	FACU
2. *Betula populifolia*	10	Yes	FAC
3.			
4.			
5.			
6.			
7.			
	25	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Pinus strobus*	5	Yes	FACU
2. *Cornus amomum*	5	Yes	FACU
3. *Sumac*	1	No	FACU
4. *Comptonia peregrina*	5	Yes	UPL
5.			
6.			
7.			
	16	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Paspalum laeve*	50	Yes	FAC
2. *Solidago canadensis*	10	No	FACU
3. *Polytrichum commune*	15	Yes	
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	75	=Total Cover	
Woody Vine Stratum (Plot size:)			
1. *Celastrus orbiculatus*	1	No	UPL
2.			
3.			
4.			
	1	=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 7 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 14.3% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	10	x 3 =	30
FACU species	36	x 4 =	144
UPL species	6	x 5 =	30
Column Totals:	52 (A)		204 (B)

Prevalence Index = B/A = 3.92

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: IW B Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 3/2	100					Sandy	FSL
8-12	2.5Y 5/4	100					Sandy	Sand

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: IW B WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Pits, gravel NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- X Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: IW B WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Salix nigra*	5	Yes	OBL
2.			
3.			
4.			
5.			
6.			
7.			
	5 =Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Juncus effusus*	5	Yes	OBL
2. *Solidago canadensis*	5	Yes	FACU
3. *Astor sp*	1	No	
4. *Eutrochium maculatum*	1	No	OBL
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	12 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 66.7% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: IW B WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-1	10YR 2/1	100					Sandy	FSL
1-8	2.5Y 5/2	95	10YR 4/6	5			Sandy	SL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: Impermeable

Depth (inches): 8

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: IW C Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%):

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Udorthents-Urban land complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)
The upland of IW C is paved.

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: IW C Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	=Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: _____ (A)

Total Number of Dominant Species Across All Strata: _____ (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: _____ (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:	
OBL species	x 1 =	
FACW species	x 2 =	
FAC species	x 3 =	
FACU species	x 4 =	
UPL species	x 5 =	
Column Totals:	(A)	(B)

Prevalence Index = B/A = _____

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ____ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)
The upland of IW C is paved with no vegetation.

SOIL

Sampling Point: IW C Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ____ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx) The upland of IW C is paved.

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/6/2022

Applicant/Owner: State: MA Sampling Point: IW C WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- X Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):	
Water Table Present?	Yes X	No	Depth (inches):	12
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches):	6

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: IW C WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	25	Yes	FAC
2. *Pinus strobus*	5	No	FACU
3.			
4.			
5.			
6.			
7.			
	30	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Lonicera morrowii*	5	Yes	FACU
2. *Frangula alnus*	5	Yes	FAC
3. *Acer rubrum*	5	Yes	FAC
4. *Taxus canadensis*	1	No	FACU
5. *Betula lenta*	1	No	FACU
6.			
7.			
	17	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Onoclea sensibilis*	5	Yes	FACW
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	5	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 60.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: IW C WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-24+	10YR 2/1	98	10YR 4/6	2			Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/21/2022

Applicant/Owner: State: MA Sampling Point: IW D Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%):

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Udorthents-Urban land complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)
The upland of IW D is paved.

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: IW D Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	=Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: _____ (A)

Total Number of Dominant Species Across All Strata: _____ (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: _____ (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:	
OBL species	x 1 =	
FACW species	x 2 =	
FAC species	x 3 =	
FACU species	x 4 =	
UPL species	x 5 =	
Column Totals:	(A)	(B)

Prevalence Index = B/A = _____

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ____ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)
The upland of IW D is paved with no vegetation.

SOIL

Sampling Point: IW D Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ____ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx) The upland of IW D is paved.

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/21/2022

Applicant/Owner: State: MA Sampling Point: IW D WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- X Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X	No	Depth (inches): 0	
Water Table Present?	Yes X	No	Depth (inches): 0	
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0	**Wetland Hydrology Present?** **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: IW D WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	25	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	25	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Acer rubrum*	5	Yes	FAC
2. *Rosa multiflora*	5	Yes	FACU
3. *Pinus strobus*	1	No	FACU
4. *Berberis thunbergii*	1	No	FACU
5.			
6.			
7.			
	12	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Onoclea sensibilis*	25	Yes	FACW
2. *Osmundastrum cinnamomeum*	25	Yes	FACW
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	50	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 4 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 80.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: IW D WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
8-0	10YR 2/1	100					Mucky Peat	Organic
0-18	10YR 2/1	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- X Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: Impermeable

Depth (inches): 18

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/21/2022

Applicant/Owner: State: MA Sampling Point: IW E Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%):

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Udorthents-Urban land complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:
The upland area is a very narrow strip next to the road.

VEGETATION – Use scientific names of plants.

Sampling Point: IW E Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	15	Yes	FAC
2. *Tsuga canadensis*	15	Yes	FACU
3.			
4.			
5.			
6.			
7.			
	30	=Total Cover	

Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
		=Total Cover	

Herb Stratum (Plot size: 5 ft radius)			
1. *Pleurozium schreberi*	50	Yes	
2. *Danthonia spicata*	50	Yes	
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	100	=Total Cover	

Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 25.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	15	x 3 =	45
FACU species	15	x 4 =	60
UPL species	0	x 5 =	0
Column Totals:	30 (A)		105 (B)

Prevalence Index = B/A = 3.50

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)
The upland area is a very narrow strip next to the road.

SOIL

Sampling Point: IW E Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 3/3	100						FSL with gravel
8-16	10YR 4/4	100						FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ____ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx) The upland area is a very narrow strip next to the road.

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/21/2022

Applicant/Owner: State: MA Sampling Point: IW E WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 0-1

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Freetown muck NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X No	Depth (inches):	0
Water Table Present?	Yes X No	Depth (inches):	0
Saturation Present? (includes capillary fringe)	Yes X No	Depth (inches):	0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: IW E WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Sambucus canadensis*	15	Yes	FACW
2. *Rosa multiflora*	5	Yes	FACU
3.			
4.			
5.			
6.			
7.			
	20 =Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Lythrum salicaria*	50	Yes	OBL
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	50 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 66.7% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: IW E WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
8-0	10YR 2/1	100					Mucky Peat	Organic
0-26	10YR 2/1	95	10YR 4/6	5			Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- X Histic Epipedon (A2)
- X Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/21/2022

Applicant/Owner: State: MA Sampling Point: IW F Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%):

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Udorthents-Urban land complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: IW F Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	5	No	FAC
2. *Pinus strobus*	10	Yes	FACU
3. *Quercus rubra*	25	Yes	FACU
4.			
5.			
6.			
7.			
	40	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Pinus strobus*	5	Yes	FACU
2. *Quercus rubra*	5	Yes	FACU
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Toxicodendron radicans*	5	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	5	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 20.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	10	x 3 =	30
FACU species	45	x 4 =	180
UPL species	0	x 5 =	0
Column Totals:	55 (A)		210 (B)

Prevalence Index = B/A = 3.82

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: IW F Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-6	10YR 3/3	100						FSL
6-9	10YR 3/4	100						FSL
9-16	10YR 4/4	100						FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/21/2022

Applicant/Owner: State: MA Sampling Point: IW F WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%):

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Udorthents-Urban land complex NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- X Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X	No	Depth (inches): 0	
Water Table Present?	Yes X	No	Depth (inches): 0	
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0	**Wetland Hydrology Present?** **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: IW F WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	15	Yes	FAC
2. *Quercus rubra*	5	Yes	FACU
3.			
4.			
5.			
6.			
7.			
	20	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Acer rubrum*	10	Yes	FACW
2. *Pinus strobus*	1	No	FACU
3.			
4.			
5.			
6.			
7.			
	11	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1.			
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
		=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 2 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 66.7% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: IW F WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-24	10YR 2/1	95	10YR 4/6	5			Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/21/2022

Applicant/Owner: State: MA Sampling Point: IW G Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%):

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Udorthents-Urban land complex NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- ___ Surface Water (A1)
- ___ High Water Table (A2)
- ___ Saturation (A3)
- ___ Water Marks (B1)
- ___ Sediment Deposits (B2)
- ___ Drift Deposits (B3)
- ___ Algal Mat or Crust (B4)
- ___ Iron Deposits (B5)
- ___ Inundation Visible on Aerial Imagery (B7)
- ___ Sparsely Vegetated Concave Surface (B8)
- ___ Water-Stained Leaves (B9)
- ___ Aquatic Fauna (B13)
- ___ Marl Deposits (B15)
- ___ Hydrogen Sulfide Odor (C1)
- ___ Oxidized Rhizospheres on Living Roots (C3)
- ___ Presence of Reduced Iron (C4)
- ___ Recent Iron Reduction in Tilled Soils (C6)
- ___ Thin Muck Surface (C7)
- ___ Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- ___ Surface Soil Cracks (B6)
- ___ Drainage Patterns (B10)
- ___ Moss Trim Lines (B16)
- ___ Dry-Season Water Table (C2)
- ___ Crayfish Burrows (C8)
- ___ Saturation Visible on Aerial Imagery (C9)
- ___ Stunted or Stressed Plants (D1)
- ___ Geomorphic Position (D2)
- ___ Shallow Aquitard (D3)
- ___ Microtopographic Relief (D4)
- ___ FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: IW G Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	15	Yes	FACU
2.			
3.			
4.			
5.			
6.			
7.			
	15	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Pinus strobus*	1	No	FACU
2. *Quercus alba*	5	Yes	FACU
3. *Rhamnus cathartica*	1	No	FAC
4.			
5.			
6.			
7.			
	7	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Toxicodendron radicans*	5	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	5	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 3 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 33.3% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	6	x 3 =	18
FACU species	21	x 4 =	84
UPL species	0	x 5 =	0
Column Totals:	27 (A)		102 (B)

Prevalence Index = B/A = 3.78

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: IW G Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 3/3	100						FSL
8-16	10YR 4/4	100						FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 12/21/2022

Applicant/Owner: State: MA Sampling Point: IW G WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%):

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Udorthents-Urban land complex NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**
Hydric Soil Present?	Yes X	No	**within a Wetland?** **Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- X Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X	No	Depth (inches): 0
Water Table Present?	Yes X	No	Depth (inches): 0
Saturation Present? (includes capillary fringe)	Yes X	No	Depth (inches): 0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants.

Sampling Point: IW G WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Acer rubrum*	10	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	10	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Vaccinium corymbosum*	5	Yes	FACW
2. *Lonicera morrowii*	5	Yes	FACU
3. *Rosa multiflora*	1	No	FACU
4.			
5.			
6.			
7.			
	11	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Onoclea sensibilis*	25	Yes	FACW
2. *Microstegium vimineum*	25	Yes	FAC
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	50	=Total Cover	
Woody Vine Stratum (Plot size: 30)			
1. *Celastrus orbiculatus*	1	No	UPL
2.			
3.			
4.			
	1	=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 3 (A)

Total Number of Dominant Species Across All Strata: 5 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 60.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:	Multiply by:
OBL species	x 1 =
FACW species	x 2 =
FAC species	x 3 =
FACU species	x 4 =
UPL species	x 5 =
Column Totals: (A)	(B)

Prevalence Index = B/A =

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

X 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: IW G WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-24	10YR 2/1	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- X Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L**)
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/18/2023

Applicant/Owner: State: MA Sampling Point: IW H Up

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 8-15

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hinckley loamy sand NWI classification:

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes	No X	**Is the Sampled Area**
Hydric Soil Present?	Yes	No X	**within a Wetland?** **Yes** **No** X
Wetland Hydrology Present?	Yes	No X	If yes, optional Wetland Site ID:

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- Surface Water (A1)
- High Water Table (A2)
- Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes	No X	Depth (inches):
Water Table Present?	Yes	No X	Depth (inches):
Saturation Present? (includes capillary fringe)	Yes	No X	Depth (inches):

Wetland Hydrology Present? **Yes** **No** X

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:

VEGETATION – Use scientific names of plants. Sampling Point: IW H Up

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1. *Pinus strobus*	10	Yes	FACU
2. *Quercus robur*	25	Yes	UPL
3.			
4.			
5.			
6.			
7.			
	35	=Total Cover	
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Fagus grandifolia*	5	Yes	FACU
2. *Frangula alnus*	1	No	FAC
3. *Juniperus communis*	1	No	FACU
4.			
5.			
6.			
7.			
	7	=Total Cover	
Herb Stratum (Plot size: 5 ft radius)			
1. *Toxicodendron radicans*	10	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	10	=Total Cover	
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
		=Total Cover	

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 4 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 25.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	10	x 3 =	30
FACU species	16	x 4 =	64
UPL species	25	x 5 =	125
Column Totals:	51 (A)		219 (B)

Prevalence Index = B/A = 4.29

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

___ 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** ___ **No** X

Remarks: (Include photo numbers here or on a separate sheet.)

SOIL

Sampling Point: IW H Up

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-8	10YR 3/2	100					Sandy	FSL
8-10	10YR 4/3	100					Sandy	FSL
10-16	10YR 4/4	100					Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- ___ Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: _____

Depth (inches): _____

Hydric Soil Present? **Yes** ___ **No** X

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

WETLAND DETERMINATION DATA FORM – Northcentral and Northeast Region

Project/Site: Well/Water Main Extension City/County: Boxborough Sampling Date: 1/18/2023

Applicant/Owner: State: MA Sampling Point: IW H WET

Investigator(s): Devin Herrick, CWS Section, Township, Range:

Landform (hillside, terrace, etc.): Local relief (concave, convex, none): Slope (%): 8-15

Subregion (LRR or MLRA): LRR R Lat: 42.523568 Long: -71.517759 Datum:

Soil Map Unit Name: Hinckley loamy sand NWI classification: PEM1E

Are climatic / hydrologic conditions on the site typical for this time of year? Yes X No (If no, explain in Remarks.)

Are Vegetation , Soil , or Hydrology significantly disturbed? Are "Normal Circumstances" present? Yes X No

Are Vegetation , Soil , or Hydrology naturally problematic? (If needed, explain any answers in Remarks.)

SUMMARY OF FINDINGS – Attach site map showing sampling point locations, transects, important features, etc.

Hydrophytic Vegetation Present?	Yes X	No	**Is the Sampled Area**	
Hydric Soil Present?	Yes X	No	**within a Wetland?**	**Yes** X **No**
Wetland Hydrology Present?	Yes X	No	If yes, optional Wetland Site ID:	

Remarks: (Explain alternative procedures here or in a separate report.)

HYDROLOGY

Wetland Hydrology Indicators:

Primary Indicators (minimum of one is required; check all that apply)

- X Surface Water (A1)
- X High Water Table (A2)
- X Saturation (A3)
- Water Marks (B1)
- Sediment Deposits (B2)
- Drift Deposits (B3)
- Algal Mat or Crust (B4)
- Iron Deposits (B5)
- Inundation Visible on Aerial Imagery (B7)
- Sparsely Vegetated Concave Surface (B8)
- Water-Stained Leaves (B9)
- Aquatic Fauna (B13)
- Marl Deposits (B15)
- Hydrogen Sulfide Odor (C1)
- Oxidized Rhizospheres on Living Roots (C3)
- Presence of Reduced Iron (C4)
- Recent Iron Reduction in Tilled Soils (C6)
- Thin Muck Surface (C7)
- Other (Explain in Remarks)

Secondary Indicators (minimum of two required)

- Surface Soil Cracks (B6)
- Drainage Patterns (B10)
- Moss Trim Lines (B16)
- Dry-Season Water Table (C2)
- Crayfish Burrows (C8)
- Saturation Visible on Aerial Imagery (C9)
- Stunted or Stressed Plants (D1)
- Geomorphic Position (D2)
- Shallow Aquitard (D3)
- Microtopographic Relief (D4)
- FAC-Neutral Test (D5)

Field Observations:

Surface Water Present?	Yes X No	Depth (inches):	0
Water Table Present?	Yes X No	Depth (inches):	0
Saturation Present? (includes capillary fringe)	Yes X No	Depth (inches):	0

Wetland Hydrology Present? **Yes** X **No**

Describe Recorded Data (stream gauge, monitoring well, aerial photos, previous inspections), if available:

Remarks:
Area of Potentail Vernal Pool (PVP).

VEGETATION – Use scientific names of plants.

Sampling Point: IW H WET

Tree Stratum (Plot size: 30 ft radius)	Absolute % Cover	Dominant Species?	Indicator Status
1.			
2.			
3.			
4.			
5.			
6.			
7.			
	=Total Cover		
Sapling/Shrub Stratum (Plot size: 15 ft radius)			
1. *Frangula alnus*	5	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
	5 =Total Cover		
Herb Stratum (Plot size: 5 ft radius)			
1. *Toxicodendron radicans*	25	Yes	FAC
2.			
3.			
4.			
5.			
6.			
7.			
8.			
9.			
10.			
11.			
12.			
	25 =Total Cover		
Woody Vine Stratum (Plot size:)			
1.			
2.			
3.			
4.			
	=Total Cover		

Dominance Test worksheet:

Number of Dominant Species That Are OBL, FACW, or FAC: 1 (A)

Total Number of Dominant Species Across All Strata: 2 (B)

Percent of Dominant Species That Are OBL, FACW, or FAC: 50.0% (A/B)

Prevalence Index worksheet:

Total % Cover of:		Multiply by:	
OBL species	0	x 1 =	0
FACW species	0	x 2 =	0
FAC species	25	x 3 =	75
FACU species	0	x 4 =	0
UPL species	0	x 5 =	0
Column Totals:	25 (A)		75 (B)

Prevalence Index = B/A = 3.00

Hydrophytic Vegetation Indicators:

___ 1 - Rapid Test for Hydrophytic Vegetation

___ 2 - Dominance Test is >50%

X 3 - Prevalence Index is ≤3.0[1]

___ 4 - Morphological Adaptations[1] (Provide supporting data in Remarks or on a separate sheet)

___ Problematic Hydrophytic Vegetation[1] (Explain)

[1]Indicators of hydric soil and wetland hydrology must be present, unless disturbed or problematic.

Definitions of Vegetation Strata:

Tree – Woody plants 3 in. (7.6 cm) or more in diameter at breast height (DBH), regardless of height.

Sapling/shrub – Woody plants less than 3 in. DBH and greater than or equal to 3.28 ft (1 m) tall.

Herb – All herbaceous (non-woody) plants, regardless of size, and woody plants less than 3.28 ft tall.

Woody vines – All woody vines greater than 3.28 ft in height.

Hydrophytic Vegetation Present? **Yes** X **No** ___

Remarks: (Include photo numbers here or on a separate sheet.)
PVP

SOIL

Sampling Point: IW H WET

Profile Description: (Describe to the depth needed to document the indicator or confirm the absence of indicators.)

Depth	Matrix		Redox Features					
(inches)	Color (moist)	%	Color (moist)	%	Type[1]	Loc[2]	Texture	Remarks
0-4	10YR 2/1	100					Sandy	FSL
4-8	10YR 2/1	95	10YR 4/6	5			Sandy	FSL

[1]Type: C=Concentration, D=Depletion, RM=Reduced Matrix, CS=Covered or Coated Sand Grains. [2]Location: PL=Pore Lining, M=Matrix.

Hydric Soil Indicators:

- ___ Histosol (A1)
- ___ Histic Epipedon (A2)
- ___ Black Histic (A3)
- ___ Hydrogen Sulfide (A4)
- ___ Stratified Layers (A5)
- X Depleted Below Dark Surface (A11)
- ___ Thick Dark Surface (A12)
- ___ Sandy Mucky Mineral (S1)
- ___ Sandy Gleyed Matrix (S4)
- ___ Sandy Redox (S5)
- ___ Stripped Matrix (S6)
- ___ Dark Surface (S7)
- ___ Polyvalue Below Surface (S8) (**LRR R, MLRA 149B**)
- ___ Thin Dark Surface (S9) (**LRR R, MLRA 149B**)
- ___ High Chroma Sands (S11) (**LRR K, L)**
- ___ Loamy Mucky Mineral (F1) (**LRR K, L**)
- ___ Loamy Gleyed Matrix (F2)
- ___ Depleted Matrix (F3)
- ___ Redox Dark Surface (F6)
- ___ Depleted Dark Surface (F7)
- ___ Redox Depressions (F8)
- ___ Marl (F10) (**LRR K, L**)

Indicators for Problematic Hydric Soils[3]:

- ___ 2 cm Muck (A10) (**LRR K, L, MLRA 149B**)
- ___ Coast Prairie Redox (A16) (**LRR K, L, R**)
- ___ 5 cm Mucky Peat or Peat (S3) (**LRR K, L, R**)
- ___ Polyvalue Below Surface (S8) (**LRR K, L**)
- ___ Thin Dark Surface (S9) (**LRR K, L**)
- ___ Iron-Manganese Masses (F12) (**LRR K, L, R**)
- ___ Piedmont Floodplain Soils (F19) (**MLRA 149B**)
- ___ Mesic Spodic (TA6) (**MLRA 144A, 145, 149B**)
- ___ Red Parent Material (F21)
- ___ Very Shallow Dark Surface (TF12)
- ___ Other (Explain in Remarks)

[3]Indicators of hydrophytic vegetation and wetland hydrology must be present, unless disturbed or problematic.

Restrictive Layer (if observed):

Type: impermeable

Depth (inches): 8

Hydric Soil Present? **Yes** X **No** ___

Remarks:

This data form is revised from Northcentral and Northeast Regional Supplement Version 2.0 to reflect the NRCS Field Indicators of Hydric Soils version 7.0 March 2013 Errata. (http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_051293.docx)

APPENDIX B

Site Photographs

Photo 1: Bordering Vegetated Wetland (BVW A)

Photo 2: Perennial Stream (TOB A)

Photo 3: Pond Bank (TOB C)

Photo 4: Isolated Vegetated Wetland (IW H)

Photo 4: Codman Hill Road

Appendix H
Photographs

Photo 1: Codman Hill Road

Photo 2: Wetland Resource Area

LITTLETON WATER DEPARTMENT

WATER SUPPLY FROM LITTLETON TO BOXBOROUGH
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397 - CONTRACT NO.2

NICK LAWLER - GENERAL MANAGER
DAVE KETCHEN - ASSISTANT GENERAL MANAGER
COREY GODFREY - WATER SUPERINTENDENT

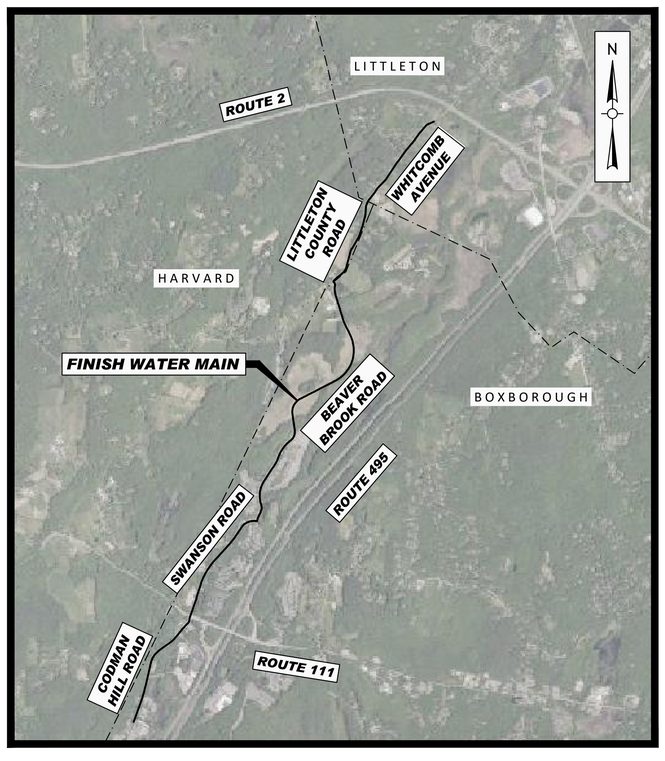

LOCUS MAP
SCALE : 1"=2000'

DRAWING INDEX

SHEET	TITLE
G000	COVER AND SHEET LIST
G001	ABBREVIATIONS, NOTES, AND LEGEND
C101	FINISH WATER PLAN WHITCOMB AVENUE
C102	FINISH WATER PLAN WHITCOMB AVENUE AND LITTLETON COUNTY ROAD
C501	DETAILS
C502	DETAILS

Weston & Sampson SM

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON

www.westonandsampson.com

Issued Date:

OCTOBER 2023

Seal:

COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

811 Know what's below. Call before you dig.

Issued For:

FOR PERMIT REVIEW

FILE NO. __-__

COPYRIGHT 2023 WESTON & SAMPSON

\\wse03-local\WSE\Projects\MA-Mwrd\DOT\13795 Water + Redlands\Water Supply - Littleton to Boxborough\06 CAD\c3d\G000 - Cover Sheet Finished Water.dwg

LEGEND

DESCRIPTION	EXISTING	PROPOSED
SANITARY SEWER	S	S
FORCE MAIN	FM	FM
WATER MAIN	W	W
TEMPORARY WATER		TW
STORM DRAIN	D	D
GAS	G	G
ELECTRIC	E	E
OVERHEAD WIRE	OHW	OHW
TELEPHONE	T	T
CABLE TELEVISION	CATV	CATV
GRINDER PUMP		GP
SANITARY SEWER MANHOLE	S	SMH
STORM DRAIN MANHOLE	D	DMH
ELECTRICAL MANHOLE	E	EMH
TELEPHONE MANHOLE	T	TMH
AIR RELEASE VALVE MANHOLE		ARMH
FORCE MAIN CLEANOUT MANHOLE		FMCO
CLEANOUT		CO
CATCH BASIN		CB
CATCH BASIN (CURB INLET)		
HYDRANT		
TEMPORARY HYDRANT		H
GATE VALVE	GV	
CHECK VALVE		
CURB STOP		
BUTTERFLY VALVE		
BALL VALVE		
REDUCER		
CAP OR PLUG		
GAS GATE VALVE		
UTILITY POLE		
GUY POLE		
LIGHT POST		
EDGE OF PAVEMENT		
EDGE OF UNPAVED ROAD		
CURB		
SIDEWALK		
RAILROAD		
STONE WALL		
RETAINING WALL	RET WALL	RET WALL
FENCE	X	X
INDIVIDUAL DECIDUOUS TREE		
INDIVIDUAL EVERGREEN TREE		
TREE LINE		
SURVEY MARKER		
PROPERTY LINE	PL	
EASEMENT LINE		
LIMIT OF WORK		
APPROX. LIMIT OF REFUSE		
SPOT ELEVATIONS	x100.5	x100.5
CONTOUR LINES	56	56
DEPRESSION CONTOUR LINES		
HOUSE NUMBER	#35	
FLOOR ELEVATION	FL=56.7	
SILL ELEVATION	S=56.7	
WETLAND		
WETLAND FLAGS		WF-7 WF-8
RIP RAP		
DRAINAGE DITCH / SWALE		
STATE HIGHWAY STATION	10	
GUARD POST		
BOLLARD	B	B
SIGN		
BENCH MARK		
PERCOLATION TEST	PT-1	PT-1
TEST PIT	TP-1	TP-1
BORING	B-1	B-1
PROBE	P-1	P-1
GROUNDWATER MONITORING WELL	WS-1	WS-1
GAS MONITORING WELL	GMW-1	GMW-1
GAS VENT	GV	GV
HAY BALES		
ROCK OUTCROP		

NOTE: ITEMS SHOWN IN THE LEGEND MAY NOT BE PRESENT IN THESE PLANS

ABBREVIATIONS

AC	ASBESTOS CEMENT PIPE
ACCMP	ASPHALT COATED CORRUGATED METAL PIPE
ARV	AIR RELEASE VALVE
ASTM	ASTM INTERNATIONAL
BC	BITUMINOUS CONCRETE
BIT	BITUMINOUS
BLDG	BUILDING
BM	BENCH MARK
BO	BLOW OFF
BV	BUTTERFLY VALVE
CATV	CABLE TELEVISION
CB	CATCH BASIN
CC	CONCRETE CURB
CI	CAST IRON
℄	CENTERLINE
CL	CEMENT LINED
CMP	CORRUGATED METAL PIPE
CONC	CONCRETE
CU FT	CUBIC FEET
CY	CUBIC YARD
D	STORM DRAIN, DEPTH FROM RIM TO INVERT
DI	DROP INLET, DUCTILE IRON
DIA	DIAMETER
DMH	DRAIN MANHOLE
DWG	DRAWING
E	EAST, ELECTRIC
EA	EACH
EF	EACH FACE
ELEV	ELEVATION
EOP	EDGE OF PAVEMENT
EW	EACH WAY
EXIST	EXISTING
FLG	FLANGE
FT	FEET, FOOT
G	NATURAL GAS
GALV	GALVANIZED
GC	GRANITE CURB
GR	GRANITE
HC	HOUSE CONNECTION
HORIZ	HORIZONTAL
HP	HIGH PRESSURE
HYD	FIRE HYDRANT
I	INVERT
INV	INVERT
ID	INSIDE DIAMETER
IP	IRON PIPE
LB	POUND
LF	LINEAR FEET
LS	LUMP SUM
MAX	MAXIMUM
MB	MAIL BOX
MECH	MECHANICAL
MH	MANHOLE
MassDOT	MASSACHUSETTS DEPARTMENT OF TRANSPORTATION
MIN	MINIMUM
MISC	MISCELLANEOUS
MJ	MECHANICAL JOINT
MWRA	MASSACHUSETTS WATER RESOURCES AUTHORITY
N	NORTH
NE	NORTH EAST
NW	NORTH WEST
NF	NOT FOUND
NO OR #	NUMBER
OD	OUTSIDE DIAMETER
PCCP	PRESTRESSED CONCRETE CYLINDER PIPE
PE	PLAIN END, POLYETHYLENE
℄	PROPERTY LINE
PL	PLATE
PVC	POLYVINYL CHLORIDE
PVCO	MOLECULARLY ORIENTED POLYVINYL CHLORIDE
PVMT	PAVEMENT
RCP	REINFORCED CONCRETE PIPE
ROW	RIGHT-OF-WAY
RQD	ROCK QUALITY
S	SEWER, SOUTH
SE	SOUTH EAST
SECT	SECTION
SF	SQUARE FEET
SHT	SHEET
SPEC	SPECIFICATIONS
SQ FT	SQUARE FEET
SS	SEWER SERVICE, STAINLESS STEEL
STA	STATION
STL	STEEL
SW	SIDEWALK, SOUTH WEST
T	HYDROSTATIC THRUST, TELEPHONE
TBM	TEMPORARY BENCH MARK
THK	THICK (NESS)
TYP	TYPICAL
UP	UTILITY POLE
VC	VITRIFIED CLAY
VERT	VERTICAL
W	WATER, WEST
W/	WITH
W/O	WITHOUT

CONSTRUCTION NOTES

1. THE CONTRACTOR SHALL CALL DIGSAFE AT 1-888-344-7233 AND CITY/TOWN DEPARTMENTS AS APPROPRIATE AT LEAST 72 HOURS, SATURDAYS, SUNDAYS, AND HOLIDAYS EXCLUDED, PRIOR TO EXCAVATING AT ANY LOCATION. A COPY OF THE DIGSAFE PROJECT REFERENCE NUMBER(S) SHALL BE GIVEN TO THE OWNER PRIOR TO EXCAVATION.

2. LOCATIONS OF EXISTING PIPES, CONDUITS, UTILITIES, FOUNDATIONS AND OTHER UNDERGROUND OBJECTS ARE NOT WARRANTED TO BE CORRECT AND THE CONTRACTOR SHALL HAVE NO CLAIM ON THAT ACCOUNT SHOULD THEY BE OTHER THAN SHOWN.

3. TEST PITS TO LOCATE EXISTING UTILITIES MAY BE ORDERED BY THE ENGINEER TO DETERMINE WHETHER TO RAISE OR LOWER THE PROPOSED WATER MAIN TO CLEAR EXISTING UTILITIES OR VERIFY EXISTING UTILITY LOCATION, SIZE AND TYPE.

4. STONE WALLS, FENCES, MAIL BOXES, SIGNS, CURBS, LIGHT POLES, ETC. SHALL BE REMOVED AS NECESSARY TO PERFORM THE WORK AND REPLACED TO A CONDITION AT LEAST EQUAL TO THAT BEFORE CONSTRUCTION BEGAN. UNLESS OTHERWISE INDICATED, ALL SUCH WORK SHALL BE INCIDENTAL TO CONSTRUCTION OF THE PROJECT.

5. ALL PAVEMENT DISTURBED BY THE CONTRACTOR'S OPERATIONS SHALL BE REPLACED IN ACCORDANCE WITH THE SPECIFICATIONS AND AS SHOWN ON THE DRAWINGS.

6. ALL AREAS DISTURBED BY THE CONTRACTOR BEYOND PAYMENT LIMITS SHALL BE RESTORED AT NO ADDITIONAL COST TO THE OWNER.

7. UNLESS OTHERWISE INDICATED, CONCRETE USED FOR PIPE ANCHOR BLOCKS, BACKING, PIPE CRADLES, ARCHES, AND FILL SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS.

8. APPROVED JOINT RESTRAINT METHODS SHALL BE PROVIDED FOR WATER MAINS WHERE ANY BENDS, TEES, PLUGS, OR WYES ARE INSTALLED. CONCRETE THRUST BLOCKS, ANCHOR BLOCKS AND TIE RODS MAY BE USED FOR 6-INCH AND 8-INCH PIPE WHERE JOINT RESTRAINT IS NOT FEASIBLE UPON APPROVAL OF THE ENGINEER. SEE TABLE 1 DETAIL FOR REQUIRED RESTRAINING LENGTHS AND SPECIFICATIONS FOR ADDITIONAL INFORMATION.

9. THE CONTRACTOR SHALL NOT STORE ANY APPARATUS, MATERIALS, SUPPLIES, OR EQUIPMENT ON DRAINAGE STRUCTURES OR WITHIN 100 FEET OF WETLANDS.

10. NEW WATER MAINS AND SERVICES SHALL BE INSTALLED AT THE MINIMUM DEPTH FROM FINISH GRADE TO TOP OF PIPE AS SHOWN ON THE DRAWINGS. WHERE NECESSARY, NEW WATER MAINS SHALL BE INSTALLED AT A GREATER DEPTH TO CLEAR OBSTACLES SHOWN ON THE DRAWINGS AT NO ADDITIONAL COST TO THE OWNER. MINIMUM CLEARANCES TO UTILITIES, AS SHOWN ON THE DRAWINGS SHALL BE MAINTAINED.

11. EXISTING SERVICES SHALL NOT BE CONNECTED TO THE PROPOSED WATER MAIN UNTIL THAT MAIN HAS PASSED PRESSURE TEST AND DISINFECTION REQUIREMENTS.

12. EXISTING WATER MAINS OR SERVICES SHALL NOT BE ABANDONED WITHOUT THE APPROVAL OF THE OWNER. WATER SERVICE SHALL NOT BE INTERRUPTED MORE THAN 4 HOURS WITHOUT PRIOR APPROVAL OF THE OWNER.

13. ALL HYDRANTS REMOVED SHALL BE SALVAGED AND DELIVERED TO A LOCATION TO BE DETERMINED BY THE OWNER. SURFACE RESTORATION SHALL BE IN KIND UNLESS OTHERWISE NOTED.

14. ANY HYDRANT WHICH IS NOT IN SERVICE SHALL BE COVERED WITH A SECURELY FASTENED AND APPROVED BAG.

15. THE LOCATION OF PIPES, CAPS, REDUCERS, BENDS, AND OTHER FITTINGS AT POINTS OF CONNECTIONS TO EXISTING MAINS IS APPROXIMATE. CONTRACTOR SHALL DIG A TEST PIT AT EACH LOCATION TO DETERMINE THE DIAMETER AND MATERIAL OF THE EXISTING PIPE AND THE LOCATION OF THE TIE-IN POINT.

16. ALL CATCH BASINS WITHIN PROJECT LIMITS SHALL BE PROTECTED AS SHOWN ON DETAIL SHEET.

17. THE CONTRACTOR SHALL NOTIFY THE MassDOT DISTRICT PERMITS ENGINEER AT 857-368-3000 TWO (2) DAYS PRIOR TO THE START OF WORK IN A STATE ROADWAY.

18. ALL STREET EXCAVATIONS SHALL BE COMPLETELY CLOSED AT THE END OF EACH WORKING DAY BY BACKFILLING. COVERING WITH STEEL PLATES MAY BE ALLOWED IF APPROVED BY THE ENGINEER.

19. THE CONTRACTOR SHALL COMPLY WITH ALL REQUIREMENTS OF MASSACHUSETTS GENERAL LAW CHAPTER 82A, TRENCH EXCAVATION AND SAFETY REQUIREMENTS, TO PREVENT THE GENERAL PUBLIC FROM UNAUTHORIZED ACCESS TO UNATTENDED TRENCHES.

20. THE CONTRACTOR SHALL NOT OPEN OR CLOSE ANY VALVES WHICH HOLD WATER IN THE SYSTEM. THE OWNER WILL, ON 72 HOURS NOTICE FROM THE CONTRACTOR, OPEN AND/OR CLOSE ANY VALVES REQUIRED FOR DRAINING OR ADMITTING WATER TO THE VARIOUS SECTIONS OF THE WATER MAINS. THE CONTRACTOR IS RESPONSIBLE TO NOTIFY IN WRITING 48 HOURS IN ADVANCE, ANY OCCUPANT THAT WILL BE WITHOUT WATER DUE TO A SHUTDOWN.

21. SOME WATER SERVICE CONNECTIONS MAY NOT BE SHOWN ON THE DRAWINGS. THE OWNER WILL MARK THE LOCATION OF SUCH CONNECTIONS, PROVIDED THE CONTRACTOR GIVES THE OWNER AT LEAST 72 HOURS ADVANCE NOTICE.

22. ALL NEW WATER SERVICES SHALL BE THE SAME SIZE AS THE EXISTING WATER SERVICE, EXCEPT THAT NO SERVICE SHALL BE LESS THAN 1" DIAMETER. COORDINATE THIS WORK WITH THE WATER DEPARTMENT.

23. ELEVATIONS REFERENCED ARE NAD83 MASSACHUSETTS STATE PLANES, MAINLAND ZONE, US FOOT.

24. EXISTING UTILITY INFORMATION, TOPOGRAPHIC INFORMATION, EDGE OF PAVEMENT, UTILITY POLE LOCATIONS, AND LOCATIONS OF EXISTING ABOVE GROUND STRUCTURES WERE TAKEN FROM PLANS PREPARED BY BEALS AND THOMAS, INC., KELLY ENGINEERING GROUP, GIS DATA, AND GROUND SURVEY CONDUCTED BY WESTON & SAMPSON.

25. ASSESSORS INFORMATION REPRESENTED ON THESE DRAWINGS IS TAKEN FROM THE CITY/TOWN ASSESSOR'S PARCEL MAPS, MASS GIS DATA AND IS INCLUDED FOR ILLUSTRATIVE PURPOSES ONLY. ASSESSORS INFORMATION IS NOT INTENDED TO BE AN AUTHORITATIVE RECORD OF PROPERTY BOUNDARIES OR A SOURCE OF INFORMATION FOR AN ACTUAL SURVEY OR LEGAL DESCRIPTION OF THE PROPERTY. NO WORK HAS BEEN PERFORMED TO DETERMINE THE DEPICTED PROPERTY LINES AND THEREFORE, THESE DRAWINGS ARE NOT INTENDED BE USED TO DELINEATE ANY EXISTING OR PROPOSED STRUCTURES, FEATURES OR BOUNDARIES RELATIVE TO PROPERTY LINES. AUTHORITATIVE RECORDS OF PROPERTY LINES MAY BE LOCATED AT THE STATE OR MUNICIPAL AGENCY RESPONSIBLE FOR MAINTAINING PUBLIC RECORDS IN WHICH THE PARCEL IS LOCATED. LEGALLY AUTHORITATIVE MAPS OF PROPERTY LINES MAY ONLY BE PRODUCED BY A PROFESSIONAL LAND SURVEYOR.

Project:

LITTLETON WATER DEPARTMENT

LITTLETON LELWD ELECTRIC LIGHT & WATER DEPARTMENTS

WATER SUPPLY FROM LITTLETON TO BOXBOROUGH
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO. 2

Weston & Sampson

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:

COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:

FOR PERMIT REVIEW ONLY

Scale: AS NOTED

Date: OCTOBER 2023
Drawn By: GJK/RWS
Reviewed By: SBR
Approved By: TEM

W&S Project No.: ENG23-0679
W&S File No.:

Drawing Title:

ABBREVIATIONS, NOTES, & LEGEND

Sheet Number:

G001

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

\\wes03.local\WSEP\Projects\MA\Active\20171\0005.Water • Ratebase\04.Water Supply - Littleton to Boxborough\06.CAD\General\G001 - Abbreviation Notes & Legend - Finish Water.dwg

NOTES:

1. WETLAND DELINEATION CONDUCTED ON DECEMBER 5,6, AND 21, JANUARY 5 AND 18, 2023, AND AUGUST 17, 2023 BY DEVIN HERRICK, CWS.
2. ENTIRE PLAN VIEW IS WITHIN LITTLETON GIS AQUIFER ZONING OVERLAY DISTRICT.

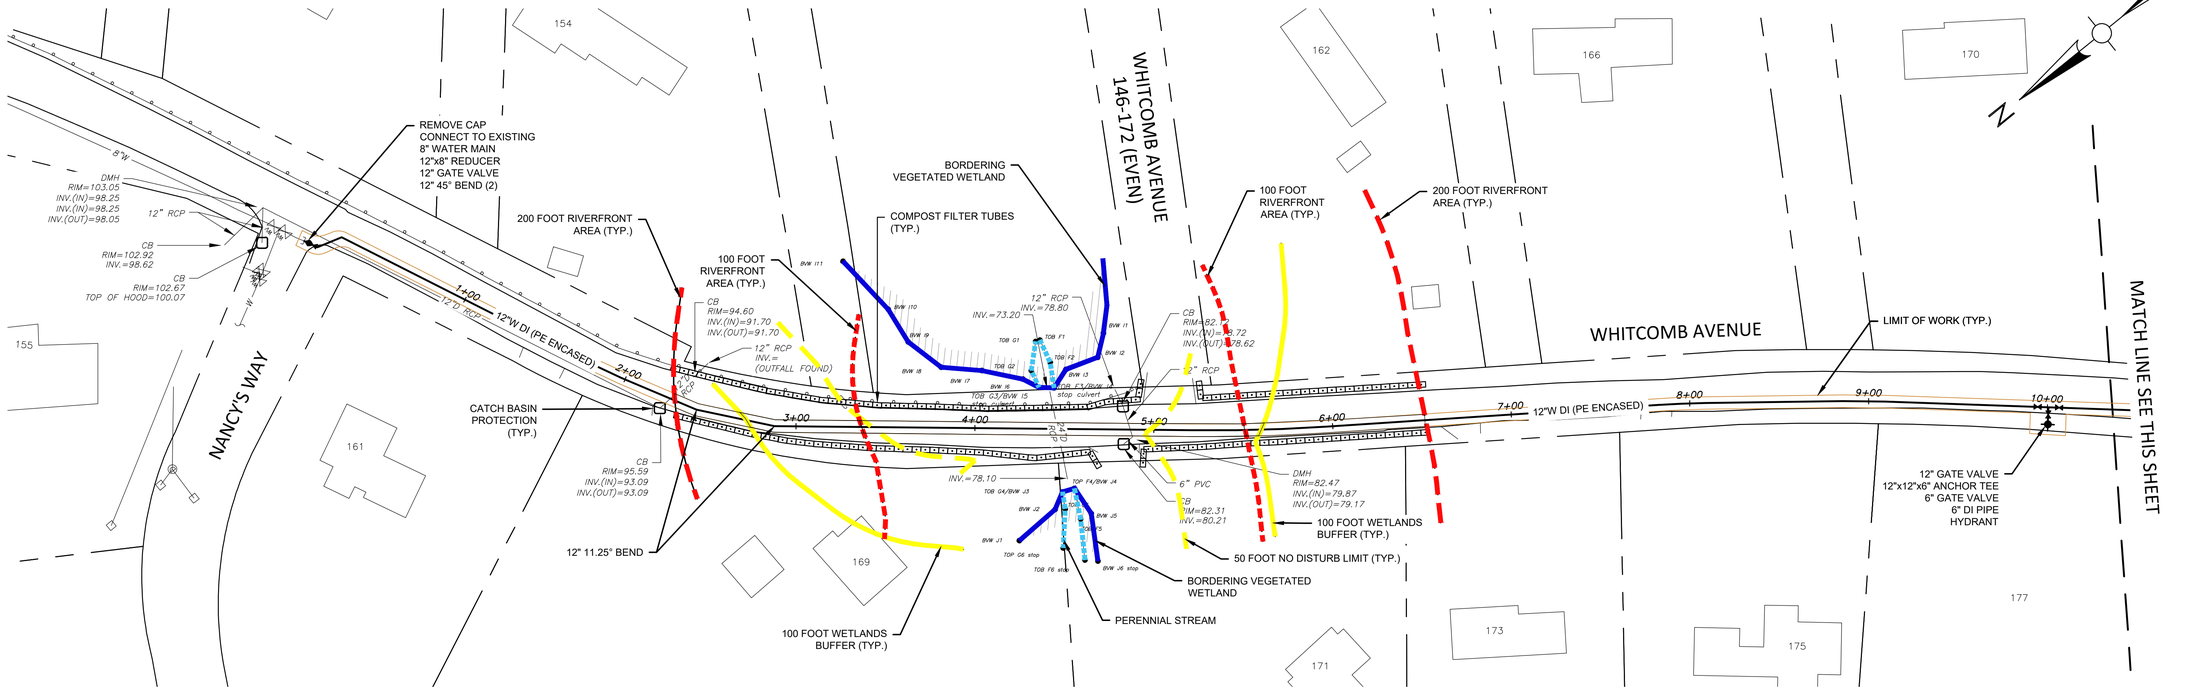

PLAN
SCALE: 1" = 40'

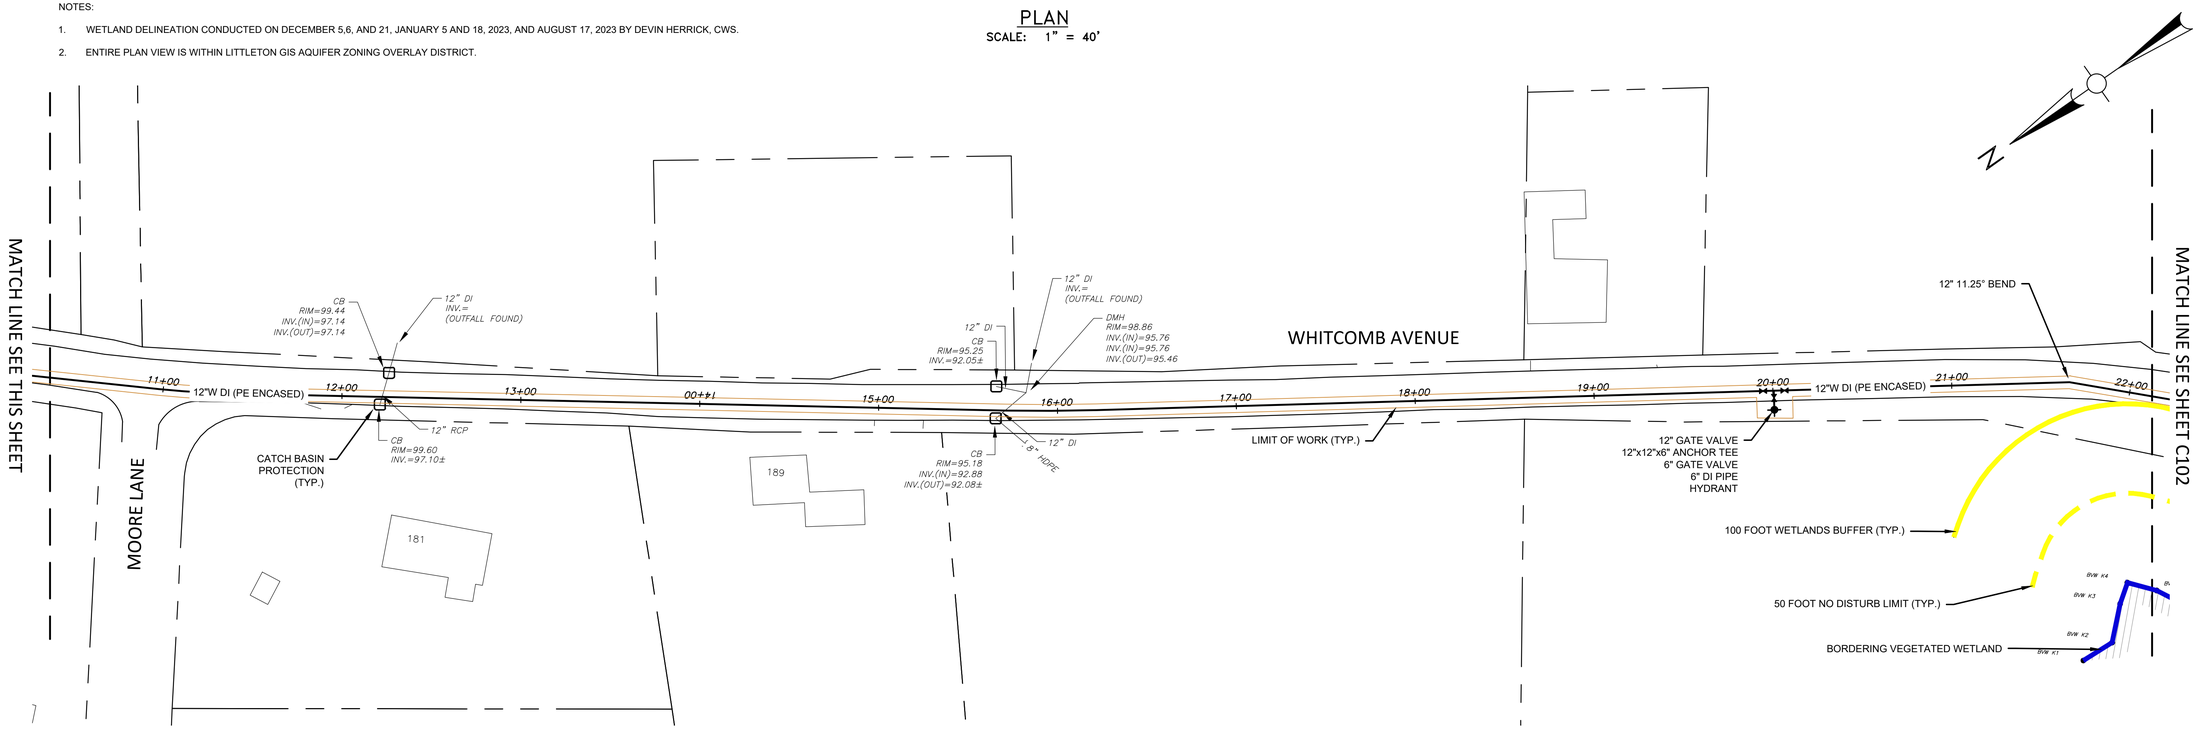

PLAN
SCALE: 1" = 40'

40 20 0 40 80
SCALE: 1"=40'

Project:
LITTLETON WATER DEPARTMENT

WATER SUPPLY FROM LITTLETON TO BOXBOROUGH
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO. 2

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:
COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:
FOR PERMIT REVIEW ONLY

Scale: AS NOTED

Date: OCTOBER 2023
Drawn By: GJK/RWS
Reviewed By: SBR
Approved By: TEM
W&S Project No.: ENG23-0679
W&S File No.:

Drawing Title:
FINISH WATER PLAN WHITCOMB AVENUE

Sheet Number:
C101

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

I:\wse03\Local\WSEProjectMgr\Mead\2019780B Water + Battleboro\04 Water Supply + Littleton to Boxborough\000 CAD\civil\ACAD\C101 C105 Finish Water Plans - NO LBWater.dwg

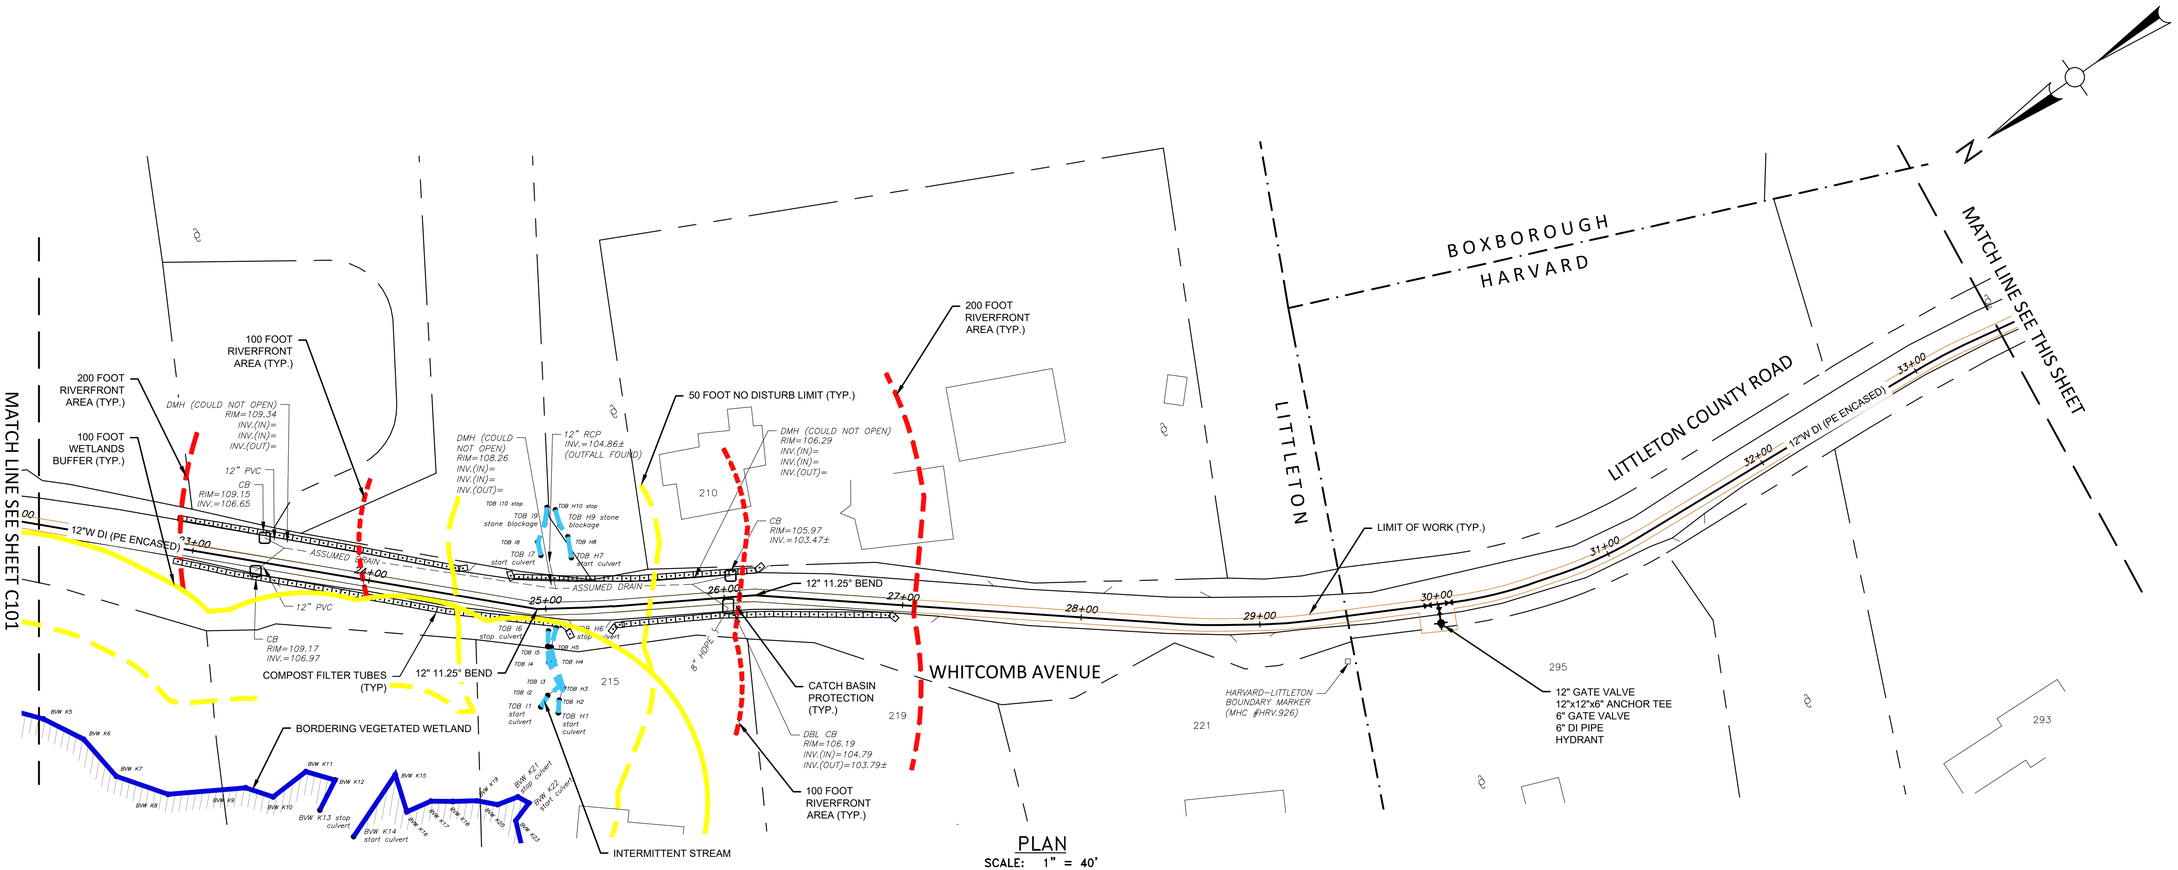

PLAN

SCALE: 1" = 40'

NOTES:

1. WETLAND DELINEATION CONDUCTED ON DECEMBER 5,6, AND 21, JANUARY 5 AND 18, 2023, AND AUGUST 17, 2023 BY DEVIN HERRICK, CWS.
2. ENTIRE PLAN VIEW IS WITHIN LITTLETON GIS AQUIFER ZONING OVERLAY DISTRICT.

Project:

LITTLETON WATER DEPARTMENT

LITTLETON LELWD ELECTRIC LIGHT & WATER DEPARTMENTS

WATER SUPPLY FROM LITTLETON TO BOXBOROUGH
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO. 2

Weston & Sampson

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:

COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:

FOR PERMIT REVIEW ONLY

Scale:	AS NOTED
Date:	OCTOBER 2023
Drawn By:	GJK/RWS
Reviewed By:	SBR
Approved By:	TEM
W&S Project No.:	ENG23-0679
W&S File No.:	

Drawing Title:

FINISH WATER PLAN WHITCOMB AVENUE AND LITTLETON COUNTY ROAD

Sheet Number:

C102

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

\\wes01\Local\WSProjects\Middle\DOT\18266 Water • Boxborough Water Supply - Littleton to Boxborough\WSK CAD\Civil\NOC\101 C109 Finish Water Plans - NOI (Littleton).dwg

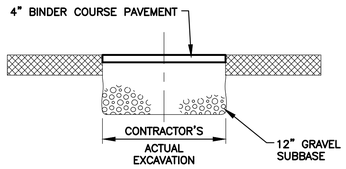

TEMPORARY TRENCH PAVEMENT

N.T.S.

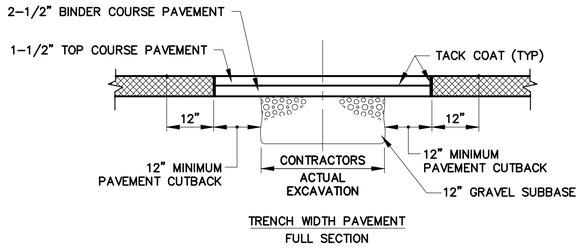

PERMANENT PAVEMENT REPLACEMENT DETAIL

N.T.S.

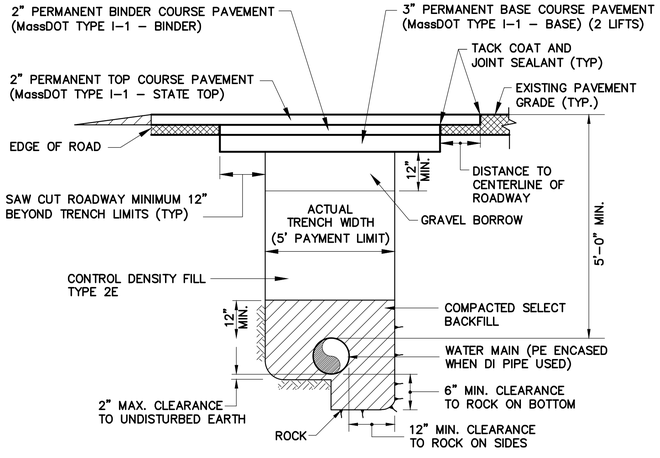

TYPE 3 AND TYPE 4
MASSACHUSETTS DEPARTMENT OF TRANSPORTATION (MassDOT)
PERMANENT TRENCH PAVEMENT AND WATER MAIN TRENCH

N.T.S.

NOTES:

1. SEE SECTION 32 11 00, PAVING FOR PAVEMENT SCHEDULE.
2. FOR ALL TRENCH PAVEMENTS, CONTRACTOR SHALL INSTALL ASPHALT EMULSION TACK COAT TO ALL SUBSURFACES AND VERTICAL SAW CUTS PRIOR TO INSTALLATION OF PERMANENT PAVEMENT.
3. PAVEMENT SHALL BE INSTALLED FLUSH WITH EXISTING GRADE BEFORE WINTER SHUTDOWN.
4. TOP LAYER OF PAVEMENT SHALL BE INSTALLED BY MECHANICAL MEANS.

PAVEMENT REPLACEMENT DETAILS

N.T.S.

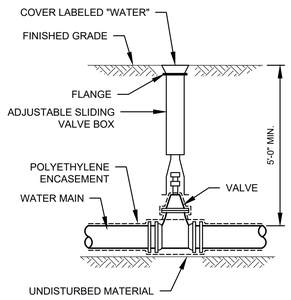

VALVE AND BOX DETAIL

N.T.S.

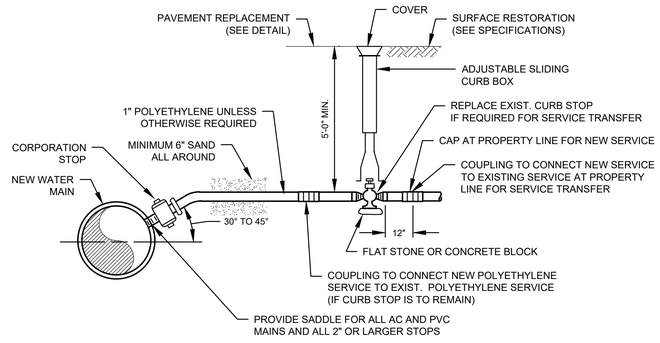

WATER SERVICE DETAIL

N.T.S.

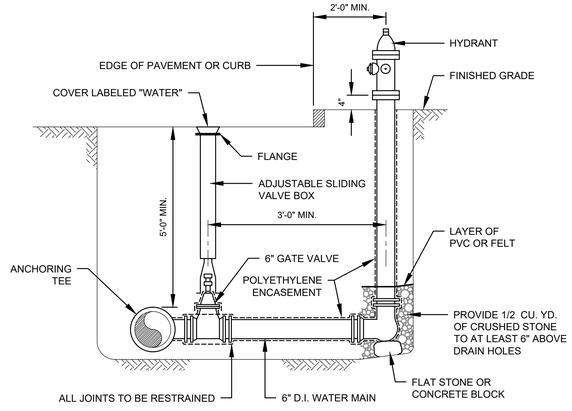

NOTE:

USE TWO 6" BENDS OR OFFSET ON LATERAL TO ACHIEVE REQUIRED HYDRANT ELEVATION IF NECESSARY.

HYDRANT AND VALVE DETAIL

N.T.S.

REQUIRED LENGTH OF RESTRAINED JOINTS FROM FITTINGS (FEET)

PIPE SIZE	90° BEND	45° BEND OR WYE BRANCH	22 1/2° BEND	11 1/4° BEND	PLUG, CAP OR IN-LINE VALVE	TEE (BRANCH)
6"	25 (30.5)	10.5 (12.5)	5 (6)	2.5 (3)	43 (64)	34 (51)
8"	33 (40)	13.5 (16.5)	6.5 (8)	3 (4)	55 (82)	47 (70)
10"	40 (48.5)	16.5 (20)	8 (9.5)	4 (5)	67 (100)	58 (87)
12"	47 (56.5)	19.5 (23.5)	9.5 (11.5)	4.5 (5.5)	79 (118)	70 (105)
16"	59.5 (72)	24.5 (30)	12 (14.5)	6 (7)	101 (152)	92 (139)
20"	72 (86.5)	30 (36)	14.5 (17)	7 (8.5)	123 (184)	114 (171)
24"	84 (100)	35 (41)	16.5 (20)	8 (10)	144 (216)	134 (202)
30"	100 (120)	41 (50)	20 (24)	10 (12)	174 (261)	165 (247)

NOTES:

1. RESTRAINED LENGTHS LISTED IN PARENTHESES ARE FOR PIPE WRAPPED IN POLYETHYLENE. THE OTHER ASSOCIATED LENGTHS ARE FOR PLAIN UNWRAPPED DUCTILE IRON PIPE.
2. THE CONTRACTOR SHALL USE THIS TABLE IN CONJUNCTION WITH THE APPROPRIATE PIPE SPECIFICATION SECTION.

RESTRAINED JOINT TABLE

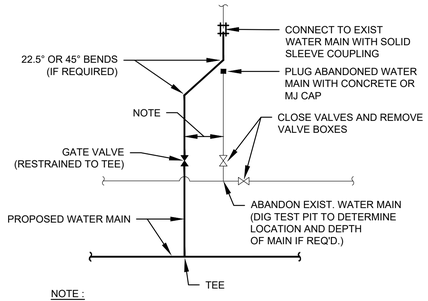

NOTE :

MINIMUM PRACTICAL DISTANCE - GENERALLY NO MORE THAN 2 FT.

WATER MAIN LATERAL CONNECTION

N.T.S.

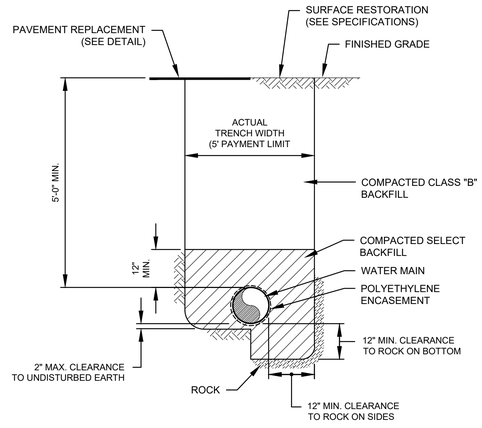

WATER MAIN TRENCH DETAIL

N.T.S.

Project:

LITTLETON WATER DEPARTMENT

LITTLETON LELWD ELECTRIC LIGHT & WATER DEPARTMENTS

WATER SUPPLY FROM LITTLETON TO BOXBOROUGH
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO. 2

Weston & Sampson

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:

COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:

FOR PERMIT REVIEW ONLY

Scale:	AS NOTED
Date:	OCTOBER 2023
Drawn By:	GJK/RWS
Reviewed By:	SBR
Approved By:	TEM
W&S Project No.:	ENG23-0679
W&S File No.:	

Drawing Title:

DETAILS I

Sheet Number:

C501

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

\\wsfs1.local\WSEProjects\Millville\DOT\13500 Water + Roadway\04 Water Supply + Letters to Boxborough\000 CAD\Civil\C501-000 Details From Water.dwg

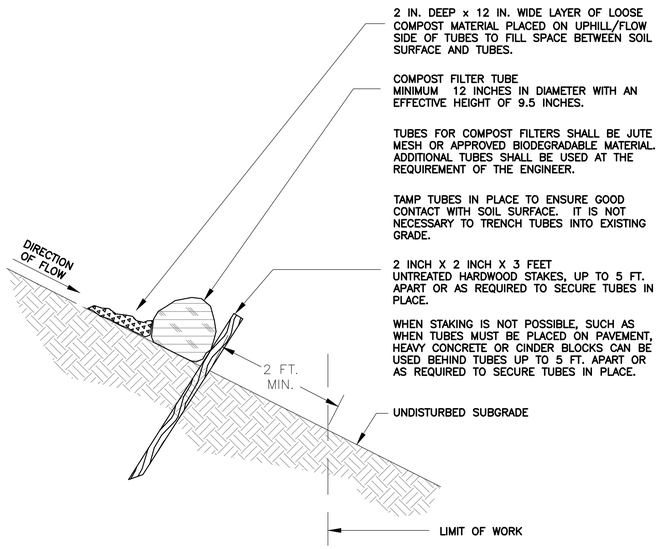

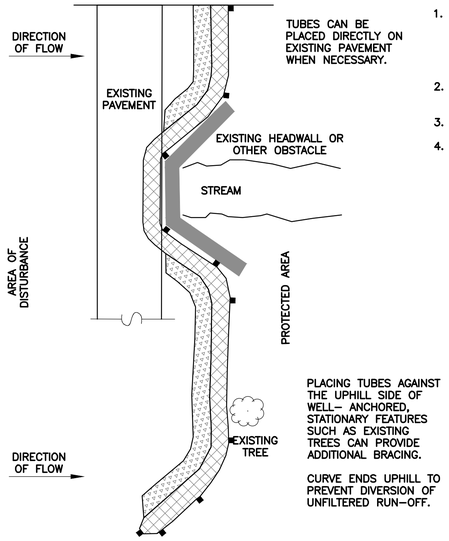

PLAN VIEW

SINGLE COMPOST FILTER TUBE DETAIL

NOT TO SCALE

GENERAL NOTES:

1. PROVIDE A MINIMUM TUBE DIAMETER OF 12 INCHES FOR SLOPES UP TO 50 FEET IN LENGTH WITH A SLOPE RATIO OF 3H:1V OR STEEPER. LONGER SLOPES OF 3H:1V MAY REQUIRE LARGER TUBE DIAMETER OR ADDITIONAL COURSING OF FILTER TUBES TO CREATE A FILTER BERM. REFER TO MANUFACTURER'S RECOMMENDATIONS FOR SITUATIONS WITH LONGER OR STEEPER SLOPES.
2. INSTALL TUBES ALONG CONTOURS AND PERPENDICULAR TO SHEET OR CONCENTRATED FLOW.
3. DO NOT INSTALL IN PERENNIAL, EPHEMERAL OR INTERMITTENT STREAMS.
4. CONFIGURE TUBES AROUND EXISTING SITE FEATURES TO MINIMIZE SITE DISTURBANCE AND MAXIMIZE CAPTURE AREA OF STORMWATER RUN–OFF.

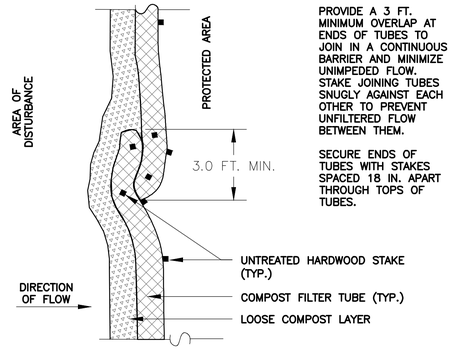

PLAN VIEW – JOIN DETAIL



CATCH BASIN PROTECTION DETAIL

N.T.S.

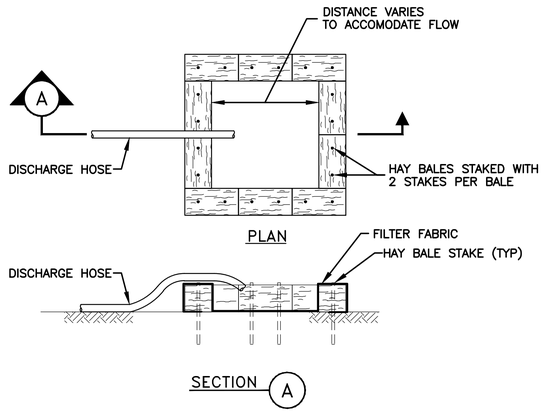

DEWATERING DISCHARGE DISPOSAL DETAIL

N.T.S.

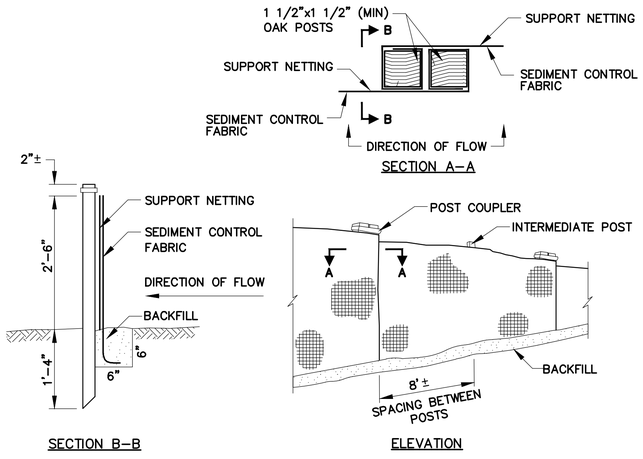

SILT FENCE DETAIL

N.T.S.

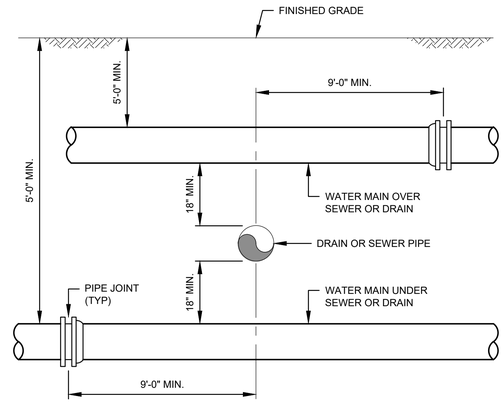

SEWER OR DRAIN CROSSING DETAIL

N.T.S.

Project:
LITTLETON WATER DEPARTMENT
LITTLETON LELWD ELECTRIC LIGHT & WATER DEPARTMENTS
WATER SUPPLY FROM LITTLETON TO BOXBOROUGH
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO. 2

Weston & Sampson
Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:
COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:
FOR PERMIT REVIEW ONLY

Scale:	AS NOTED
Date:	OCTOBER 2023
Drawn By:	GJK/RWS
Reviewed By:	SBR
Approved By:	TEM
W&S Project No.:	ENG23-0679
W&S File No.:	

Drawing Title:
DETAILS II

Sheet Number:
C502

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

\\wse03.local\WSEProjects\MA\Littleton\DOT\13505 Water + Wastewater\AA Water Supply + Meters to Boxborough\05K CAD\Civil\C501-505 Details Erosion Control.dwg

LITTLETON WATER DEPARTMENT

TAYLOR STREET WELL AND RAW WATER MAIN
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397 - CONTRACT NO.1

NICK LAWLER - GENERAL MANAGER
DAVE KETCHEN - ASSISTANT GENERAL MANAGER
COREY GODFREY - WATER SUPERINTENDENT

DRAWING INDEX

SHEET	TITLE
G000	COVER AND SHEET LIST
G001	ABBREVIATIONS, NOTES, AND LEGEND
C101	RAW WATER PLAN WHITCOMB AVENUE
C102	RAW WATER PLAN WHITCOMB AVENUE
C103	RAW WATER PLAN CROSS COUNTRY
C104	ACCESS ROAD GRADING & DRAINAGE PLAN
C105	ACCESS ROAD GRADING & DRAINAGE PLAN
C201	BEAVER BROOK DIRECTIONAL DRILL
C501	DETAILS I
C502	DETAILS II
C503	DETAILS III
C504	DETAILS IV

LOCUS MAP
SCALE : 1"=2000'

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Issued Date:

OCTOBER 2023

Seal:

COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

811 Know what's **below.** **Call** before you dig.

Issued For:

FOR PERMIT REVIEW

FILE NO. ___-__

COPYRIGHT 2023 WESTON & SAMPSON

\\wse03.local\WESP\Projects\MA Mass\20713106 Water + Resiliency\04 Water Supply - Littleton to Boxborough\04 CAD\Civil\M0G000 - Cover Sheet Raw Water.dwg

LEGEND

DESCRIPTION	EXISTING	PROPOSED
SANITARY SEWER	S	S
FORCE MAIN	FM	FM
WATER MAIN	W	W
TEMPORARY WATER		TW
STORM DRAIN	D	D
GAS	G	G
ELECTRIC	E	E
OVERHEAD WIRE	OHW	OHW
TELEPHONE	T	T
CABLE TELEVISION	CATV	CATV
GRINDER PUMP		GP
SANITARY SEWER MANHOLE	S	SMH
STORM DRAIN MANHOLE	D	DMH
ELECTRICAL MANHOLE	E	EMH
TELEPHONE MANHOLE	T	TMH
AIR RELEASE VALVE MANHOLE		ARMH
FORCE MAIN CLEANOUT MANHOLE		FMCO
CLEANOUT		CO
CATCH BASIN		CB
CATCH BASIN (CURB INLET)		
HYDRANT		
TEMPORARY HYDRANT		H
GATE VALVE		
CHECK VALVE		
CURB STOP		
BUTTERFLY VALVE		
BALL VALVE		
REDUCER		
CAP OR PLUG		
GAS GATE VALVE		
UTILITY POLE		
GUY POLE		
LIGHT POST		
EDGE OF PAVEMENT		
EDGE OF UNPAVED ROAD		
CURB		
SIDEWALK		
RAILROAD		
STONE WALL		
RETAINING WALL	RET WALL	RET WALL
FENCE	x x	x x
INDIVIDUAL DECIDUOUS TREE		
INDIVIDUAL EVERGREEN TREE		
TREE LINE		
SURVEY MARKER		
PROPERTY LINE		
EASEMENT LINE		
LIMIT OF WORK		
APPROX. LIMIT OF REFUSE		
SPOT ELEVATIONS	x100.5	x100.5
CONTOUR LINES	56	56
DEPRESSION CONTOUR LINES		
HOUSE NUMBER	#35	
FLOOR ELEVATION	FL=56.7	
SILL ELEVATION	S=56.7	
WETLAND		
WETLAND FLAGS		WF-7 WF-8
RIP RAP		
DRAINAGE DITCH / SWALE		
STATE HIGHWAY STATION	10	
GUARD POST		
BOLLARD	B	B
SIGN		
BENCH MARK		
PERCOLATION TEST	PT-1	PT-1
TEST PIT	TP-1	TP-1
BORING	B-1	B-1
PROBE	P-1	P-1
GROUNDWATER MONITORING WELL	WS-1	WS-1
GAS MONITORING WELL	GMW-1	GMW-1
GAS VENT	GV	GV
HAY BALES		
ROCK OUTCROP		

NOTE: ITEMS SHOWN IN THE LEGEND MAY NOT BE PRESENT IN THESE PLANS

ABBREVIATIONS

AC	ASBESTOS CEMENT PIPE
ACCMP	ASPHALT COATED CORRUGATED METAL PIPE
ARV	AIR RELEASE VALVE
ASTM	ASTM INTERNATIONAL
BC	BITUMINOUS CONCRETE
BIT	BITUMINOUS
BLDG	BUILDING
BM	BENCH MARK
BO	BLOW OFF
BV	BUTTERFLY VALVE
CATV	CABLE TELEVISION
CB	CATCH BASIN
CC	CONCRETE CURB
CI	CAST IRON
℄	CENTERLINE
CL	CEMENT LINED
CMP	CORRUGATED METAL PIPE
CONC	CONCRETE
CU FT	CUBIC FEET
CY	CUBIC YARD
D	STORM DRAIN, DEPTH FROM RIM TO INVERT
DI	DROP INLET, DUCTILE IRON
DIA	DIAMETER
DMH	DRAIN MANHOLE
DWG	DRAWING
E	EAST, ELECTRIC
EA	EACH
EF	EACH FACE
ELEV	ELEVATION
EOP	EDGE OF PAVEMENT
EW	EACH WAY
EXIST	EXISTING
FLG	FLANGE
FT	FEET, FOOT
G	NATURAL GAS
GALV	GALVANIZED
GC	GRANITE CURB
GR	GRANITE
HC	HOUSE CONNECTION
HORIZ	HORIZONTAL
HP	HIGH PRESSURE
HYD	FIRE HYDRANT
I	INVERT
INV	INVERT
ID	INSIDE DIAMETER
IP	IRON PIPE
LB	POUND
LF	LINEAR FEET
LS	LUMP SUM
MAX	MAXIMUM
MB	MAIL BOX
MECH	MECHANICAL
MH	MANHOLE
MassDOT	MASSACHUSETTS DEPARTMENT OF TRANSPORTATION
MIN	MINIMUM
MISC	MISCELLANEOUS
MJ	MECHANICAL JOINT
MWRA	MASSACHUSETTS WATER RESOURCES AUTHORITY
N	NORTH
NE	NORTH EAST
NW	NORTH WEST
NF	NOT FOUND
NO OR #	NUMBER
OD	OUTSIDE DIAMETER
PCCP	PRESTRESSED CONCRETE CYLINDER PIPE
PE	PLAIN END, POLYETHYLENE
℄	PROPERTY LINE
PL	PLATE
PVC	POLYVINYL CHLORIDE
PVCO	MOLECULARLY ORIENTED POLYVINYL CHLORIDE
PVMT	PAVEMENT
RCP	REINFORCED CONCRETE PIPE
ROW	RIGHT-OF-WAY
RQD	ROCK QUALITY
S	SEWER, SOUTH
SE	SOUTH EAST
SECT	SECTION
SF	SQUARE FEET
SHT	SHEET
SPEC	SPECIFICATIONS
SQ FT	SQUARE FEET
SS	SEWER SERVICE, STAINLESS STEEL
STA	STATION
STL	STEEL
SW	SIDEWALK, SOUTH WEST
T	HYDROSTATIC THRUST, TELEPHONE
TBM	TEMPORARY BENCH MARK
THK	THICK (NESS)
TYP	TYPICAL
UP	UTILITY POLE
VC	VITRIFIED CLAY
VERT	VERTICAL
W	WATER, WEST
W/	WITH
W/O	WITHOUT

CONSTRUCTION NOTES

1. THE CONTRACTOR SHALL CALL DIGSAFE AT 1-888-344-7233 AND CITY/TOWN DEPARTMENTS AS APPROPRIATE AT LEAST 72 HOURS, SATURDAYS, SUNDAYS, AND HOLIDAYS EXCLUDED, PRIOR TO EXCAVATING AT ANY LOCATION. A COPY OF THE DIGSAFE PROJECT REFERENCE NUMBER(S) SHALL BE GIVEN TO THE OWNER PRIOR TO EXCAVATION.
2. LOCATIONS OF EXISTING PIPES, CONDUITS, UTILITIES, FOUNDATIONS AND OTHER UNDERGROUND OBJECTS ARE NOT WARRANTED TO BE CORRECT AND THE CONTRACTOR SHALL HAVE NO CLAIM ON THAT ACCOUNT SHOULD THEY BE OTHER THAN SHOWN.
3. TEST PITS TO LOCATE EXISTING UTILITIES MAY BE ORDERED BY THE ENGINEER TO DETERMINE WHETHER TO RAISE OR LOWER THE PROPOSED WATER MAIN TO CLEAR EXISTING UTILITIES OR VERIFY EXISTING UTILITY LOCATION, SIZE AND TYPE.
4. STONE WALLS, FENCES, MAIL BOXES, SIGNS, CURBS, LIGHT POLES, ETC. SHALL BE REMOVED AS NECESSARY TO PERFORM THE WORK AND REPLACED TO A CONDITION AT LEAST EQUAL TO THAT BEFORE CONSTRUCTION BEGAN. UNLESS OTHERWISE INDICATED, ALL SUCH WORK SHALL BE INCIDENTAL TO CONSTRUCTION OF THE PROJECT.
5. ALL PAVEMENT DISTURBED BY THE CONTRACTOR'S OPERATIONS SHALL BE REPLACED IN ACCORDANCE WITH THE SPECIFICATIONS AND AS SHOWN ON THE DRAWINGS.
6. ALL AREAS DISTURBED BY THE CONTRACTOR BEYOND PAYMENT LIMITS SHALL BE RESTORED AT NO ADDITIONAL COST TO THE OWNER.
7. UNLESS OTHERWISE INDICATED, CONCRETE USED FOR PIPE ANCHOR BLOCKS, BACKING, PIPE CRADLES, ARCHES, AND FILL SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI AT 28 DAYS.
8. APPROVED JOINT RESTRAINT METHODS SHALL BE PROVIDED FOR WATER MAINS WHERE ANY BENDS, TEES, PLUGS, OR WYES ARE INSTALLED. CONCRETE THRUST BLOCKS, ANCHOR BLOCKS AND TIE RODS MAY BE USED FOR 6-INCH AND 8-INCH PIPE WHERE JOINT RESTRAINT IS NOT FEASIBLE UPON APPROVAL OF THE ENGINEER. SEE TABLE 1 DETAIL FOR REQUIRED RESTRAINING LENGTHS AND SPECIFICATIONS FOR ADDITIONAL INFORMATION.
9. THE CONTRACTOR SHALL NOT STORE ANY APPARATUS, MATERIALS, SUPPLIES, OR EQUIPMENT ON DRAINAGE STRUCTURES OR WITHIN 100 FEET OF WETLANDS.
10. NEW WATER MAINS AND SERVICES SHALL BE INSTALLED AT THE MINIMUM DEPTH FROM FINISH GRADE TO TOP OF PIPE AS SHOWN ON THE DRAWINGS. WHERE NECESSARY, NEW WATER MAINS SHALL BE INSTALLED AT A GREATER DEPTH TO CLEAR OBSTACLES SHOWN ON THE DRAWINGS AT NO ADDITIONAL COST TO THE OWNER. MINIMUM CLEARANCES TO UTILITIES, AS SHOWN ON THE DRAWINGS SHALL BE MAINTAINED.
11. EXISTING SERVICES SHALL NOT BE CONNECTED TO THE PROPOSED WATER MAIN UNTIL THAT MAIN HAS PASSED PRESSURE TEST AND DISINFECTION REQUIREMENTS.
12. EXISTING WATER MAINS OR SERVICES SHALL NOT BE ABANDONED WITHOUT THE APPROVAL OF THE OWNER. WATER SERVICE SHALL NOT BE INTERRUPTED MORE THAN 4 HOURS WITHOUT PRIOR APPROVAL OF THE OWNER.
13. ALL HYDRANTS REMOVED SHALL BE SALVAGED AND DELIVERED TO A LOCATION TO BE DETERMINED BY THE OWNER. SURFACE RESTORATION SHALL BE IN KIND UNLESS OTHERWISE NOTED.
14. ANY HYDRANT WHICH IS NOT IN SERVICE SHALL BE COVERED WITH A SECURELY FASTENED AND APPROVED BAG.
15. THE LOCATION OF PIPES, CAPS, REDUCERS, BENDS, AND OTHER FITTINGS AT POINTS OF CONNECTIONS TO EXISTING MAINS IS APPROXIMATE. CONTRACTOR SHALL DIG A TEST PIT AT EACH LOCATION TO DETERMINE THE DIAMETER AND MATERIAL OF THE EXISTING PIPE AND THE LOCATION OF THE TIE-IN POINT.
16. ALL CATCH BASINS WITHIN PROJECT LIMITS SHALL BE PROTECTED AS SHOWN ON DETAIL SHEET.
17. THE CONTRACTOR SHALL NOTIFY THE MassDOT DISTRICT PERMITS ENGINEER AT 857-368-3000 TWO (2) DAYS PRIOR TO THE START OF WORK IN A STATE ROADWAY.
18. ALL STREET EXCAVATIONS SHALL BE COMPLETELY CLOSED AT THE END OF EACH WORKING DAY BY BACKFILLING. COVERING WITH STEEL PLATES MAY BE ALLOWED IF APPROVED BY THE ENGINEER.
19. THE CONTRACTOR SHALL COMPLY WITH ALL REQUIREMENTS OF MASSACHUSETTS GENERAL LAW CHAPTER 82A, TRENCH EXCAVATION AND SAFETY REQUIREMENTS, TO PREVENT THE GENERAL PUBLIC FROM UNAUTHORIZED ACCESS TO UNATTENDED TRENCHES.
20. THE CONTRACTOR SHALL NOT OPEN OR CLOSE ANY VALVES WHICH HOLD WATER IN THE SYSTEM. THE OWNER WILL, ON 72 HOURS NOTICE FROM THE CONTRACTOR, OPEN AND/OR CLOSE ANY VALVES REQUIRED FOR DRAINING OR ADMITTING WATER TO THE VARIOUS SECTIONS OF THE WATER MAINS. THE CONTRACTOR IS RESPONSIBLE TO NOTIFY IN WRITING 48 HOURS IN ADVANCE, ANY OCCUPANT THAT WILL BE WITHOUT WATER DUE TO A SHUTDOWN.
21. SOME WATER SERVICE CONNECTIONS MAY NOT BE SHOWN ON THE DRAWINGS. THE OWNER WILL MARK THE LOCATION OF SUCH CONNECTIONS, PROVIDED THE CONTRACTOR GIVES THE OWNER AT LEAST 72 HOURS ADVANCE NOTICE.
22. ALL NEW WATER SERVICES SHALL BE THE SAME SIZE AS THE EXISTING WATER SERVICE, EXCEPT THAT NO SERVICE SHALL BE LESS THAN 1" DIAMETER. COORDINATE THIS WORK WITH THE WATER DEPARTMENT.
23. ELEVATIONS REFERENCED ARE NAD83 MASSACHUSETTS STATE PLANES, MAINLAND ZONE, US FOOT.
24. EXISTING UTILITY INFORMATION, TOPOGRAPHIC INFORMATION, EDGE OF PAVEMENT, UTILITY POLE LOCATIONS, AND LOCATIONS OF EXISTING ABOVE GROUND STRUCTURES WERE TAKEN FROM PLANS PREPARED BY BEALS AND THOMAS, INC., KELLY ENGINEERING GROUP, GIS DATA, AND GROUND SURVEY CONDUCTED BY WESTON & SAMPSON.
25. ASSESSORS INFORMATION REPRESENTED ON THESE DRAWINGS IS TAKEN FROM THE CITY/TOWN ASSESSOR'S PARCEL MAPS, MASS GIS DATA AND IS INCLUDED FOR ILLUSTRATIVE PURPOSES ONLY. ASSESSORS INFORMATION IS NOT INTENDED TO BE AN AUTHORITATIVE RECORD OF PROPERTY BOUNDARIES OR A SOURCE OF INFORMATION FOR AN ACTUAL SURVEY OR LEGAL DESCRIPTION OF THE PROPERTY. NO WORK HAS BEEN PERFORMED TO DETERMINE THE DEPICTED PROPERTY LINES AND THEREFORE, THESE DRAWINGS ARE NOT INTENDED BE USED TO DELINEATE ANY EXISTING OR PROPOSED STRUCTURES, FEATURES OR BOUNDARIES RELATIVE TO PROPERTY LINES. AUTHORITATIVE RECORDS OF PROPERTY LINES MAY BE LOCATED AT THE STATE OR MUNICIPAL AGENCY RESPONSIBLE FOR MAINTAINING PUBLIC RECORDS IN WHICH THE PARCEL IS LOCATED. LEGALLY AUTHORITATIVE MAPS OF PROPERTY LINES MAY ONLY BE PRODUCED BY A PROFESSIONAL LAND SURVEYOR.

Project:

LITTLETON WATER DEPARTMENT

LITTLETON LELWD ELECTRIC LIGHT & WATER DEPARTMENTS

TAYLOR STREET WELL AND RAW WATER MAIN
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO.1

Weston & Sampson

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:

COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:

FOR PERMIT REVIEW ONLY

Scale: AS NOTED

Date: OCTOBER 2023
Drawn By: GJK/RWS
Reviewed By: SBR
Approved By: TEM

W&S Project No.: ENG23-0679
W&S File No.:

Drawing Title:

ABBREVIATIONS, NOTES, & LEGEND

Sheet Number:

G001

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

\\wes453.local\WSPProjects\MAMaud2071\2500 Water + Sewer\cvil\ Water Supply - Littleton to Boxborough\GW CAD\General\G001 - Abbreviations Notes & Legend -Raw Water.dwg

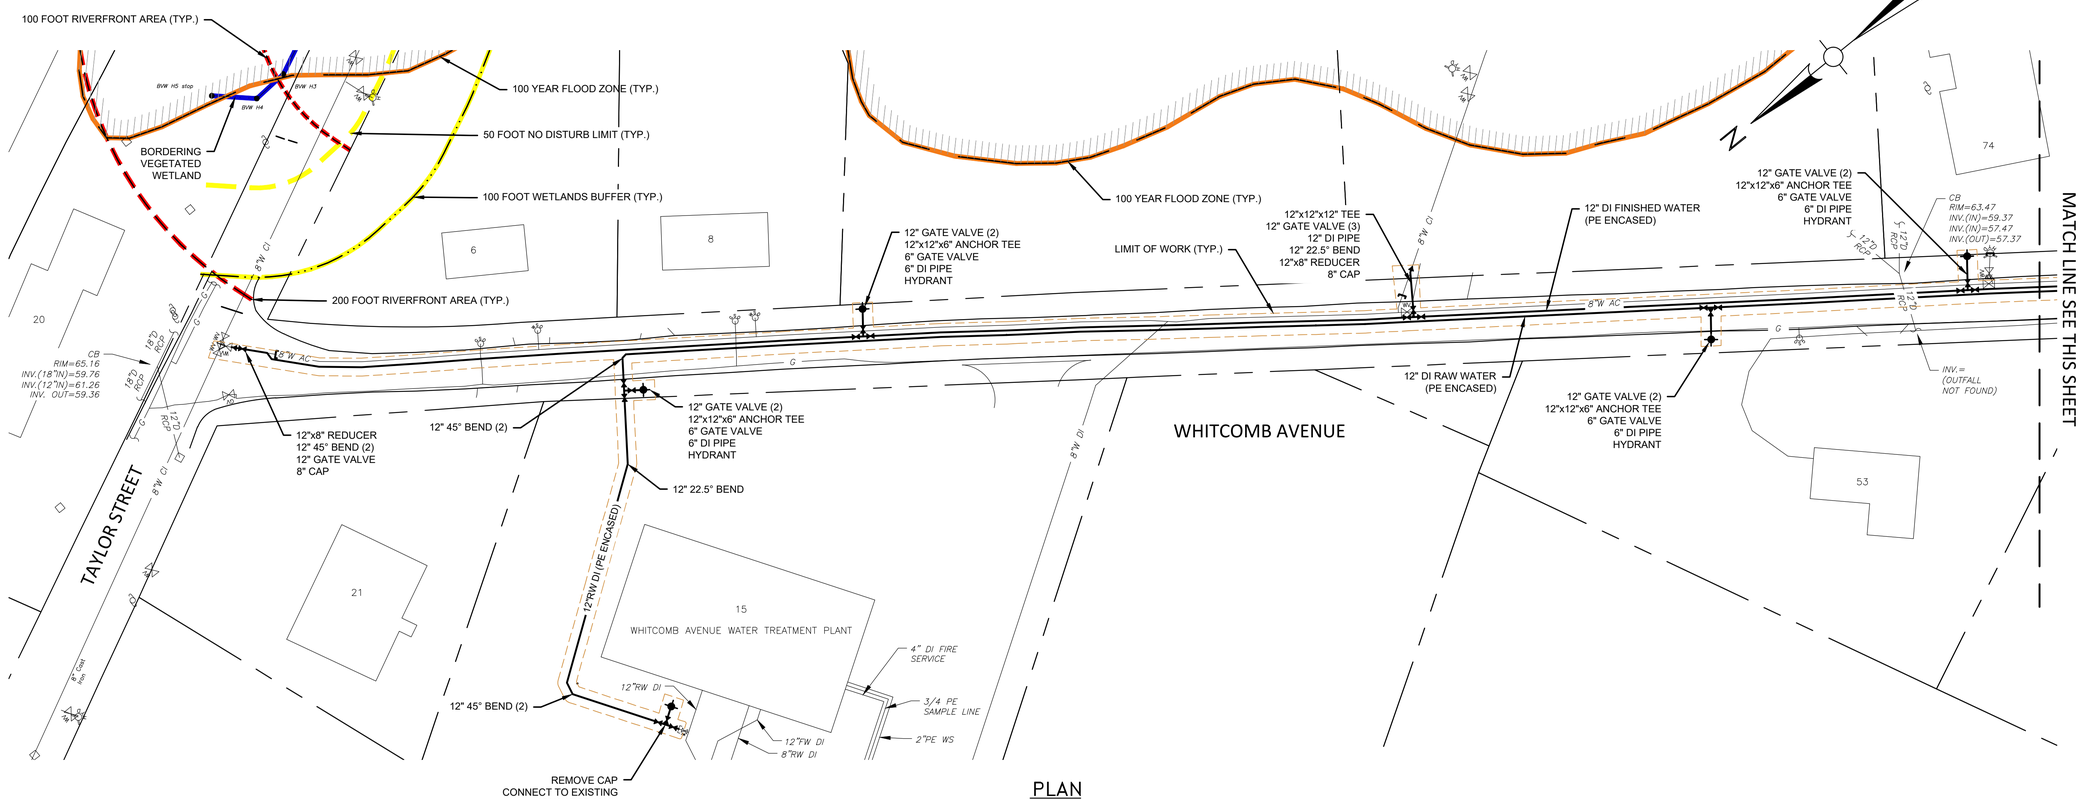

Project:

LITTLETON WATER DEPARTMENT

TAYLOR STREET WELL AND RAW WATER MAIN
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO.1

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:

COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:

FOR PERMIT REVIEW ONLY

Scale: AS NOTED

Date:	OCTOBER 2023
Drawn By:	GJK/RWS
Reviewed By:	SBR
Approved By:	TEM
W&S Project No.:	ENG23-0679
W&S File No.:	

Drawing Title:

RAW WATER PLAN WHITCOMB AVENUE

Sheet Number:

C101

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

\\ws01\civil\WSE Projects\MA\Mas\25711\006 Water + Biodiversity\SW Water Supply – Letters to Biodiversity\SW CAD\CIVIL\C105 Raw Water Plans_NO3 (Meter.dwg

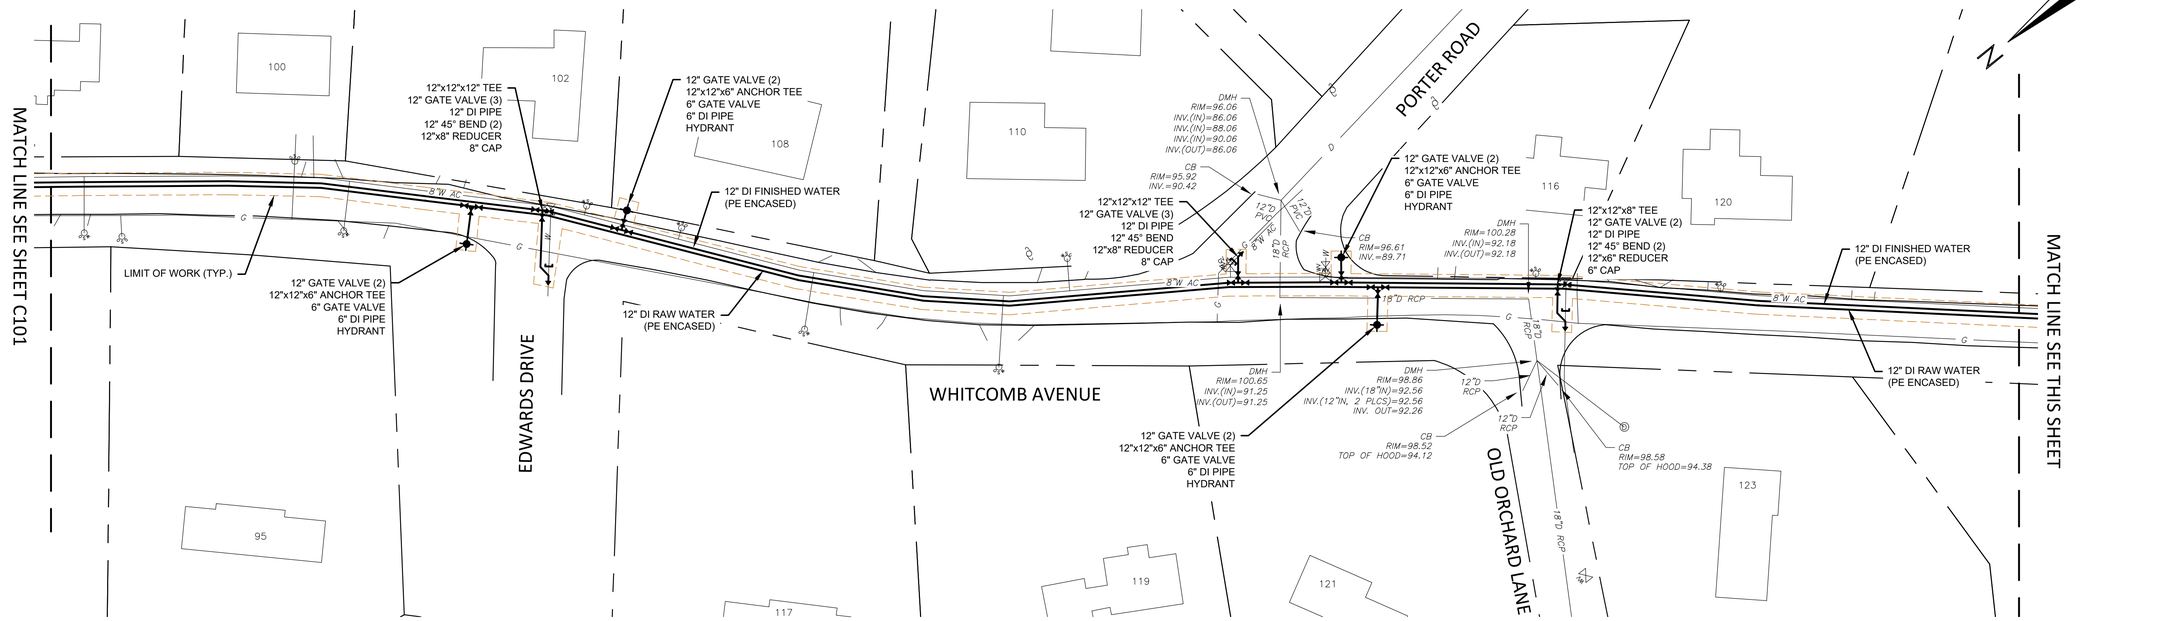

PLAN

SCALE: 1" = 40'

NOTES:

1. WETLAND DELINEATION CONDUCTED ON DECEMBER 5,6, AND 21, JANUARY 5 AND 18, 2023, AND AUGUST 17, 2023 BY DEVIN HERRICK, CWS.
2. ENTIRE PLAN VIEW IS WITHIN LITTLETON GIS AQUIFER ZONING OVERLAY DISTRICT.

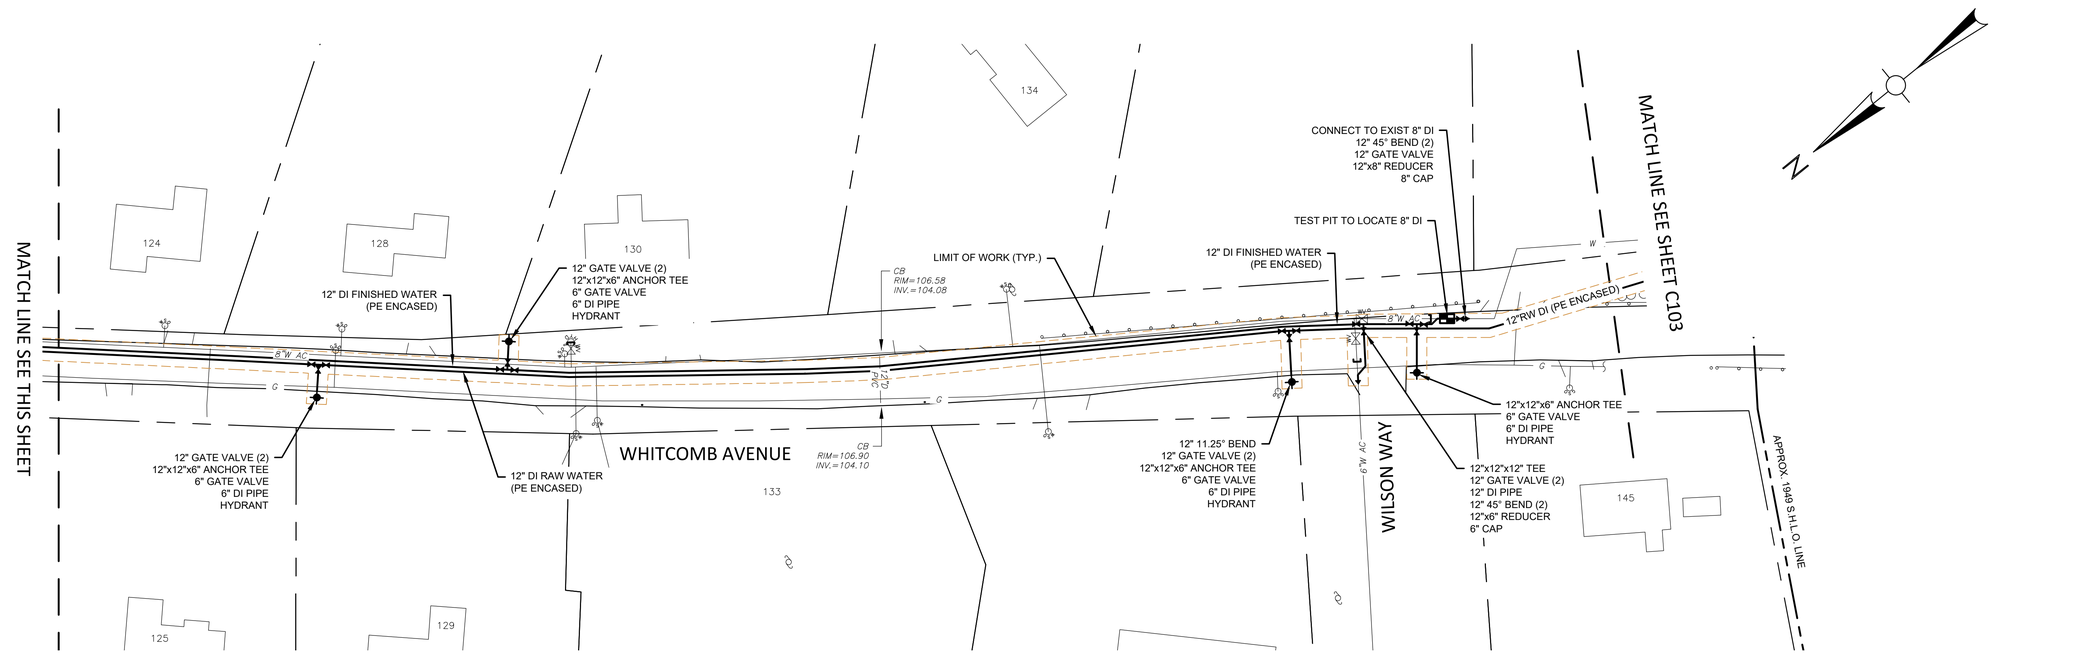

PLAN

SCALE: 1" = 40'

40 20 0 40 80

SCALE: 1"=40'

Project:

LITTLETON WATER DEPARTMENT

LITTLETON LELWD ELECTRIC LIGHT & WATER DEPARTMENTS

TAYLOR STREET WELL AND RAW WATER MAIN
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO.1

Weston & Sampson

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:

COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:

FOR PERMIT REVIEW ONLY

Scale: AS NOTED

Date: OCTOBER 2023
Drawn By: GJK/RWS
Reviewed By: SBR
Approved By: TEM

W&S Project No.: ENG23-0679
W&S File No.:

Drawing Title:

RAW WATER PLAN
WHITCOMB AVENUE

Sheet Number:

C102

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

\\wes01\local\WSE\Projects\MA\West\20713\06 Water + Wastewater\06 CAD\CAM\CIVIL\C103 Raw Water Plans - NO1.1.dwg, Jay

MATCH LINE SEE SHEET C102

APPROX. 1949 S.H.L.O. LINE

12" 22.5° BEND

12"x12"x12" TEE
12" 45° BEND (2)
12" GATE VALVE (4)
12"x12"x6" ANCHOR TEE (2)
6" GATE VALVE (2)
6" DI PIPE
HYDRANT (2)

12" 45° BEND (2)
12" GATE VALVE (3)
12"x12"x6" ANCHOR TEE
6" GATE VALVE
6" DI PIPE
HYDRANT

100 FOOT RIVERFRONT AREA (TYP.)

200 FOOT RIVERFRONT AREA (TYP.)

DIRECTIONAL DRILL ACCESS PIT

DIRECTIONAL DRILL

BEAVER BROOK

ROUTE 2 (WEST)

ROUTE 2 (EAST)

WHITCOMB AVENUE

12"x12"x12" TEE
12" 45° BEND (3)
12" GATE VALVE (4)
12"x12"x6" ANCHOR TEE (2)
6" GATE VALVE (2)
6" DI PIPE
HYDRANT (2)

12" DI RAW WATER MAIN

APPROX. 1949 S.H.L.O. LINE

100 FOOT WETLANDS BUFFER (TYP.)

POND

50 FOOT NO DISTURB LIMIT (TYP.)

BORDERING VEGETATED WETLAND

PERENNIAL STREAM

100 YEAR FLOOD ZONE (TYP.)

APPROXIMATE UPLAND ISLAND

12" RAW WATER MAIN - DOT EASEMENT

COMPOST FILTER TUBES (TYP.)

100 FOOT WETLANDS BUFFER (TYP.)

12" GATE VALVE (2)
12"x12"x6" ANCHOR TEE
6" GATE VALVE
6" DI PIPE
HYDRANT

50 FOOT NO DISTURB LIMIT (TYP.)

LIMIT OF WORK (TYP.)

12" 45° BEND (2)

12"RW DI (PE ENCASED)

12" GATE VALVE (3)
12"x12"x6" ANCHOR TEE
6" GATE VALVE
6" DI PIPE
HYDRANT

12" 11.25° BEND

12" 45° BEND

12" 45° BEND

12" GATE VALVE (2)
12"x12"x6" ANCHOR TEE
6" GATE VALVE
6" DI PIPE
HYDRANT

12" 22.5° BEND (2)

PROPOSED BIT CONC ACCESS ROAD

3-PH PRIMARY FEED
12" RAW WATER MAIN

12" 11.25° BEND

SEE ENLARGED PLAN THIS SHEET

BORDERING VEGETATED WETLAND

AMAZON WAREHOUSE PARKING LOT

NOTES:

1. WETLAND DELINEATION CONDUCTED ON DECEMBER 5,6, AND 21, JANUARY 5 AND 18, 2023, AND AUGUST 17, 2023 BY DEVIN HERRICK, CWS.
2. ENTIRE PLAN VIEW IS WITHIN LITTLETON GIS AQUIFER ZONING OVERLAY DISTRICT.

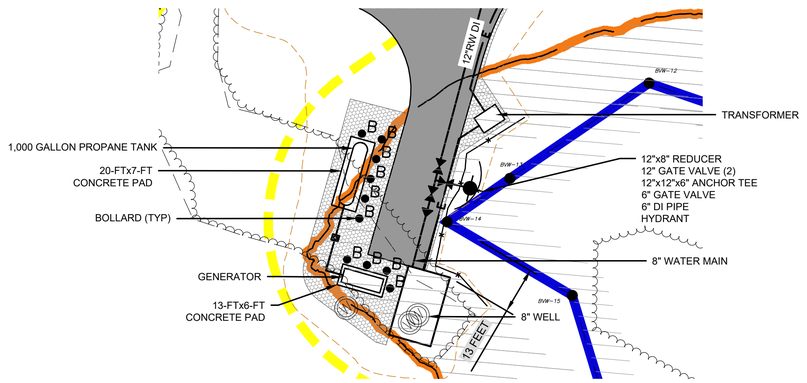

WELL SITE PLAN
SCALE: 1"=20'

20 10 0 20 40
SCALE: 1"=20'

PLAN
SCALE: 1" = 80'

80 40 0 80 160
SCALE: 1"=80'

Project:
LITTLETON WATER DEPARTMENT
LITTLETON LELWD ELECTRIC LIGHT & WATER DEPARTMENTS
TAYLOR STREET WELL AND RAW WATER MAIN
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO.1

Weston & Sampson
Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:
COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:
FOR PERMIT REVIEW ONLY

Scale: AS NOTED

Date:	OCTOBER 2023
Drawn By:	GJK/RWS
Reviewed By:	SBR
Approved By:	TEM
W&S Project No.:	ENG23-0679
W&S File No.:	

Drawing Title:
RAW WATER PLAN CROSS COUNTRY

Sheet Number:
C103

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

I:\wse01\cad\WSProjects\MA\Aug2017\3506.Water + Sewer\proj\04.Water Supply - Littleton to Boxborough\05.CAD\CIVIL\C105 Raw Water Plans - MOI (Station Alley

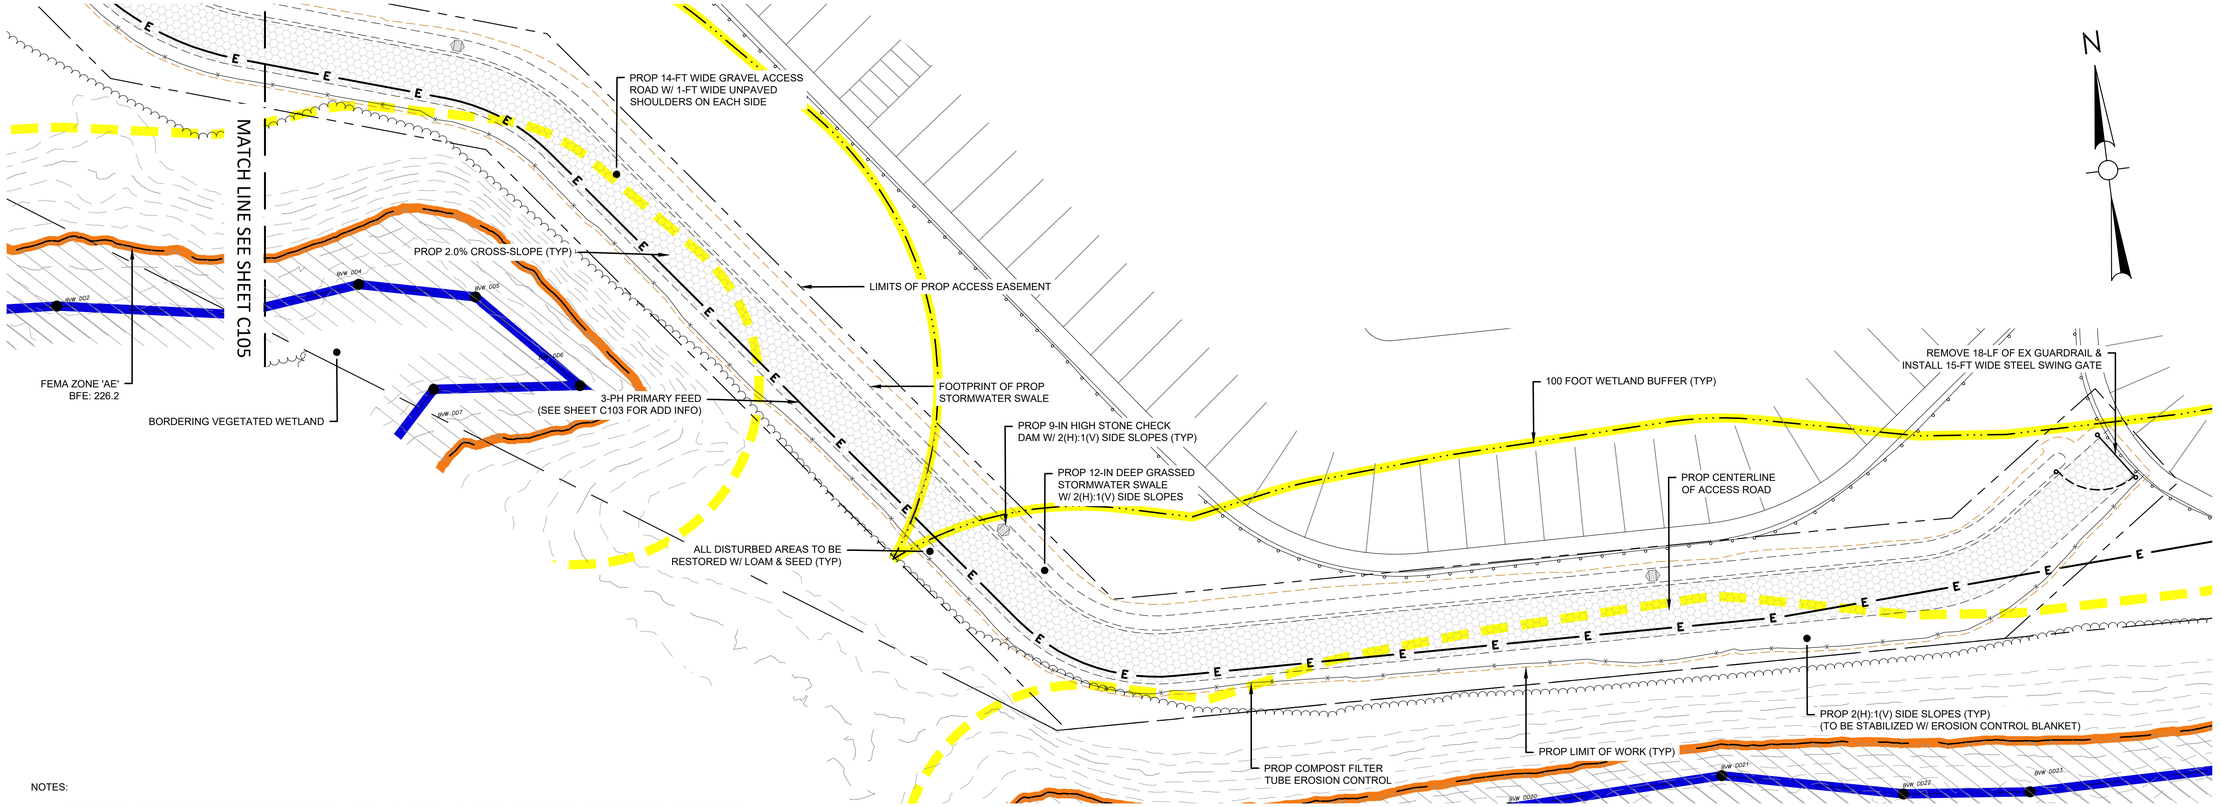

NOTES:

1. WETLAND DELINEATION CONDUCTED ON DECEMBER 5,6, AND 21, JANUARY 5 AND 18, 2023, AND AUGUST 17, 2023 BY DEVIN HERRICK, CWS.
2. ENTIRE PLAN VIEW IS WITHIN LITTLETON GIS AQUIFER ZONING OVERLAY DISTRICT.

PLAN

SCALE: 1" = 20'

20 10 0 20 40

SCALE: 1"=20'

EX GRADE (TYP)

PROP GRADE (TYP)

PROFILE

SCALE: 1"=20' HORIZ
1"=4' VERT

20 10 0 20 40
4 2 0 4 8

HORIZONTAL SCALE: 1"=20'
VERTICAL SCALE: 1"=4'

Project:

LITTLETON WATER DEPARTMENT

LITTLETON LELWD ELECTRIC LIGHT & WATER DEPARTMENTS

TAYLOR STREET WELL AND RAW WATER MAIN
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO.1

Weston & Sampson

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:

COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:

FOR PERMIT REVIEW ONLY

Scale:	AS NOTED
Date:	OCTOBER 2023
Drawn By:	GJK/RWS
Reviewed By:	SBR
Approved By:	TEM
W&S Project No.:	ENG23-0679
W&S File No.:	

Drawing Title:

ACCESS ROAD GRADING & DRAINAGE PLAN

Sheet Number:

C104

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

I:\wse01\Local\WSProjects\Littleton\DOT\13936 Water + Roadway\04 Water Supply + Littleton to Boxborough\RW CAD\CAD\ACD\01 C105 Raw Water Plan + ACV Station.dwg

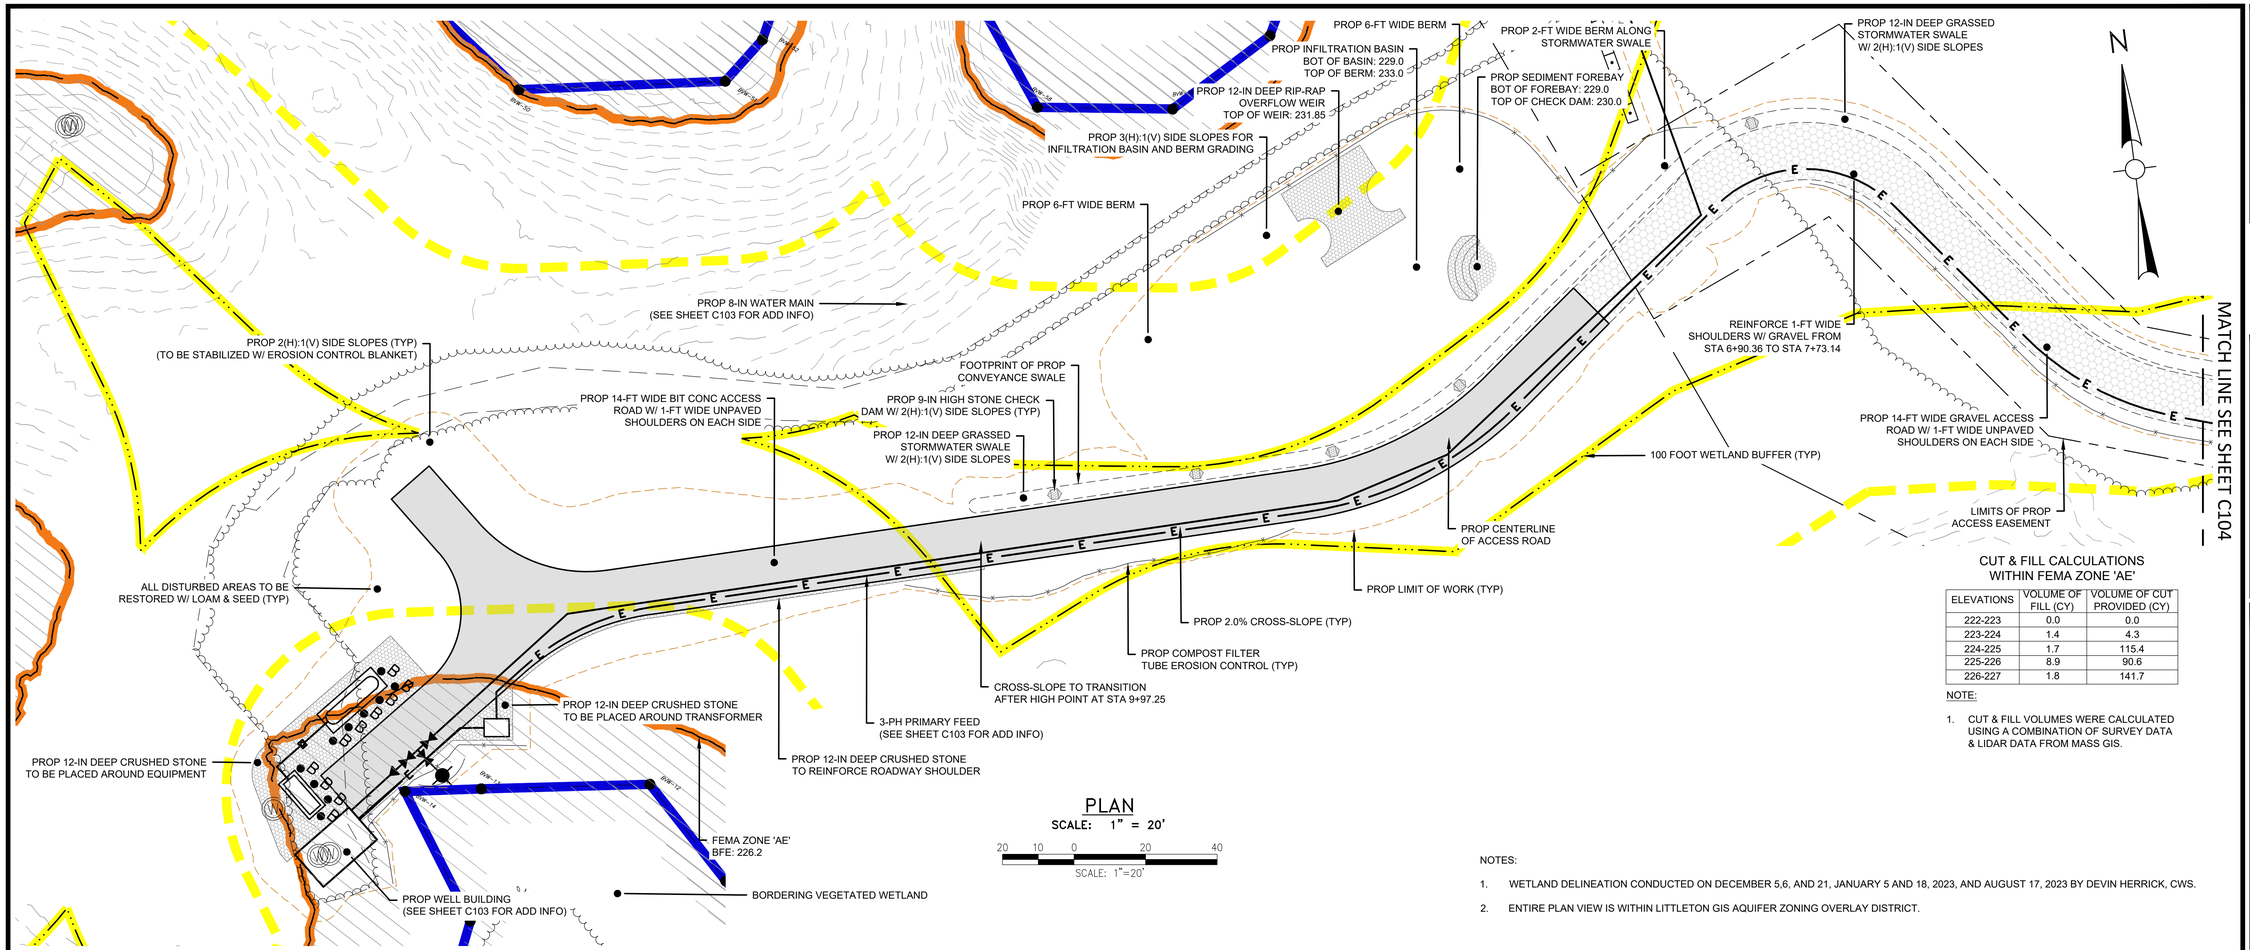

CUT & FILL CALCULATIONS
WITHIN FEMA ZONE 'AE'

ELEVATIONS	VOLUME OF FILL (CY)	VOLUME OF CUT PROVIDED (CY)
222-223	0.0	0.0
223-224	1.4	4.3
224-225	1.7	115.4
225-226	8.9	90.6
226-227	1.8	141.7

NOTE:

1. CUT & FILL VOLUMES WERE CALCULATED USING A COMBINATION OF SURVEY DATA & LIDAR DATA FROM MASS GIS.

NOTES:

1. WETLAND DELINEATION CONDUCTED ON DECEMBER 5,6, AND 21, JANUARY 5 AND 18, 2023, AND AUGUST 17, 2023 BY DEVIN HERRICK, CWS.
2. ENTIRE PLAN VIEW IS WITHIN LITTLETON GIS AQUIFER ZONING OVERLAY DISTRICT.

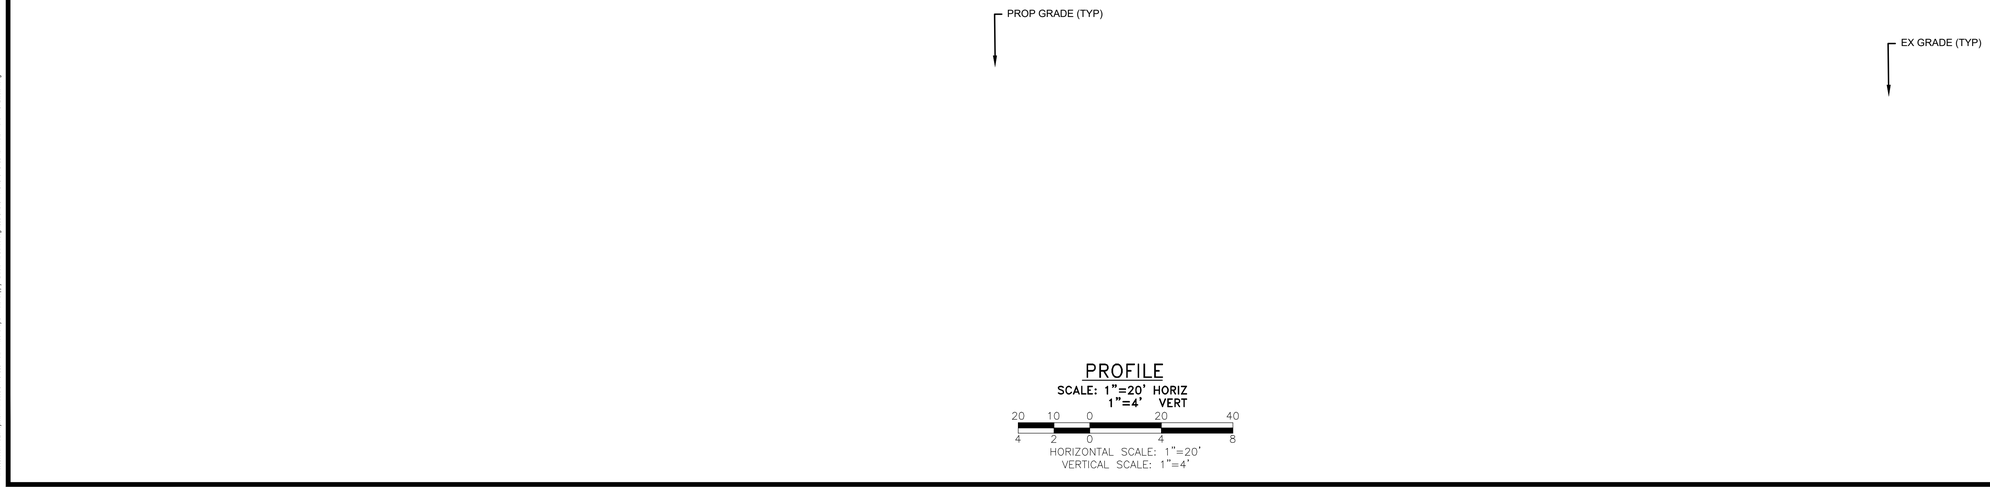

Project:
LITTLETON WATER DEPARTMENT
LITTLETON LELWD ELECTRIC LIGHT & WATER DEPARTMENTS
TAYLOR STREET WELL AND RAW WATER MAIN
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO.1

Weston & Sampson
Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:
COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:
FOR PERMIT REVIEW ONLY

Scale:	AS NOTED
Date:	OCTOBER 2023
Drawn By:	GJK/RWS
Reviewed By:	SBR
Approved By:	TEM
W&S Project No.:	ENG23-0679
W&S File No.:	

Drawing Title:
ACCESS ROAD GRADING & DRAINAGE PLAN

Sheet Number:
C105

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

\\wes01.local\WSE\Projects\MA\Mwa\SOT\101505 Water + Resiliency\GIS Water Supply + Littleton Is Boxborough\GIS\CAD\ArcGIS\101 C105 Site Water Plans - MOD 2.mxd Littleton Jeg

HORIZONTAL DIRECTIONAL DRILL PATH

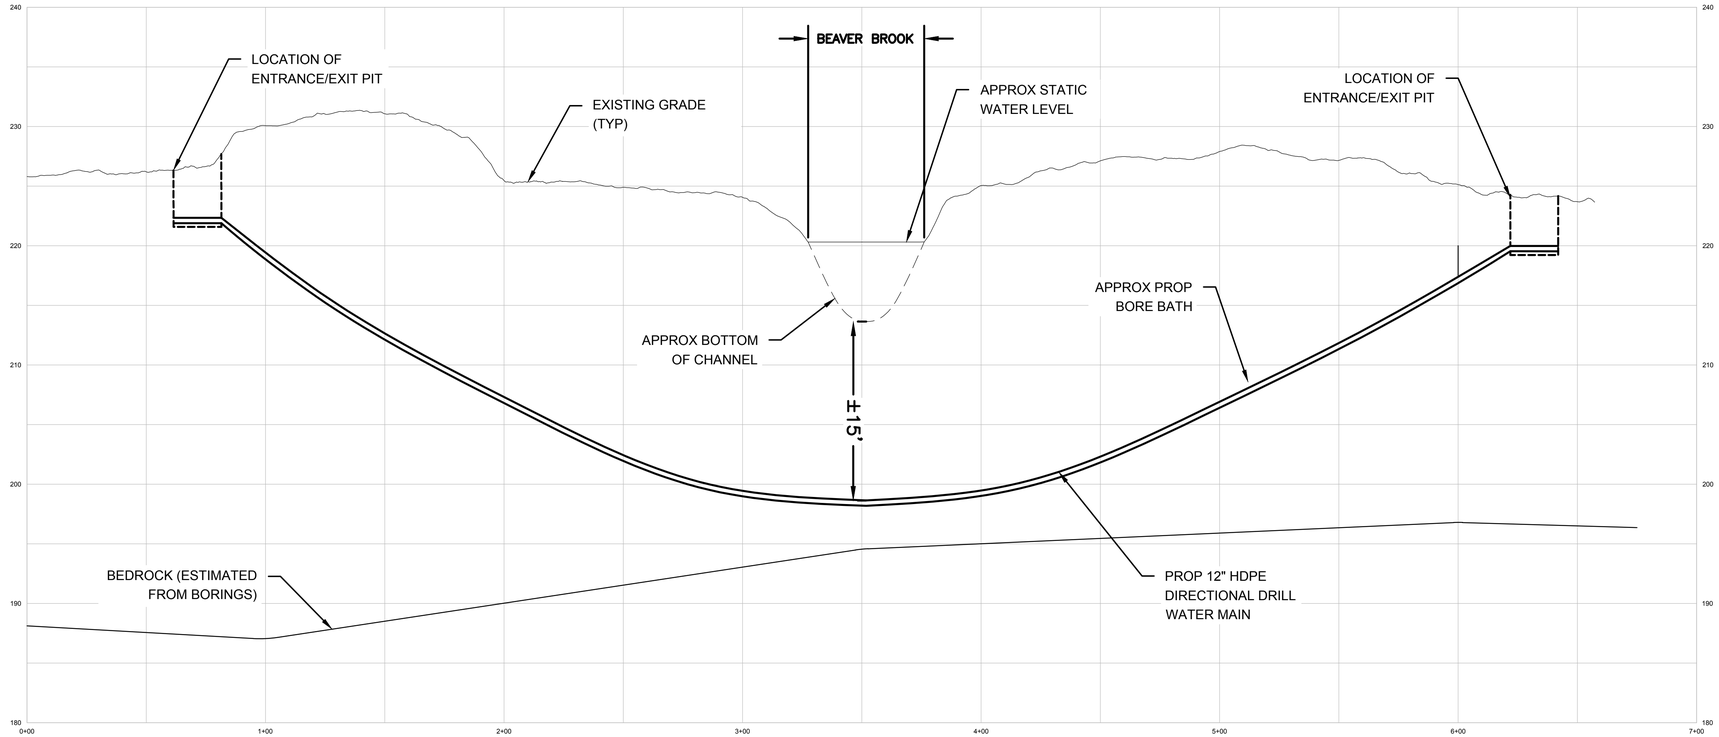

PROFILE

SCALE: 1"=20' HORIZ
1"=4' VERT

\\wsfs01\Staff\PEP\Projects\MA\MA\C01\01000 Water + Wastewater\Littleton Water Supply - Littleton to Boxborough\000-CAD\C-C201 - Directional Drill Profile.dwg

Project:
LITTLETON WATER DEPARTMENT

TAYLOR STREET WELL AND RAW WATER MAIN
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO.1

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:
COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:
FOR PERMIT REVIEW ONLY

Scale: AS NOTED

Date: OCTOBER 2023
Drawn By: GJK
Reviewed By: SBR
Approved By: TEM

W&S Project No.: ENG23-0679
W&S File No.:

Drawing Title:
BEAVER BROOK DIRECTIONAL DRILL

Sheet Number:
C201

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

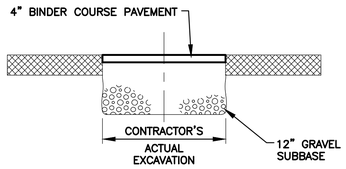

TEMPORARY TRENCH PAVEMENT

N.T.S.

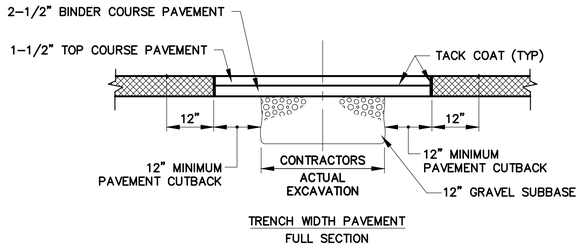

PERMANENT PAVEMENT REPLACEMENT DETAIL

N.T.S.

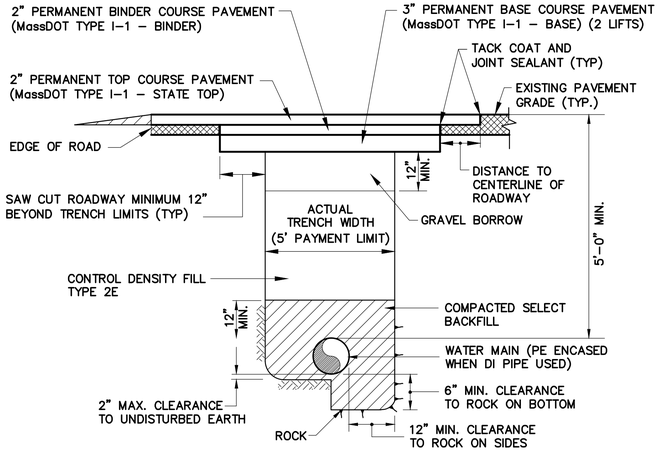

TYPE 3 AND TYPE 4
MASSACHUSETTS DEPARTMENT OF TRANSPORTATION (MassDOT)
PERMANENT TRENCH PAVEMENT AND WATER MAIN TRENCH

N.T.S.

NOTES:

1. SEE SECTION 32 11 00, PAVING FOR PAVEMENT SCHEDULE.
2. FOR ALL TRENCH PAVEMENTS, CONTRACTOR SHALL INSTALL ASPHALT EMULSION TACK COAT TO ALL SUBSURFACES AND VERTICAL SAW CUTS PRIOR TO INSTALLATION OF PERMANENT PAVEMENT.
3. PAVEMENT SHALL BE INSTALLED FLUSH WITH EXISTING GRADE BEFORE WINTER SHUTDOWN.
4. TOP LAYER OF PAVEMENT SHALL BE INSTALLED BY MECHANICAL MEANS.

PAVEMENT REPLACEMENT DETAILS

N.T.S.

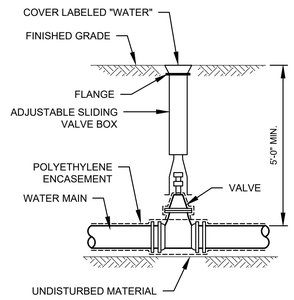

VALVE AND BOX DETAIL

N.T.S.

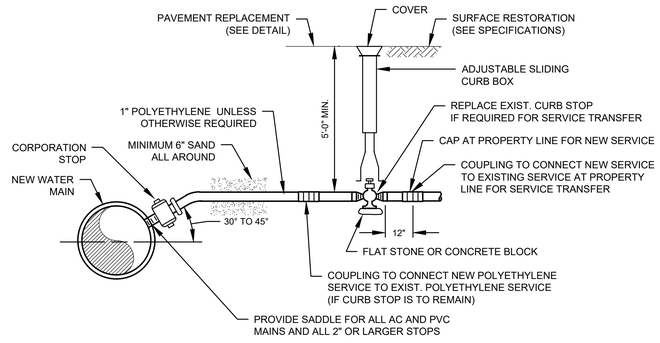

WATER SERVICE DETAIL

N.T.S.

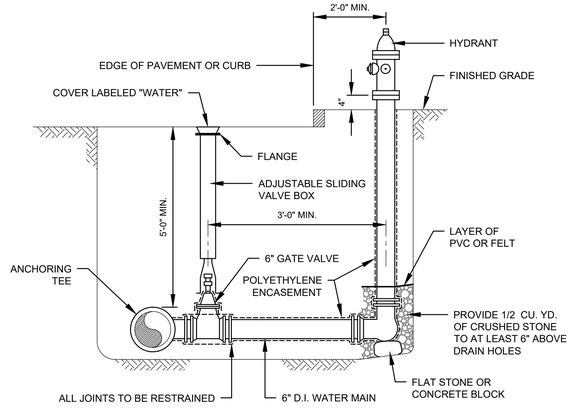

NOTE:

USE TWO 6" BENDS OR OFFSET ON LATERAL TO ACHIEVE REQUIRED HYDRANT ELEVATION IF NECESSARY.

HYDRANT AND VALVE DETAIL

N.T.S.

REQUIRED LENGTH OF RESTRAINED JOINTS FROM FITTINGS (FEET)

PIPE SIZE	90° BEND	45° BEND OR WYE BRANCH	22 1/2° BEND	11 1/4° BEND	PLUG, CAP OR IN-LINE VALVE	TEE (BRANCH)
6"	25 (30.5)	10.5 (12.5)	5 (6)	2.5 (3)	43 (64)	34 (51)
8"	33 (40)	13.5 (16.5)	6.5 (8)	3 (4)	55 (82)	47 (70)
10"	40 (48.5)	16.5 (20)	8 (9.5)	4 (5)	67 (100)	58 (87)
12"	47 (56.5)	19.5 (23.5)	9.5 (11.5)	4.5 (5.5)	79 (118)	70 (105)
16"	59.5 (72)	24.5 (30)	12 (14.5)	6 (7)	101 (152)	92 (139)
20"	72 (86.5)	30 (36)	14.5 (17)	7 (8.5)	123 (184)	114 (171)
24"	84 (100)	35 (41)	16.5 (20)	8 (10)	144 (216)	134 (202)
30"	100 (120)	41 (50)	20 (24)	10 (12)	174 (261)	165 (247)

NOTES:

1. RESTRAINED LENGTHS LISTED IN PARENTHESES ARE FOR PIPE WRAPPED IN POLYETHYLENE. THE OTHER ASSOCIATED LENGTHS ARE FOR PLAIN UNWRAPPED DUCTILE IRON PIPE.
2. THE CONTRACTOR SHALL USE THIS TABLE IN CONJUNCTION WITH THE APPROPRIATE PIPE SPECIFICATION SECTION.

RESTRAINED JOINT TABLE

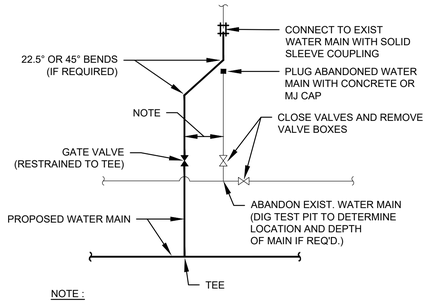

NOTE :

MINIMUM PRACTICAL DISTANCE - GENERALLY NO MORE THAN 2 FT.

WATER MAIN LATERAL CONNECTION

N.T.S.

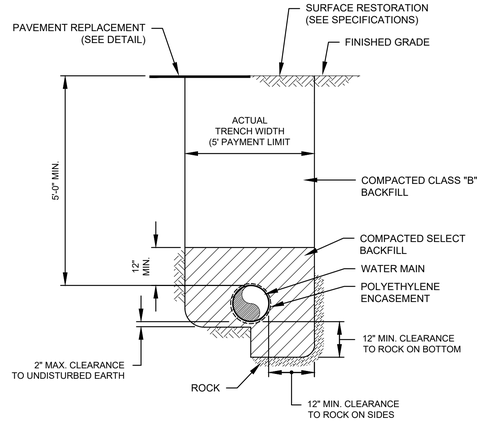

WATER MAIN TRENCH DETAIL

N.T.S.

Project:

LITTLETON WATER DEPARTMENT

TAYLOR STREET WELL AND RAW WATER MAIN
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO.1

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:

COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:

FOR PERMIT REVIEW ONLY

Scale: AS NOTED

Date: OCTOBER 2023
Drawn By: GJK/RWS
Reviewed By: SBR
Approved By: TEM

W&S Project No.: ENG23-0679
W&S File No.:

Drawing Title:

DETAILS I

Sheet Number:

C501

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

\\wsfs1.local\WSEProjects\Millville\TOWN\Water + Wastewater\04 Water Supply - Littleton to Boxborough\006 CAD\Civil\C501 004 Details Raw Water.dwg

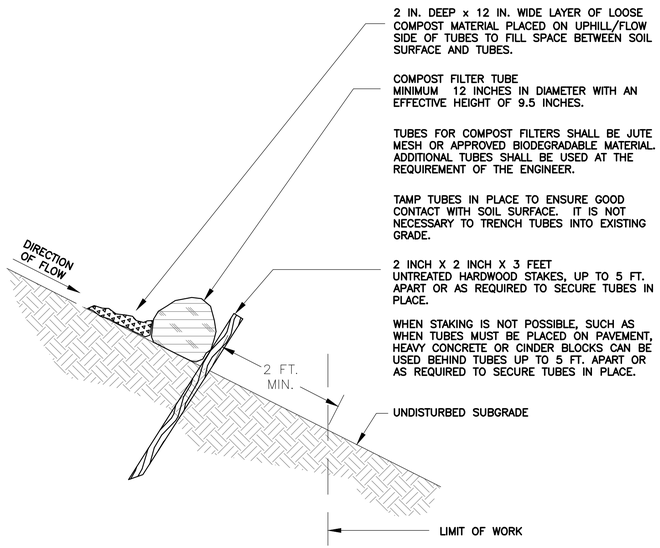

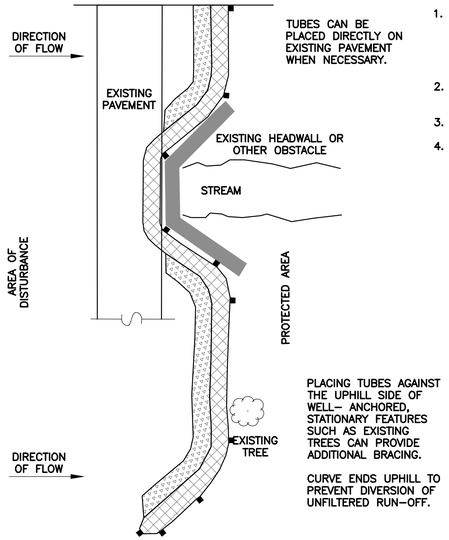

PLAN VIEW

SINGLE COMPOST FILTER TUBE DETAIL

NOT TO SCALE

GENERAL NOTES:

1. PROVIDE A MINIMUM TUBE DIAMETER OF 12 INCHES FOR SLOPES UP TO 50 FEET IN LENGTH WITH A SLOPE RATIO OF 3H:1V OR STEEPER. LONGER SLOPES OF 3H:1V MAY REQUIRE LARGER TUBE DIAMETER OR ADDITIONAL COURSING OF FILTER TUBES TO CREATE A FILTER BERM. REFER TO MANUFACTURER'S RECOMMENDATIONS FOR SITUATIONS WITH LONGER OR STEEPER SLOPES.
2. INSTALL TUBES ALONG CONTOURS AND PERPENDICULAR TO SHEET OR CONCENTRATED FLOW.
3. DO NOT INSTALL IN PERENNIAL, EPHEMERAL OR INTERMITTENT STREAMS.
4. CONFIGURE TUBES AROUND EXISTING SITE FEATURES TO MINIMIZE SITE DISTURBANCE AND MAXIMIZE CAPTURE AREA OF STORMWATER RUN–OFF.

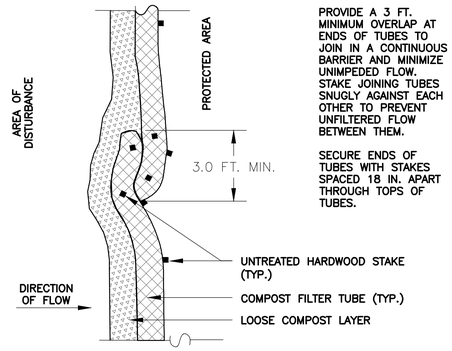

PLAN VIEW – JOIN DETAIL



CATCH BASIN PROTECTION DETAIL

N.T.S.

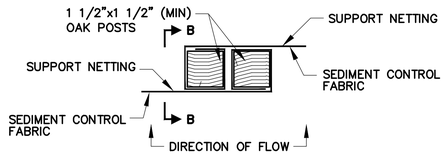

SECTION A–A

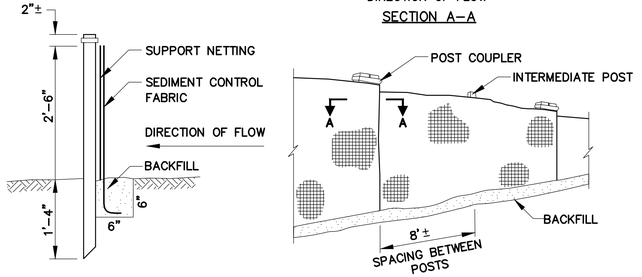

SILT FENCE DETAIL

N.T.S.

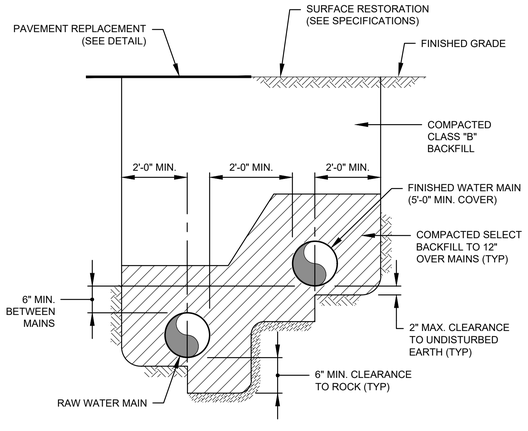

DUAL WATER MAIN TRENCH DETAIL

N.T.S.

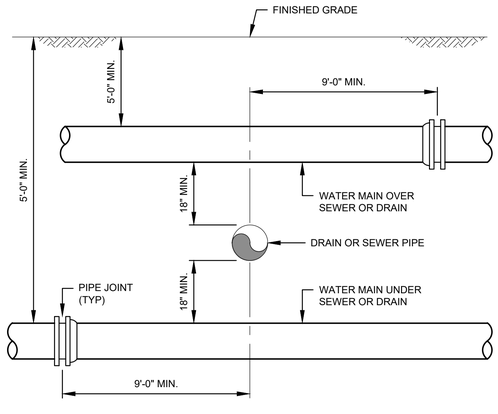

SEWER OR DRAIN CROSSING DETAIL

N.T.S.

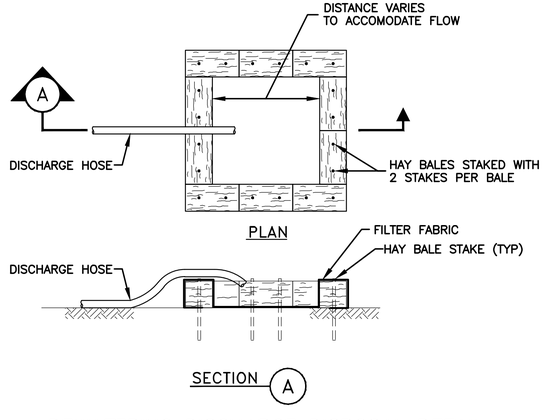

DEWATERING DISCHARGE DISPOSAL DETAIL

N.T.S.

Project:
LITTLETON WATER DEPARTMENT
LITTLETON LELWD ELECTRIC LIGHT & WATER DEPARTMENTS
TAYLOR STREET WELL AND RAW WATER MAIN
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO.1

Weston & Sampson
Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:
COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:
FOR PERMIT REVIEW ONLY

Scale: AS NOTED

Date:	OCTOBER 2023
Drawn By:	GJK/RWS
Reviewed By:	SBR
Approved By:	TEM
W&S Project No.:	ENG23-0679
W&S File No.:	

Drawing Title:
DETAILS II

Sheet Number:
C502

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

\\wes03.local\WSEProjects\Mass\Mass01\13700\Water + Wastewater\04 Water Supply + Littleton to Boxborough\006 CAD\Civil\C502.SW.Details Raw Water.dwg

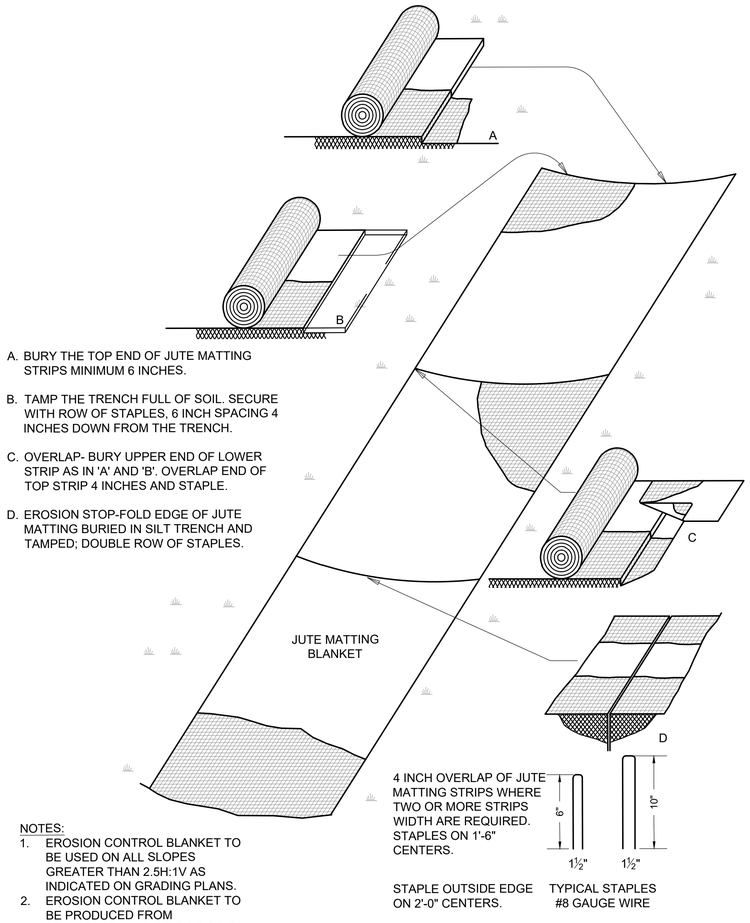

A. BURY THE TOP END OF JUTE MATTING STRIPS MINIMUM 6 INCHES.

B. TAMP THE TRENCH FULL OF SOIL. SECURE WITH ROW OF STAPLES, 6 INCH SPACING 4 INCHES DOWN FROM THE TRENCH.

C. OVERLAP- BURY UPPER END OF LOWER STRIP AS IN 'A' AND 'B'. OVERLAP END OF TOP STRIP 4 INCHES AND STAPLE.

D. EROSION STOP-FOLD EDGE OF JUTE MATTING BURIED IN SILT TRENCH AND TAMPED; DOUBLE ROW OF STAPLES.

NOTES:
1. EROSION CONTROL BLANKET TO BE USED ON ALL SLOPES GREATER THAN 2.5H:1V AS INDICATED ON GRADING PLANS.
2. EROSION CONTROL BLANKET TO BE PRODUCED FROM BIODEGRADABLE JUTE OR COIR MATTING AND IS NOT TO CONTAIN PLASTICS.

EROSION CONTROL BLANKET DETAIL
N.T.S.

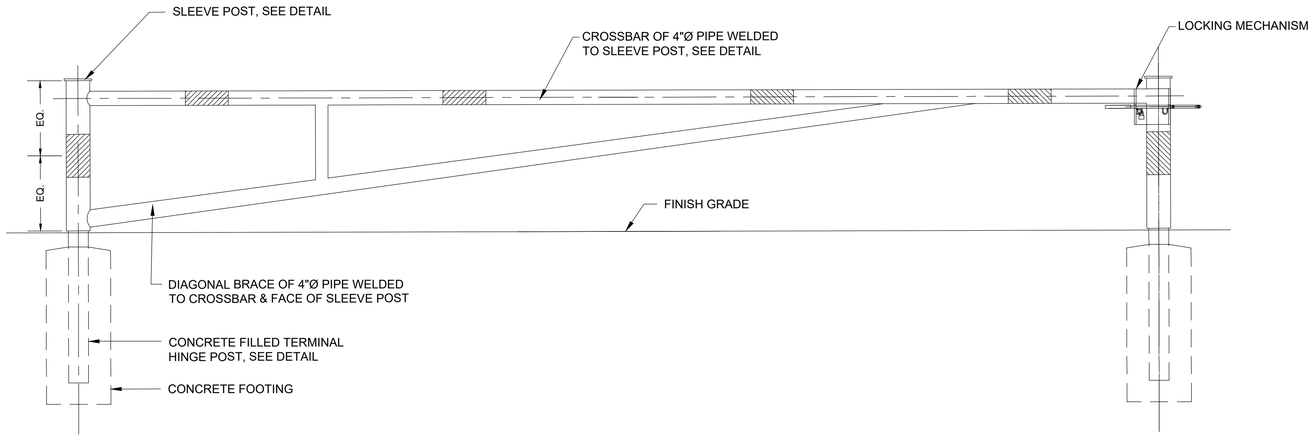

ELEVATION

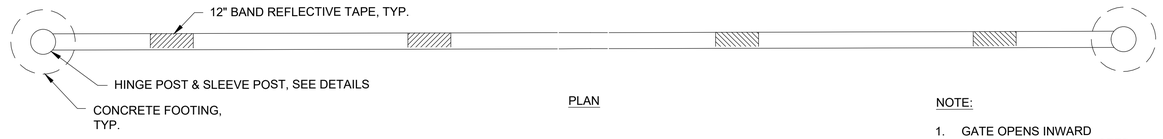

PLAN

NOTE:
1. GATE OPENS INWARD UNLESS OTHERWISE NOTED

STEEL SWING ARM GATE
N.T.S.

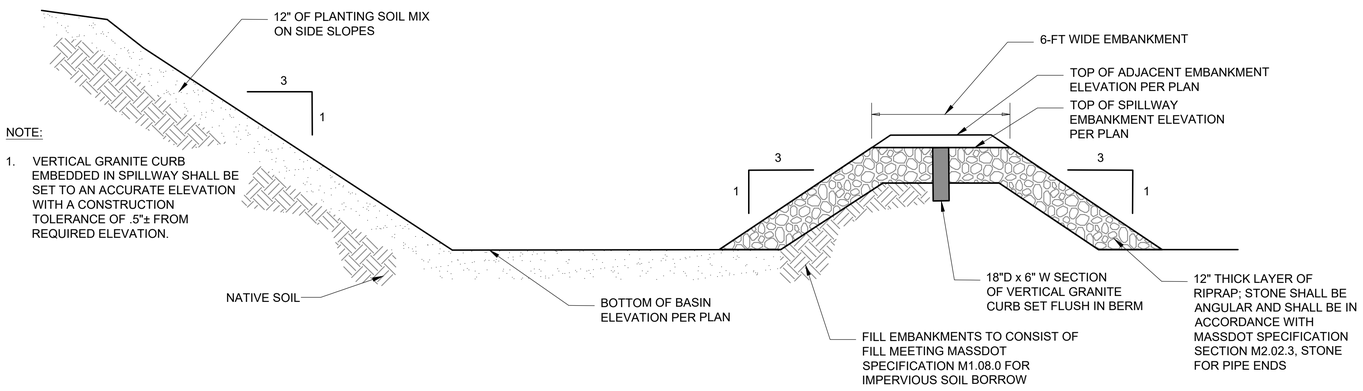

NOTE:
1. VERTICAL GRANITE CURB EMBEDDED IN SPILLWAY SHALL BE SET TO AN ACCURATE ELEVATION WITH A CONSTRUCTION TOLERANCE OF .5"± FROM REQUIRED ELEVATION.

INFILTRATION BASIN DETAIL
N.T.S.

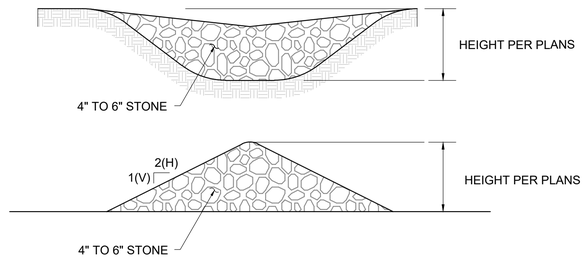

NOTE:
1. STRUCTURES SHALL BE INSTALLED ACCORDING TO THE DIMENSIONS SHOWN ON THE PLANS WHERE SEDIMENT FOREBAYS OR STONE CHECK DAMS ARE LOCATED.

SEDIMENT FOREBAY / STONE CHECKDAM DETAIL
N.T.S.

Project:
LITTLETON WATER DEPARTMENT

LITTLETON LELWD ELECTRIC LIGHT & WATER DEPARTMENTS

TAYLOR STREET WELL AND RAW WATER MAIN
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO.1

Weston & Sampson

Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:

COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:
FOR PERMIT REVIEW ONLY

Scale:	AS NOTED
Date:	OCTOBER 2023
Drawn By:	GJK/RWS
Reviewed By:	SBR
Approved By:	TEM
W&S Project No.:	ENG23-0679
W&S File No.:	

Drawing Title:
DETAILS III

Sheet Number:
C503

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

I:\eng\03\Littleton\Projects\Taylor Well\Design\Civil\Plans\Taylor Well Plans.dwg

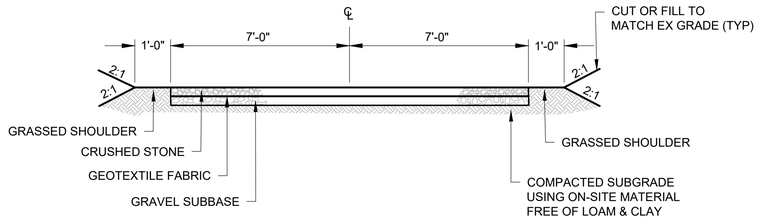

GRAVEL ROAD - TYPICAL SECTION 'A'

STA 0+00.00 - 0+05.00

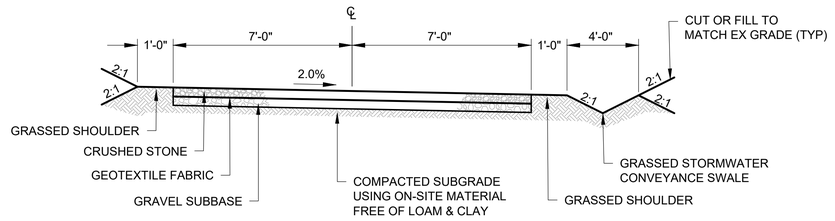

GRAVEL ROAD - TYPICAL SECTION 'B'

STA 0+05.00 - 6+90.36
STA 7+73.14 - 8+07.71

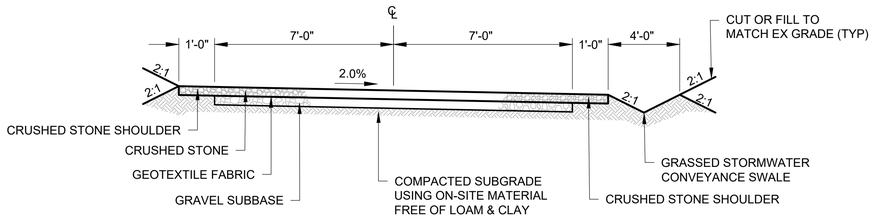

GRAVEL ROAD - TYPICAL SECTION 'C'

STA 6+90.36 - 7+73.14

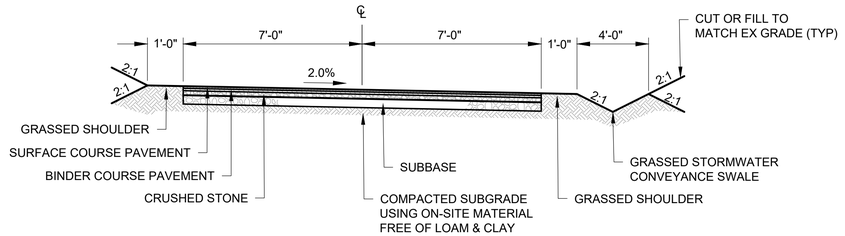

PAVED ROAD - TYPICAL SECTION 'D'

STA 8+07.71 - 9+97.25

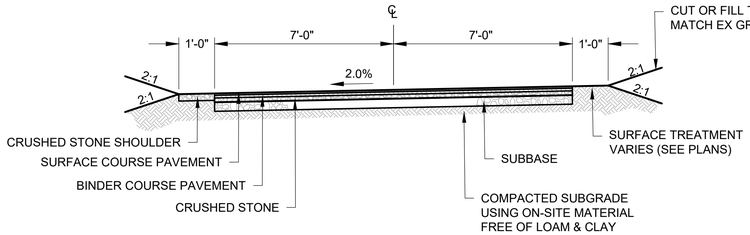

PAVED ROAD - TYPICAL SECTION 'E'

STA 9+97.25 - 11+96.61

NOTE:

1. SEE BITUMINOUS CONCRETE AND GRAVEL ACCESS ROADWAY CROSS-SECTIONS FOR INFORMATION ON MATERIAL DEPTHS AND ADDITIONAL REQUIREMENTS.

ACCESS ROADWAY CROSS-SECTIONS

N.T.S.

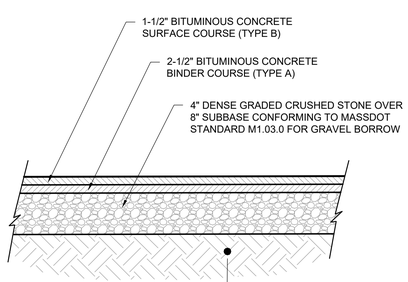

NOTE:

1. SEE HOT MIX ASPHALT SPECIFICATIONS (SECTION 32 12 00) FOR PAVING MATERIAL REQUIREMENTS.

SECTION VIEW

BITUMINOUS CONCRETE ACCESS ROADWAY CROSS-SECTION

N.T.S.

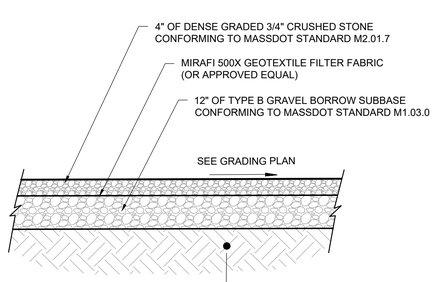

NOTE:

1. SEE GRAVEL SURFACE SPECIFICATIONS (SECTION 32 11 23) FOR MATERIAL REQUIREMENTS.

SECTION VIEW

GRAVEL ACCESS ROADWAY CROSS-SECTION

N.T.S.

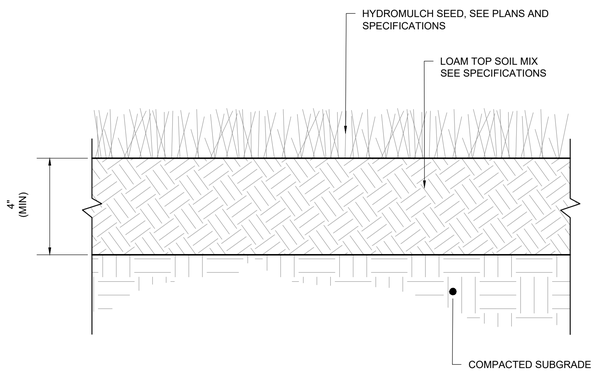

LOAM & SEED DETAIL

N.T.S.

Project:
LITTLETON WATER DEPARTMENT
LITTLETON LELWD ELECTRIC LIGHT & WATER DEPARTMENTS
TAYLOR STREET WELL AND RAW WATER MAIN
TOWN CONTRACT NO. IFB-2024
DWSRF NO. 12397
CONTRACT NO.1

Weston & Sampson
Weston & Sampson Engineers, Inc.
55 Walkers Brook Drive, Suite 100
Reading, MA 01867
978.532.1900 800.SAMPSON
www.westonandsampson.com

Consultants:

Revisions:

No.	Date	Description

COA:

Seal:
COMMONWEALTH OF MASSACHUSETTS
TARA E MCMANUS
No. 57127
REGISTERED PROFESSIONAL ENGINEER

Issued For:
FOR PERMIT REVIEW ONLY

Scale:	AS NOTED
Date:	OCTOBER 2023
Drawn By:	GJK/RWS
Reviewed By:	SBR
Approved By:	TEM
W&S Project No.:	ENG23-0679
W&S File No.:	

Drawing Title:
DETAILS IV

Sheet Number:
C504

COPYRIGHT © 2022 WESTON & SAMPSON, INC.

I:\ww25\Local\WESPrincetA\Mine\20711\7000 Water + Resiliency\04 Water Supply - Littleton to Boxborough\06 CAD\ArcGIS\11-GM Details Raw Water.dwg