

# **Stormwater Management Report**

For

**Strawberry Farms**  
**95 Taylor Street**  
**Map U40, Parcel 8**  
Littleton, MA

**Date: February 20, 2024**

Applicant:

Seal Harbor Companies, LLC  
P.O. Box 2857  
Acton, MA 01720

# **Table of Contents**

Narrative

Stormwater Checklist

Pre-Development Hydrology

Post-Development Hydrology

Recharge Volume Calculations

Water Quality Volume Calculations

Pipe Sizing Calculations

TSS Removal Worksheets

Soil Evaluation

Drainage Maps

Stormwater Operation and Maintenance Manual

## **Narrative**

# STORMWATER MANAGEMENT

The proposed project is for the subdivision of the property at 95 Taylor Street to create 3 new building lots. The existing dwelling on the property will be razed to accommodate the proposed subdivision. The proposed project is not subject to the Massachusetts Stormwater Standards (construction of 4 or fewer residential units), but is subject to the Stormwater management design standards under the Town of Littleton's regulations for the Subdivision of Land.

## Pre-Development

The project site is 95 Taylor Street. The site currently contains a single-family dwelling with appurtenances. There is a large wooded area to the rear of the existing dwelling. Beaver Brook is located to the rear of the property and projects 200' Riverfront Area onto the site. There are Bordering Vegetated Wetland (BVW) located adjacent to the brook that projects 100' Buffer Zone onto the property. The property was extensively altered in the past by gravel hauling activities, resulting in a unique topography. The site has been divided into 3 subcatchments as shown on the attached drainage map.

Subcatchment E-1 is located on the south side of the project site. The subcatchment contains the existing dwelling at 95 Taylor Street, gravel parking area, lawn area, wooded area, and offsite area. Runoff from this subcatchment drains towards the BVW at the rear of the site. This subcatchment is identified as **Analysis Point 1** on the drainage map.

Subcatchment E-2 is located in the northeastern portion of the site and contains wooded area. Runoff from this subcatchment drains towards abutting properties northeast of the project site. This subcatchment is identified as **Analysis Point 2** on the drainage map.

Subcatchment E-3 is located in the center of the site and contains wooded area. Runoff from this subcatchment is contained onsite in an existing depression.

## Post-Development

The proposed work is for the construction of a subdivision roadway and 3 new single family dwellings with appurtenances. The proposed subdivision roadway has been designed as a common driveway to minimize impervious coverage. The proposed Subcatchments are shown on the attached drainage map.

Subcatchment P-1A contains the proposed roadway, lawn area, and offsite area that drains onto the site. Runoff from this subcatchment will be collected via area drains and directed to a proposed infiltration basin. The infiltration basin has been designed to fully infiltrate up to the 100-year design storm.

Subcatchment P-1B is located on the west side of the site and contains lawn and wooded area. Runoff from this subcatchment will flow uncontrolled towards the BVW at the rear of the site. Runoff from this subcatchment combines with the outflow from the proposed infiltration basin to



compare to pre-development Subcatchment E-1. The discharge point for the combined runoff from these two subcatchments is identified as **Analysis Point 1** on the drainage map.

Subcatchment P-2A is located entirely on the proposed Lot 3 and contains lawn area. Runoff from this subcatchment will be directed via swale to a proposed infiltration trench where it will be fully infiltrated up to the 100-year design storm.

Subcatchment P-2B is located in the northeast corner of the site and contains lawn and wooded area. Runoff from this subcatchment will flow uncontrolled towards abutting properties northeast of the development site. This subcatchment compares to pre-development Subcatchment E-2. The discharge point of this subcatchment is identified as **Analysis Point 2** on the drainage map.

Subcatchment P-3 is located in the approximate center of the project site and contains lawn and wooded area. Runoff from this subcatchment will be contained onsite in an existing onsite depression.

Each of the proposed dwellings will be provided with one or two roof drywells to infiltrate roof runoff for up to the 100-year design storms. Lot 3 is provided with a single drywell (Roof Drywell A) to the rear of the proposed dwelling; Roof Drywell A is designed to infiltrate up to 3500 s.f. of roof area. Lots 1 and 2 are proposed with two roof drywells each (Roof Drywell B), which are designed to each infiltrate up to 1750 s.f. of roof area.

#### **Compliance with MA DEP Stormwater Management Standards**

Compliance with the Stormwater Management Standards is as follows:

#### **Standard #1 No Untreated Discharges:**

No new untreated discharges are proposed. Any additional runoff will be treated and/or infiltrated.

#### **Standard #2 Peak Rate Attenuation:**

The Post-Development peak discharge rates must not be increased from pre-development rates for the 2-year, 10-year, 25-year, and 50-year storm events. Also, offsite flood impact from the 100-year storm must not be increased. With a combination of infiltration and detention, the peak runoff rate and volume have been decreased. The peak runoff rates have been summarized in the following tables.

#### **Discharge Summary Tables**

##### **Analysis Point 1**

	2-year Storm		10-year Storm		25-year Storm		50-year Storm		100-year Storm	
	Pre	Post	Pre	Post	Pre	Post	Pre	Post	Pre	Post
Peak Flow (cfs)	0.000	0.000	0.052	0.028	0.309	0.167	0.718	0.428	1.361	0.843
Total Volume (cf)	0.000	0.000	1,401	773	3,906	2,362	6,401	3,986	9,709	6,177

### Analysis Point 2

	2-year Storm		10-year Storm		25-year Storm		50-year Storm		100-year Storm	
	Pre	Post	Pre	Post	Pre	Post	Pre	Post	Pre	Post
Peak Flow (cfs)	0.000	0.000	0.001	0.001	0.007	0.007	0.019	0.016	0.052	0.051
Total Volume (cf)	0.000	0.000	7.38	17.5	209	188	516	416	994	759

### Standard #3 Stormwater Recharge:

This standard prescribes the stormwater volume that must be recharged to groundwater based on the existing site soil conditions. The Natural Resources Conservation Service (N.R.C.S.) Middlesex Soil Survey map and onsite soil evaluations indicate Hydrologic Group A. The Stormwater Management Policy requires 0.6 inches of runoff over the total impervious area to be recharged in areas with Hydrologic Group A soils. Detailed “Recharge Volume Calculations” showing compliance with this standard are attached.

### Standard #4 Water Quality:

According to the guidelines provided in the Stormwater Management Standards 80% Total Suspended Solids (TSS) removal is required for the total increase in impervious area associated with the project. This standard requires 1.0 inches of water over the impervious area as the project site is located in Hydrologic Group A. The use of deep sump hooded drop inlets, sediment forebays, infiltration basins, and roof drywells will be utilized to achieve the required treatment levels. Infiltration Basins and roof drywells have been selected due to the TMDL of the Assabet River associated with Phosphorous.

### Standard #5 Land Uses with Higher Potential Pollutant Loads:

The site will not contain “land uses with higher potential pollutant loads.”

### Standard #6 Critical Areas:

The site does not discharge runoff to critical areas.

### Standard #7 Redevelopment:

This project is not redevelopment. This standard would require that the Stormwater Management Standards be met to the extent practicable. The project has been designed to meet all of the standards.

### Standard #8 Erosion/Sediment Control:

Erosion and sediment controls are incorporated into the project design to prevent erosion, control sediment movement, and stabilize exposed and disturbed soils during construction. Temporary erosion and sedimentation controls during construction include minimizing areas of exposed soil, directing and controlling runoff, and rapidly stabilizing exposed areas. Soils left exposed for extended periods will be mulched and seeded for temporary vegetative cover. Following construction, exposed areas will be permanently vegetated with appropriate ground cover. Erosion and sedimentation control measures will be maintained throughout all phases of

construction. Inspections will be made regularly and after rainfalls exceeding 0.5 inches in a 24-hour period during construction. The contractor will be required to inspect erosion and sedimentation control measures at the end of each workday, when precipitation is forecasted, and after each rainfall. All measures will be inspected prior to each weekend. The contractor will replace and repair any malfunctioning or damaged control measures including vegetative stabilization. Long term erosion and sedimentation control will be realized using the Best Management Practices described previously. Areas where soils have been disturbed will be loamed and vegetated with lawn, trees, and shrubs.

### **Standard #9 Operation and Maintenance Plan:**

An Operation and Maintenance Plan has been prepared and is included in this report as well as shown on the plan set.

### **Standard #10 Illicit Discharges to Drainage System:**

No known illicit discharges exist nor are any proposed.

### **Design Basis**

1. The United States Department of Agriculture Natural Resource Conservation Service (N.R.C.S.) TR55 methodology was used to determine offsite rates of runoff.
2. The twenty-four-hour rainfall, taken from the NOAA Atlas, is 7.65 inches for the 100-year storm, 6.78 inches for the 50-year storm, 5.99 inches for the 25-year storm, 4.91 inches for the 10-year storm, and 3.18 inches for the 2-year storm event.
3. The hydrologic calculations were performed using the computer program: "Hydrology Studio" by Hydrology Studio.
4. The soil types of the site were taken from the N.R.C.S. Soil Survey Map for Middlesex County.
5. Soil conditions and estimated seasonal high groundwater table were based on on-site soil evaluations.
6. The Natural Resources Conservation Service (N.R.C.S.) soil survey indicated the presences of Quonset sandy loam. The soil is identified as Hydrologic Group A.

**SUMMARY TABLE****SM-7306**Project: 95 Taylor StreetBy PFKRev Date 2/12/24Location: Littleton, MAChecked Date 

EX	AREA	CN	TIME OF CONCENTRATION
E-1	3.24	37	14.8
E-2	0.81	30	17.9
E-3	1.73	30	20.1
TOTAL	5.77		


PROP	AREA	CN	TIME OF CONCENTRATION
P-1A	1.16	55	6.0
P-1B	2.22	36	7.9
P-2A	0.08	39	6.0
P-2B	0.52	31	17.9
P-3	1.60	32	19.2
Roofs	0.19	98	6.0
TOTAL	5.77		

# Basin Model

Hydrology Studio v 3.0.0.31

Project Name:

02-13-2024

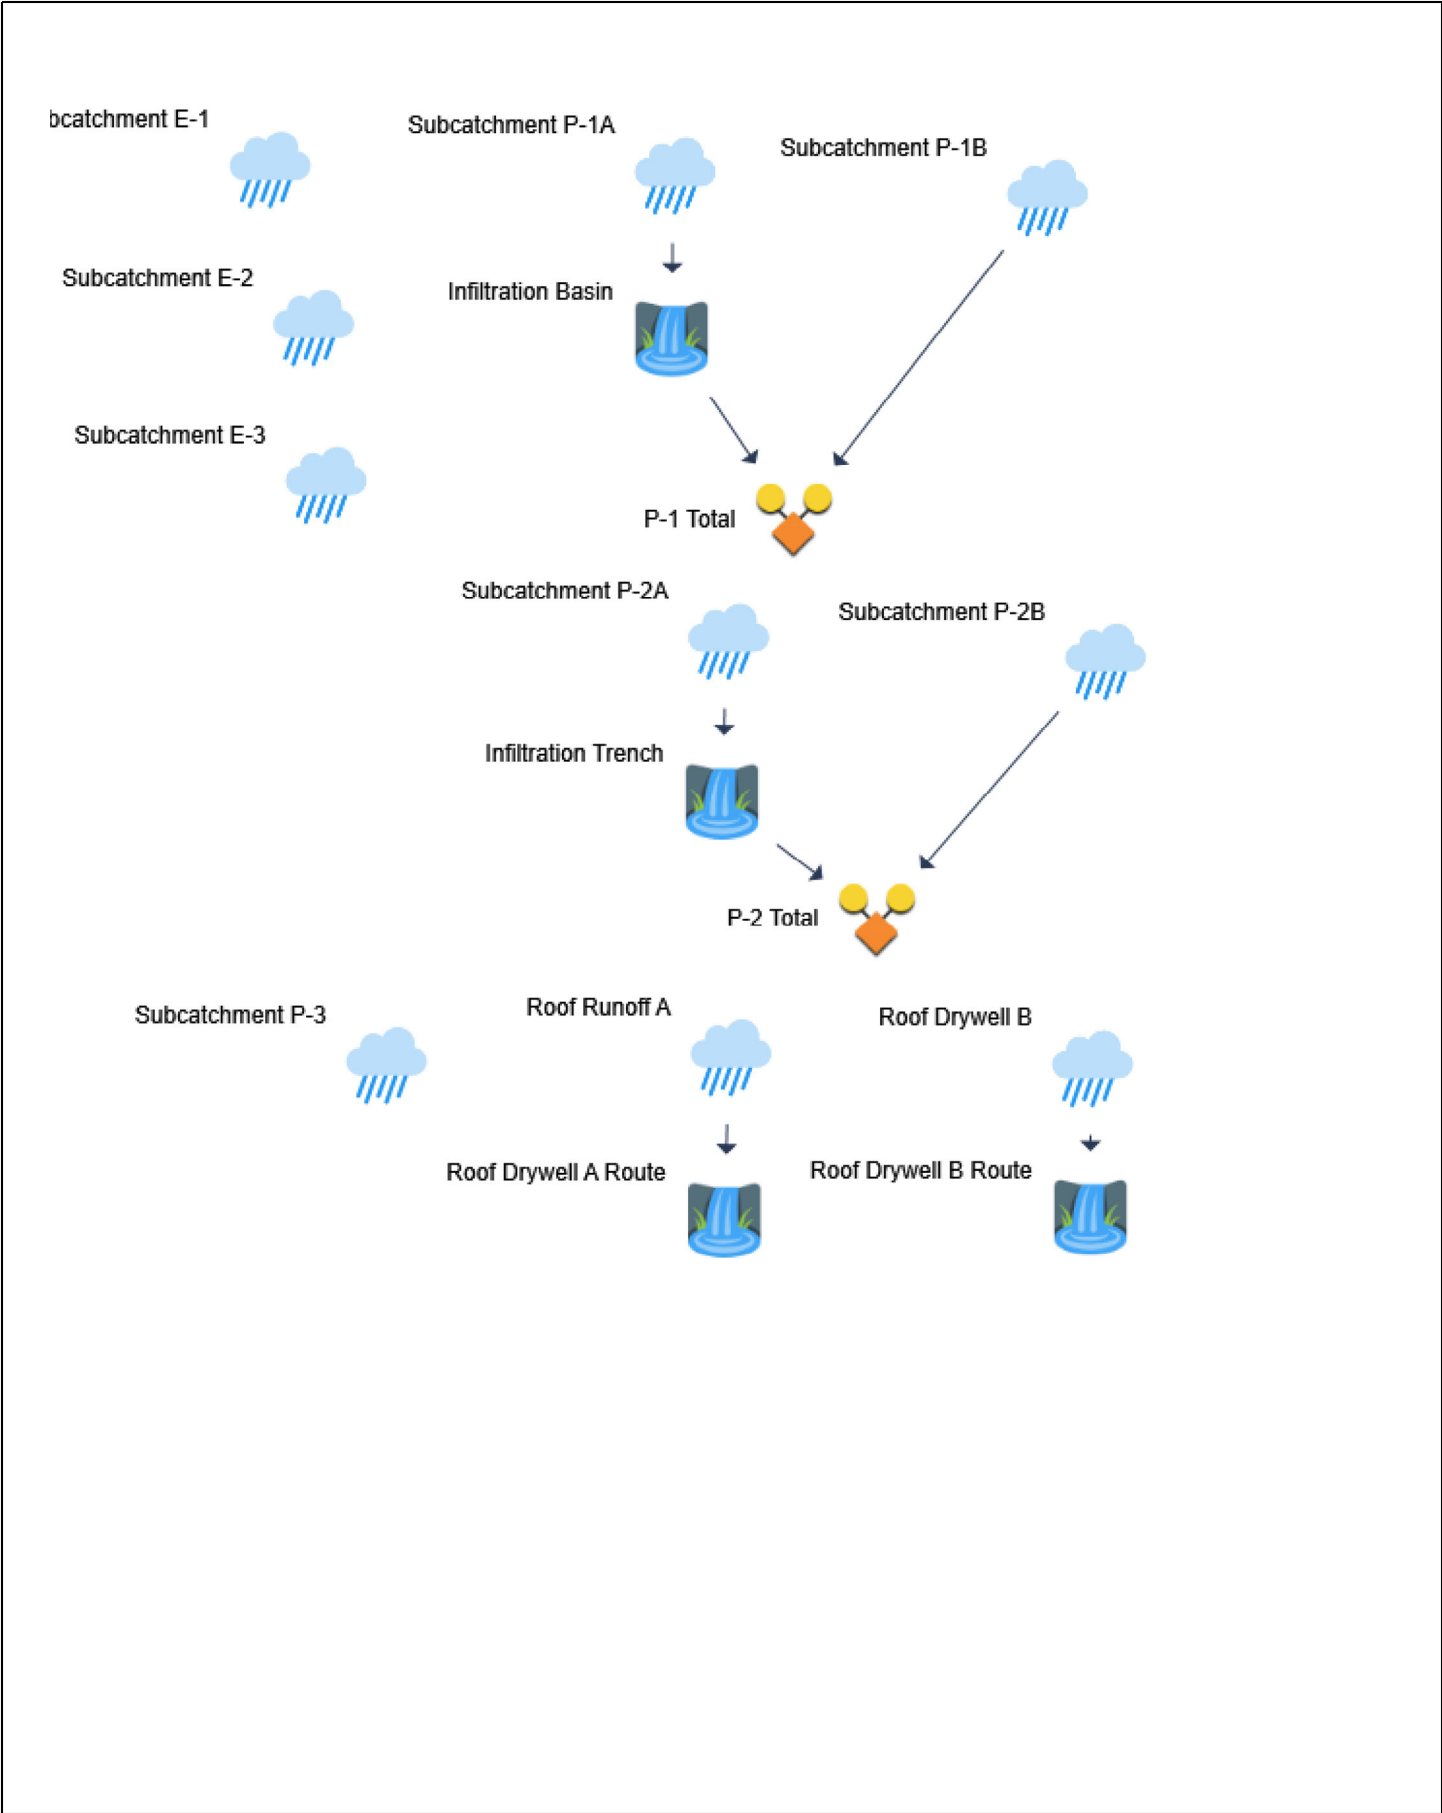

## **Stormwater Checklist**



# Checklist for Stormwater Report

## A. Introduction

**Important:** When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



A Stormwater Report must be submitted with the Notice of Intent permit application to document compliance with the Stormwater Management Standards. The following checklist is NOT a substitute for the Stormwater Report (which should provide more substantive and detailed information) but is offered here as a tool to help the applicant organize their Stormwater Management documentation for their Report and for the reviewer to assess this information in a consistent format. As noted in the Checklist, the Stormwater Report must contain the engineering computations and supporting information set forth in Volume 3 of the [Massachusetts Stormwater Handbook](#). The Stormwater Report must be prepared and certified by a Registered Professional Engineer (RPE) licensed in the Commonwealth.

The Stormwater Report must include:

- The Stormwater Checklist completed and stamped by a Registered Professional Engineer (see page 2) that certifies that the Stormwater Report contains all required submittals.<sup>1</sup> This Checklist is to be used as the cover for the completed Stormwater Report.
- Applicant/Project Name
- Project Address
- Name of Firm and Registered Professional Engineer that prepared the Report
- Long-Term Pollution Prevention Plan required by Standards 4-6
- Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan required by Standard 8<sup>2</sup>
- Operation and Maintenance Plan required by Standard 9

In addition to all plans and supporting information, the Stormwater Report must include a brief narrative describing stormwater management practices, including environmentally sensitive site design and LID techniques, along with a diagram depicting runoff through the proposed BMP treatment train. Plans are required to show existing and proposed conditions, identify all wetland resource areas, NRCS soil types, critical areas, Land Uses with Higher Potential Pollutant Loads (LUHPPL), and any areas on the site where infiltration rate is greater than 2.4 inches per hour. The Plans shall identify the drainage areas for both existing and proposed conditions at a scale that enables verification of supporting calculations.

As noted in the Checklist, the Stormwater Management Report shall document compliance with each of the Stormwater Management Standards as provided in the Massachusetts Stormwater Handbook. The soils evaluation and calculations shall be done using the methodologies set forth in Volume 3 of the Massachusetts Stormwater Handbook.

To ensure that the Stormwater Report is complete, applicants are required to fill in the Stormwater Report Checklist by checking the box to indicate that the specified information has been included in the Stormwater Report. If any of the information specified in the checklist has not been submitted, the applicant must provide an explanation. The completed Stormwater Report Checklist and Certification must be submitted with the Stormwater Report.

<sup>1</sup> The Stormwater Report may also include the Illicit Discharge Compliance Statement required by Standard 10. If not included in the Stormwater Report, the Illicit Discharge Compliance Statement must be submitted prior to the discharge of stormwater runoff to the post-construction best management practices.

<sup>2</sup> For some complex projects, it may not be possible to include the Construction Period Erosion and Sedimentation Control Plan in the Stormwater Report. In that event, the issuing authority has the discretion to issue an Order of Conditions that approves the project and includes a condition requiring the proponent to submit the Construction Period Erosion and Sedimentation Control Plan before commencing any land disturbance activity on the site.



# Checklist for Stormwater Report

---

## B. Stormwater Checklist and Certification

The following checklist is intended to serve as a guide for applicants as to the elements that ordinarily need to be addressed in a complete Stormwater Report. The checklist is also intended to provide conservation commissions and other reviewing authorities with a summary of the components necessary for a comprehensive Stormwater Report that addresses the ten Stormwater Standards.

*Note:* Because stormwater requirements vary from project to project, it is possible that a complete Stormwater Report may not include information on some of the subjects specified in the Checklist. If it is determined that a specific item does not apply to the project under review, please note that the item is not applicable (N.A.) and provide the reasons for that determination.


A complete checklist must include the Certification set forth below signed by the Registered Professional Engineer who prepared the Stormwater Report.


---

### Registered Professional Engineer's Certification

I have reviewed the Stormwater Report, including the soil evaluation, computations, Long-term Pollution Prevention Plan, the Construction Period Erosion and Sedimentation Control Plan (if included), the Long-term Post-Construction Operation and Maintenance Plan, the Illicit Discharge Compliance Statement (if included) and the plans showing the stormwater management system, and have determined that they have been prepared in accordance with the requirements of the Stormwater Management Standards as further elaborated by the Massachusetts Stormwater Handbook. I have also determined that the information presented in the Stormwater Checklist is accurate and that the information presented in the Stormwater Report accurately reflects conditions at the site as of the date of this permit application.

Registered Professional Engineer Block and Signature

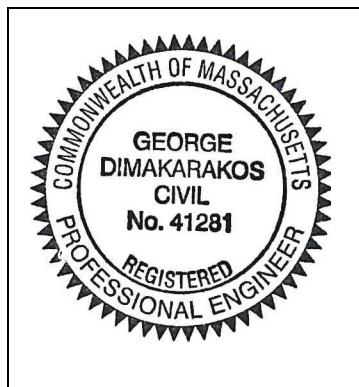

 2/16/2024

Signature and Date

---

## Checklist

**Project Type:** Is the application for new development, redevelopment, or a mix of new and redevelopment?

- ☒ New development
- ☐ Redevelopment
- ☐ Mix of New Development and Redevelopment





# Checklist for Stormwater Report

---

## Checklist (continued)

**LID Measures:** Stormwater Standards require LID measures to be considered. Document what environmentally sensitive design and LID Techniques were considered during the planning and design of the project:

- ☒ No disturbance to any Wetland Resource Areas
- ☒ Site Design Practices (e.g. clustered development, reduced frontage setbacks)
- ☐ Reduced Impervious Area (Redevelopment Only)
- ☒ Minimizing disturbance to existing trees and shrubs
- ☐ LID Site Design Credit Requested:
  - ☐ Credit 1
  - ☐ Credit 2
  - ☐ Credit 3
- ☐ Use of "country drainage" versus curb and gutter conveyance and pipe
- ☐ Bioretention Cells (includes Rain Gardens)
- ☐ Constructed Stormwater Wetlands (includes Gravel Wetlands designs)
- ☐ Treebox Filter
- ☐ Water Quality Swale
- ☐ Grass Channel
- ☐ Green Roof
- ☒ Other (describe): Infiltration Basin, Roof Drywells

## Standard 1: No New Untreated Discharges

- ☒ No new untreated discharges
- ☒ Outlets have been designed so there is no erosion or scour to wetlands and waters of the Commonwealth
- ☒ Supporting calculations specified in Volume 3 of the Massachusetts Stormwater Handbook included.



# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 2: Peak Rate Attenuation

- ☐ Standard 2 waiver requested because the project is located in land subject to coastal storm flowage and stormwater discharge is to a wetland subject to coastal flooding.
- ☒ Evaluation provided to determine whether off-site flooding increases during the 100-year 24-hour storm.
- ☒ Calculations provided to show that post-development peak discharge rates do not exceed pre-development rates for the 2-year and 10-year 24-hour storms. If evaluation shows that off-site flooding increases during the 100-year 24-hour storm, calculations are also provided to show that post-development peak discharge rates do not exceed pre-development rates for the 100-year 24-hour storm.

### Standard 3: Recharge

- ☒ Soil Analysis provided.
- ☒ Required Recharge Volume calculation provided.
- ☐ Required Recharge volume reduced through use of the LID site Design Credits.
- ☒ Sizing the infiltration, BMPs is based on the following method: Check the method used.
  - ☐ Static
  - ☒ Simple Dynamic
  - ☐ Dynamic Field<sup>1</sup>
- ☒ Runoff from all impervious areas at the site discharging to the infiltration BMP.
- ☐ Runoff from all impervious areas at the site is *not* discharging to the infiltration BMP and calculations are provided showing that the drainage area contributing runoff to the infiltration BMPs is sufficient to generate the required recharge volume.
- ☒ Recharge BMPs have been sized to infiltrate the Required Recharge Volume.
- ☐ Recharge BMPs have been sized to infiltrate the Required Recharge Volume *only* to the maximum extent practicable for the following reason:
  - ☐ Site is comprised solely of C and D soils and/or bedrock at the land surface
  - ☐ M.G.L. c. 21E sites pursuant to 310 CMR 40.0000
  - ☐ Solid Waste Landfill pursuant to 310 CMR 19.000
  - ☐ Project is otherwise subject to Stormwater Management Standards only to the maximum extent practicable.
- ☒ Calculations showing that the infiltration BMPs will drain in 72 hours are provided.
- ☐ Property includes a M.G.L. c. 21E site or a solid waste landfill and a mounding analysis is included.

---

<sup>1</sup> 80% TSS removal is required prior to discharge to infiltration BMP if Dynamic Field method is used.



# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 3: Recharge (continued)

- ! ☐ The infiltration BMP is used to attenuate peak flows during storms greater than or equal to the 10-year 24-hour storm and separation to seasonal high groundwater is less than 4 feet and a mounding analysis is provided.
- ☒ Documentation is provided showing that infiltration BMPs do not adversely impact nearby wetland resource areas.

### Standard 4: Water Quality

The Long-Term Pollution Prevention Plan typically includes the following:

- Good housekeeping practices;
  - Provisions for storing materials and waste products inside or under cover;
  - Vehicle washing controls;
  - Requirements for routine inspections and maintenance of stormwater BMPs;
  - Spill prevention and response plans;
  - Provisions for maintenance of lawns, gardens, and other landscaped areas;
  - Requirements for storage and use of fertilizers, herbicides, and pesticides;
  - Pet waste management provisions;
  - Provisions for operation and management of septic systems;
  - Provisions for solid waste management;
  - Snow disposal and plowing plans relative to Wetland Resource Areas;
  - Winter Road Salt and/or Sand Use and Storage restrictions;
  - Street sweeping schedules;
  - Provisions for prevention of illicit discharges to the stormwater management system;
  - Documentation that Stormwater BMPs are designed to provide for shutdown and containment in the event of a spill or discharges to or near critical areas or from LUHPPL;
  - Training for staff or personnel involved with implementing Long-Term Pollution Prevention Plan;
  - List of Emergency contacts for implementing Long-Term Pollution Prevention Plan.
- ☒ A Long-Term Pollution Prevention Plan is attached to Stormwater Report and is included as an attachment to the Wetlands Notice of Intent.
- ☒ Treatment BMPs subject to the 44% TSS removal pretreatment requirement and the one inch rule for calculating the water quality volume are included, and discharge:
- ☐ is within the Zone II or Interim Wellhead Protection Area
  - ☐ is near or to other critical areas
  - ☒ is within soils with a rapid infiltration rate (greater than 2.4 inches per hour)
  - ☐ involves runoff from land uses with higher potential pollutant loads.
- ☐ The Required Water Quality Volume is reduced through use of the LID site Design Credits.
- ☒ Calculations documenting that the treatment train meets the 80% TSS removal requirement and, if applicable, the 44% TSS removal pretreatment requirement, are provided.



# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 4: Water Quality (continued)

- ☒ The BMP is sized (and calculations provided) based on:
  - ☒ The ½" or 1" Water Quality Volume or
  - ☐ The equivalent flow rate associated with the Water Quality Volume and documentation is provided showing that the BMP treats the required water quality volume.
- ☐ The applicant proposes to use proprietary BMPs, and documentation supporting use of proprietary BMP and proposed TSS removal rate is provided. This documentation may be in the form of the propriety BMP checklist found in Volume 2, Chapter 4 of the Massachusetts Stormwater Handbook and submitting copies of the TARP Report, STEP Report, and/or other third party studies verifying performance of the proprietary BMPs.
- ☒ A TMDL exists that indicates a need to reduce pollutants other than TSS and documentation showing that the BMPs selected are consistent with the TMDL is provided.

### Standard 5: Land Uses With Higher Potential Pollutant Loads (LUHPPLs)

- ☐ The NPDES Multi-Sector General Permit covers the land use and the Stormwater Pollution Prevention Plan (SWPPP) has been included with the Stormwater Report.
- ☒ The NPDES Multi-Sector General Permit covers the land use and the SWPPP will be submitted **prior to** the discharge of stormwater to the post-construction stormwater BMPs.
- ☐ The NPDES Multi-Sector General Permit does **not** cover the land use.
- ☐ LUHPPLs are located at the site and industry specific source control and pollution prevention measures have been proposed to reduce or eliminate the exposure of LUHPPLs to rain, snow, snow melt and runoff, and been included in the long term Pollution Prevention Plan.
- ☐ All exposure has been eliminated.
- ☐ All exposure has **not** been eliminated and all BMPs selected are on MassDEP LUHPPL list.
- ☐ The LUHPPL has the potential to generate runoff with moderate to higher concentrations of oil and grease (e.g. all parking lots with >1000 vehicle trips per day) and the treatment train includes an oil grit separator, a filtering bioretention area, a sand filter or equivalent.

### Standard 6: Critical Areas

- ☐ The discharge is near or to a critical area and the treatment train includes only BMPs that MassDEP has approved for stormwater discharges to or near that particular class of critical area.
- ☐ Critical areas and BMPs are identified in the Stormwater Report.



# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 7: Redevelopments and Other Projects Subject to the Standards only to the maximum extent practicable

- ☐ The project is subject to the Stormwater Management Standards only to the maximum Extent Practicable as a:
  - ☐ Limited Project
  - ☐ Small Residential Projects: 5-9 single family houses or 5-9 units in a multi-family development provided there is no discharge that may potentially affect a critical area.
  - ☐ Small Residential Projects: 2-4 single family houses or 2-4 units in a multi-family development with a discharge to a critical area
  - ☐ Marina and/or boatyard provided the hull painting, service and maintenance areas are protected from exposure to rain, snow, snow melt and runoff
  - ☐ Bike Path and/or Foot Path
  - ☐ Redevelopment Project
  - ☐ Redevelopment portion of mix of new and redevelopment.
- ☐ Certain standards are not fully met (Standard No. 1, 8, 9, and 10 must always be fully met) and an explanation of why these standards are not met is contained in the Stormwater Report.
- ☐ The project involves redevelopment and a description of all measures that have been taken to improve existing conditions is provided in the Stormwater Report. The redevelopment checklist found in Volume 2 Chapter 3 of the Massachusetts Stormwater Handbook may be used to document that the proposed stormwater management system (a) complies with Standards 2, 3 and the pretreatment and structural BMP requirements of Standards 4-6 to the maximum extent practicable and (b) improves existing conditions.

### Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control

A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan must include the following information:

- Narrative;
  - Construction Period Operation and Maintenance Plan;
  - Names of Persons or Entity Responsible for Plan Compliance;
  - Construction Period Pollution Prevention Measures;
  - Erosion and Sedimentation Control Plan Drawings;
  - Detail drawings and specifications for erosion control BMPs, including sizing calculations;
  - Vegetation Planning;
  - Site Development Plan;
  - Construction Sequencing Plan;
  - Sequencing of Erosion and Sedimentation Controls;
  - Operation and Maintenance of Erosion and Sedimentation Controls;
  - Inspection Schedule;
  - Maintenance Schedule;
  - Inspection and Maintenance Log Form.
- ☒ A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan containing the information set forth above has been included in the Stormwater Report.



# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control (continued)

- ☐ The project is highly complex and information is included in the Stormwater Report that explains why it is not possible to submit the Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan with the application. A Construction Period Pollution Prevention and Erosion and Sedimentation Control has **not** been included in the Stormwater Report but will be submitted **before** land disturbance begins.
- ☐ The project is **not** covered by a NPDES Construction General Permit.
- ☐ The project is covered by a NPDES Construction General Permit and a copy of the SWPPP is in the Stormwater Report.
- ☒ The project is covered by a NPDES Construction General Permit but no SWPPP been submitted. The SWPPP will be submitted BEFORE land disturbance begins.

### Standard 9: Operation and Maintenance Plan

- ☒ The Post Construction Operation and Maintenance Plan is included in the Stormwater Report and includes the following information:
  - ☒ Name of the stormwater management system owners;
  - ☒ Party responsible for operation and maintenance;
  - ☒ Schedule for implementation of routine and non-routine maintenance tasks;
  - ☒ Plan showing the location of all stormwater BMPs maintenance access areas;
  - ☒ Description and delineation of public safety features;
  - ☒ Estimated operation and maintenance budget; and
  - ☒ Operation and Maintenance Log Form.
- ☐ The responsible party is **not** the owner of the parcel where the BMP is located and the Stormwater Report includes the following submissions:
  - ☐ A copy of the legal instrument (deed, homeowner's association, utility trust or other legal entity) that establishes the terms of and legal responsibility for the operation and maintenance of the project site stormwater BMPs;
  - ☐ A plan and easement deed that allows site access for the legal entity to operate and maintain BMP functions.

### Standard 10: Prohibition of Illicit Discharges

- ☒ The Long-Term Pollution Prevention Plan includes measures to prevent illicit discharges;
- ☐ An Illicit Discharge Compliance Statement is attached;
- ☒ NO Illicit Discharge Compliance Statement is attached but will be submitted **prior to** the discharge of any stormwater to post-construction BMPs.

## **Pre-Development Hydrology**

## Hydrograph 2-yr Summary

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

[illegible]



# Hydrograph 10-yr Summary

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

[illegible]

# Hydrograph 25-yr Summary

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

[illegible]

## Hydrology Studio v 3.0.0.31

02-13-2024

[illegible]

# Hydrograph 100-yr Summary

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

[illegible]

## Worksheet 2: Runoff curve number and runoff

SM-7306

Project: 95 Taylor Street By PFK Date 2/12/24Location: Littleton, MA Checked            Date           Circle one: ☒ Present ☐ Developed E-11. Runoff curve number (CN)

Soil name and hydrologic group (appendix A)	Cover description (cover type, treatment, and hydrologic condition: percent impervious: unconnected/connected impervious area ratio)	CN 1/			Area	Product of CN x Area
		Table 2-2	Fig. 2-3	Fig. 2-4	Acres	
-	Impervious	98			0.05	4.41
A	Open Space-Good Condition	39			0.36	13.89
A	Woods- Good Condition	30			1.91	57.29
A	Residential Districts - 2 acres	46			0.92	42.21
A	Gravel	76			0.01	0.95
Totals =					3.24	118.75

1/ Use only one CN source per line.

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{118.75}{3.24} = 36.64 ; \quad \text{Use CN} = \boxed{37}$$

2. Runoff

Frequency..... yr

Rainfall, P (24-hour)..... in

Runoff, Q..... in

(Use P and CN with table 2-1, fig. 2-1, or eqs. 2-3 and 2-4.)

Storm #1	Storm #2	Storm #3
2	10	100
3.1	4.5	6.5
0.01	0.06	0.46

## Worksheet 3: Time of Concentration (Tc) or travel time (Tt)

SM-7306

Project: 95 Taylor StreetBy PFKDate 2/12/2024Location: Littleton, MA

Checked \_\_\_\_\_

Date \_\_\_\_\_

Circle one:

Present
Tc

Developed

Tt

through  
subarea

E-1

Sheet flow (Applicable to Tc only)

Segment ID

1. Surface Description (table 3-1)

2. Mannings roughness coeff., n (table 3-1)

3. Flow length, L (total L &lt;= 300 ft)

ft

4. Two-yr 24-hr rainfall, P2

in

5. Land Slope, s

ft/ft

6.  $Tt = 0.007 (nL)^{0.8} / (P2^{0.5} s^{0.4})$ 

Compute Tt hr

A-B		
lawn		
0.24		
50		
3.1		
0.01		
0.18		

0.18

Shallow concentrated Flow

Segment ID

7. Surface Description (paved or unpaved)

8. Flow Length, L

ft

9. Watercourse slope, s

ft/ft

10. Average Velocity, V (figure 3-1)

ft/s

11.  $Tt = L / 3600V$ 

Compute Tt hr

B-C	C-D	
UNPAVED	UNPAVED	
351	62	
0.01	0.13	
1.61	5.82	
0.06	0.00	

0.06

Channel flow

Segment ID

12. Cross sectional flow area, a

sf

13. Wetted perimeter, pw

ft

14. Hydraulic radius,  $r=a/wp$ 

Compute r ft

15. Channel Slope, s

ft/ft

16. Manning's roughness coeff., n

17.  $V = 1.49 r^{2/3} s^{1/2} / n$ 

Compute V ft/s

18. Flow length, L

ft

19.  $Tt = L / 3600V$ 

Compute Tt hr


0.00

20. Watershed or subarea Tc or Tt (add Tt in steps 6, 11, and 19)

hr  
min0.25  
14.8

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment E-1

**Hyd. No. 1**

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.000 cfs
Storm Frequency	= 2-yr	Time to Peak	= 0.00 hrs
Time Interval	= 2 min	Runoff Volume	= 0.000 cuft
Drainage Area	= 3.24 ac	Curve Number	= 37
Tc Method	= User	Time of Conc. (Tc)	= 14.8 min
Total Rainfall	= 3.18 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

**Qp = 0.00 cfs**

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment E-1

## Hyd. No. 1

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.052 cfs
Storm Frequency	= 10-yr	Time to Peak	= 14.80 hrs
Time Interval	= 2 min	Runoff Volume	= 1,401 cuft
Drainage Area	= 3.24 ac	Curve Number	= 37
Tc Method	= User	Time of Conc. (Tc)	= 14.8 min
Total Rainfall	= 4.91 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

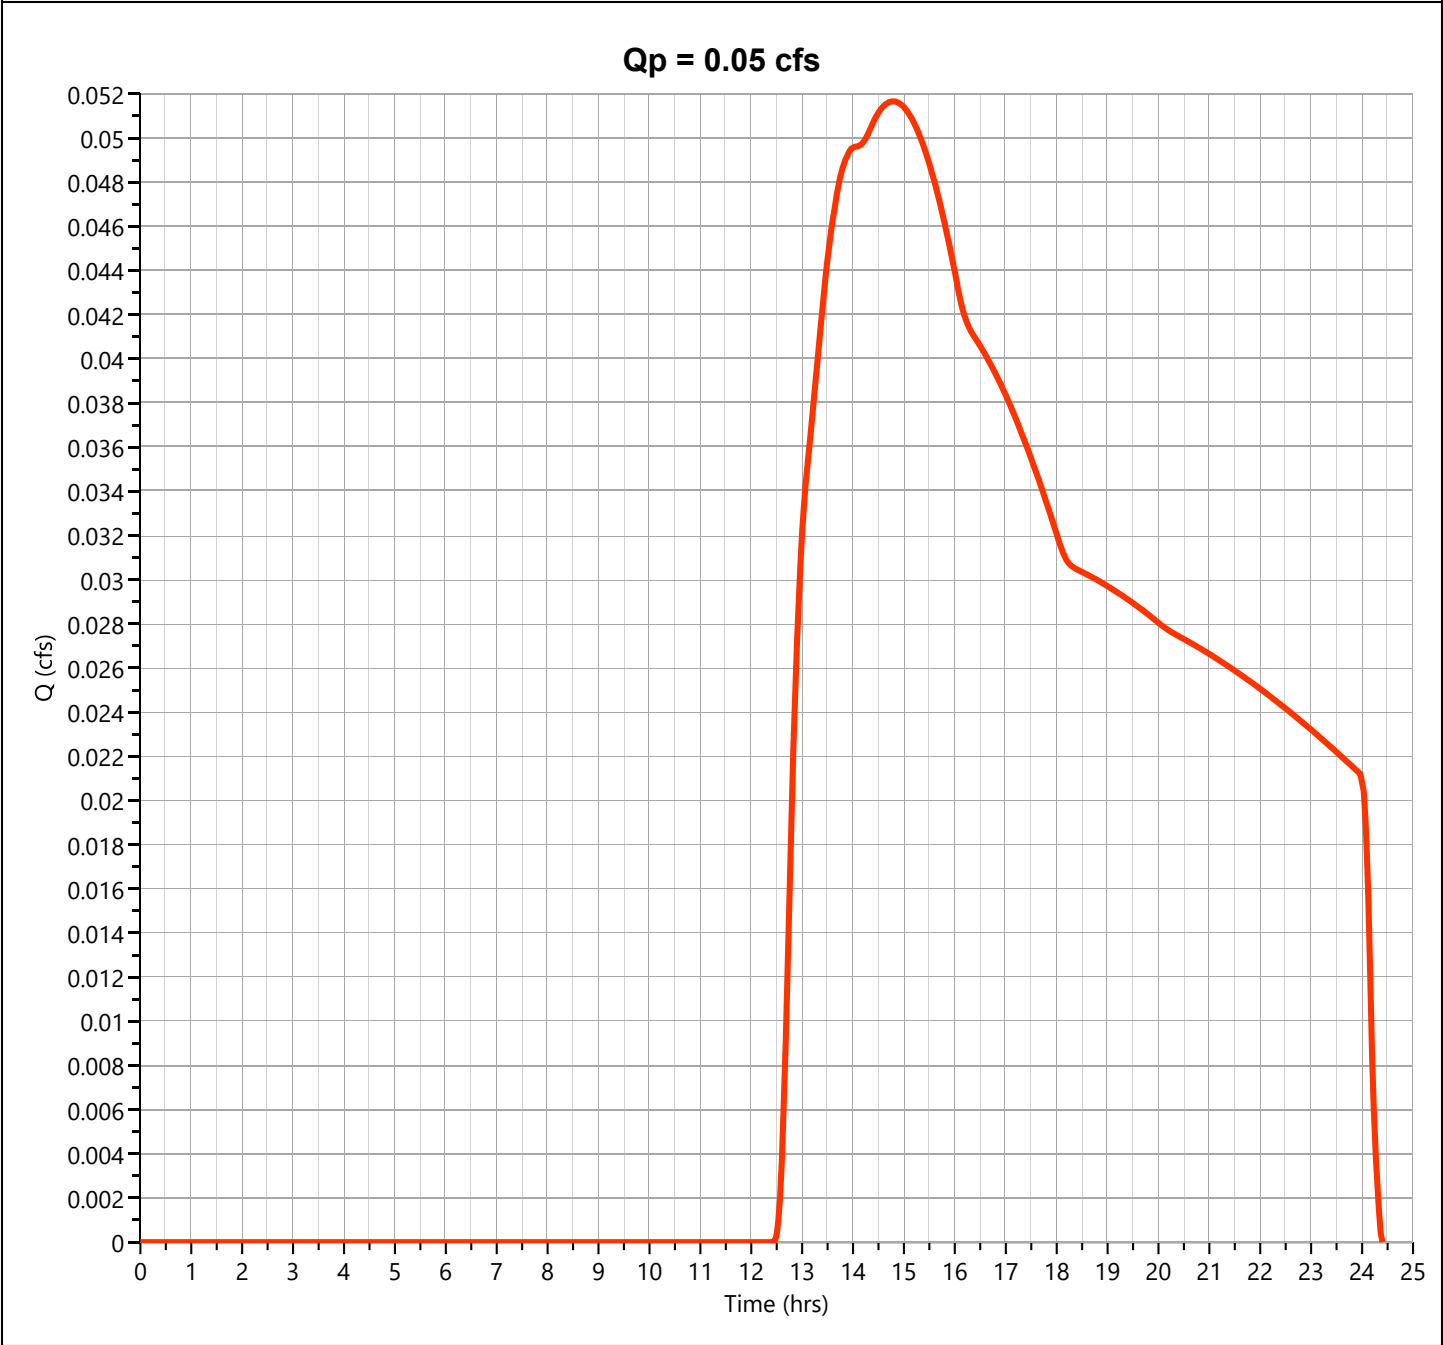



# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment E-1

## Hyd. No. 1

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.309 cfs
Storm Frequency	= 25-yr	Time to Peak	= 12.50 hrs
Time Interval	= 2 min	Runoff Volume	= 3,906 cuft
Drainage Area	= 3.24 ac	Curve Number	= 37
Tc Method	= User	Time of Conc. (Tc)	= 14.8 min
Total Rainfall	= 5.99 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

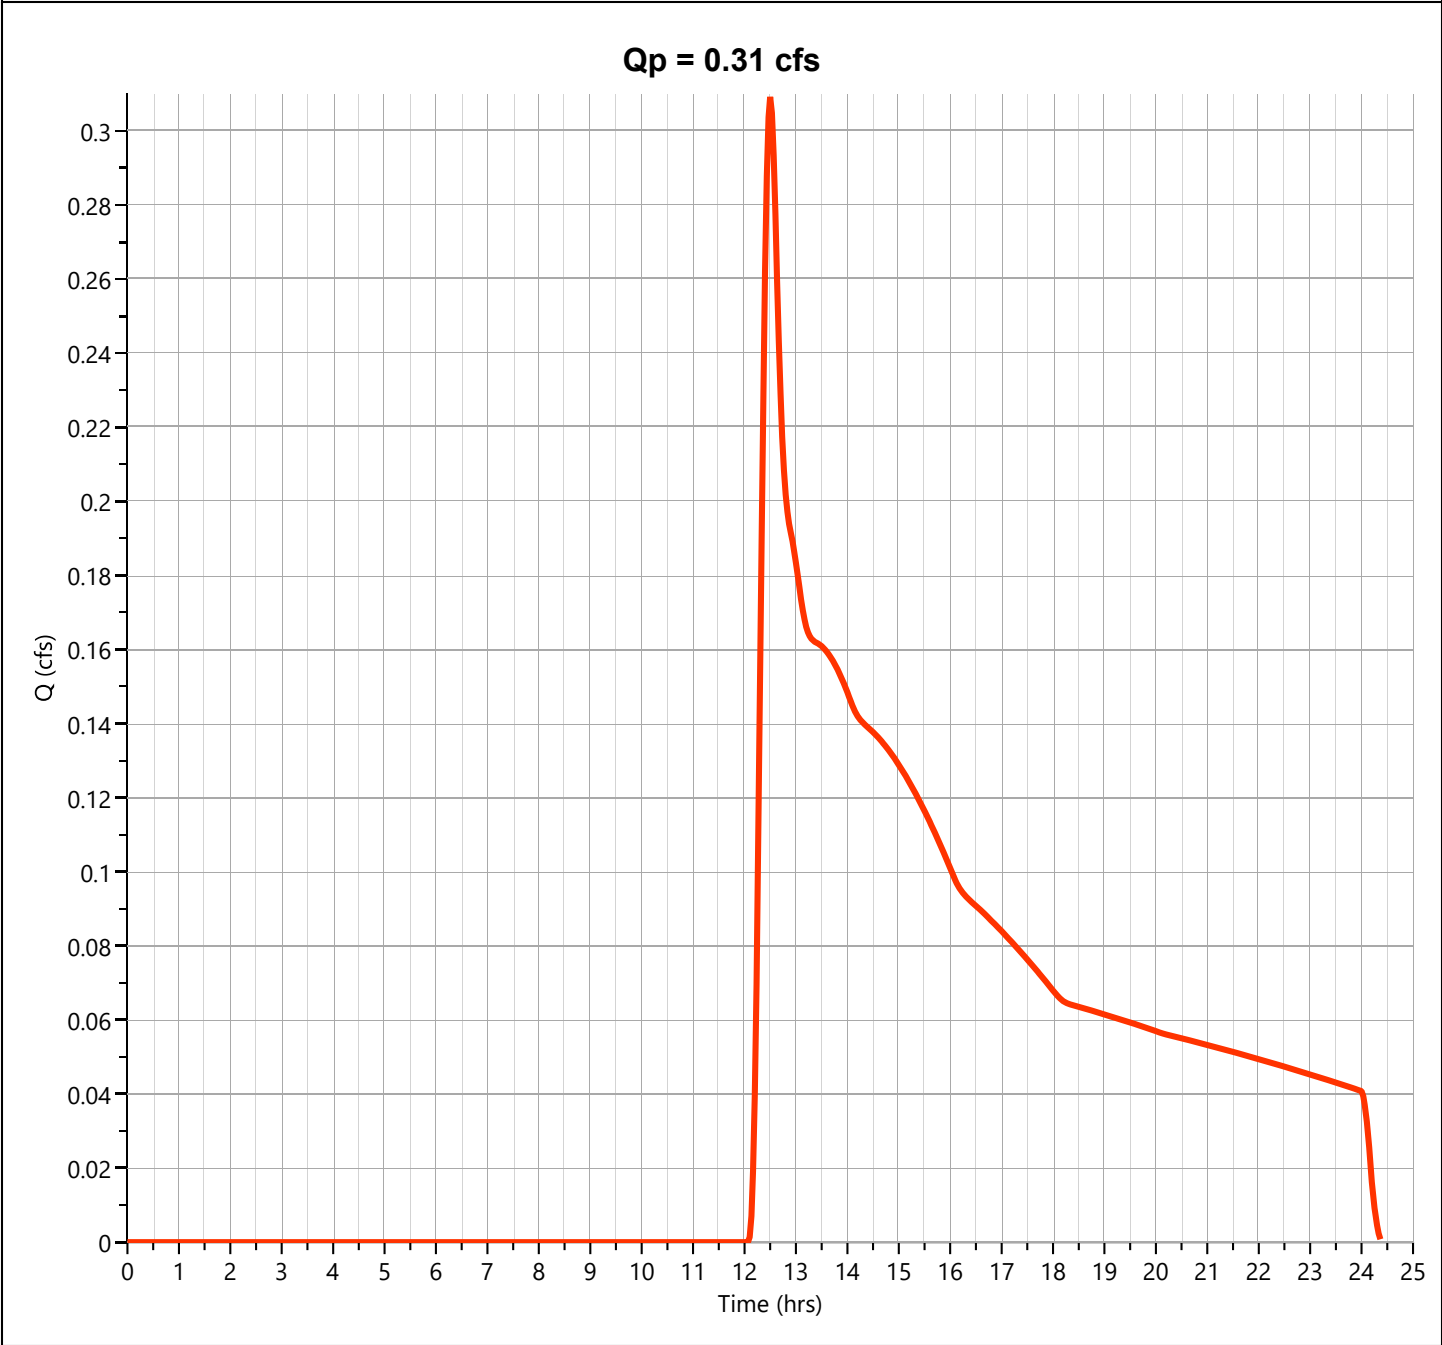

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment E-1

## Hyd. No. 1

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.718 cfs
Storm Frequency	= 50-yr	Time to Peak	= 12.40 hrs
Time Interval	= 2 min	Runoff Volume	= 6,401 cuft
Drainage Area	= 3.24 ac	Curve Number	= 37
Tc Method	= User	Time of Conc. (Tc)	= 14.8 min
Total Rainfall	= 6.78 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

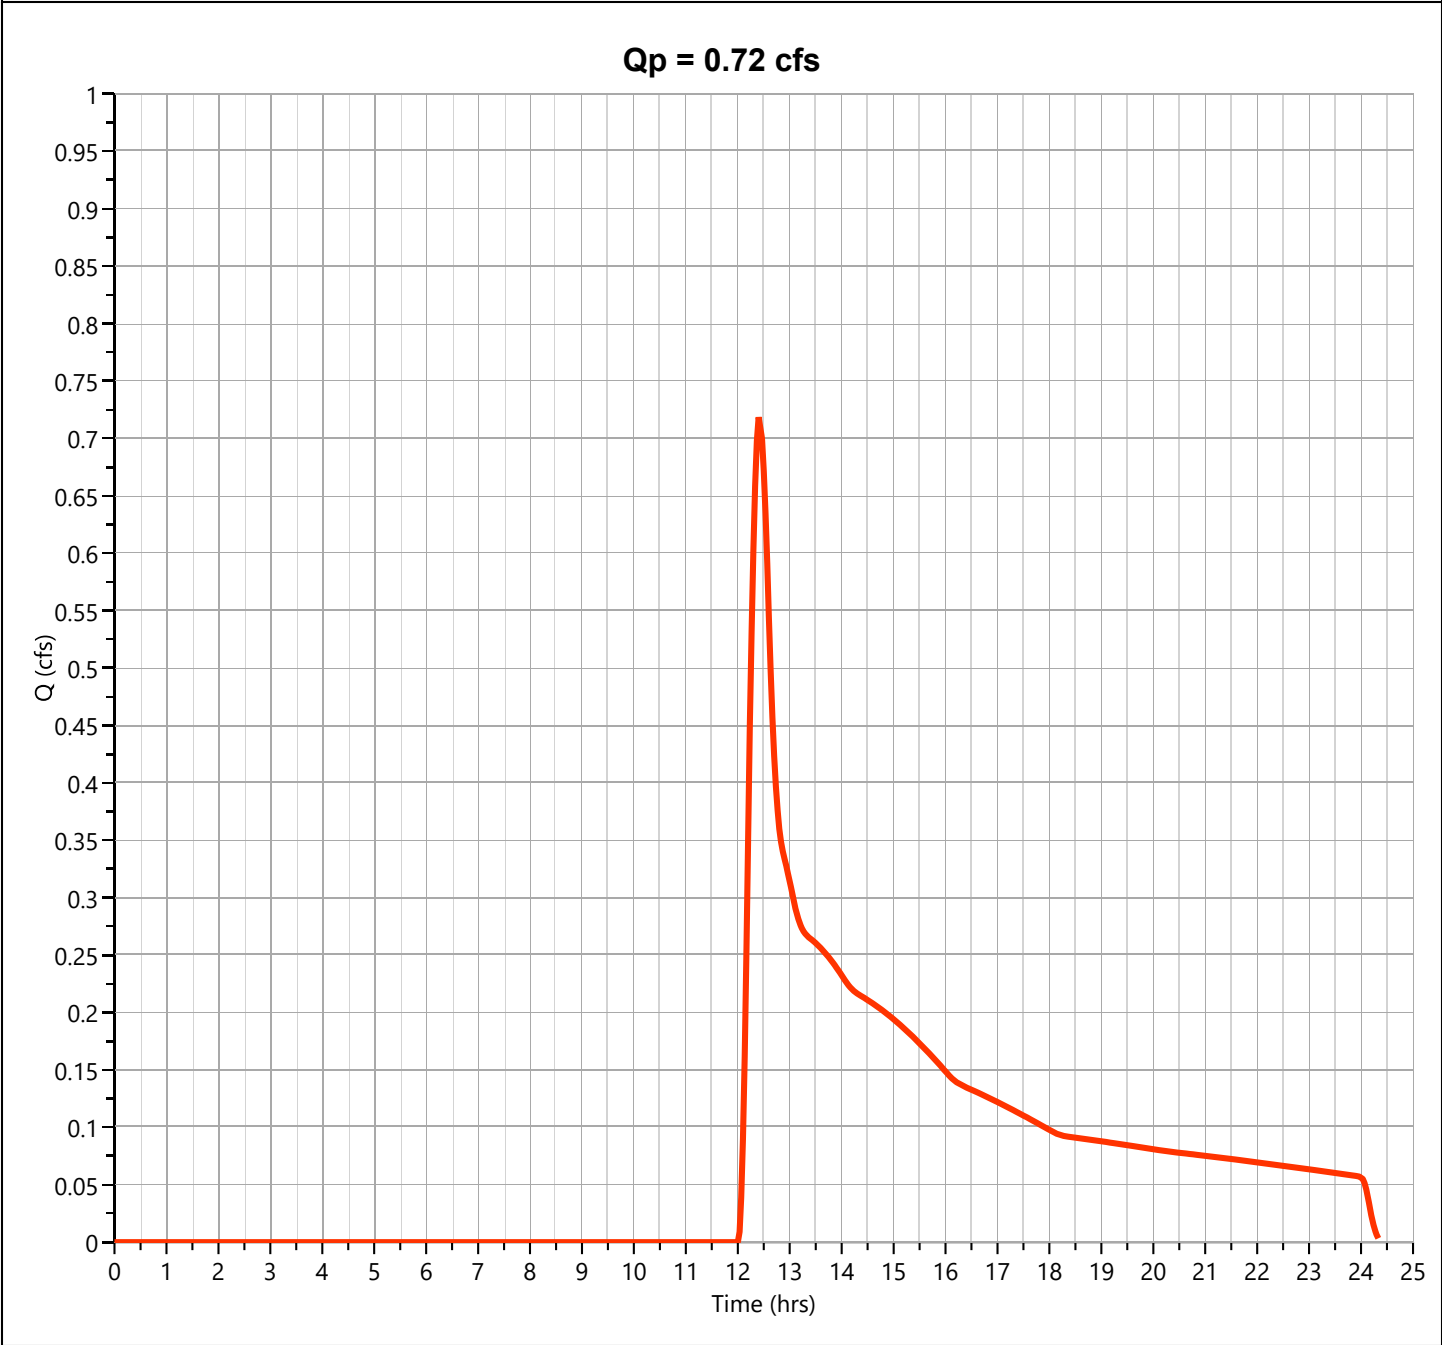

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment E-1

## Hyd. No. 1

Hydrograph Type	= NRCS Runoff	Peak Flow	= 1.361 cfs
Storm Frequency	= 100-yr	Time to Peak	= 12.33 hrs
Time Interval	= 2 min	Runoff Volume	= 9,709 cuft
Drainage Area	= 3.24 ac	Curve Number	= 37
Tc Method	= User	Time of Conc. (Tc)	= 14.8 min
Total Rainfall	= 7.65 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

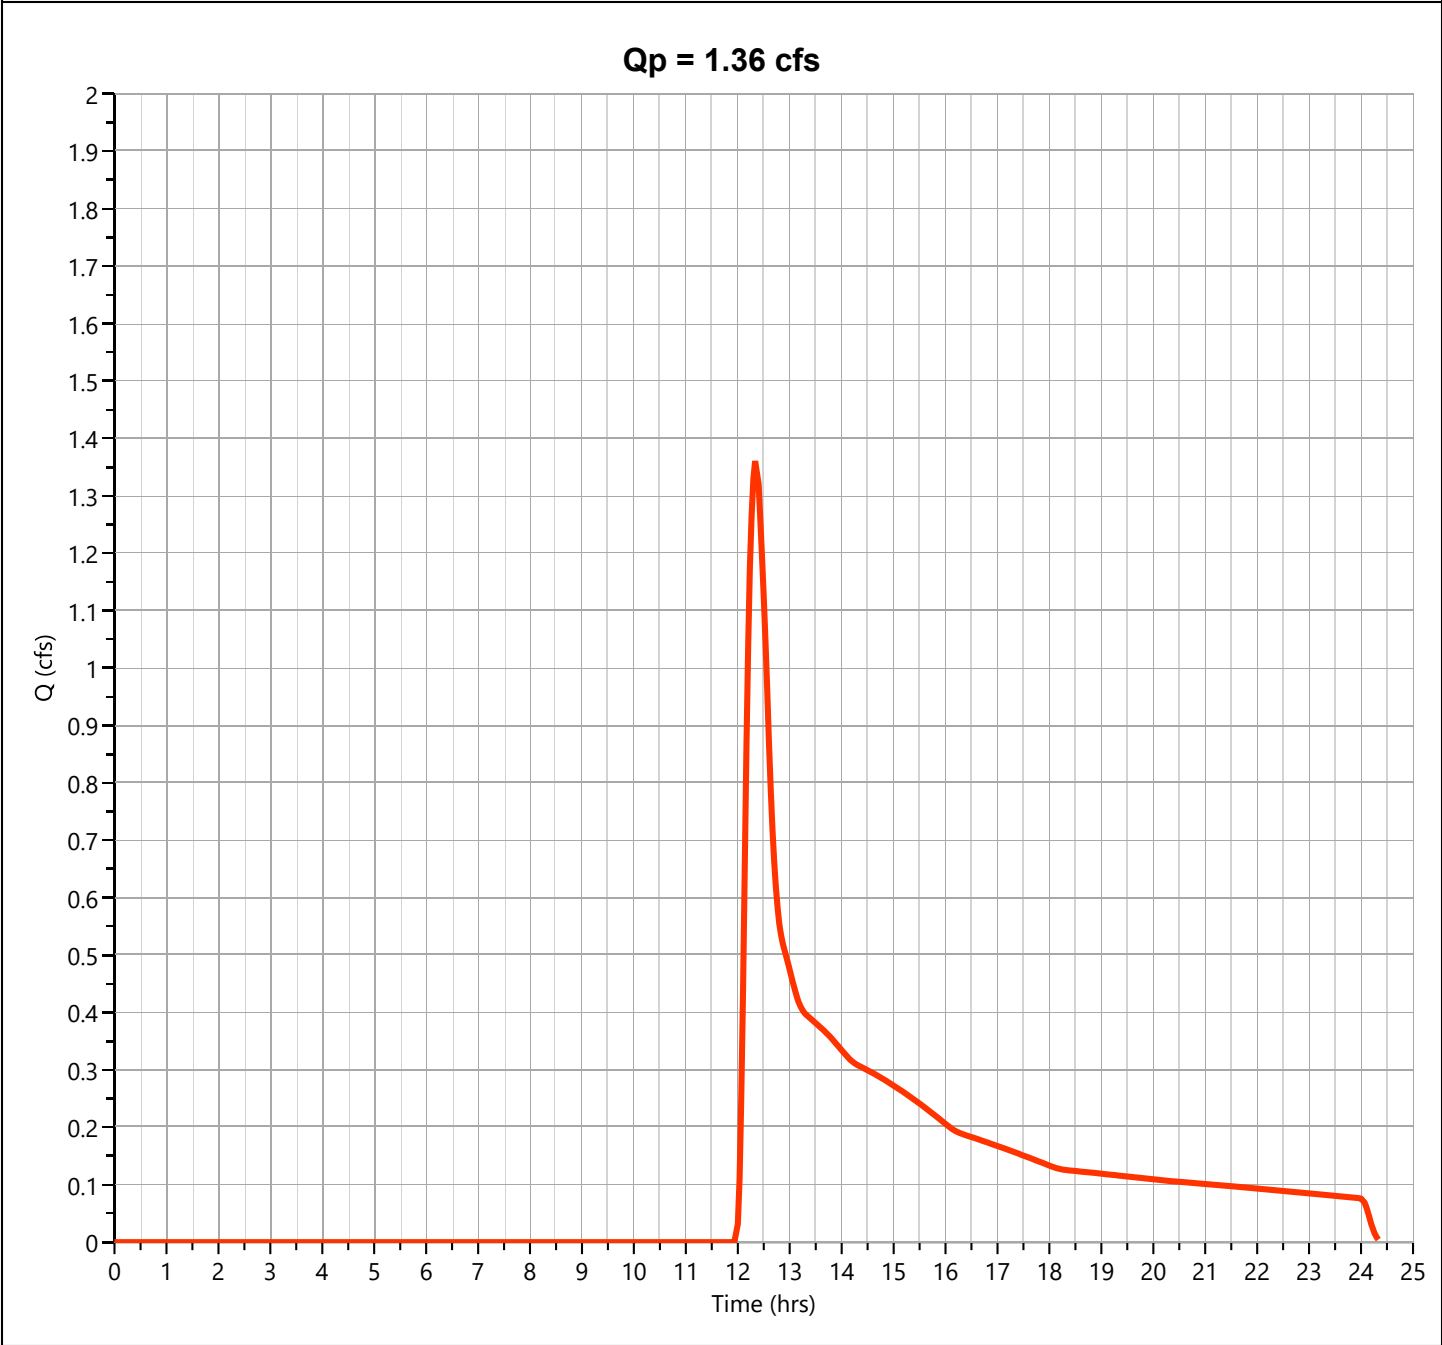

## Worksheet 2: Runoff curve number and runoff

SM-7306

Project: 95 Taylor Street By PFK Date 2/12/24Location: Littleton, MA Checked \_\_\_\_\_ Date \_\_\_\_\_Circle one: ☒ Present ☐ Developed E-21. Runoff curve number (CN)

Soil name and hydrologic group (appendix A)	Cover description (cover type, treatment, and hydrologic condition: percent impervious: unconnected/connected impervious area ratio)	CN 1/			Area  Acres	Product of CN x Area
		Table 2-2	Fig. 2-3	Fig. 2-4		
-	Impervious	98			0.00	0.00
A	Open Space-Good Condition	39			0.00	0.00
A	Woods- Good Condition	30			0.81	24.15
A	Residential Districts - 2 acres	46			0.00	0.00
A	Gravel	76			0.00	0.00
Totals =					0.81	24.15

1/ Use only one CN source per line.

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{24.15}{0.81} = \underline{30.00}; \quad \text{Use CN} = \underline{30}$$

2. Runoff

Frequency..... yr

Rainfall, P (24-hour)..... in

Runoff, Q..... in

(Use P and CN with table 2-1, fig. 2-1,  
or eqs. 2-3 and 2-4.)

Storm #1	Storm #2	Storm #3
2	10	100
3.1	4.5	6.5
0.11	0.00	0.13

## Worksheet 3: Time of Concentration (Tc) or travel time (Tt)

SM-7306

Project: 95 Taylor StreetBy PFKDate 2/12/2024Location: Littleton, MA

Checked \_\_\_\_\_

Date \_\_\_\_\_

Circle one:

Present
Tc

Developed

Tt

through  
subareaE-2Sheet flow (Applicable to Tc only)

Segment ID

1. Surface Description (table 3-1)

2. Mannings roughness coeff., n (table 3-1)

3. Flow length, L (total L &lt;= 300 ft)

ft

4. Two-yr 24-hr rainfall, P2

in

5. Land Slope, s

ft/ft

6.  $Tt = 0.007 (nL)^{0.8} / (P2^{0.5} s^{0.4})$ 

Compute Tt hr

A-B		
WOODED		
0.6		
50		
3.1		
0.02		
0.29		

0.29

Shallow concentrated Flow

Segment ID

7. Surface Description (paved or unpaved)

8. Flow Length, L

ft

9. Watercourse slope, s

ft/ft

10. Average Velocity, V (figure 3-1)

ft/s

11.  $Tt = L / 3600V$ 

Compute Tt hr

B-C		
UNPAVED		
99		
0.03		
2.79		
0.01		

0.01

Channel flow

Segment ID

12. Cross sectional flow area, a

sf

13. Wetted perimeter, pw

ft

14. Hydraulic radius,  $r=a/wp$ 

Compute r ft

15. Channel Slope, s

ft/ft

16. Manning's roughness coeff., n

17.  $V = 1.49 r^{2/3} s^{1/2} / n$ 

Compute V ft/s

18. Flow length, L

ft

19.  $Tt = L / 3600V$ 

Compute Tt hr


0.00

20. Watershed or subarea Tc or Tt (add Tt in steps 6, 11, and 19)

hr  
min0.30  
17.9

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment E-2

## Hyd. No. 2

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.000 cfs
Storm Frequency	= 2-yr	Time to Peak	= 0.00 hrs
Time Interval	= 2 min	Runoff Volume	= 0.000 cuft
Drainage Area	= 0.81 ac	Curve Number	= 30
Tc Method	= User	Time of Conc. (Tc)	= 17.9 min
Total Rainfall	= 3.18 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

**Qp = 0.00 cfs**

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment E-2

## Hyd. No. 2

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.001 cfs
Storm Frequency	= 10-yr	Time to Peak	= 24.00 hrs
Time Interval	= 2 min	Runoff Volume	= 7.38 cuft
Drainage Area	= 0.81 ac	Curve Number	= 30
Tc Method	= User	Time of Conc. (Tc)	= 17.9 min
Total Rainfall	= 4.91 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

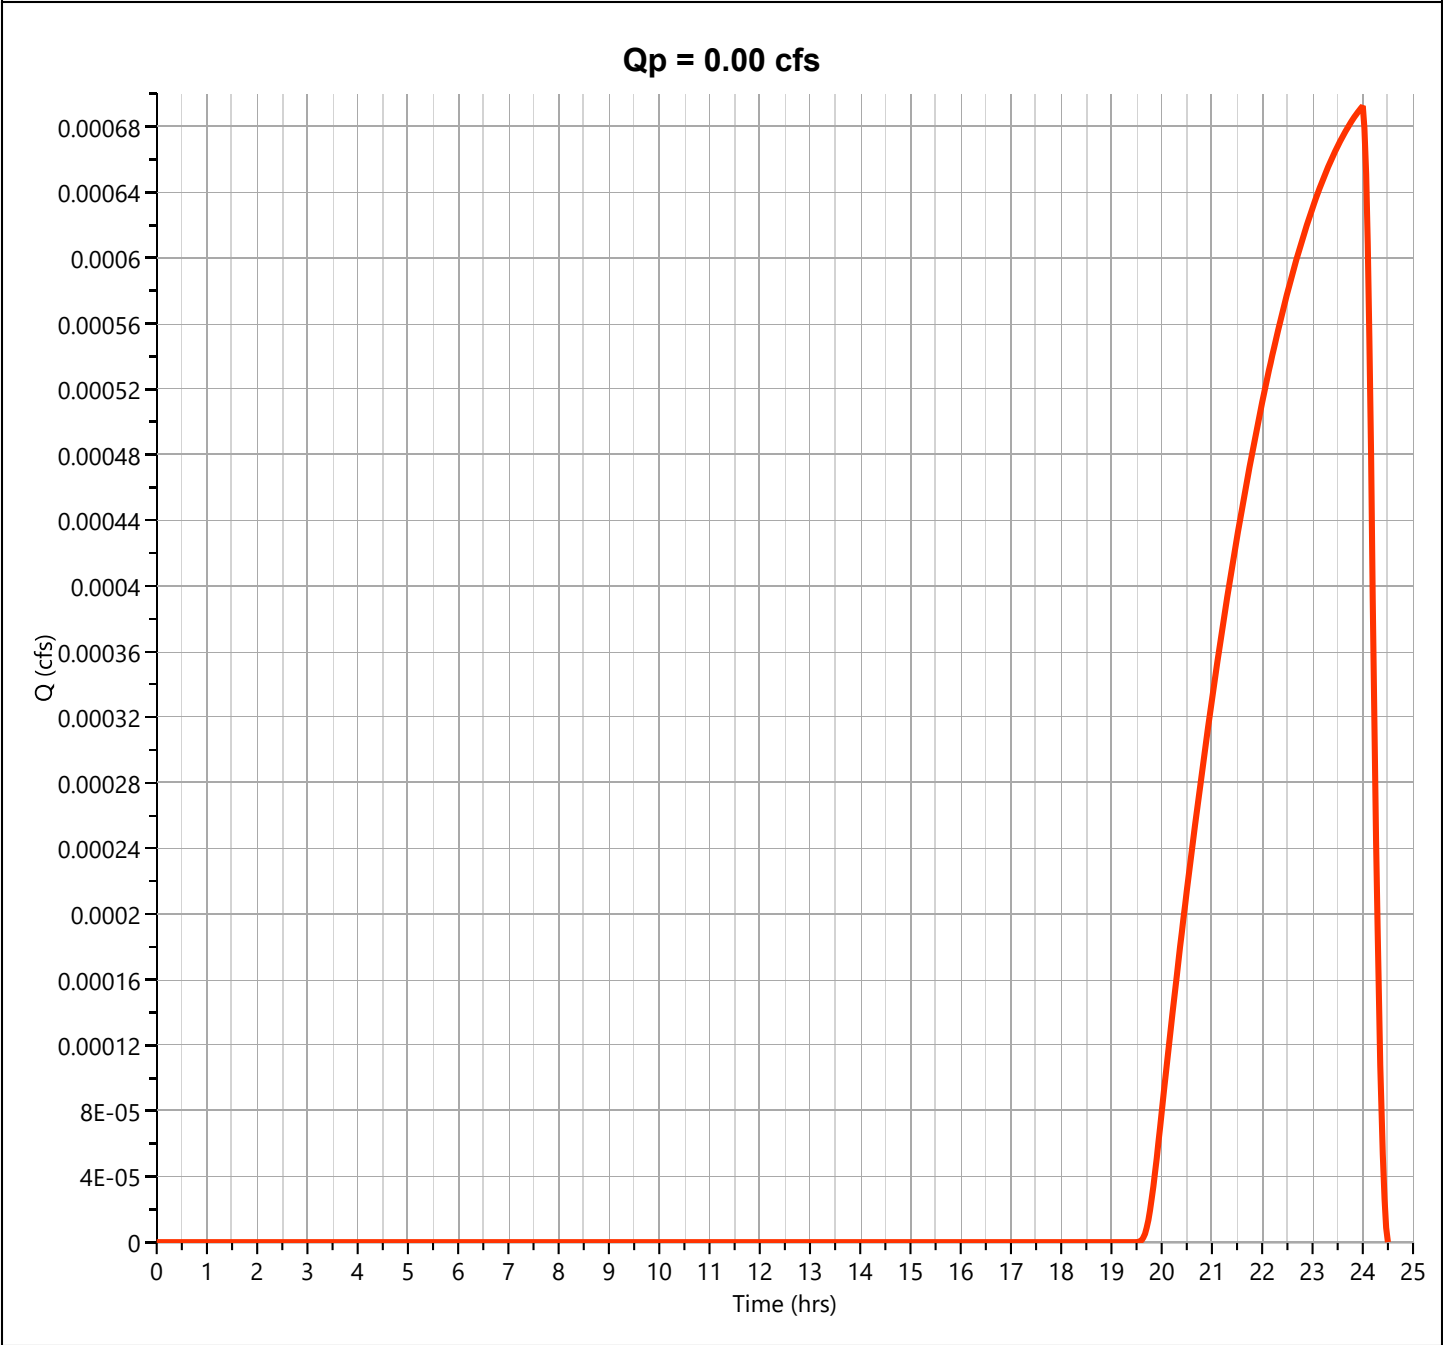

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment E-2

## Hyd. No. 2

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.007 cfs
Storm Frequency	= 25-yr	Time to Peak	= 15.63 hrs
Time Interval	= 2 min	Runoff Volume	= 209 cuft
Drainage Area	= 0.81 ac	Curve Number	= 30
Tc Method	= User	Time of Conc. (Tc)	= 17.9 min
Total Rainfall	= 5.99 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

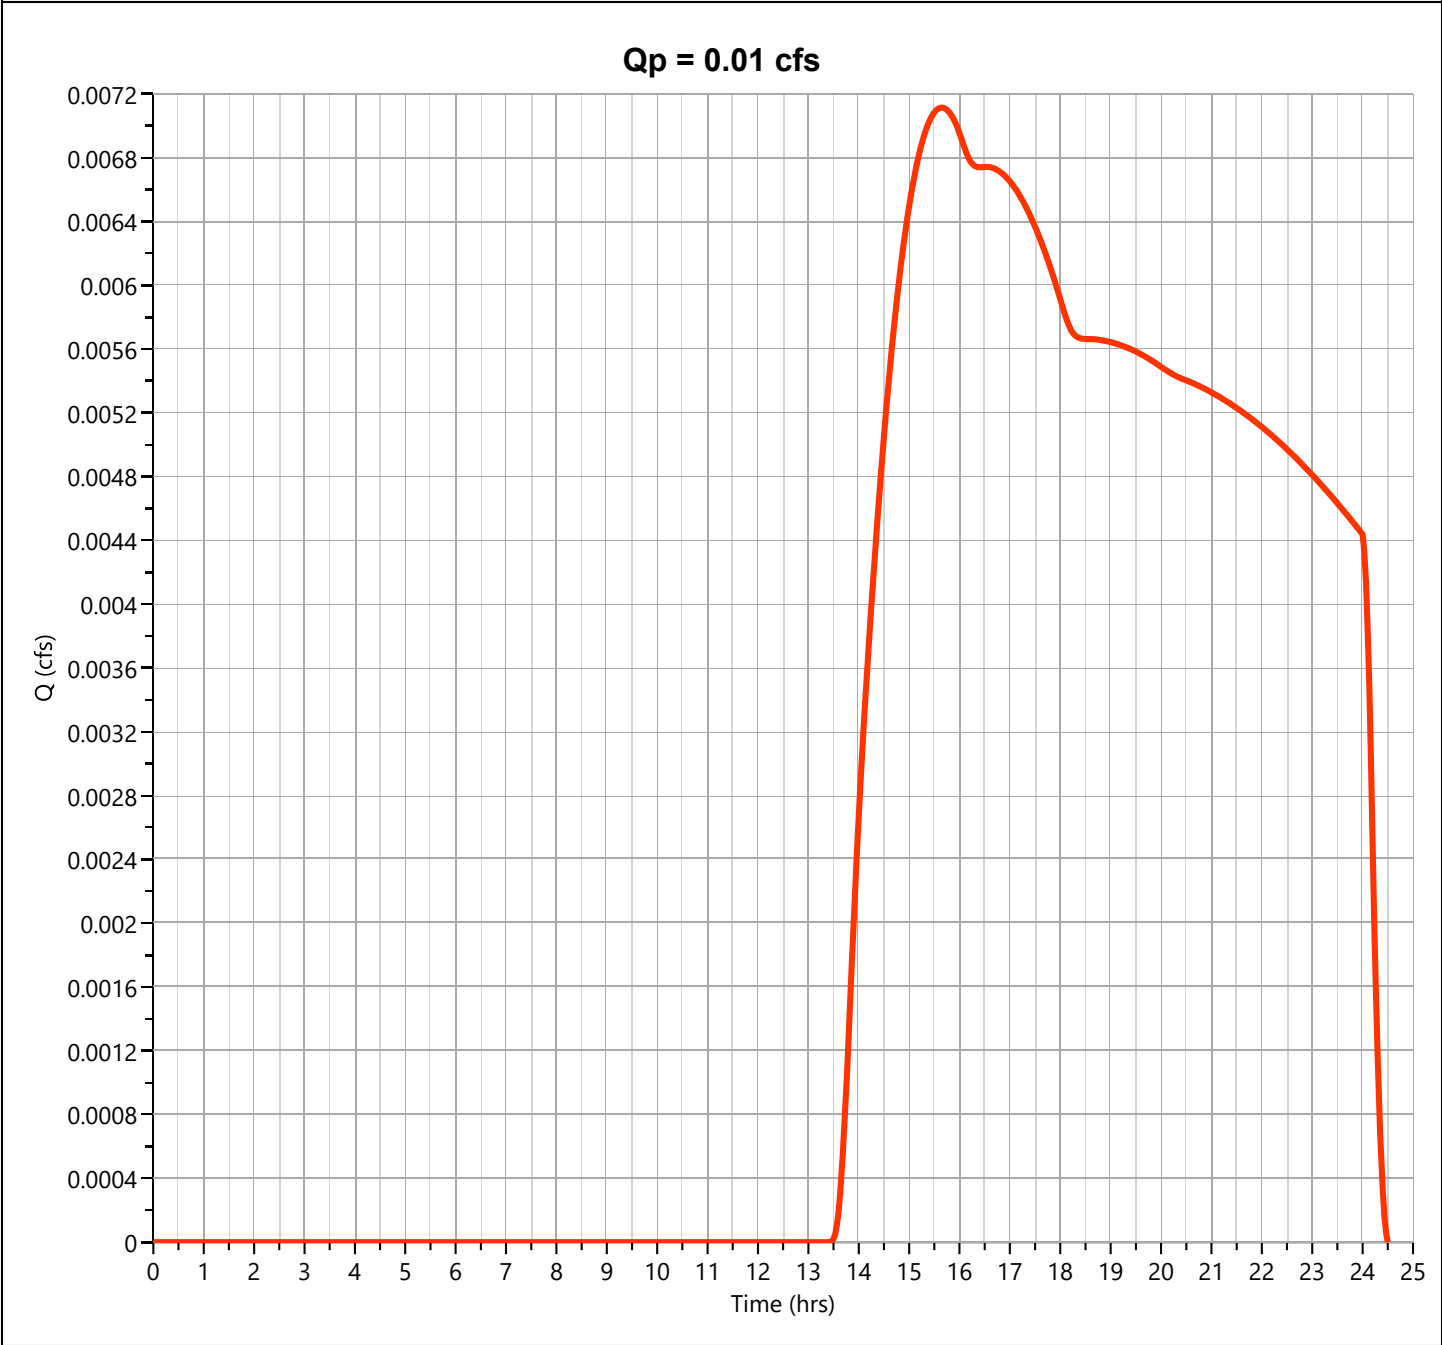



# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment E-2

## Hyd. No. 2

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.019 cfs
Storm Frequency	= 50-yr	Time to Peak	= 14.80 hrs
Time Interval	= 2 min	Runoff Volume	= 516 cuft
Drainage Area	= 0.81 ac	Curve Number	= 30
Tc Method	= User	Time of Conc. (Tc)	= 17.9 min
Total Rainfall	= 6.78 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

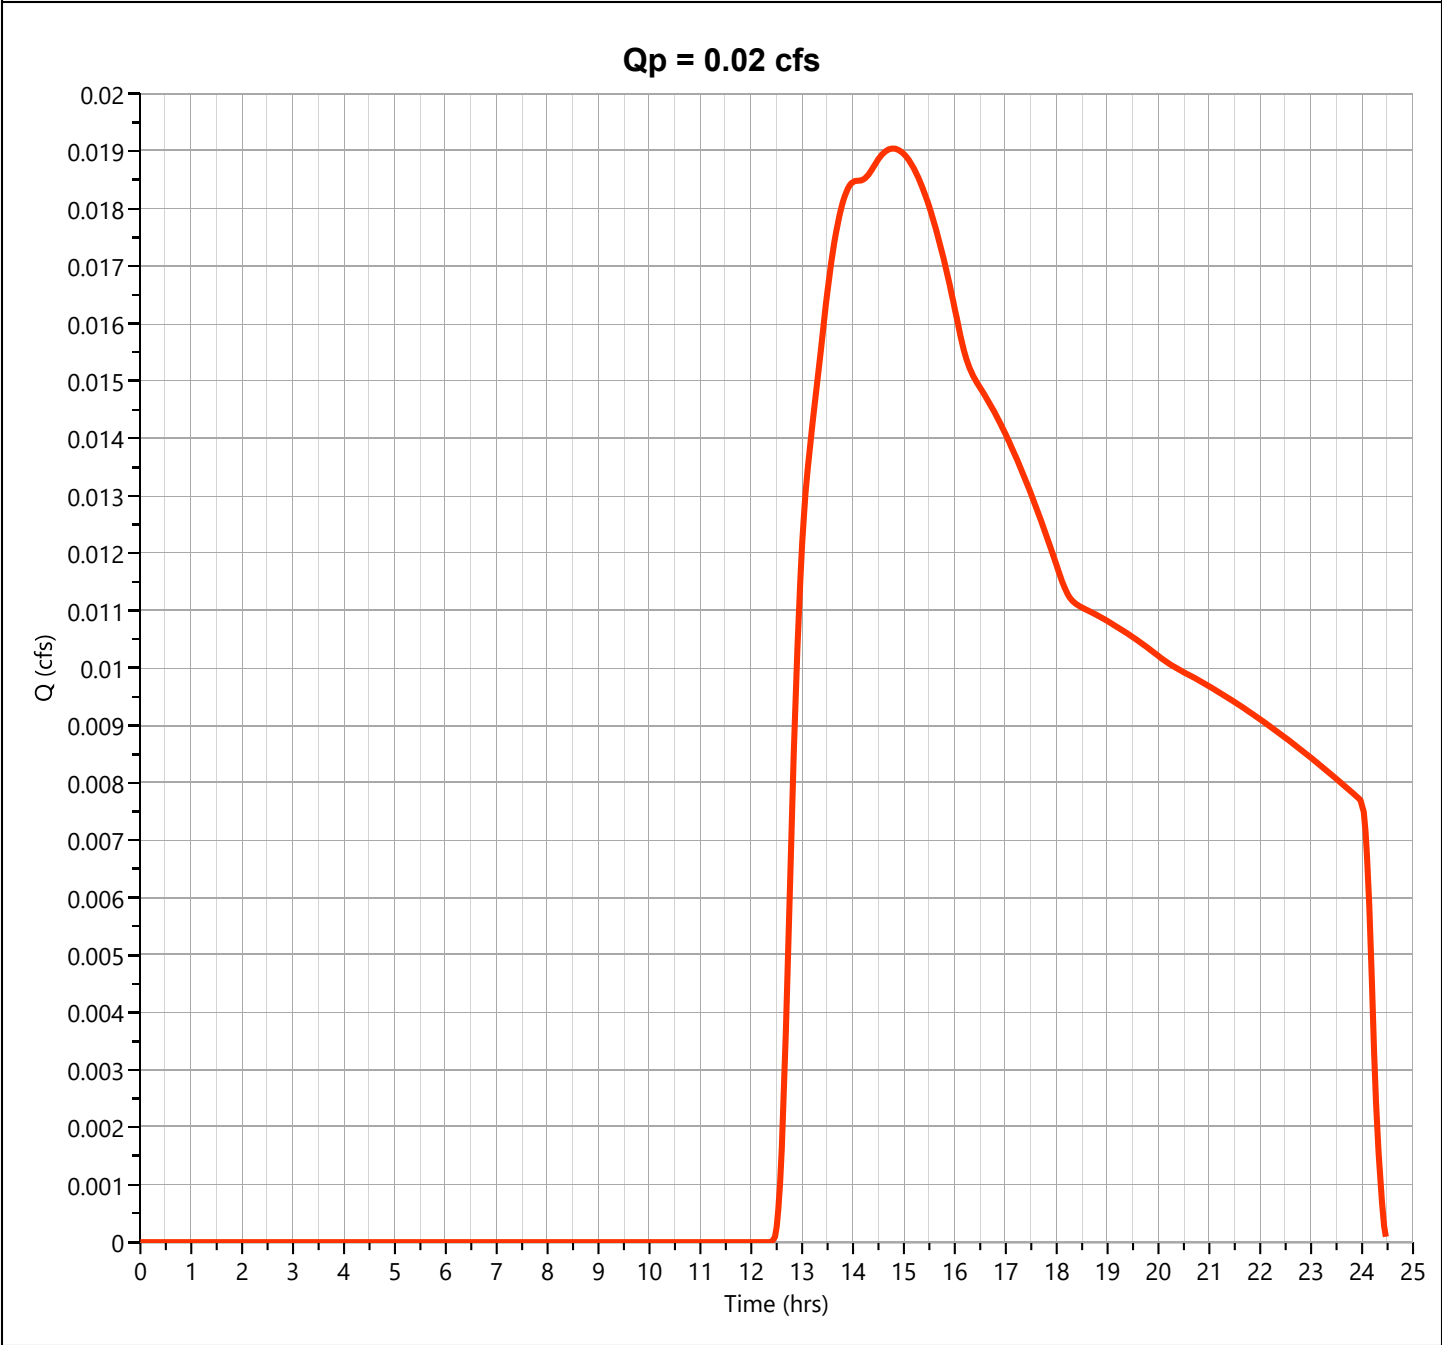

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment E-2

## Hyd. No. 2

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.052 cfs
Storm Frequency	= 100-yr	Time to Peak	= 12.63 hrs
Time Interval	= 2 min	Runoff Volume	= 994 cuft
Drainage Area	= 0.81 ac	Curve Number	= 30
Tc Method	= User	Time of Conc. (Tc)	= 17.9 min
Total Rainfall	= 7.65 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

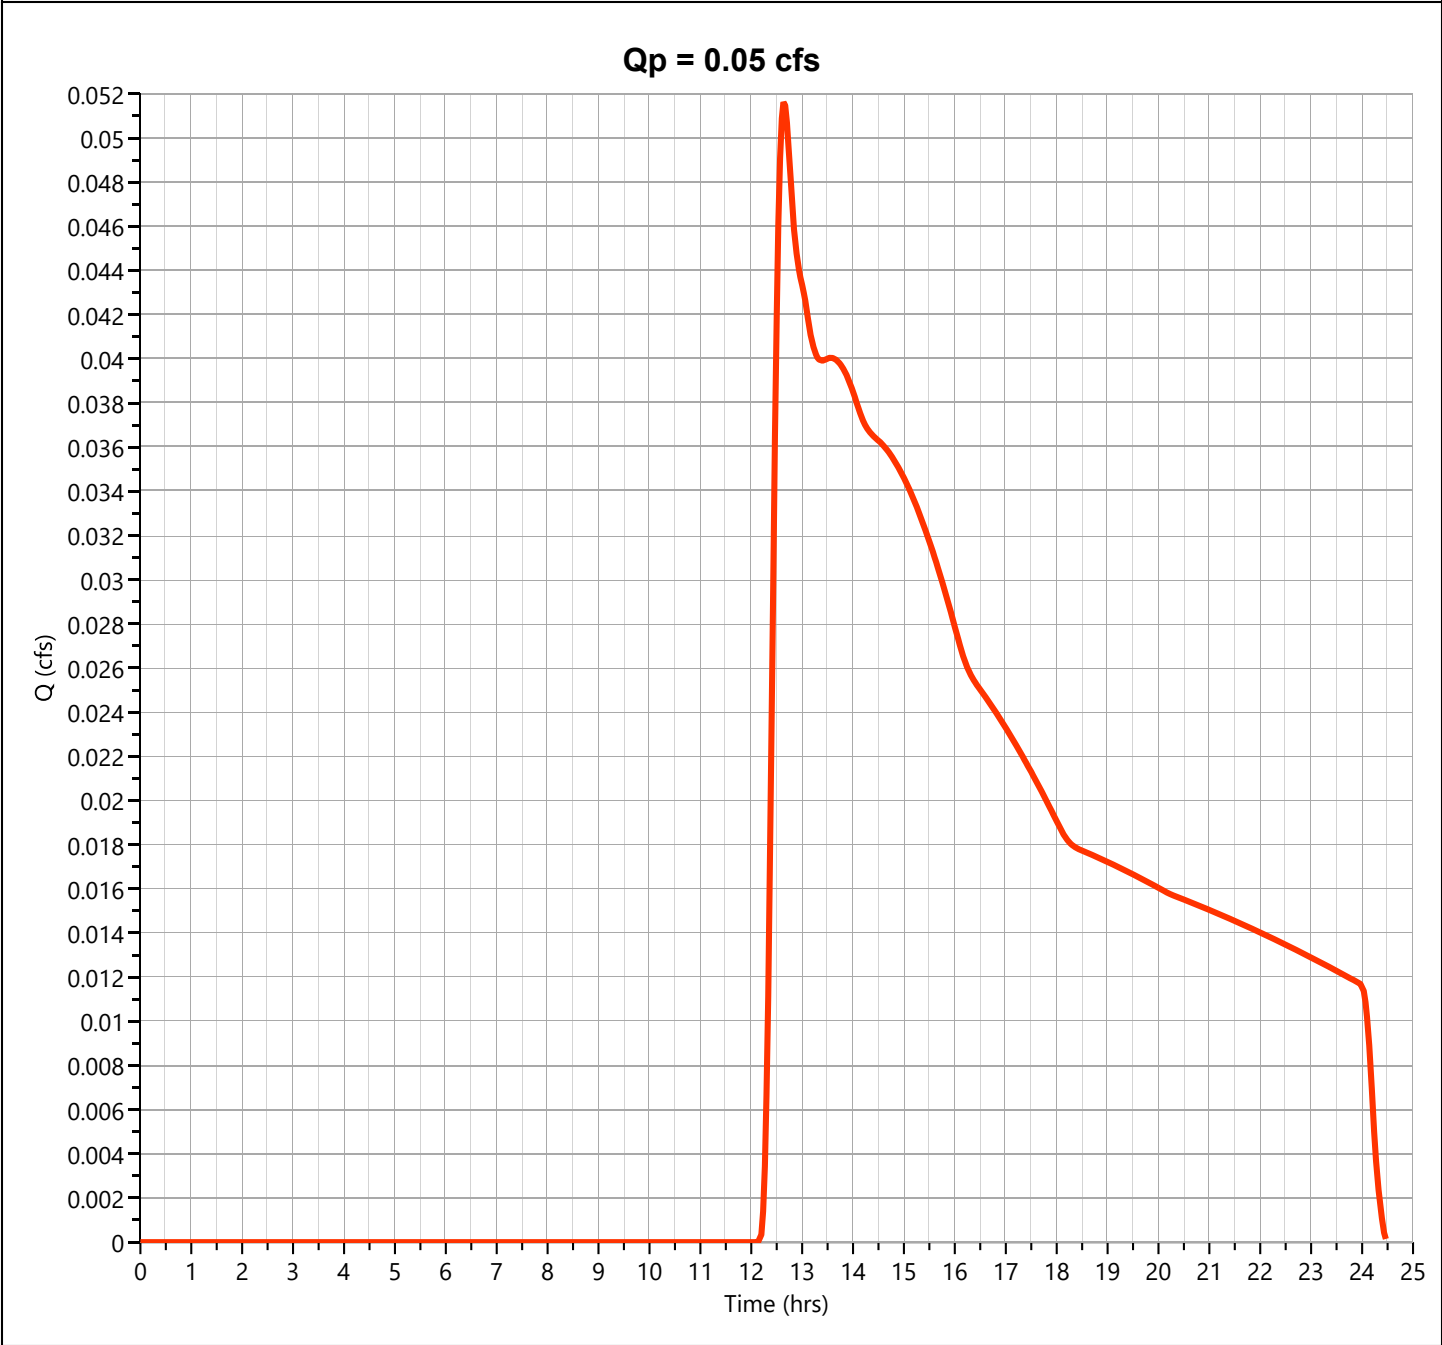

## Worksheet 2: Runoff curve number and runoff

SM-7306

Project: 95 Taylor Street By PFK Date 2/12/24Location: Littleton, MA Checked            Date           Circle one: ☒ Present ☐ Developed E-31. Runoff curve number (CN)

Soil name and hydrologic group (appendix A)	Cover description (cover type, treatment, and hydrologic condition: percent impervious: unconnected/connected impervious area ratio)	CN 1/			Area  Acres	Product of CN x Area
		Table 2-2	Fig. 2-3	Fig. 2-4		
-	Impervious	98			0.00	0.00
A	Open Space-Good Condition	39			0.00	0.00
A	Woods- Good Condition	30			1.73	51.80
A	Residential Districts - 2 acres	46			0.00	0.00
A	Gravel	76			0.00	0.00
Totals =					1.73	51.80

1/ Use only one CN source per line.

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{51.80}{1.73} = \underline{30.00}; \quad \text{Use CN} = \underline{30}$$

2. Runoff

Frequency..... yr

Rainfall, P (24-hour)..... in

Runoff, Q..... in

(Use P and CN with table 2-1, fig. 2-1,  
or eqs. 2-3 and 2-4.)

Storm #1	Storm #2	Storm #3
2	10	100
3.1	4.5	6.5
0.11	0.00	0.13

## Worksheet 3: Time of Concentration (Tc) or travel time (Tt)

SM-7306

Project: 95 Taylor StreetBy PFKDate 2/12/2024Location: Littleton, MA

Checked \_\_\_\_\_

Date \_\_\_\_\_

Circle one:

Present
Tc

Developed

Tt

through  
subarea

E-3

Sheet flow (Applicable to Tc only)

Segment ID

1. Surface Description (table 3-1)

2. Mannings roughness coeff., n (table 3-1)

3. Flow length, L (total L &lt;= 300 ft)

ft

4. Two-yr 24-hr rainfall, P2

in

5. Land Slope, s

ft/ft

6.  $Tt = 0.007 (nL)^{0.8} / (P2^{0.5} s^{0.4})$ 

Compute Tt hr

A-B		
WOODS		
0.6		
50		
3.1		
0.02		
0.29		

0.29

Shallow concentrated Flow

Segment ID

7. Surface Description (paved or unpaved)

8. Flow Length, L

ft

9. Watercourse slope, s

ft/ft

10. Average Velocity, V (figure 3-1)

ft/s

11.  $Tt = L / 3600V$ 

Compute Tt hr

B-C		
UNPAVED		
330		
0.015		
1.98		
0.05		

0.05

Channel flow

Segment ID

12. Cross sectional flow area, a

sf

13. Wetted perimeter, pw

ft

14. Hydraulic radius,  $r=a/wp$ 

Compute r ft

15. Channel Slope, s

ft/ft

16. Manning's roughness coeff., n

17.  $V = 1.49 r^{2/3} s^{1/2} / n$ 

Compute V ft/s

18. Flow length, L

ft

19.  $Tt = L / 3600V$ 

Compute Tt hr


0.00

20. Watershed or subarea Tc or Tt (add Tt in steps 6, 11, and 19)

hr  
min0.34  
20.1

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

### Subcatchment E-3

**Hyd. No. 3**

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.000 cfs
Storm Frequency	= 2-yr	Time to Peak	= 0.00 hrs
Time Interval	= 2 min	Runoff Volume	= 0.000 cuft
Drainage Area	= 1.73 ac	Curve Number	= 30
Tc Method	= User	Time of Conc. (Tc)	= 20.1 min
Total Rainfall	= 3.18 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

**Qp = 0.00 cfs**

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment E-3

## Hyd. No. 3

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.001 cfs
Storm Frequency	= 10-yr	Time to Peak	= 24.00 hrs
Time Interval	= 2 min	Runoff Volume	= 15.8 cuft
Drainage Area	= 1.73 ac	Curve Number	= 30
Tc Method	= User	Time of Conc. (Tc)	= 20.1 min
Total Rainfall	= 4.91 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

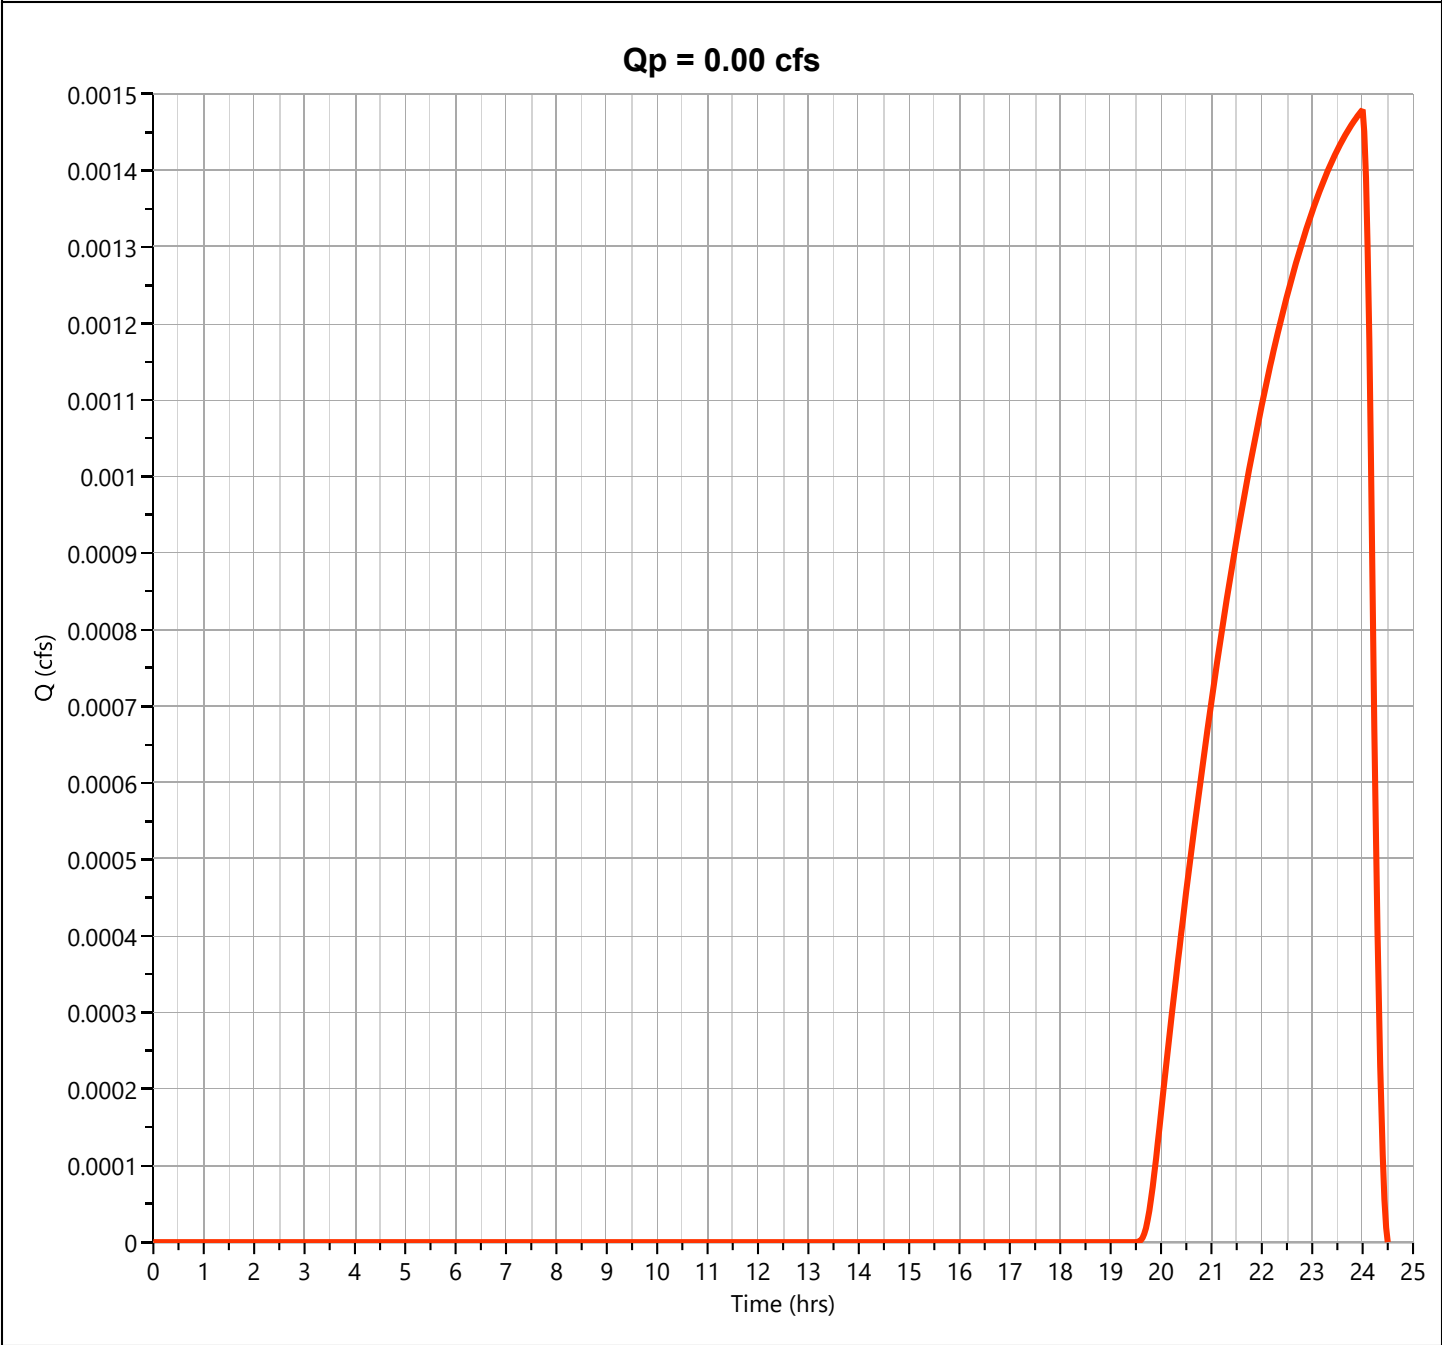

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment E-3

## Hyd. No. 3

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.015 cfs
Storm Frequency	= 25-yr	Time to Peak	= 15.63 hrs
Time Interval	= 2 min	Runoff Volume	= 446 cuft
Drainage Area	= 1.73 ac	Curve Number	= 30
Tc Method	= User	Time of Conc. (Tc)	= 20.1 min
Total Rainfall	= 5.99 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

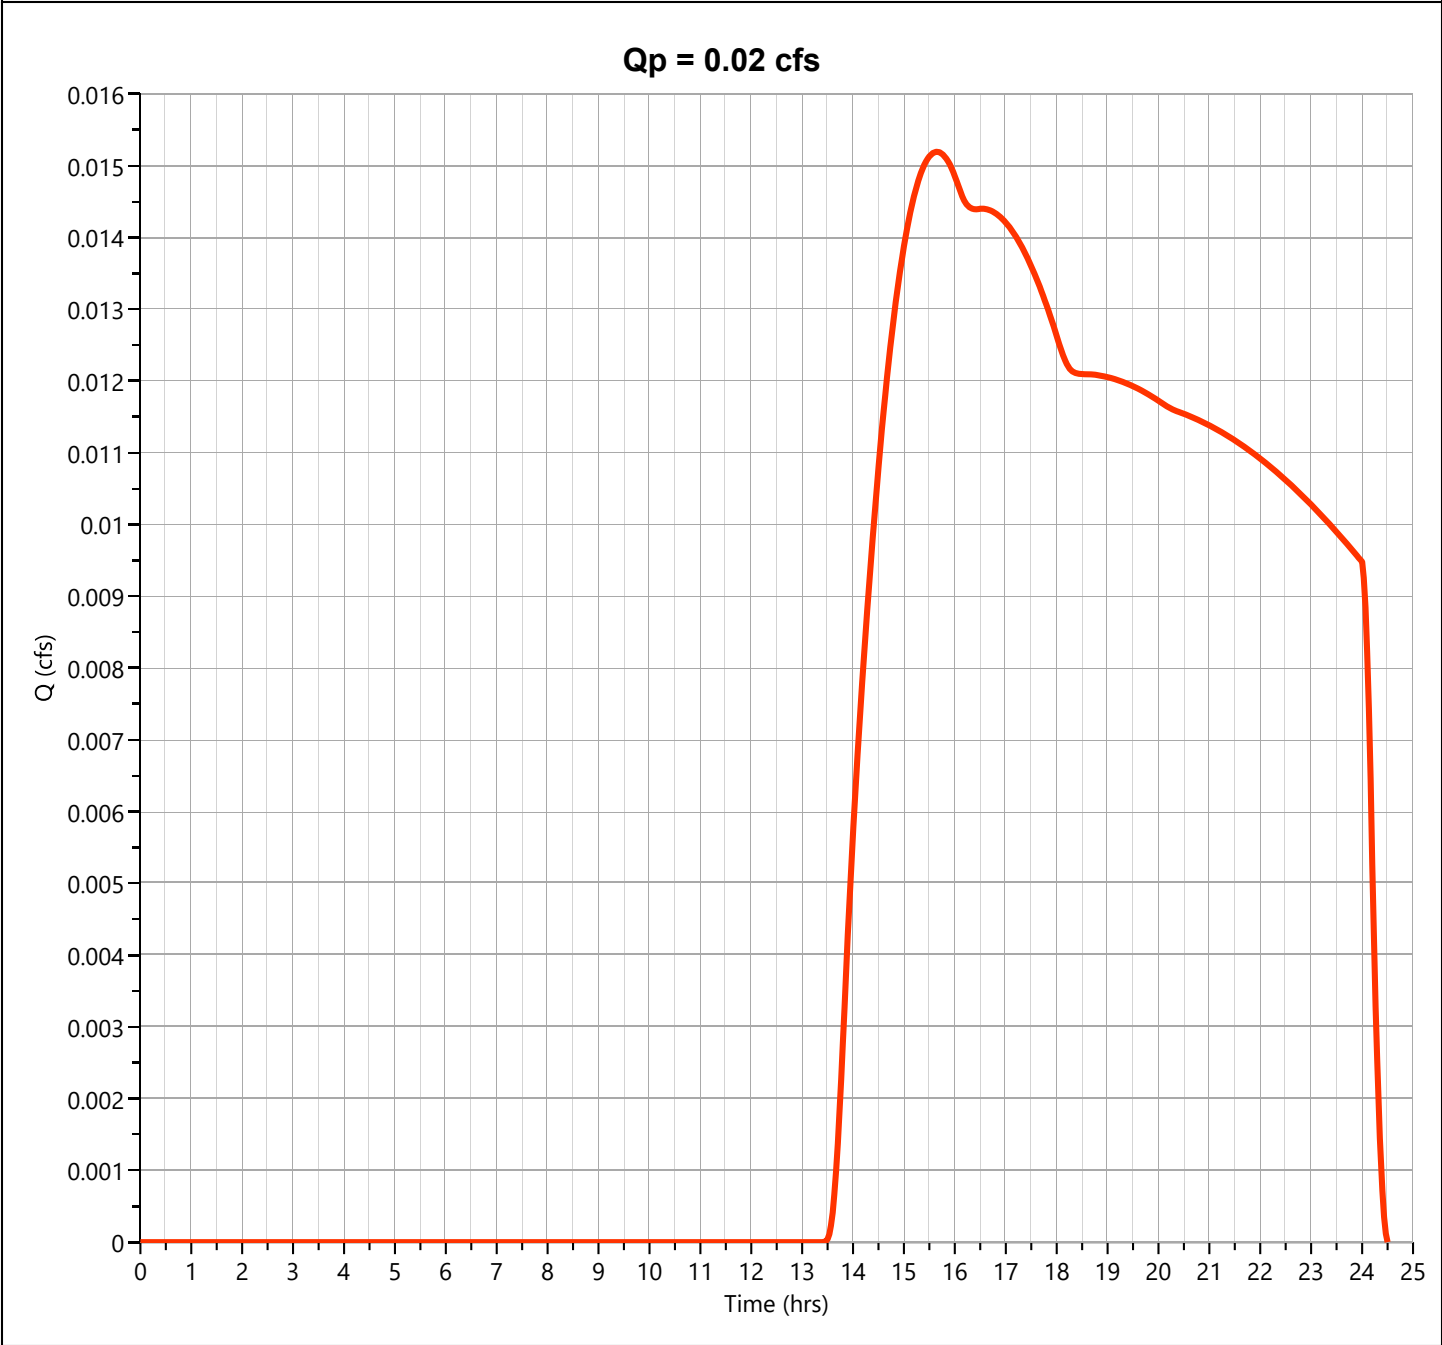

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment E-3

## Hyd. No. 3

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.041 cfs
Storm Frequency	= 50-yr	Time to Peak	= 14.80 hrs
Time Interval	= 2 min	Runoff Volume	= 1,102 cuft
Drainage Area	= 1.73 ac	Curve Number	= 30
Tc Method	= User	Time of Conc. (Tc)	= 20.1 min
Total Rainfall	= 6.78 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

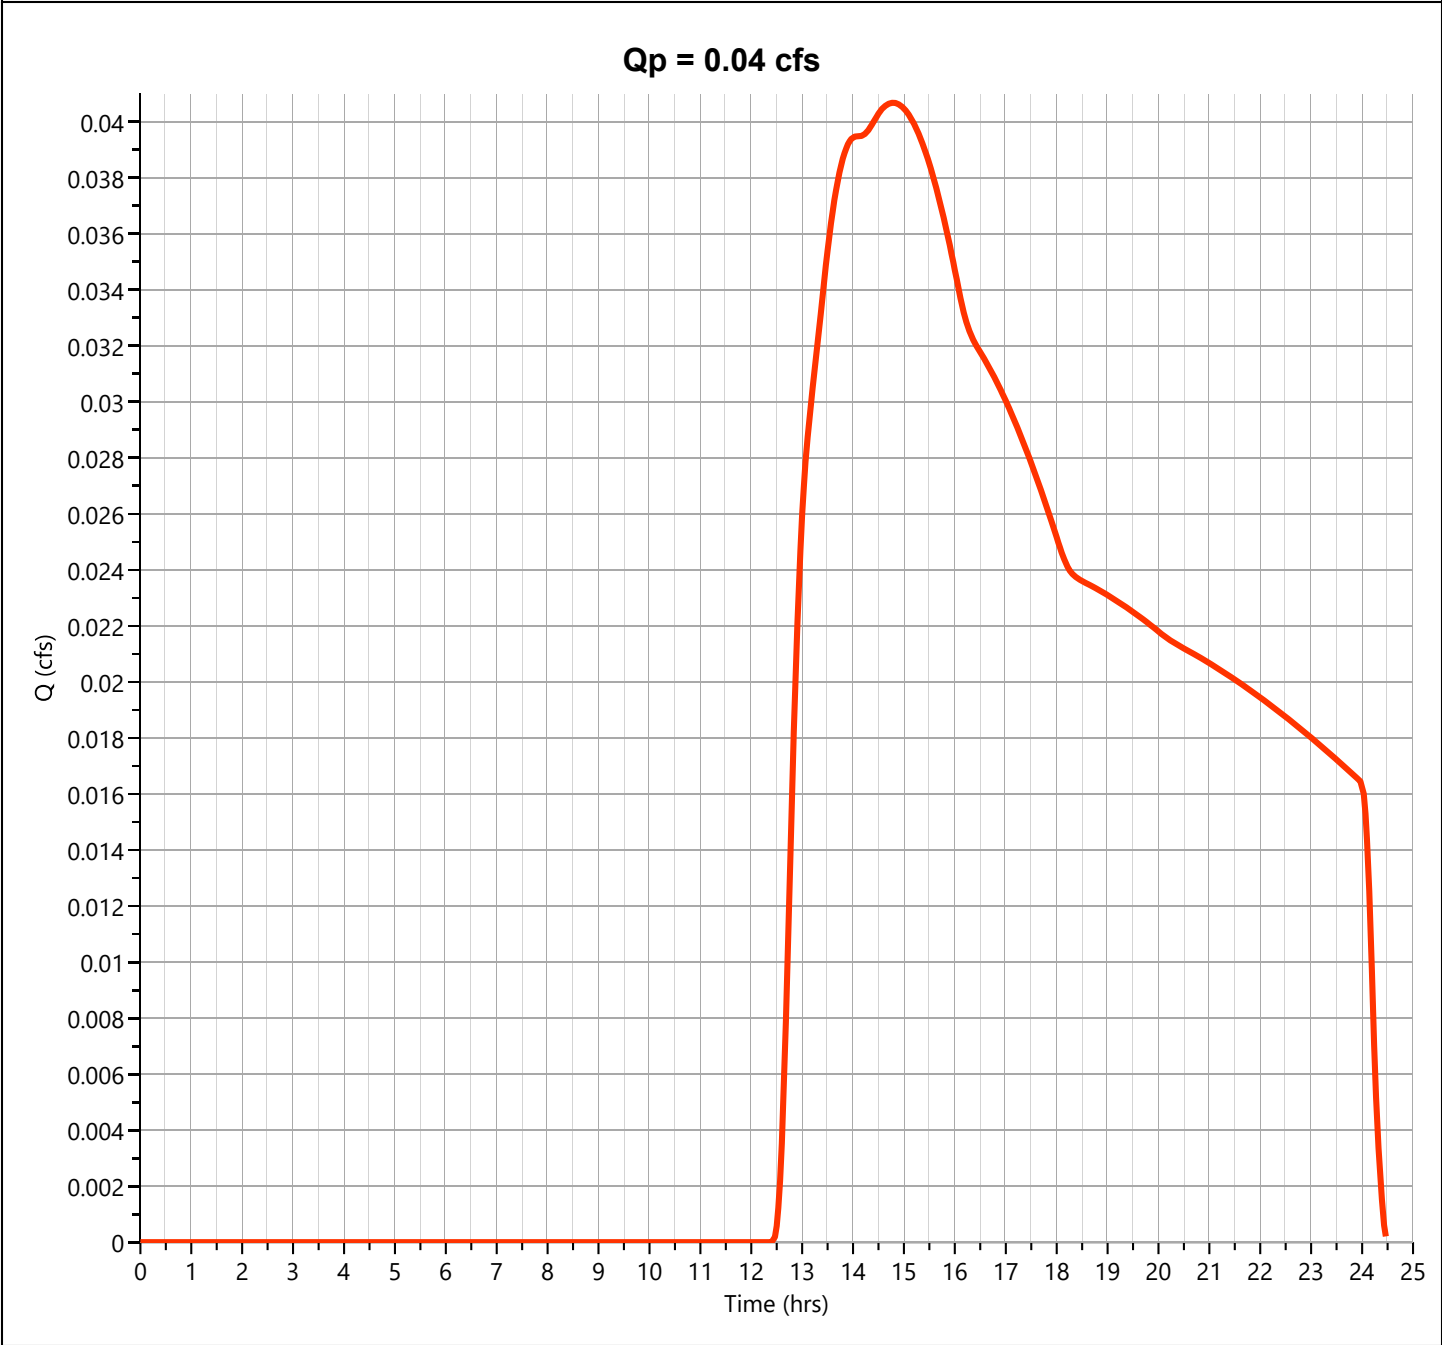



# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment E-3

## Hyd. No. 3

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.110 cfs
Storm Frequency	= 100-yr	Time to Peak	= 12.63 hrs
Time Interval	= 2 min	Runoff Volume	= 2,124 cuft
Drainage Area	= 1.73 ac	Curve Number	= 30
Tc Method	= User	Time of Conc. (Tc)	= 20.1 min
Total Rainfall	= 7.65 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

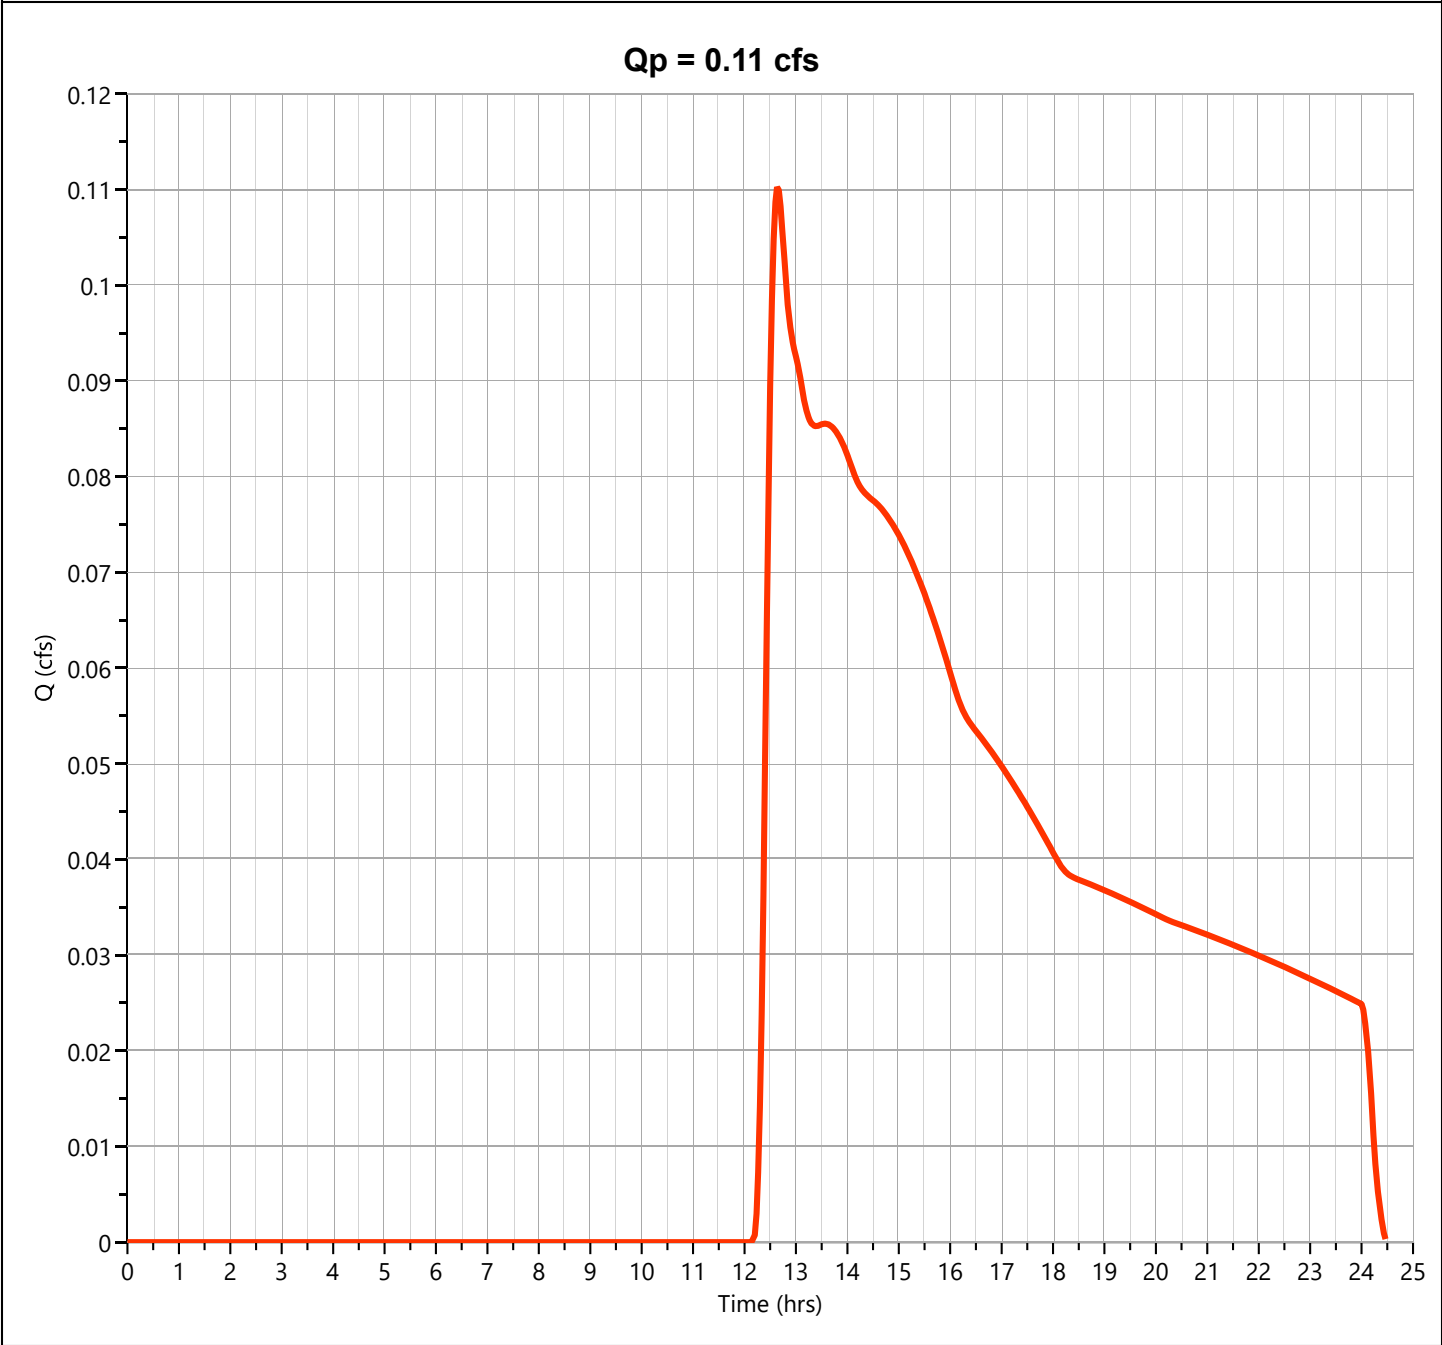

## **Post-Development Hydrology**

## Worksheet 2: Runoff curve number and runoff

SM-7306

Project: 95 Taylor Street By PFK Date 2/12/24Location: Littleton, MA Checked \_\_\_\_\_ Date \_\_\_\_\_Circle one: Present ☒ Developed \_\_\_\_\_ P-1A \_\_\_\_\_1. Runoff curve number (CN)

Soil name and hydrologic group (appendix A)	Cover description (cover type, treatment, and hydrologic condition: percent impervious: unconnected/connected impervious area ratio)	CN 1/			Area	Product of CN x Area
		Table 2-2	Fig. 2-3	Fig. 2-4	Acres	
-	Impervious	98			0.22	21.33
A	Open Space-Good Condition	39			0.64	25.08
A	Woods- Good Condition	30			0.00	0.00
A	Residential Districts - 2 acres	46			0.24	10.89
A	Gravel	76			0.00	0.00
-	Basin Surface	98			0.06	6.07
Totals =					1.16	63.38

1/ Use only one CN source per line.

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{63.38}{1.16} = 54.66 ; \quad \text{Use CN} = \boxed{55}$$

2. Runoff

Frequency..... yr

Rainfall, P (24-hour)..... in

Runoff, Q..... in

(Use P and CN with table 2-1, fig. 2-1, or eqs. 2-3 and 2-4.)

Storm #1	Storm #2	Storm #3
2	10	100
3.1	4.5	6.5
0.21	0.72	1.78

## Worksheet 3: Time of Concentration (Tc) or travel time (Tt)

SM-7306

Project: 95 Taylor StreetBy PFKDate 2/12/2024Location: Littleton, MA

Checked \_\_\_\_\_

Date \_\_\_\_\_

Circle one: 

Present	Developed
---------	-----------

P-1ACircle one: 

Tc	Tt
----	----

through  
subarea \_\_\_\_\_Sheet flow (Applicable to Tc only)

Segment ID

1. Surface Description (table 3-1)

2. Mannings roughness coeff., n (table 3-1)

3. Flow length, L (total L &lt;= 300 ft)

ft

4. Two-yr 24-hr rainfall, P2

in

5. Land Slope, s

ft/ft

6.  $T_t = 0.007 (nL)^{0.8} / (P2^{0.5} s^{0.4})$ 

Compute Tt hr

A-B		
Lawn		
0.24		
50		
3.1		
0.05		
0.10		

0.10

Shallow concentrated Flow

Segment ID

7. Surface Description (paved or unpaved)

8. Flow Length, L

ft

9. Watercourse slope, s

ft/ft

10. Average Velocity, V (figure 3-1)

ft/s

11.  $T_t = L / 3600V$ 

Compute Tt hr

B-C		
UNPAVED		
77		
0.1		
5.10		
0.00		

0.00

Channel flow

Segment ID

12. Cross sectional flow area, a

sf

13. Wetted perimeter, pw

ft

14. Hydraulic radius,  $r=a/wp$ 

Compute r ft

15. Channel Slope, s

ft/ft

16. Manning's roughness coeff., n

17.  $V = 1.49 r^{2/3} s^{1/2} / n$ 

Compute V ft/s

18. Flow length, L

ft

19.  $T_t = L / 3600V$ 

Compute Tt hr


0.00

20. Watershed or subarea Tc or Tt (add Tt in steps 6, 11, and 19)

hr  
min0.10  
6.0

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-1A

## Hyd. No. 5

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.110 cfs
Storm Frequency	= 2-yr	Time to Peak	= 12.30 hrs
Time Interval	= 2 min	Runoff Volume	= 966 cuft
Drainage Area	= 1.16 ac	Curve Number	= 55
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 3.18 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

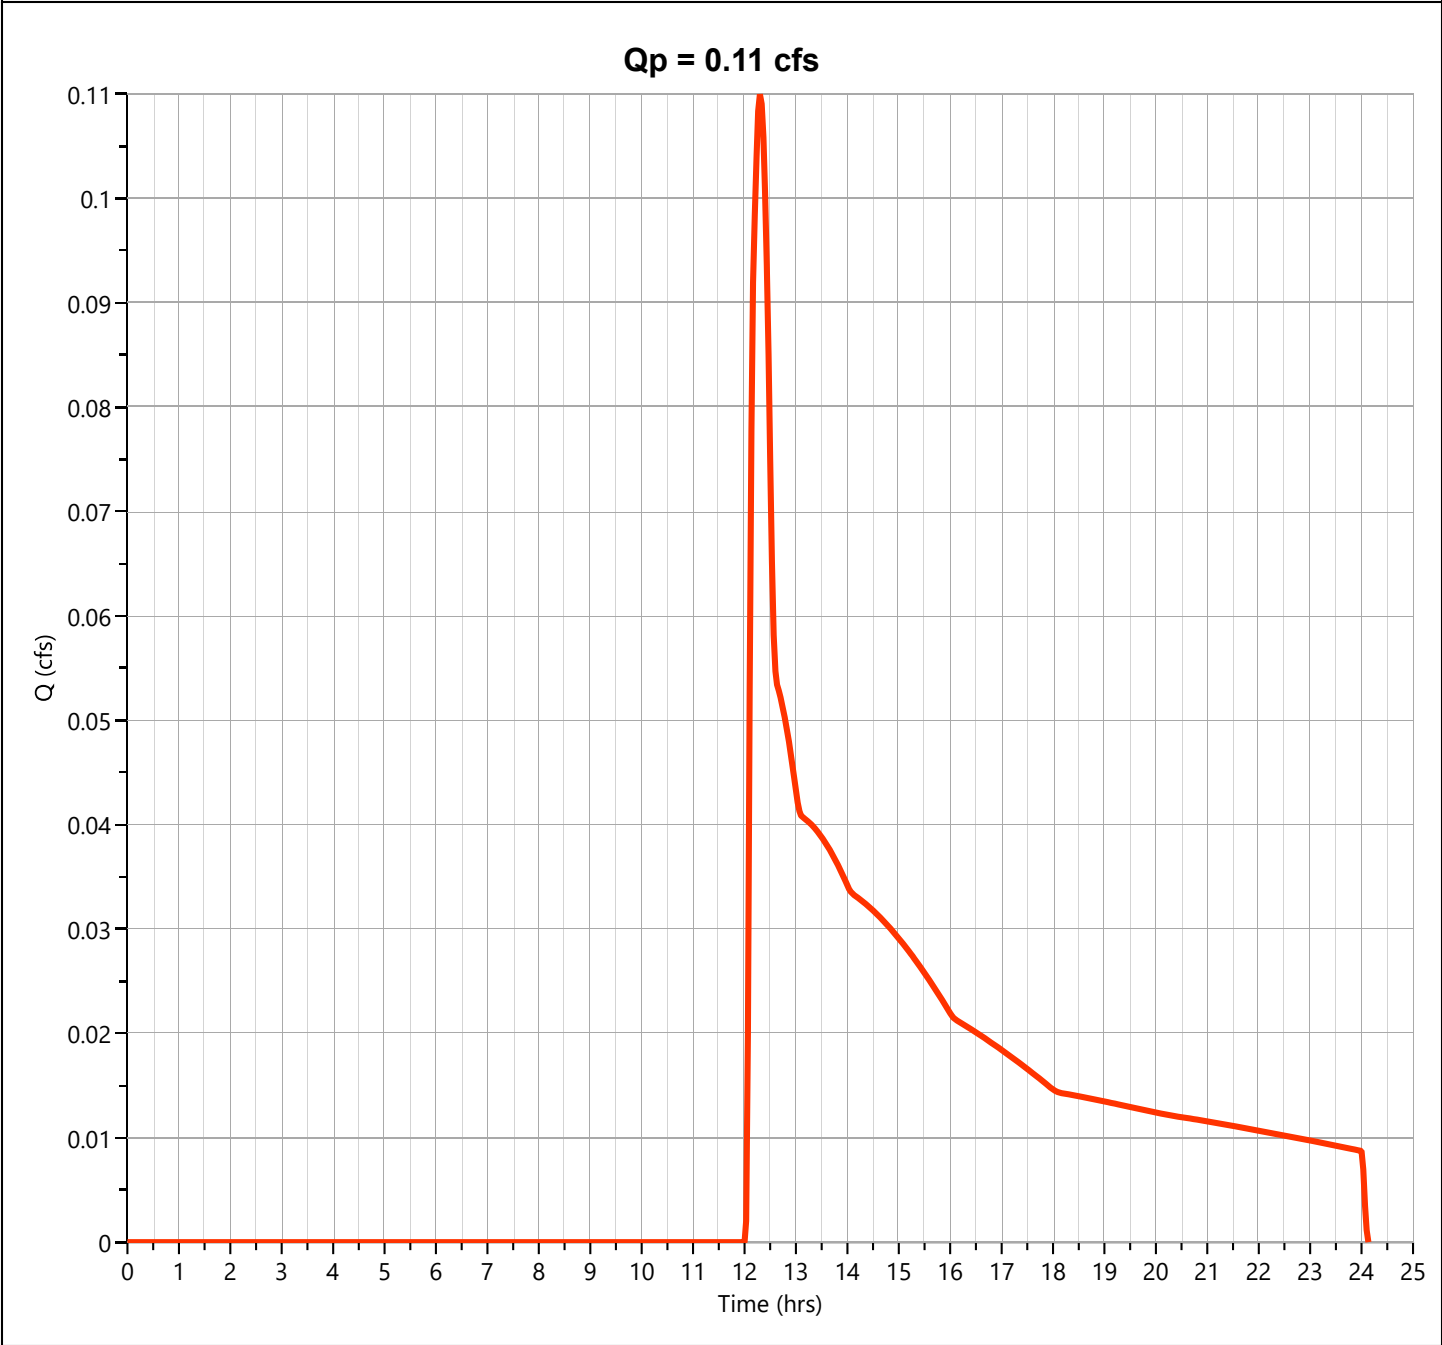

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-1A

## Hyd. No. 5

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.962 cfs
Storm Frequency	= 10-yr	Time to Peak	= 12.10 hrs
Time Interval	= 2 min	Runoff Volume	= 3,693 cuft
Drainage Area	= 1.16 ac	Curve Number	= 55
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 4.91 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

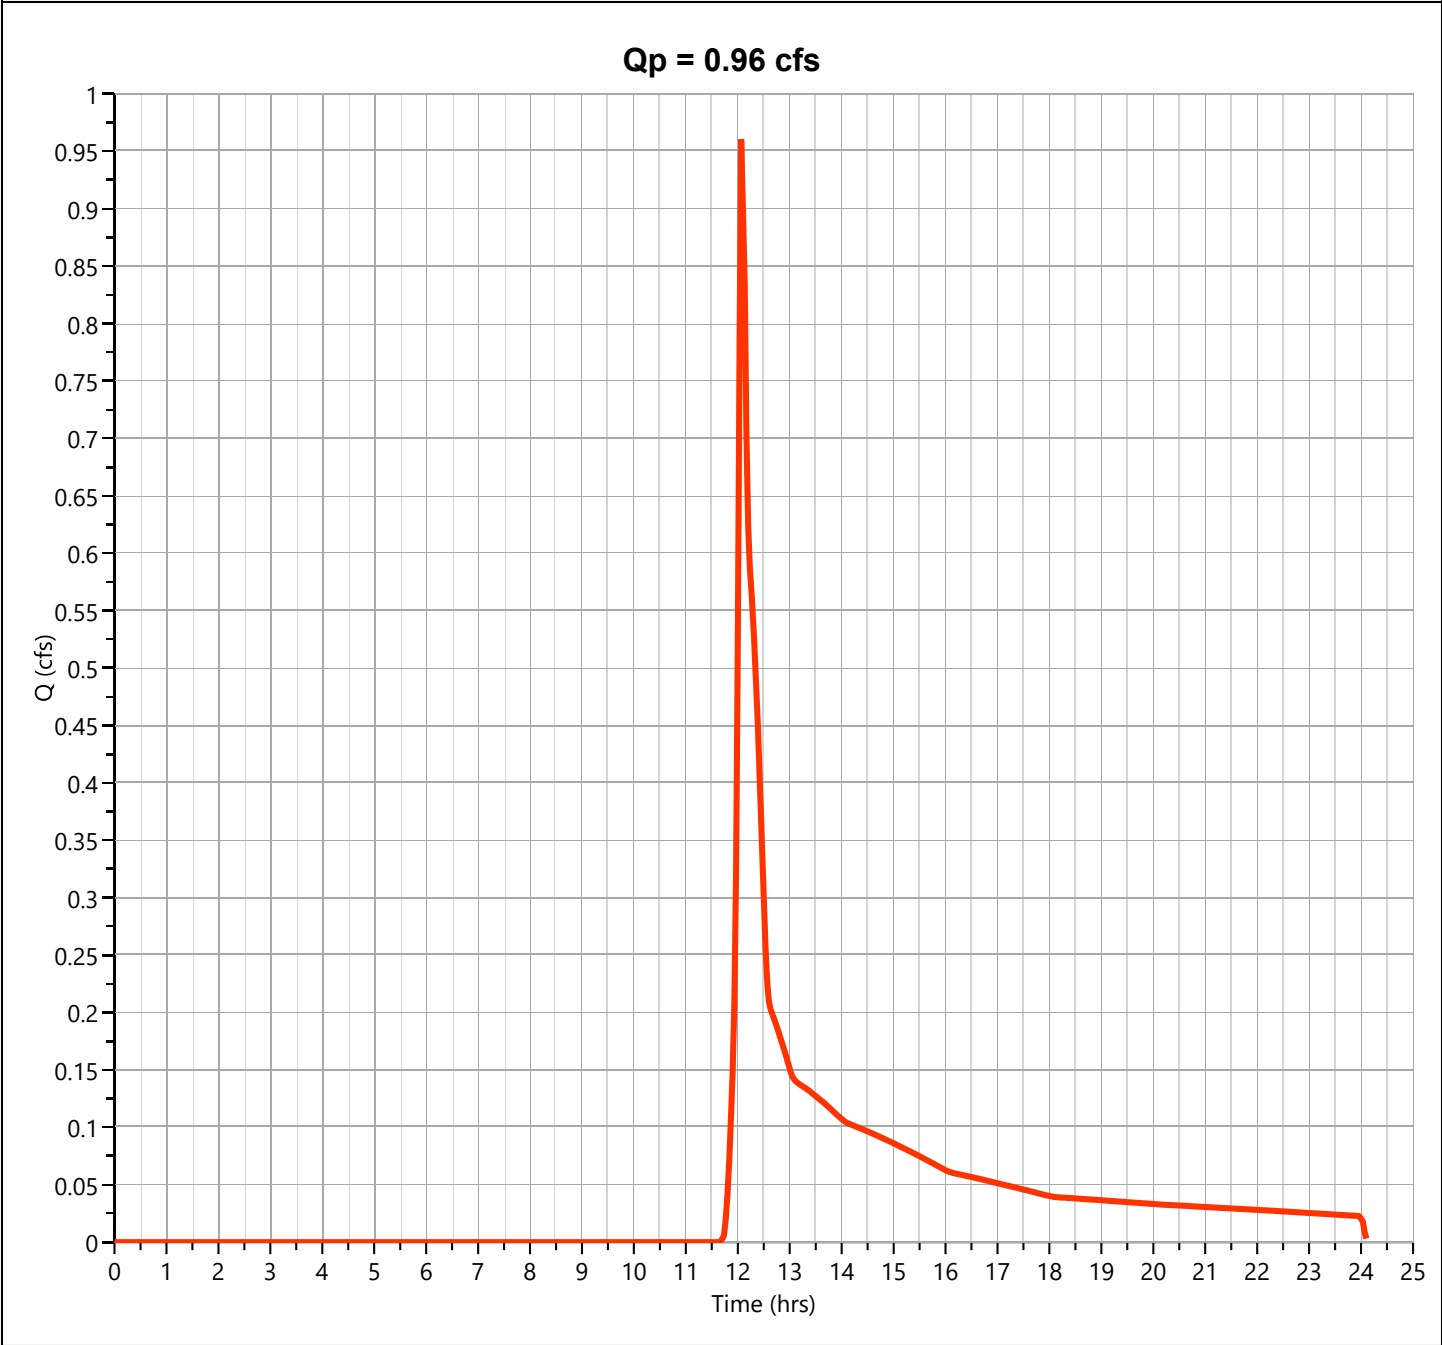

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-1A

## Hyd. No. 5

Hydrograph Type	= NRCS Runoff	Peak Flow	= 1.771 cfs
Storm Frequency	= 25-yr	Time to Peak	= 12.07 hrs
Time Interval	= 2 min	Runoff Volume	= 5,969 cuft
Drainage Area	= 1.16 ac	Curve Number	= 55
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 5.99 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

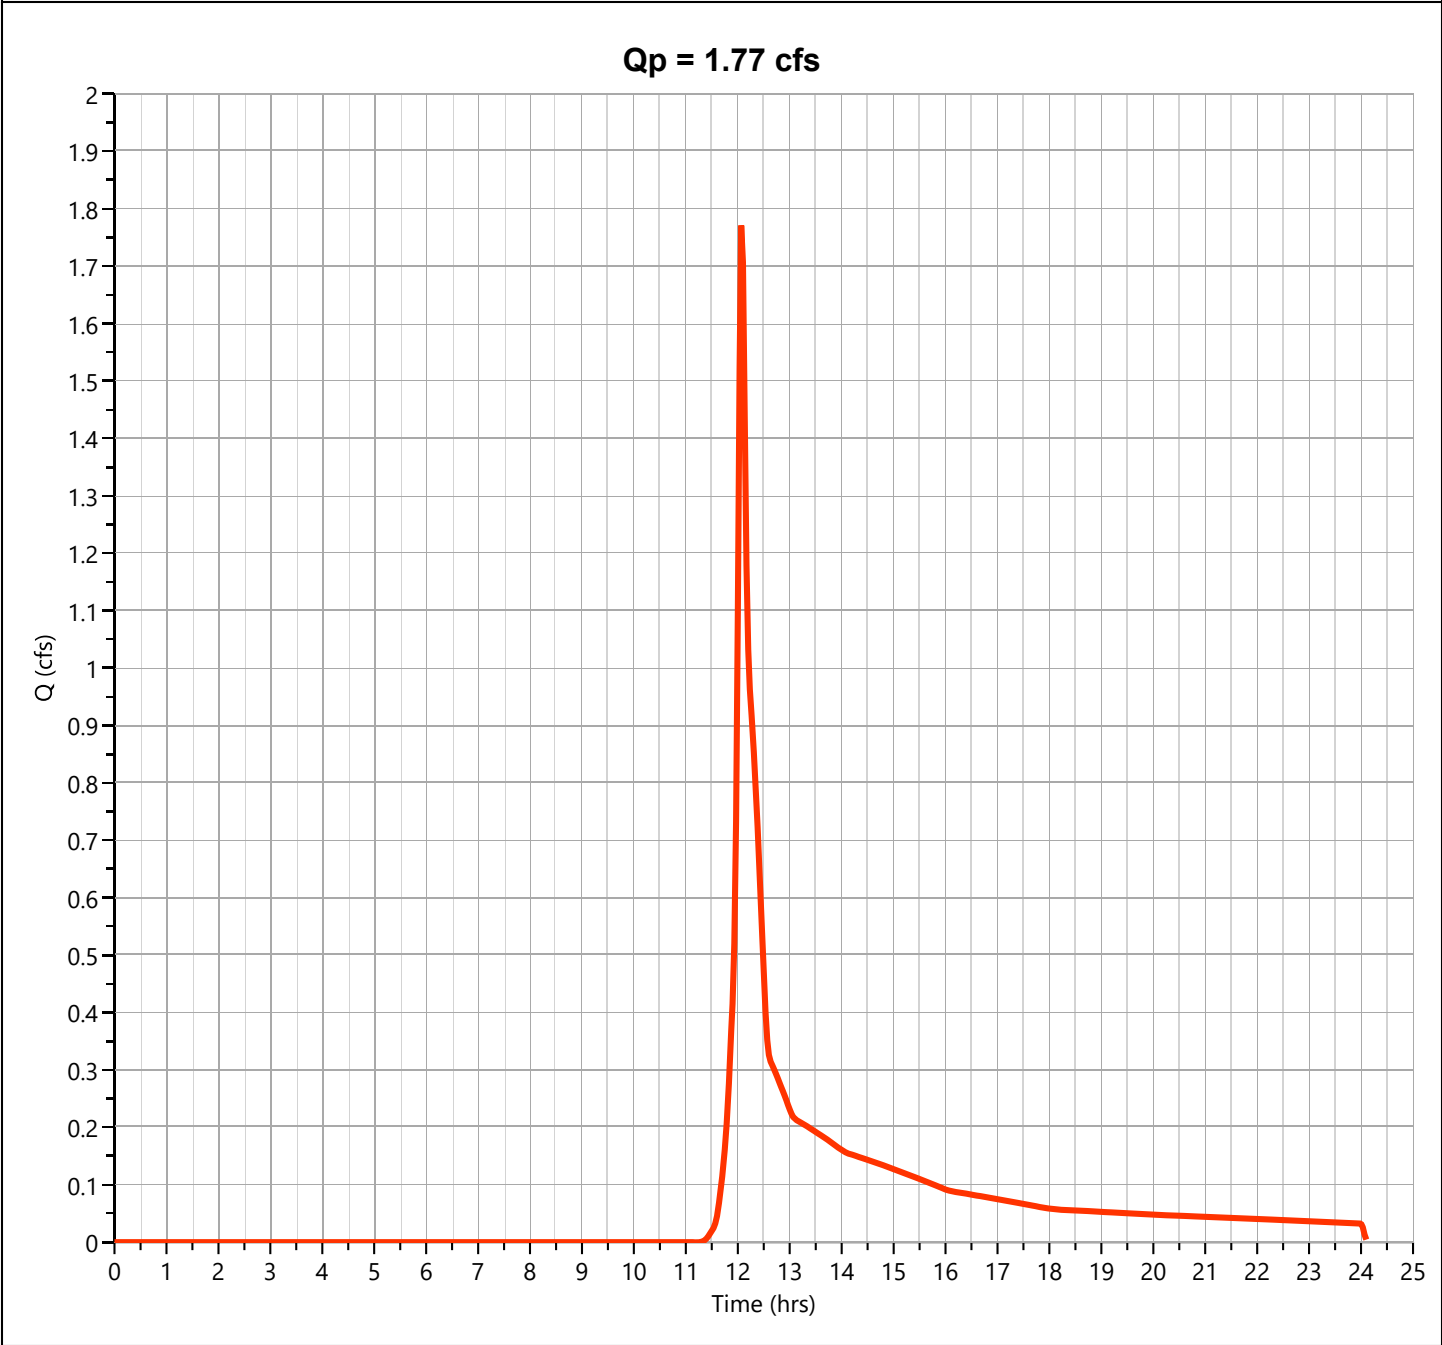

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-1A

## Hyd. No. 5

Hydrograph Type	= NRCS Runoff	Peak Flow	= 2.431 cfs
Storm Frequency	= 50-yr	Time to Peak	= 12.07 hrs
Time Interval	= 2 min	Runoff Volume	= 7,838 cuft
Drainage Area	= 1.16 ac	Curve Number	= 55
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 6.78 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

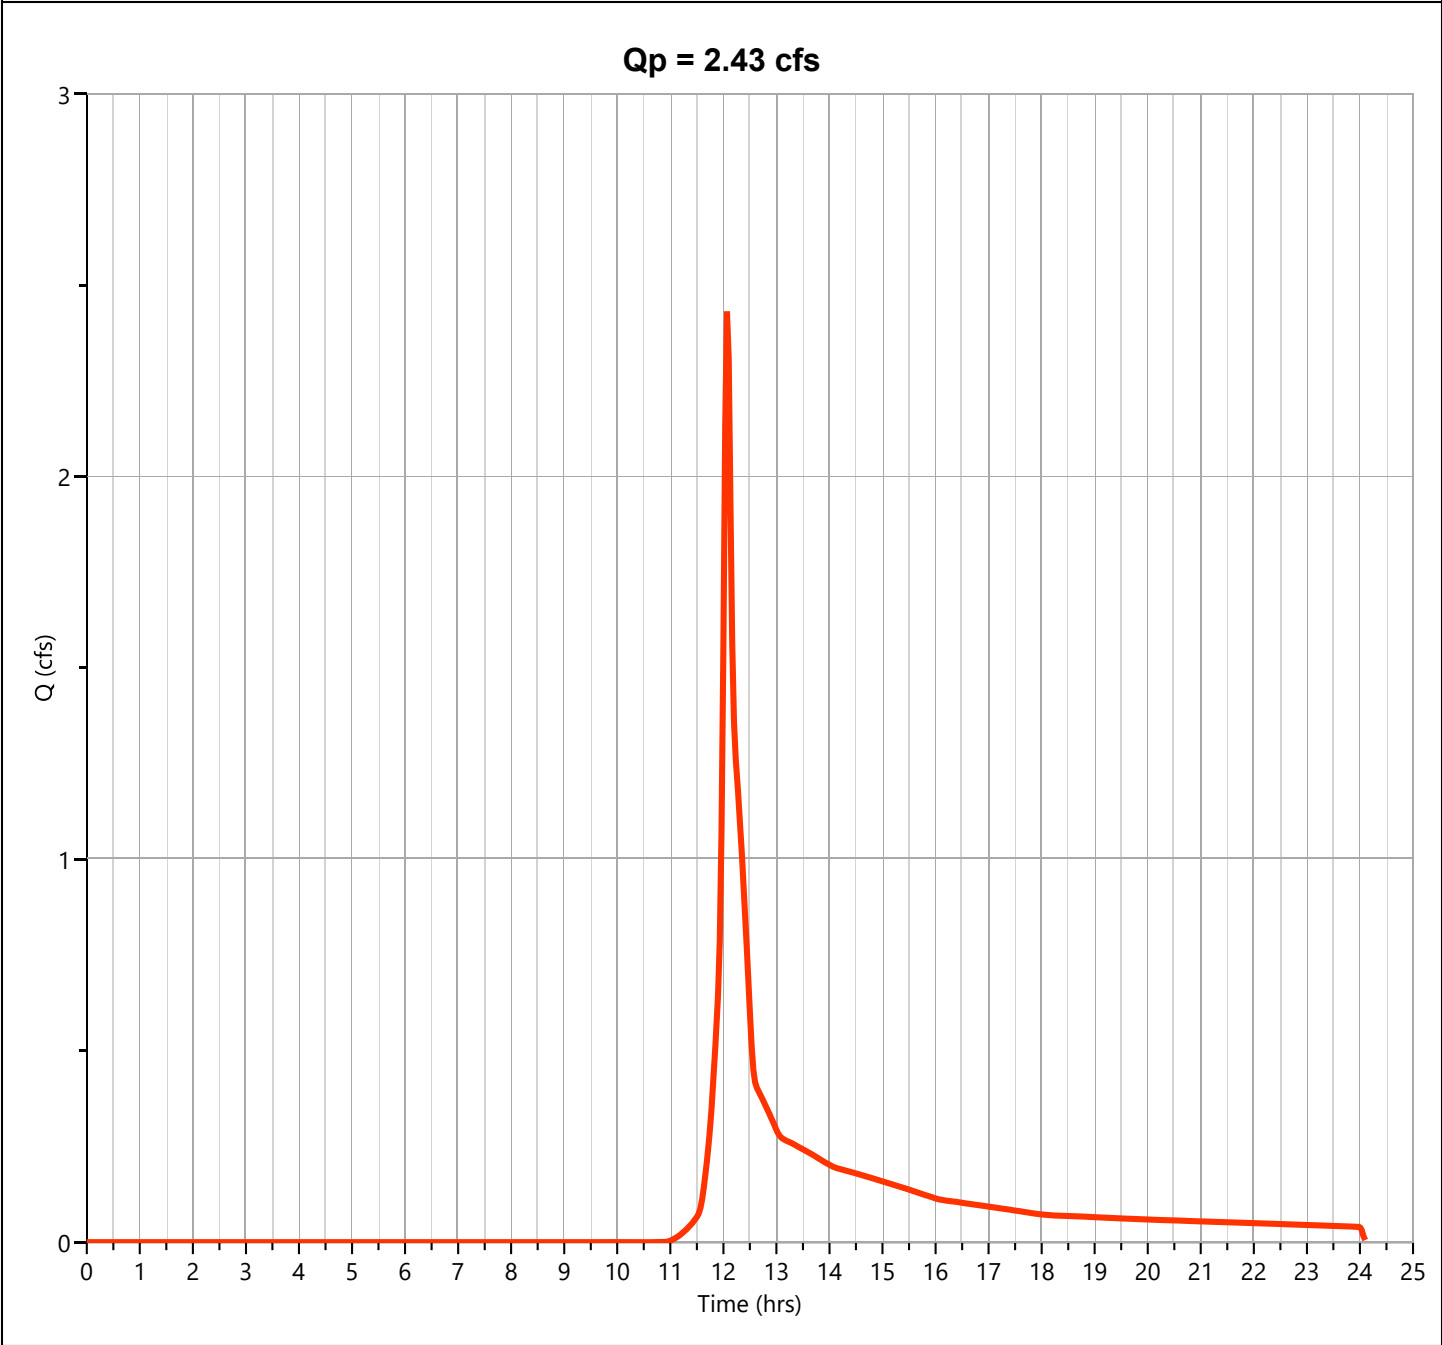



# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-1A

## Hyd. No. 5

Hydrograph Type	= NRCS Runoff	Peak Flow	= 3.211 cfs
Storm Frequency	= 100-yr	Time to Peak	= 12.07 hrs
Time Interval	= 2 min	Runoff Volume	= 10,057 cuft
Drainage Area	= 1.16 ac	Curve Number	= 55
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 7.65 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

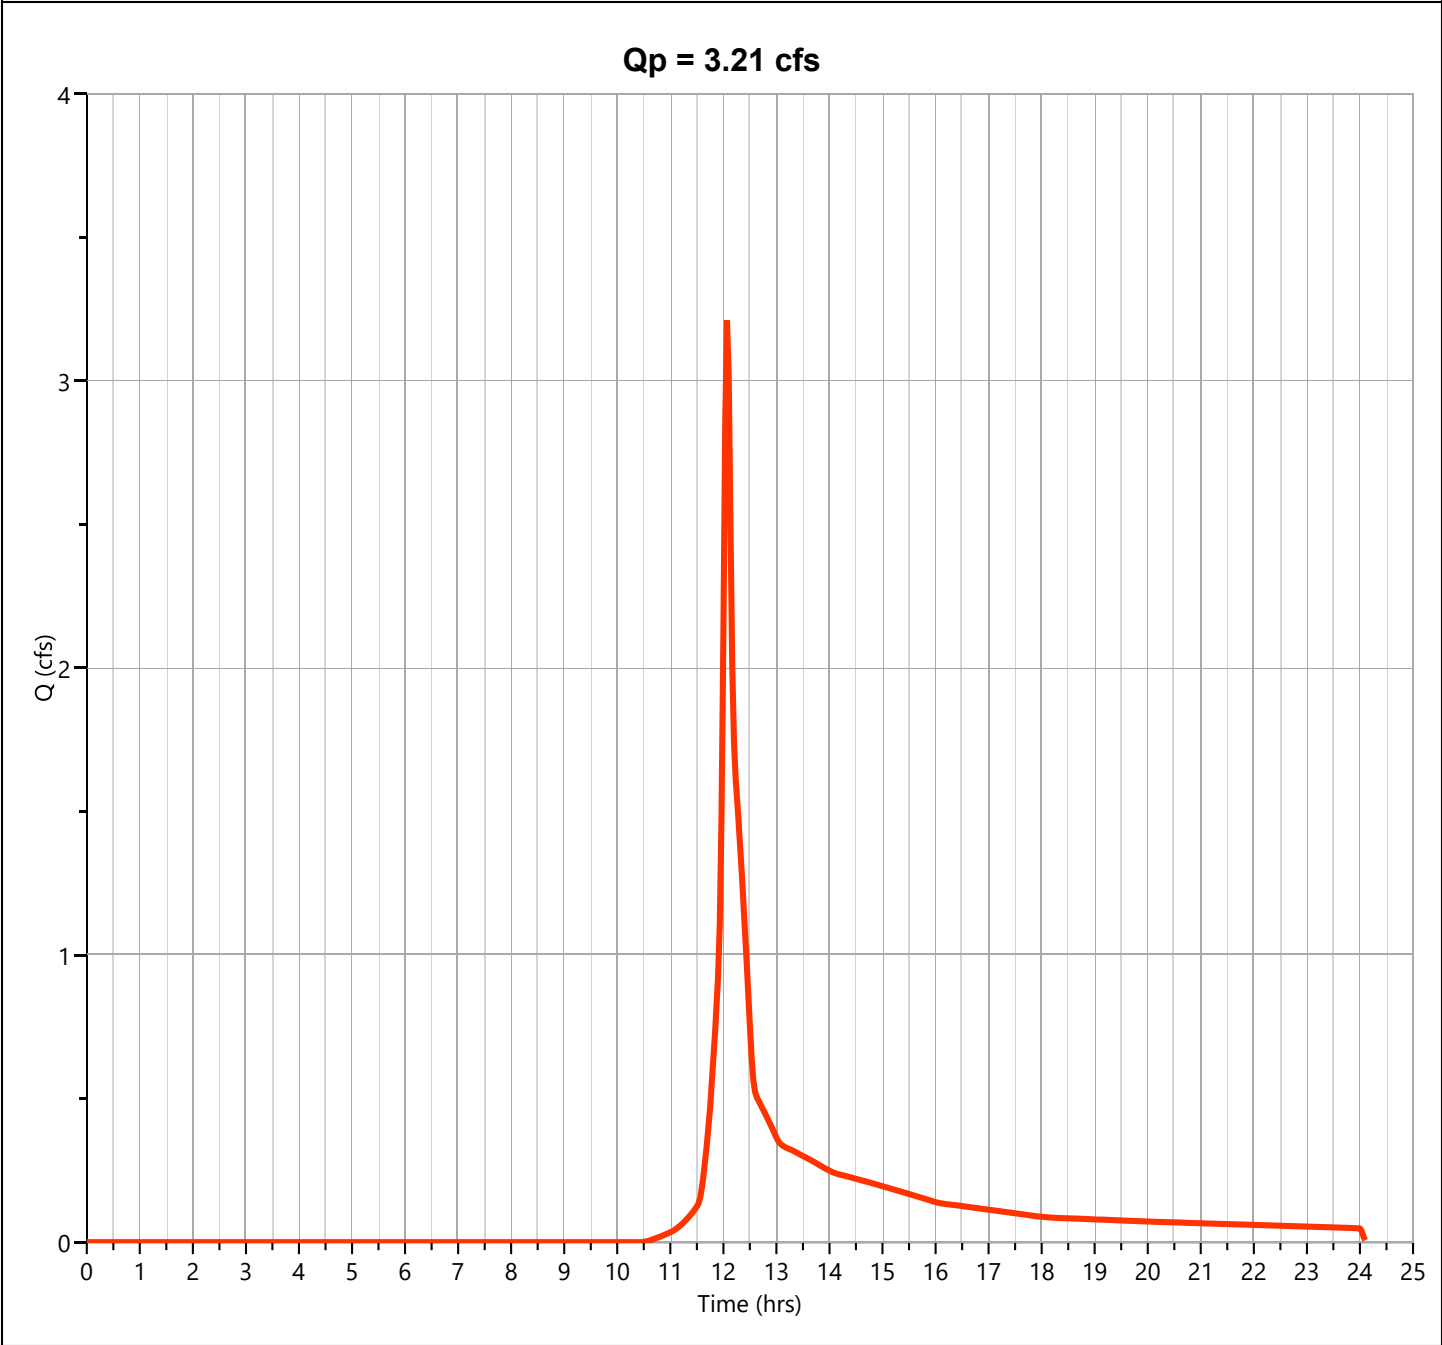

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31


02-13-2024

## Infiltration Basin

Hyd. No. 6

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 2-yr	Time to Peak	= 20.17 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 5 - Subcatchment P-1A	Max. Elevation	= 227.08 ft
Pond Name	= Infiltration Basin	Max. Storage	= 56.9 cuft

Pond Routing by Storage Indication Method

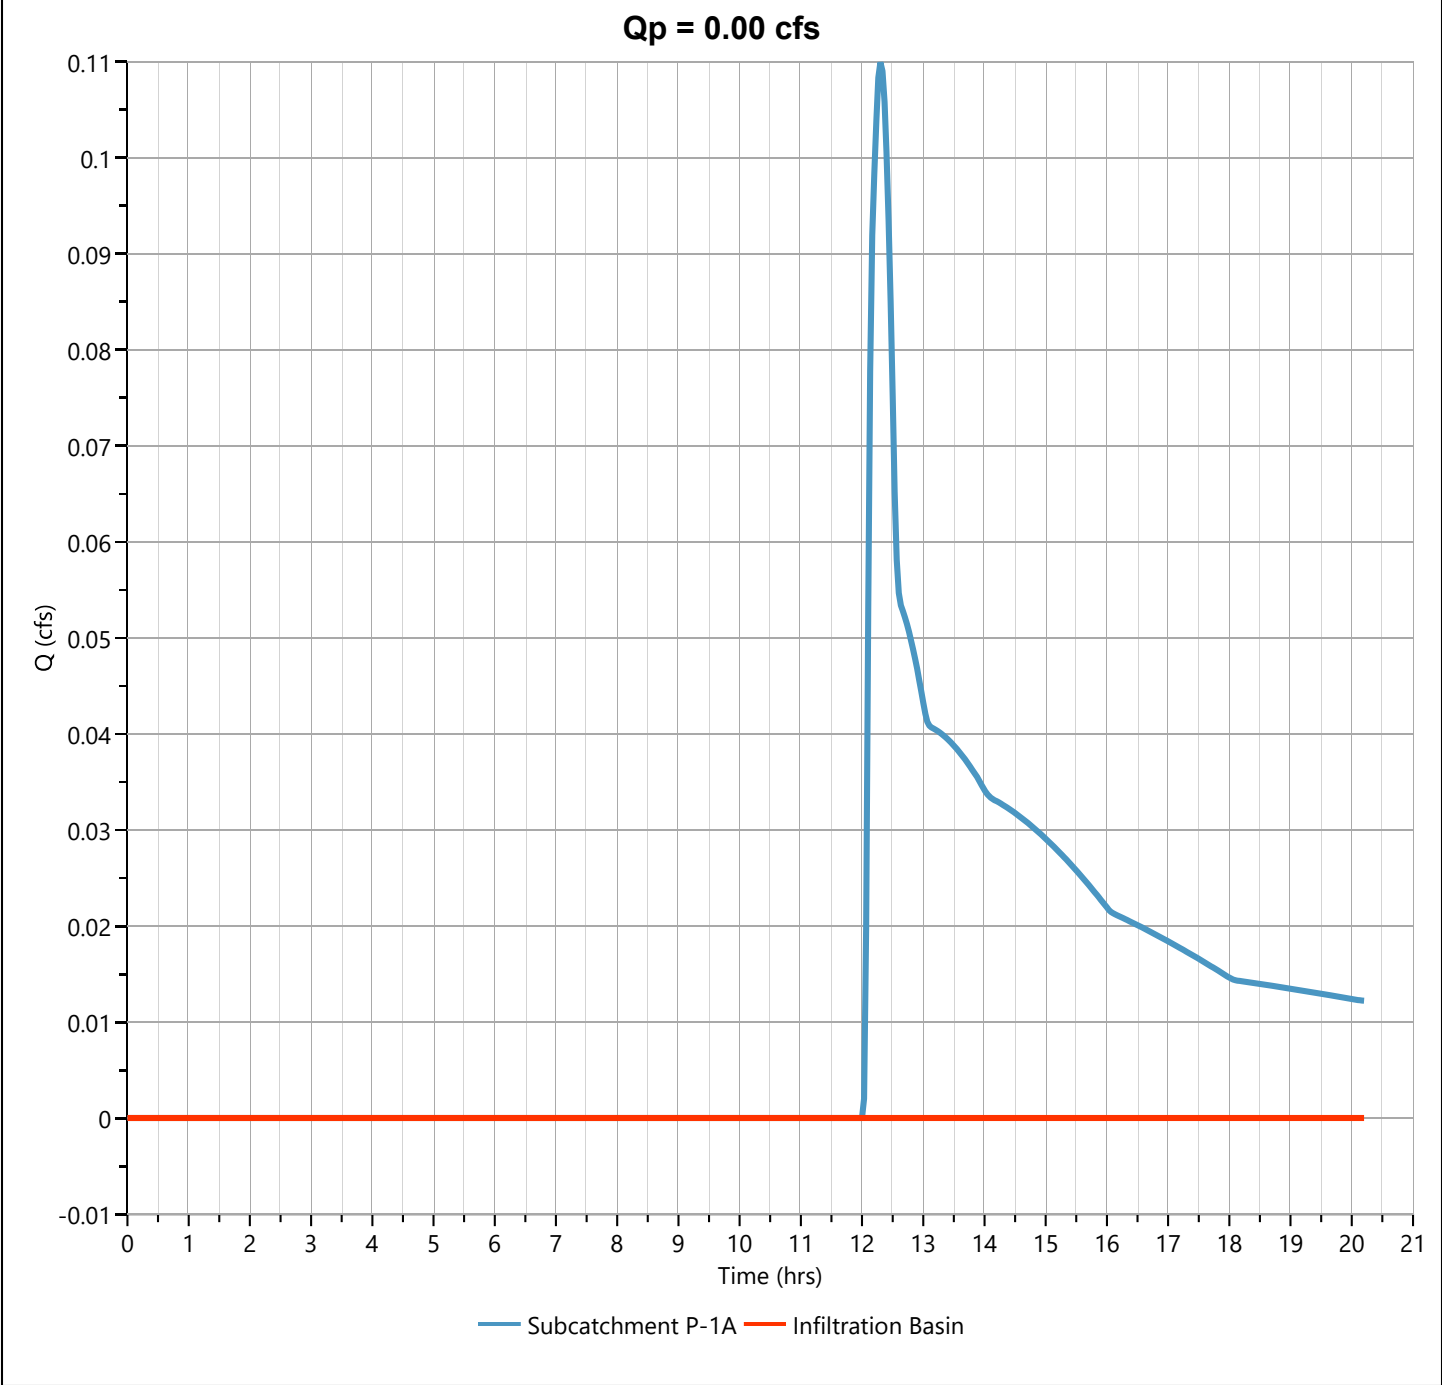

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31


02-13-2024

## Infiltration Basin

Hyd. No. 6

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 10-yr	Time to Peak	= 12.50 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 5 - Subcatchment P-1A	Max. Elevation	= 228.18 ft
Pond Name	= Infiltration Basin	Max. Storage	= 928 cuft

Pond Routing by Storage Indication Method

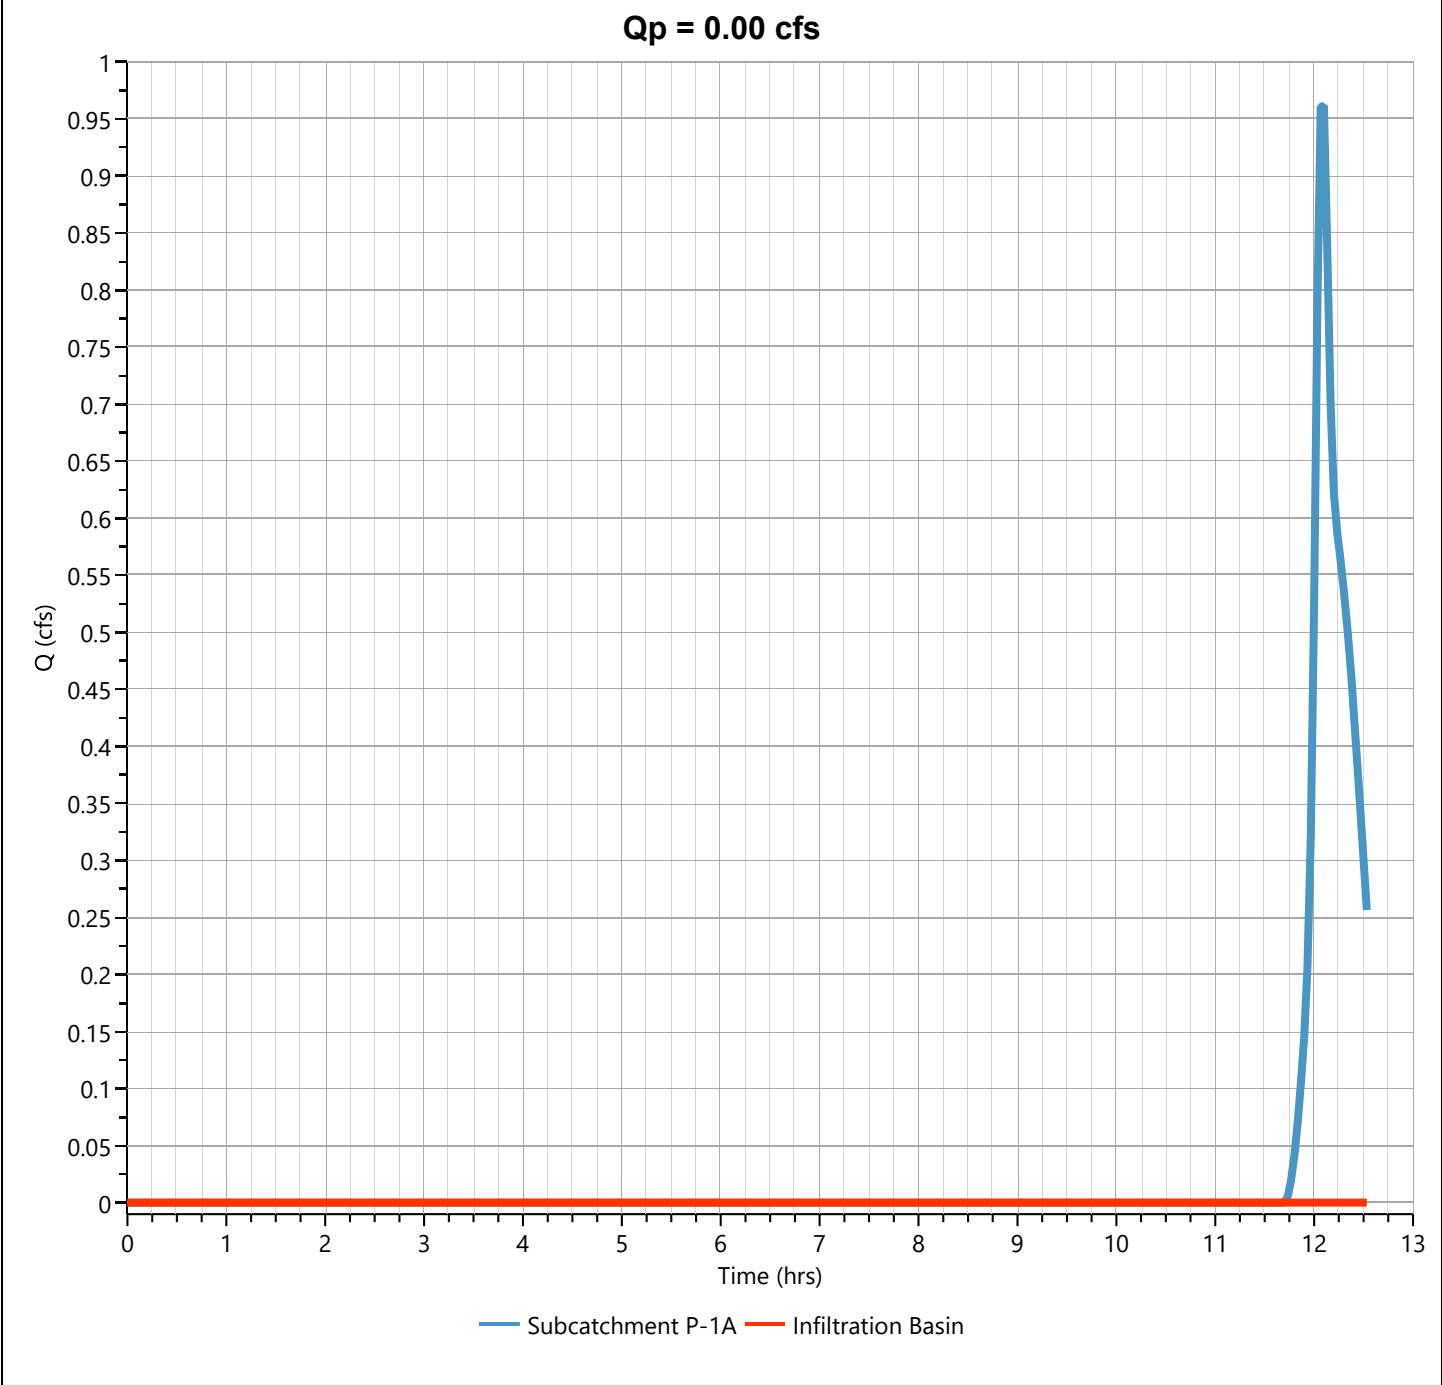

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31


02-13-2024

## Infiltration Basin

Hyd. No. 6

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 25-yr	Time to Peak	= 12.13 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 5 - Subcatchment P-1A	Max. Elevation	= 228.79 ft
Pond Name	= Infiltration Basin	Max. Storage	= 1,778 cuft

Pond Routing by Storage Indication Method

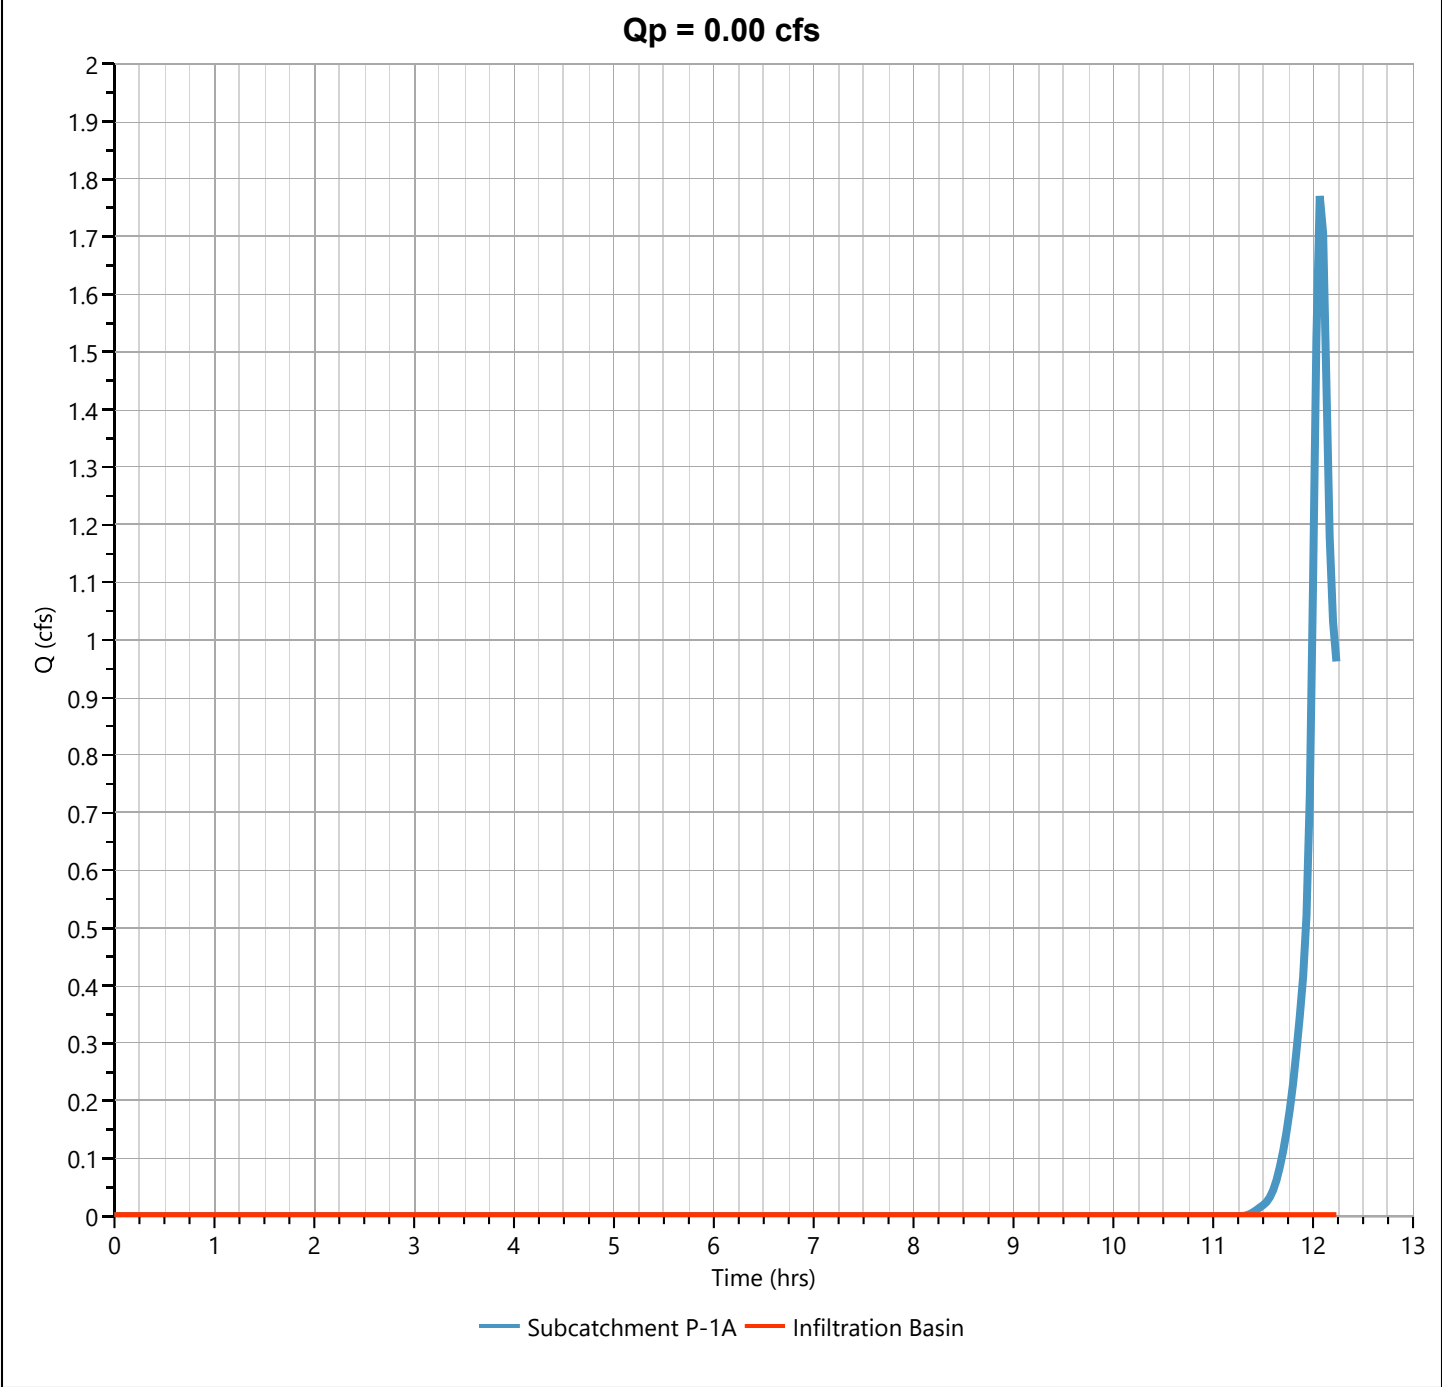


Infiltration Basin

Hyd. No. 6

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 50-yr	Time to Peak	= 12.37 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 5 - Subcatchment P-1A	Max. Elevation	= 229.20 ft
Pond Name	= Infiltration Basin	Max. Storage	= 2,532 cuft

Pond Routing by Storage Indication Method

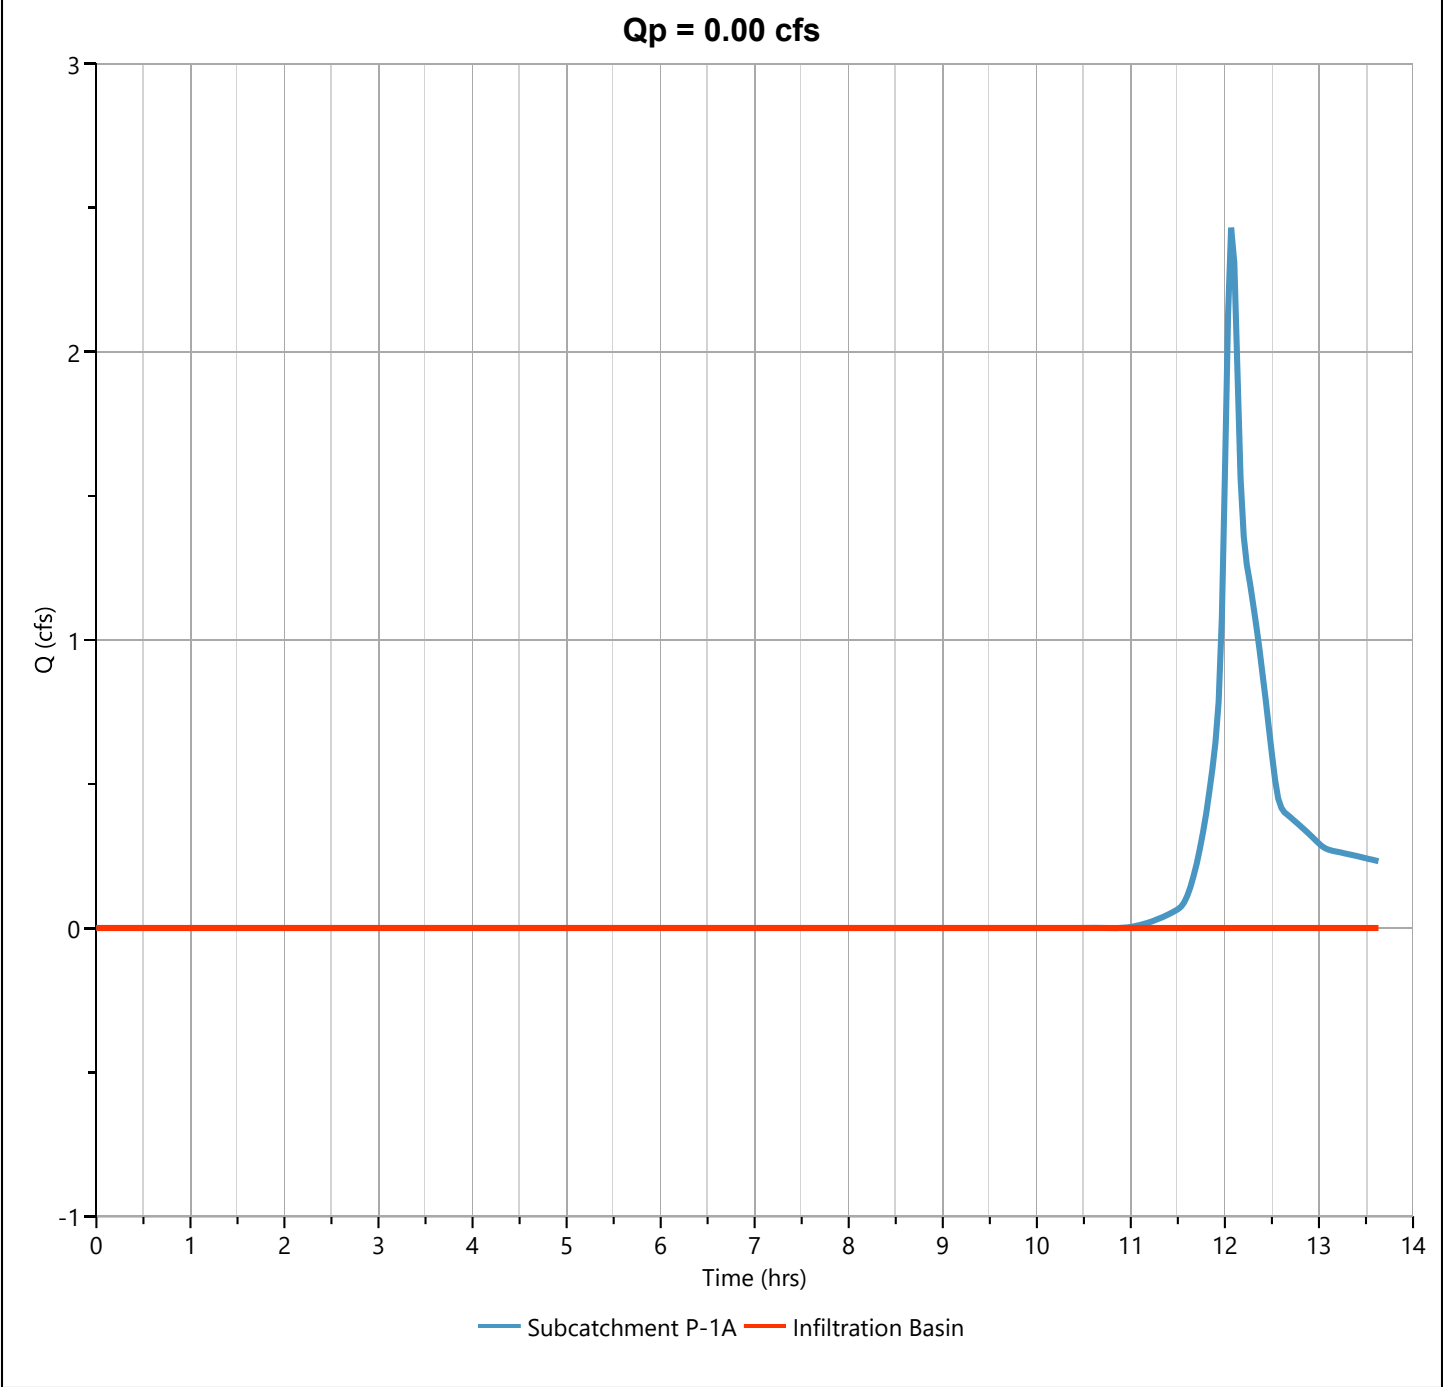


Infiltration Basin

Hyd. No. 6

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 100-yr	Time to Peak	= 14.47 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 5 - Subcatchment P-1A	Max. Elevation	= 229.63 ft
Pond Name	= Infiltration Basin	Max. Storage	= 3,517 cuft

Pond Routing by Storage Indication Method

Center of mass detention time = 1.47 hrs

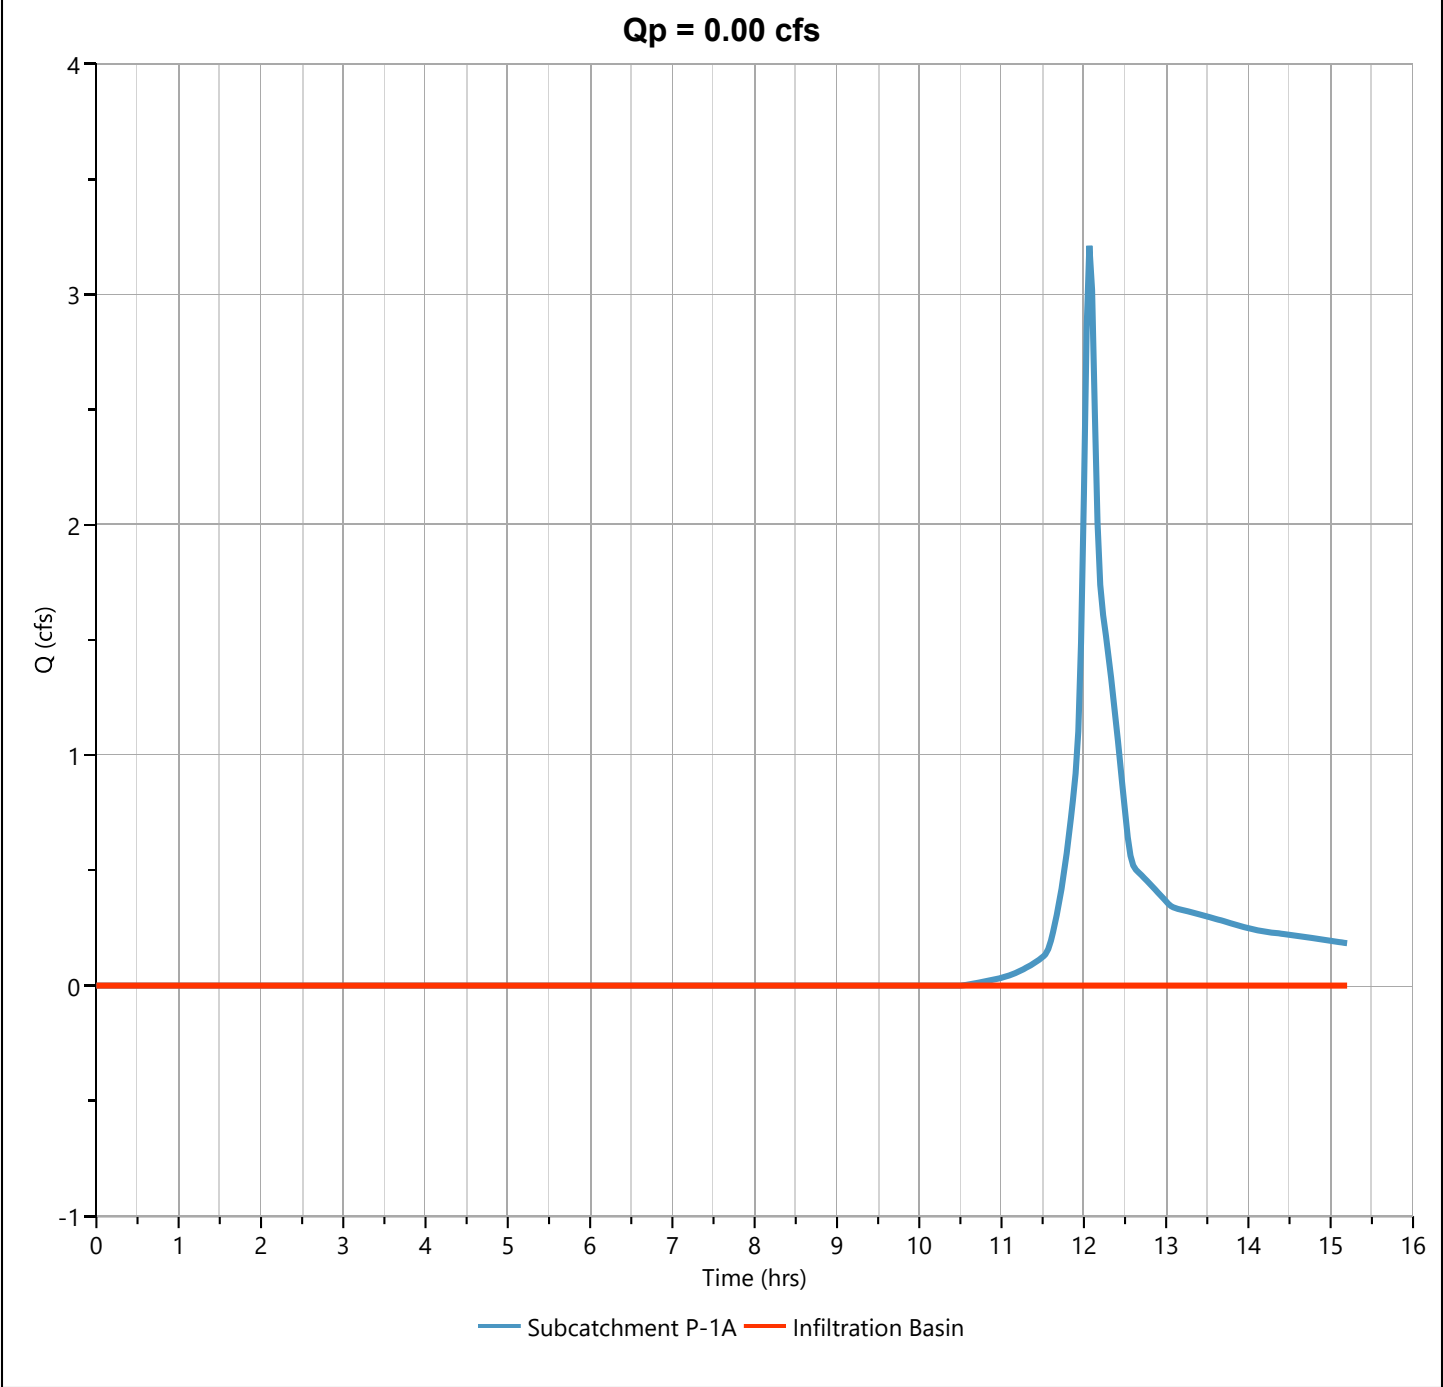

# Pond Report


Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## Infiltration Basin

## Stage-Storage

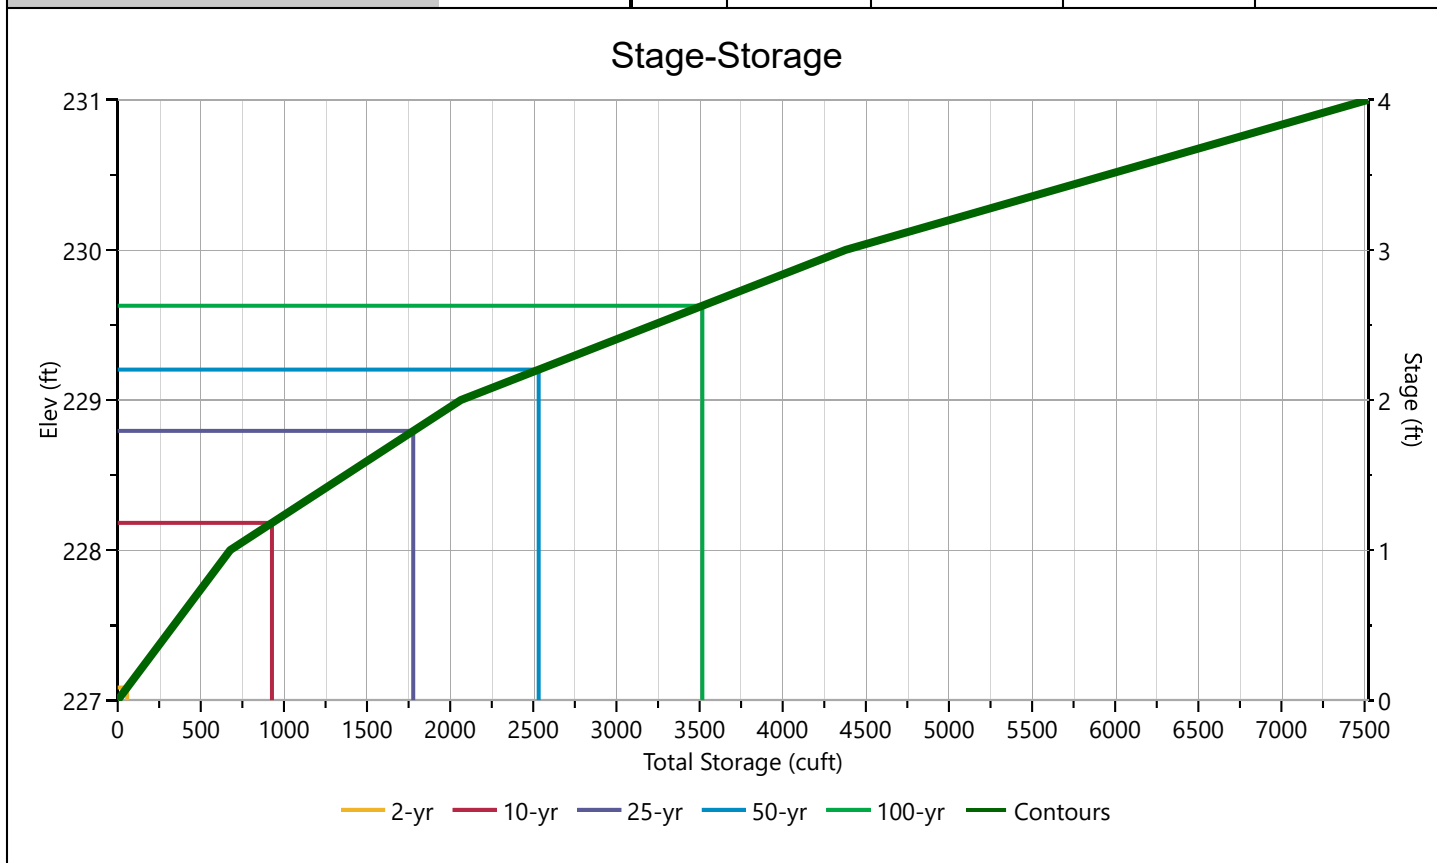[illegible]

# Pond Report

Project Name:

Hydrology Studio v 3.0.0.31


02-13-2024

## Infiltration Basin

## Stage-Discharge

Culvert / Orifices	Culvert	Orifices			Orifice Plate	
		1	2	3		
Rise, in	12				Orifice Dia, in	
Span, in	12				No. Orifices	
No. Barrels	1				Invert Elevation, ft	
Invert Elevation, ft	228.00				Height, ft	
Orifice Coefficient, Co	0.60				Orifice Coefficient, Co	
Length, ft	32					
Barrel Slope, %	.6					
N-Value, n	0.012					
Weirs	Riser*	Weirs			Ancillary	
		1	2	3		
Shape / Type	Circular				Exfiltration, in/hr	8.27**
Crest Elevation, ft	230					
Crest Length, ft	12.56					
Angle, deg						
Weir Coefficient, Cw	3.3					

\*Routes through Culvert. \*\*Exfiltration extracted from outflow hydrograph. Rate applied to contours.

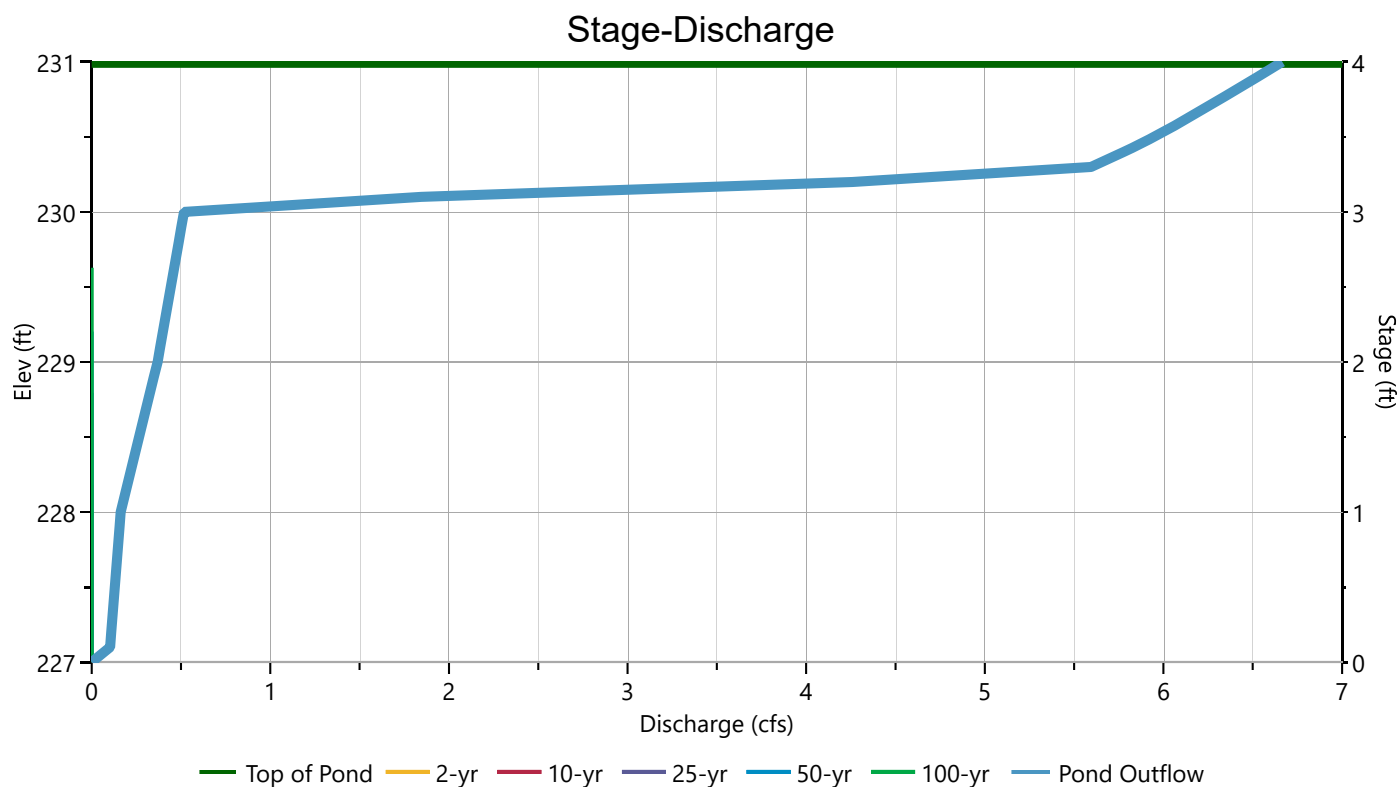



# Pond Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## Infiltration Basin


## Stage-Storage-Discharge Summary

Stage (ft)	Elev. (ft)	Storage (cuft)	Culvert (cfs)	Orifices, cfs			Riser (cfs)	Weirs, cfs			Pf Riser (cfs)	Exfil (cfs)	User (cfs)	Total (cfs)
				1	2	3		1	2	3				
0.00	227.00	0.000	0.000				0.000					0.000		0.000
1.00	228.00	677	0.000				0.000					0.162		0.162
2.00	229.00	2,065	0.000				0.000					0.369		0.369
3.00	230.00	4,378	0.000				0.000					0.517		0.517
4.00	231.00	7,521	5.979 ic				0.000					0.686		6.665

Suffix key: ic = inlet control, oc = outlet control, s = submerged weir

Infiltration Basin

Pond Drawdown

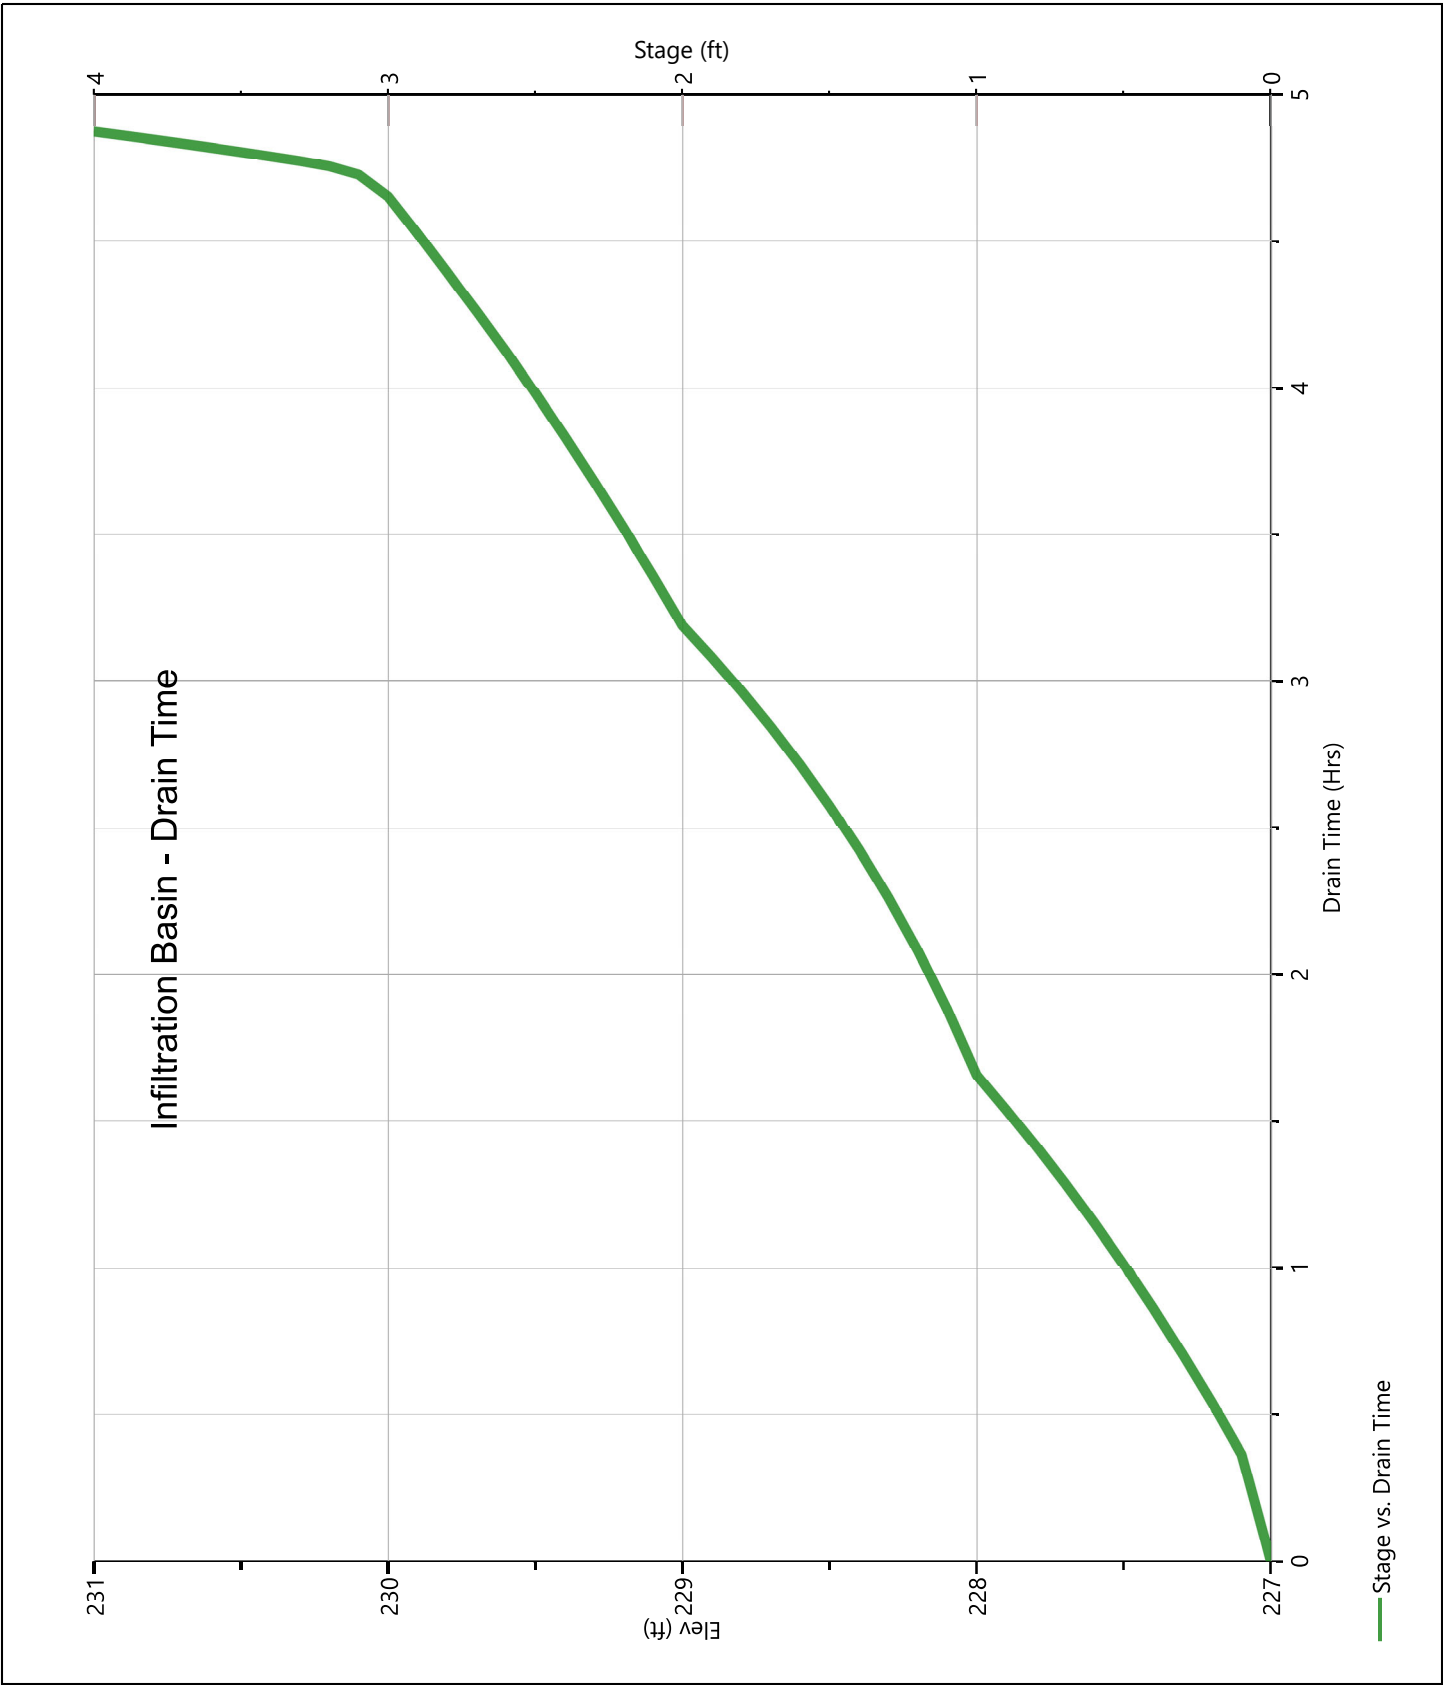

## Worksheet 2: Runoff curve number and runoff

SM-7306

Project: 95 Taylor Street By PFK Date 2/12/24Location: Littleton, MA Checked \_\_\_\_\_ Date \_\_\_\_\_Circle one: Present ☒ Developed \_\_\_\_\_ P-1B \_\_\_\_\_1. Runoff curve number (CN)

Soil name and hydrologic group (appendix A)	Cover description (cover type, treatment, and hydrologic condition: percent impervious: unconnected/connected impervious area ratio)	CN 1/			Area  Acres	Product of CN x Area
		Table 2-2	Fig. 2-3	Fig. 2-4		
-	Impervious	98			0.00	0.00
A	Open Space-Good Condition	39			0.25	9.79
A	Woods- Good Condition	30			1.29	38.58
A	Residential Districts - 2 acres	46			0.68	31.31
A	Gravel	76			0.00	0.00
Totals =					2.22	79.68

1/ Use only one CN source per line.

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{79.68}{2.22} = 35.93 ; \quad \text{Use CN} = \boxed{36}$$

2. Runoff

Frequency..... yr

Rainfall, P (24-hour)..... in

Runoff, Q..... in

(Use P and CN with table 2-1, fig. 2-1,  
or eqs. 2-3 and 2-4.)

Storm #1	Storm #2	Storm #3
2	10	100
3.1	4.5	6.5
0.01	0.05	0.41

## Worksheet 3: Time of Concentration (Tc) or travel time (Tt)

SM-7306

Project: 95 Taylor StreetBy PFKDate 2/12/2024Location: Littleton, MA

Checked \_\_\_\_\_

Date \_\_\_\_\_

Circle one: ☐ Present ☒ DevelopedP-1BCircle one: ☐ Tc ☐ Ttthrough  
subarea \_\_\_\_\_Sheet flow (Applicable to Tc only)

Segment ID

1. Surface Description (table 3-1)

2. Mannings roughness coeff., n (table 3-1)

3. Flow length, L (total L &lt;= 300 ft)

ft

4. Two-yr 24-hr rainfall, P2

in

5. Land Slope, s

ft/ft

6.  $T_t = 0.007 (nL)^{0.8} / (P2^{0.5} s^{0.4})$ 

Compute Tt hr

A-B		
LAWN		
0.24		
50		
3.1		
0.03		
0.12		

0.12

Shallow concentrated Flow

Segment ID

7. Surface Description (paved or unpaved)

8. Flow Length, L

ft

9. Watercourse slope, s

ft/ft

10. Average Velocity, V (figure 3-1)

ft/s

11.  $T_t = L / 3600V$ 

Compute Tt hr

B-C	C-D	
UNPAVED	UNPAVED	
106	61	
0.03	0.13	
2.79	5.82	
0.01	0.00	

0.01

Channel flow

Segment ID

12. Cross sectional flow area, a

sf

13. Wetted perimeter, pw

ft

14. Hydraulic radius,  $r=a/wp$ 

Compute r ft

15. Channel Slope, s

ft/ft

16. Manning's roughness coeff., n

17.  $V = 1.49 r^{2/3} s^{1/2} / n$ 

Compute V ft/s

18. Flow length, L

ft

19.  $T_t = L / 3600V$ 

Compute Tt hr


0.00

20. Watershed or subarea Tc or Tt (add Tt in steps 6, 11, and 19)

hr  
min0.13  
7.9

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-1B

## Hyd. No. 7

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.000 cfs
Storm Frequency	= 2-yr	Time to Peak	= 0.00 hrs
Time Interval	= 2 min	Runoff Volume	= 0.000 cuft
Drainage Area	= 2.22 ac	Curve Number	= 36
Tc Method	= User	Time of Conc. (Tc)	= 7.9 min
Total Rainfall	= 3.18 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

**Qp = 0.00 cfs**

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-1B

## Hyd. No. 7

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.028 cfs
Storm Frequency	= 10-yr	Time to Peak	= 14.97 hrs
Time Interval	= 2 min	Runoff Volume	= 773 cuft
Drainage Area	= 2.22 ac	Curve Number	= 36
Tc Method	= User	Time of Conc. (Tc)	= 7.9 min
Total Rainfall	= 4.91 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

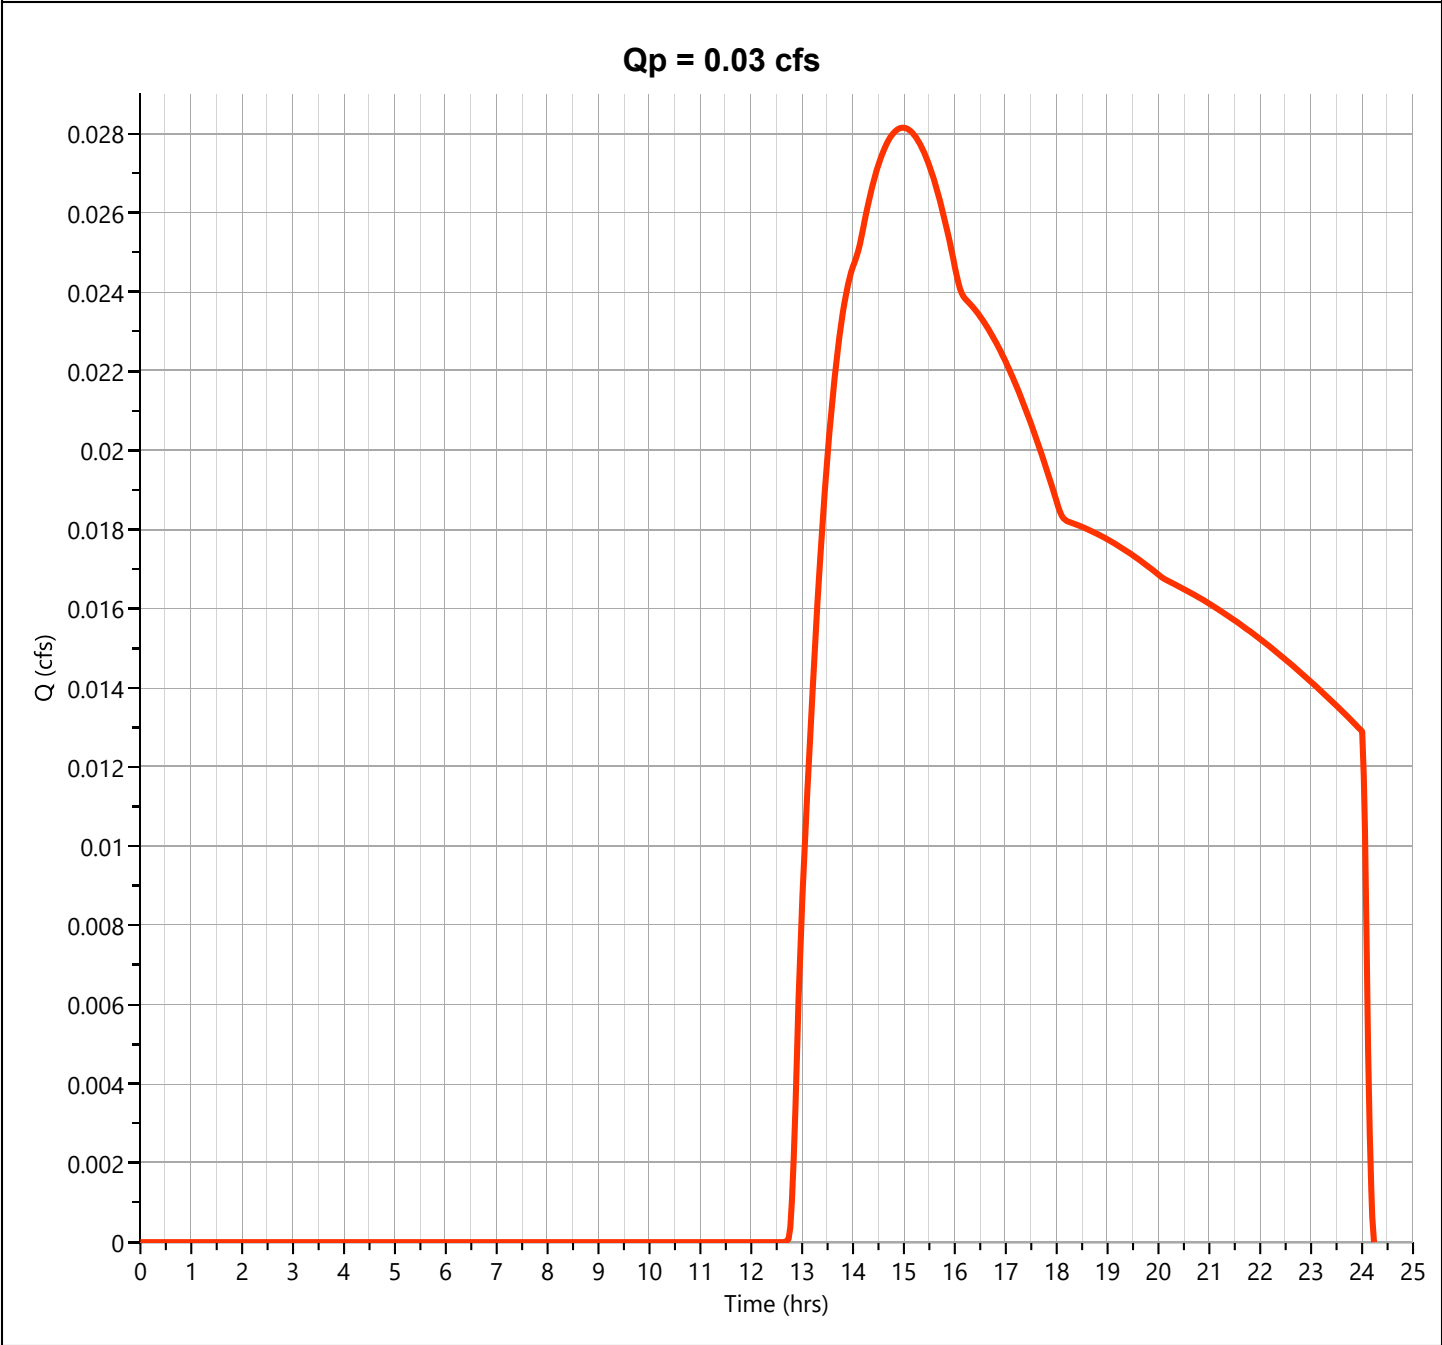

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-1B

## Hyd. No. 7

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.167 cfs
Storm Frequency	= 25-yr	Time to Peak	= 12.43 hrs
Time Interval	= 2 min	Runoff Volume	= 2,362 cuft
Drainage Area	= 2.22 ac	Curve Number	= 36
Tc Method	= User	Time of Conc. (Tc)	= 7.9 min
Total Rainfall	= 5.99 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

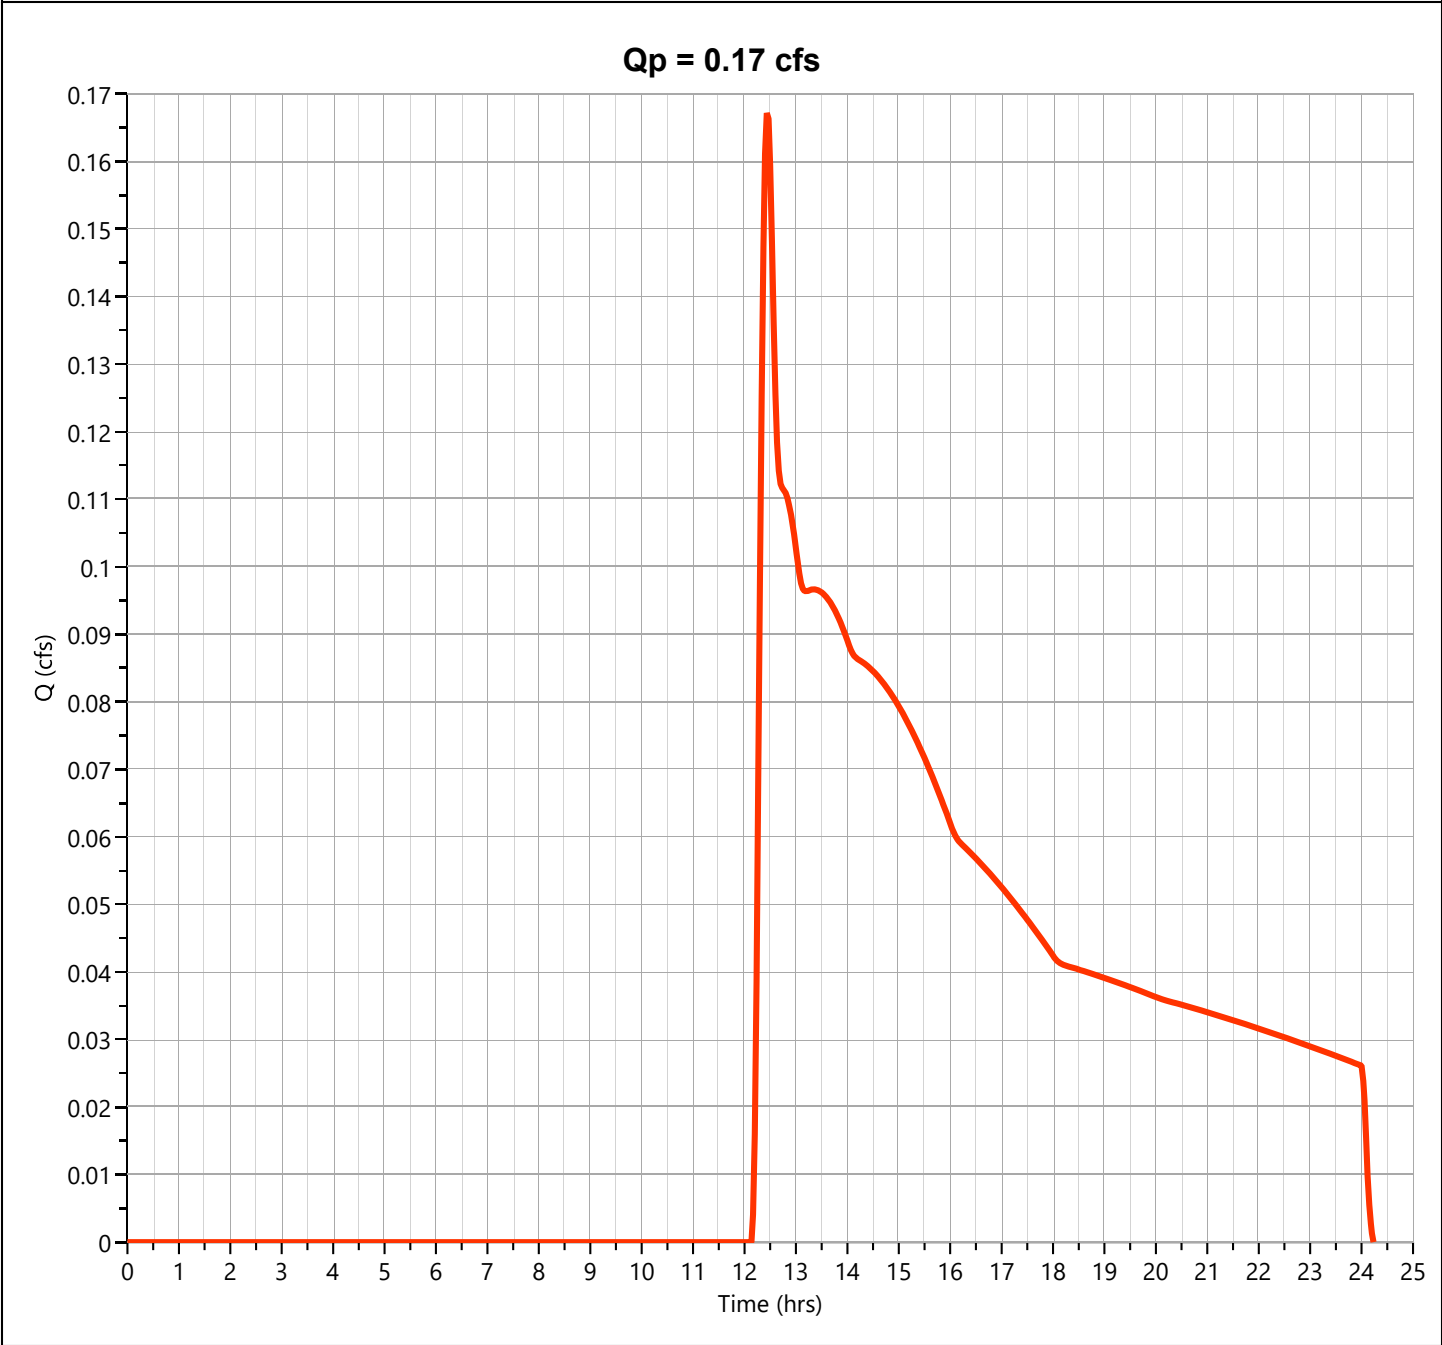

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-1B

## Hyd. No. 7

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.428 cfs
Storm Frequency	= 50-yr	Time to Peak	= 12.37 hrs
Time Interval	= 2 min	Runoff Volume	= 3,986 cuft
Drainage Area	= 2.22 ac	Curve Number	= 36
Tc Method	= User	Time of Conc. (Tc)	= 7.9 min
Total Rainfall	= 6.78 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

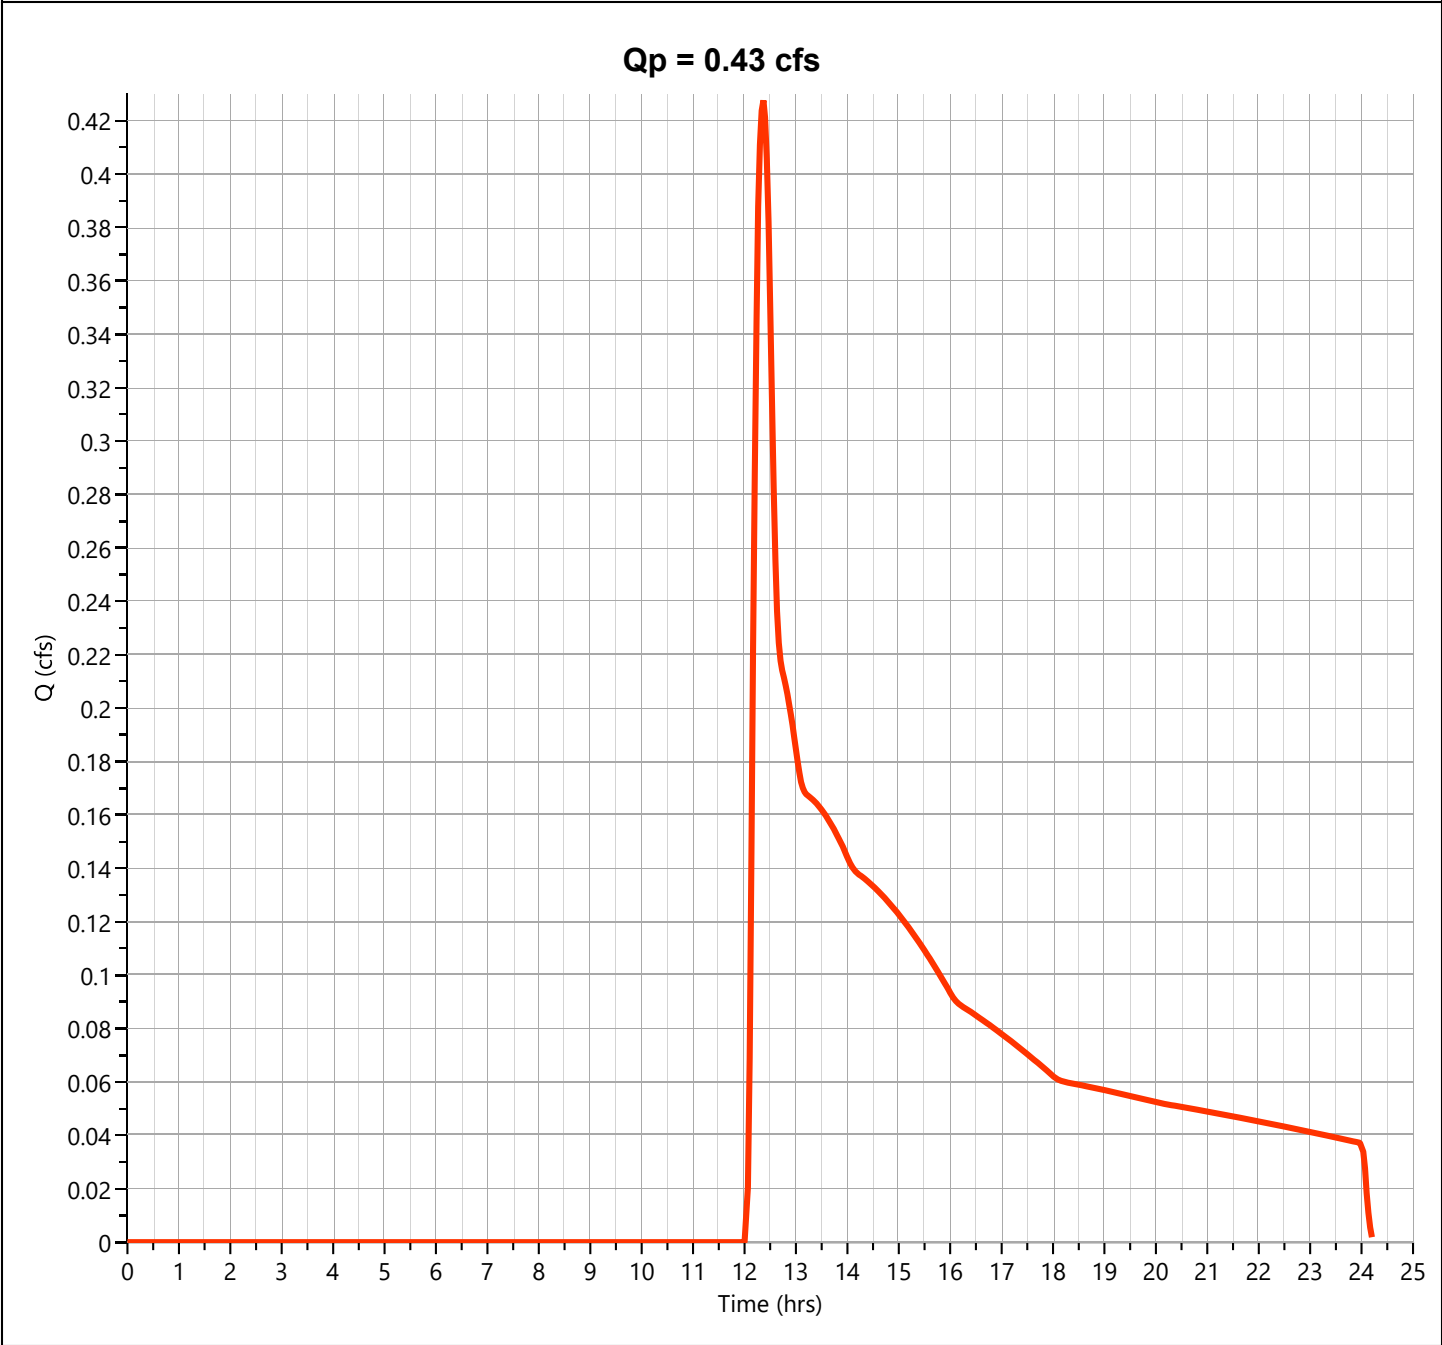



# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-1B

## Hyd. No. 7

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.843 cfs
Storm Frequency	= 100-yr	Time to Peak	= 12.23 hrs
Time Interval	= 2 min	Runoff Volume	= 6,177 cuft
Drainage Area	= 2.22 ac	Curve Number	= 36
Tc Method	= User	Time of Conc. (Tc)	= 7.9 min
Total Rainfall	= 7.65 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

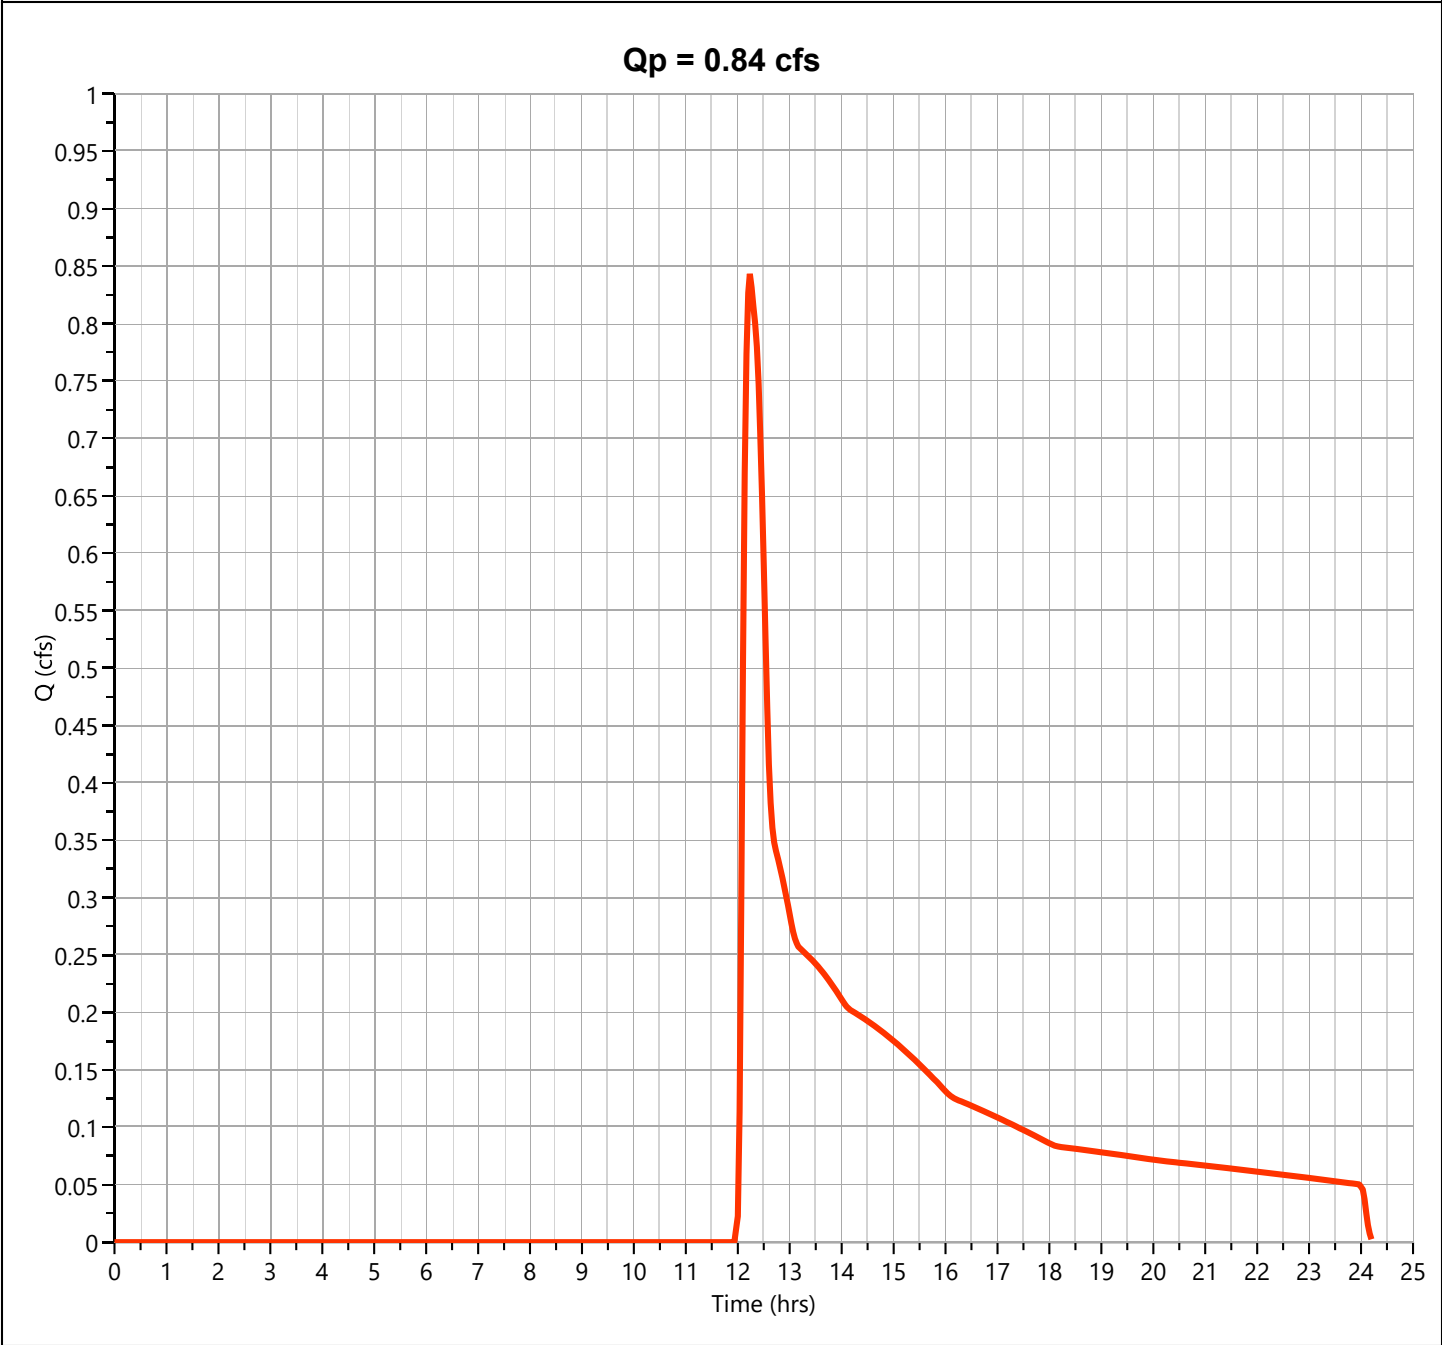

# Hydrograph Report


Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## P-1 Total

Hyd. No. 8

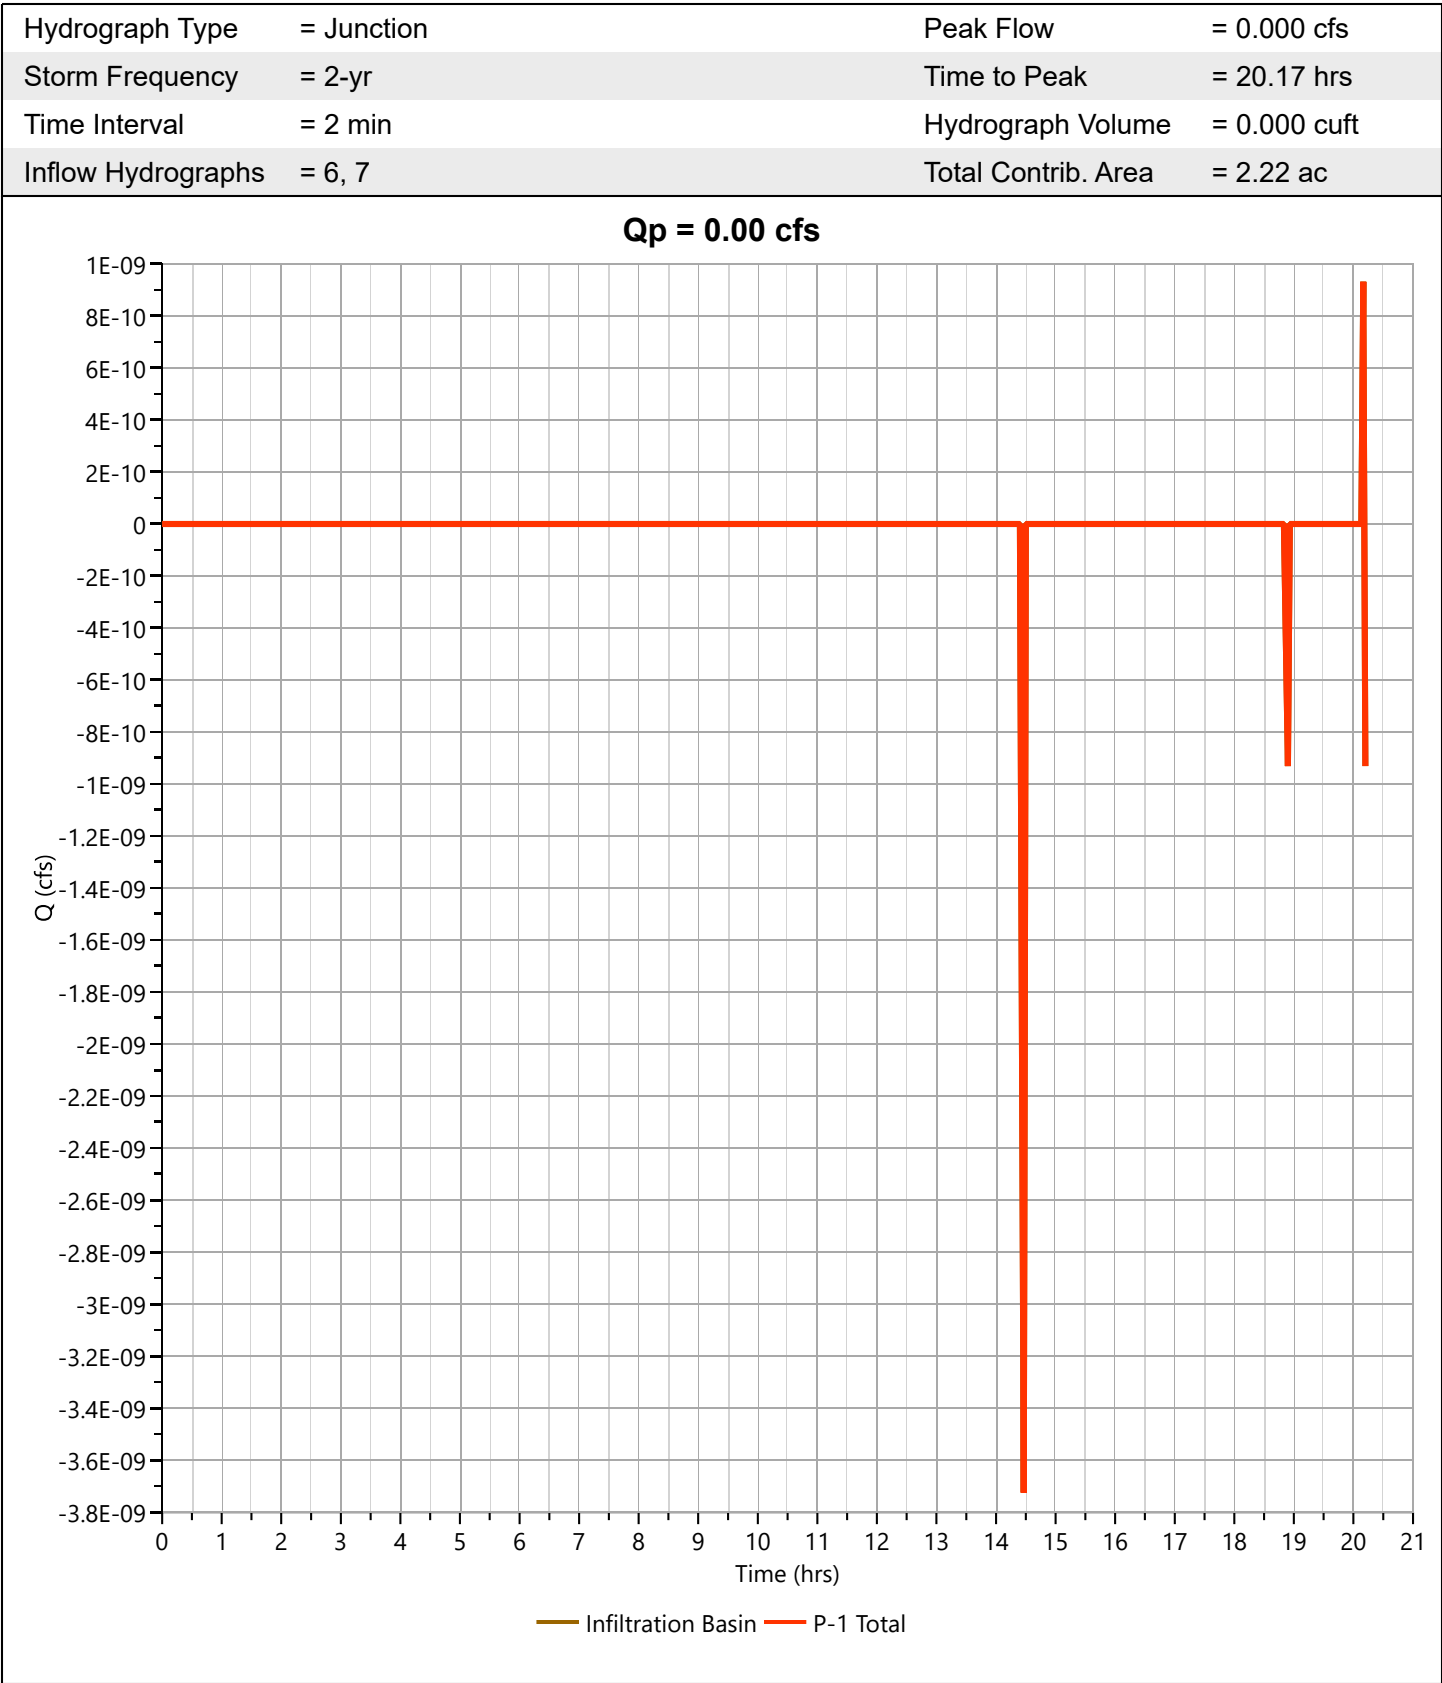

# Hydrograph Report


Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## P-1 Total

Hyd. No. 8

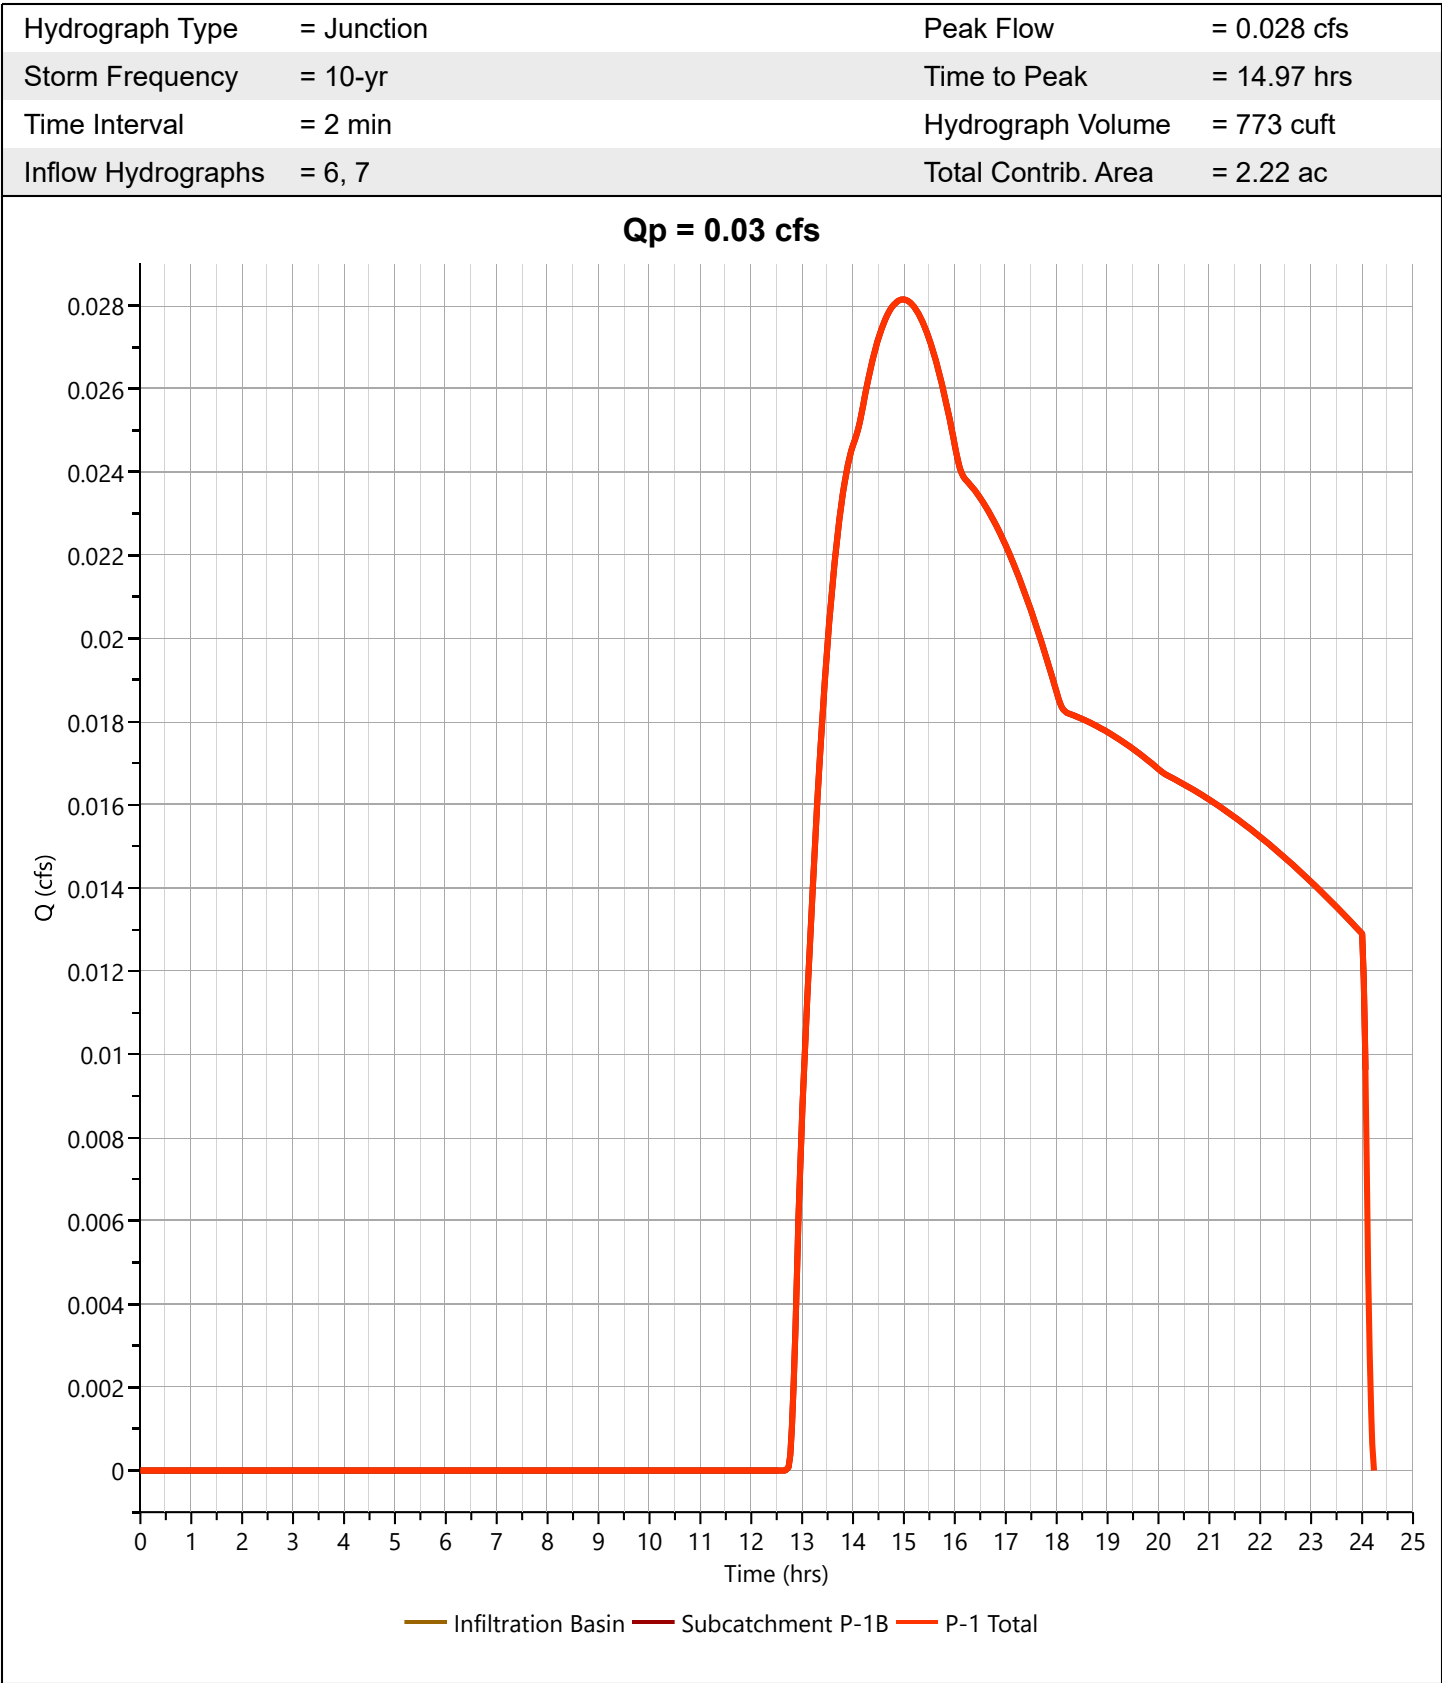

# Hydrograph Report


Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## P-1 Total

Hyd. No. 8

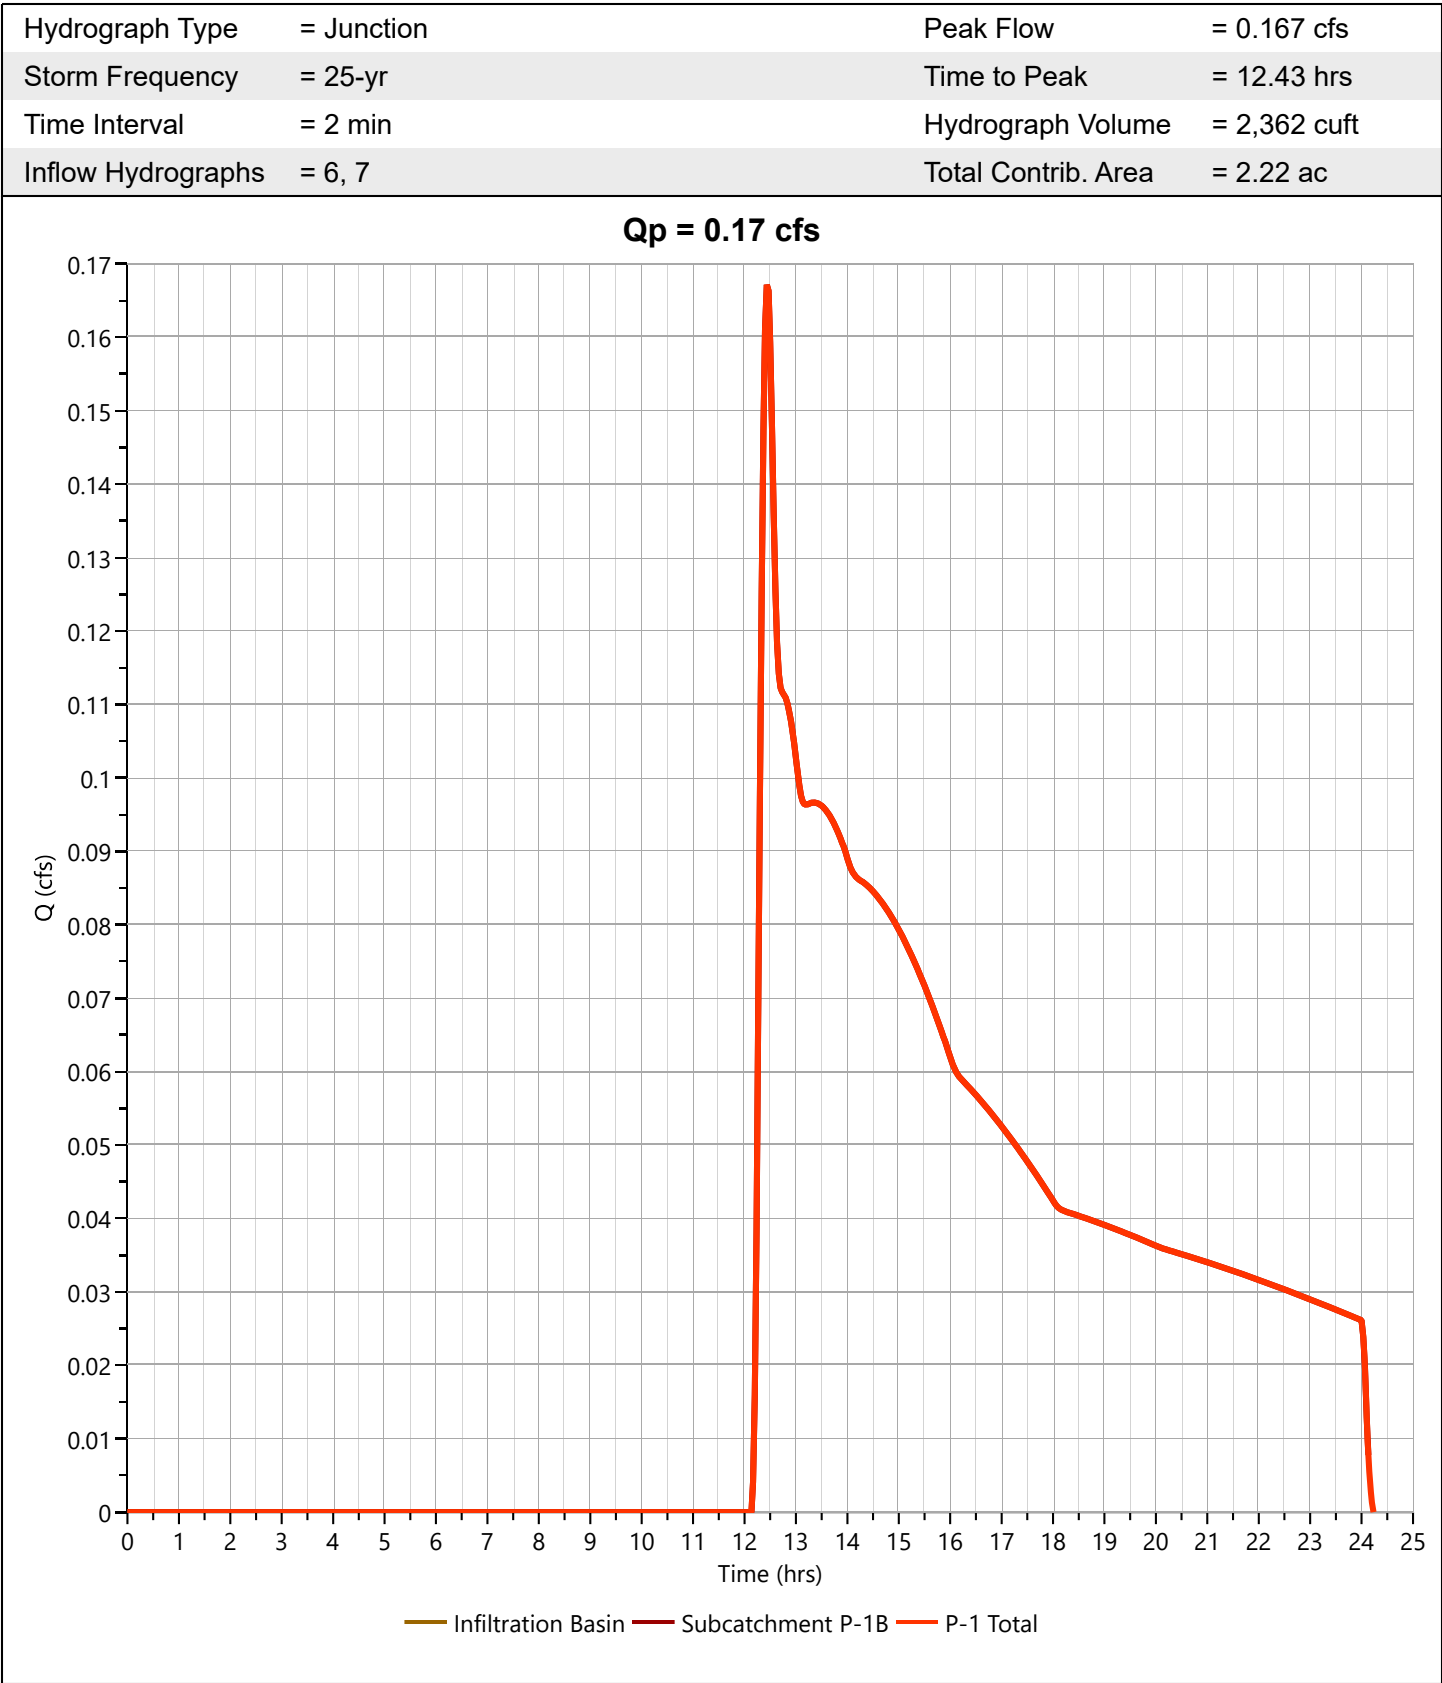

# Hydrograph Report


Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## P-1 Total

Hyd. No. 8

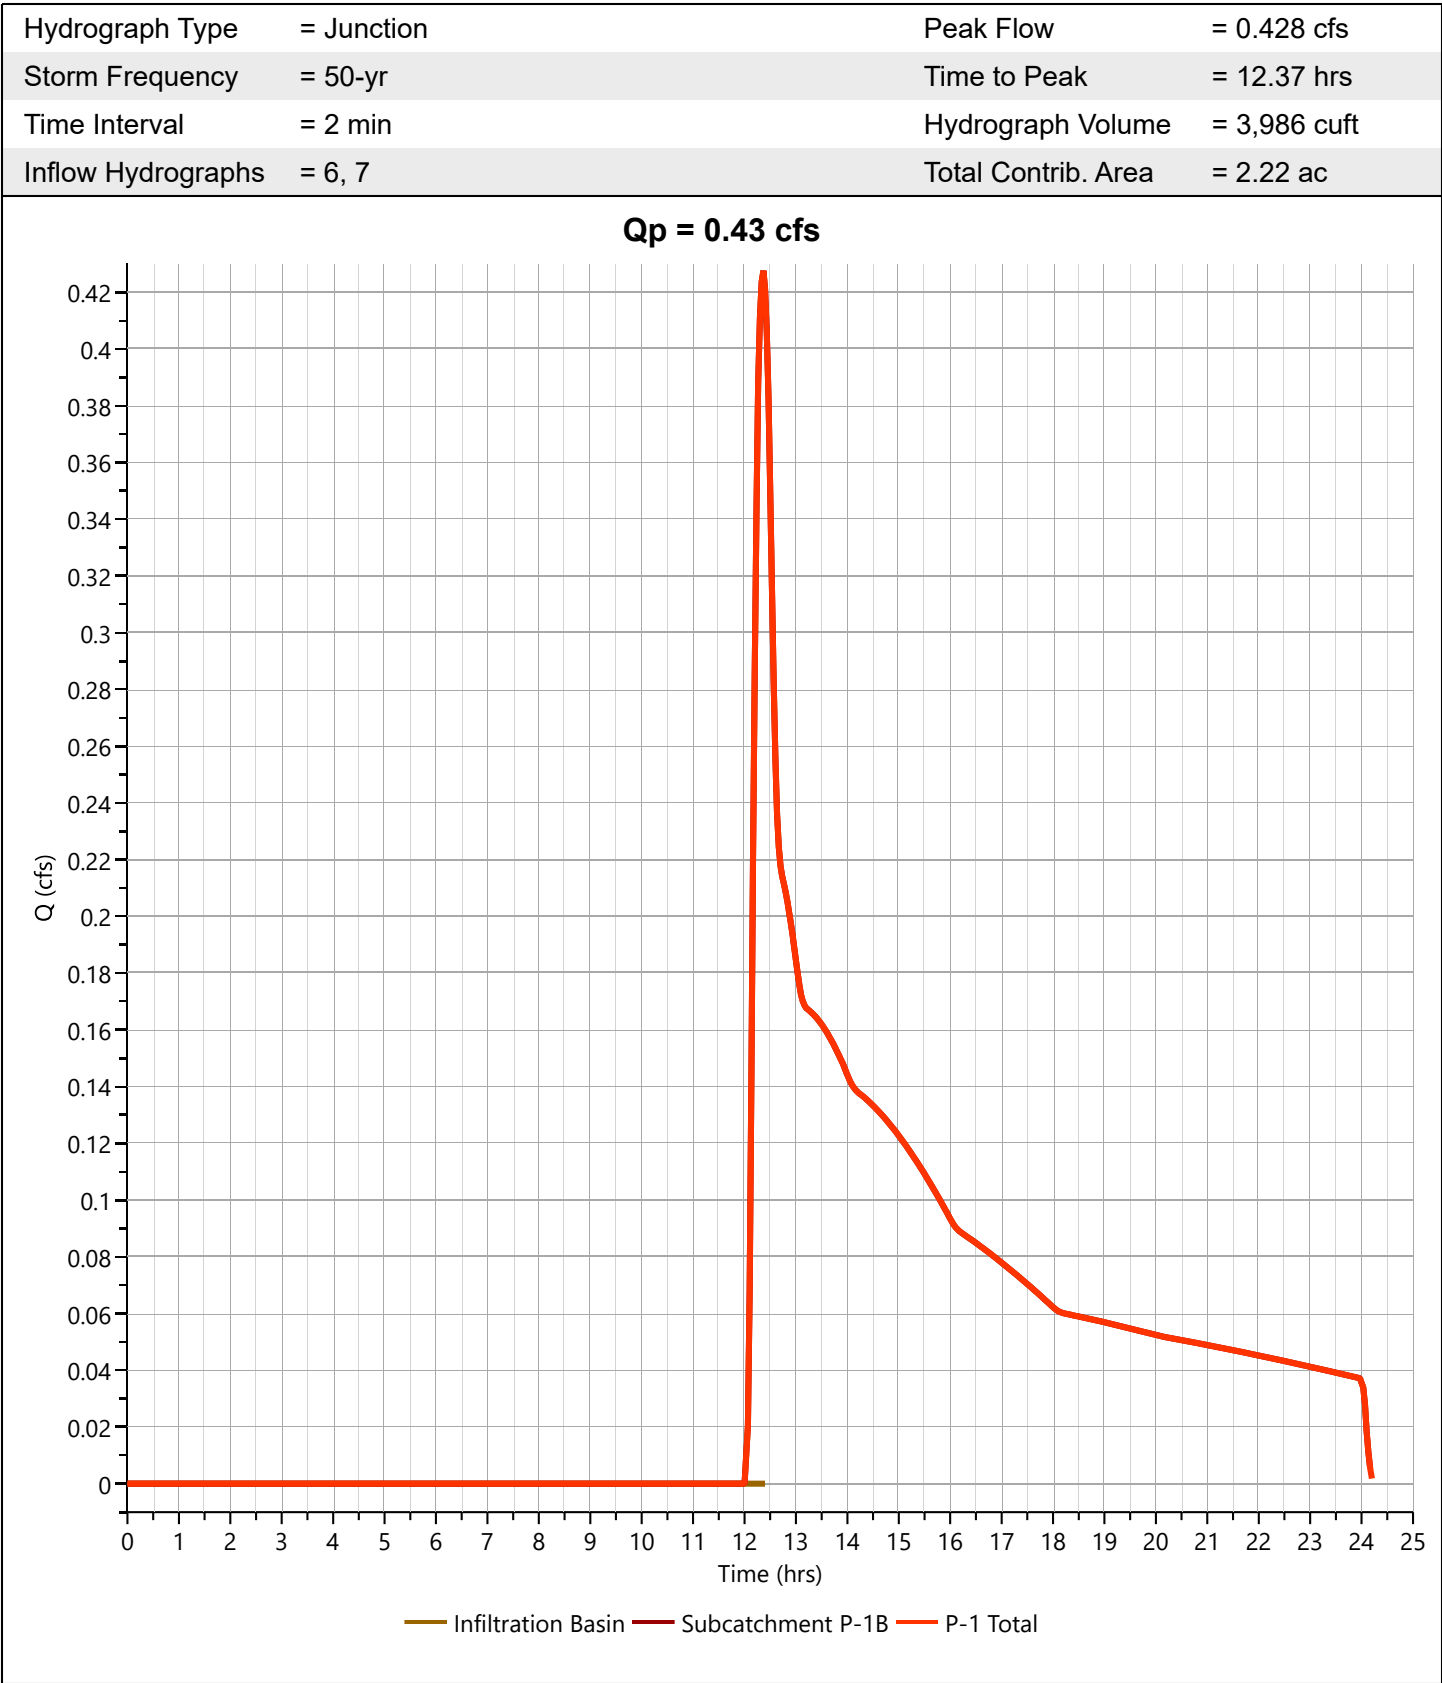

# Hydrograph Report


Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## P-1 Total

Hyd. No. 8

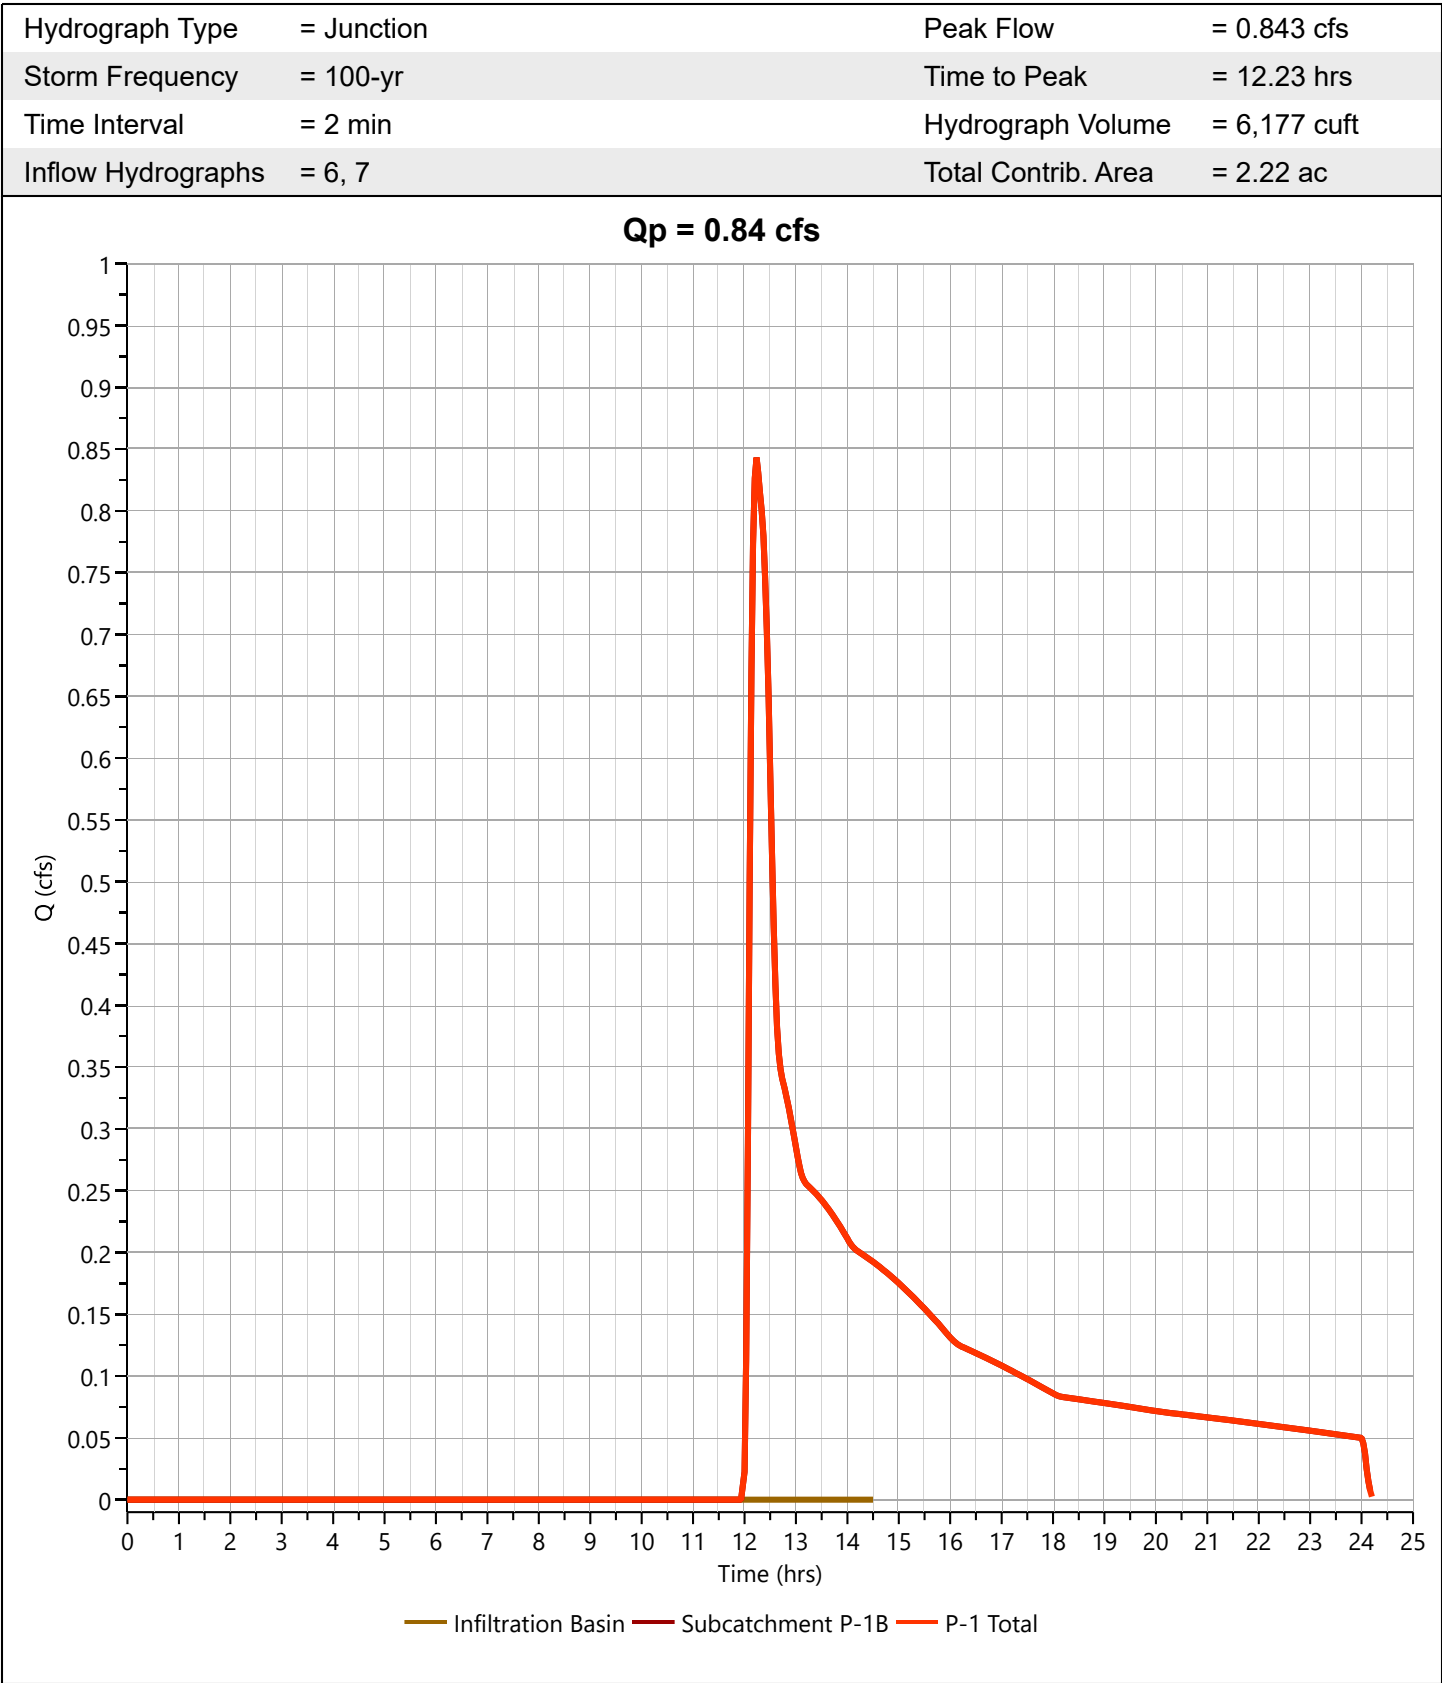

## Worksheet 2: Runoff curve number and runoff

SM-7306

Project: 95 Taylor Street By PFK Date 2/12/24Location: Littleton, MA Checked \_\_\_\_\_ Date \_\_\_\_\_Circle one: Present ☐ ☒ Developed \_\_\_\_\_ P-2A \_\_\_\_\_1. Runoff curve number (CN)

Soil name and hydrologic group (appendix A)	Cover description (cover type, treatment, and hydrologic condition: percent impervious: unconnected/connected impervious area ratio)	CN 1/			Area  Acres	Product of CN x Area
		Table 2-2	Fig. 2-3	Fig. 2-4		
-	Impervious	98			0.00	0.00
A	Open Space-Good Condition	39			0.08	3.27
A	Woods- Good Condition	30			0.00	0.00
A	Residential Districts - 2 acres	46			0.00	0.00
A	Gravel	76			0.00	0.00
Totals =					0.08	3.27

1/ Use only one CN source per line.

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{3.27}{0.08} = \underline{39.00} ; \quad \text{Use CN} = \underline{39}$$

2. Runoff

Frequency..... yr

Rainfall, P (24-hour)..... in

Runoff, Q..... in

(Use P and CN with table 2-1, fig. 2-1,  
or eqs. 2-3 and 2-4.)

Storm #1	Storm #2	Storm #3
2	10	100
3.1	4.5	6.5
0.00	0.11	0.60

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-2A

## Hyd. No. 10

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.000 cfs
Storm Frequency	= 2-yr	Time to Peak	= 24.00 hrs
Time Interval	= 2 min	Runoff Volume	= 0.047 cuft
Drainage Area	= 0.08 ac	Curve Number	= 39
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 3.18 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

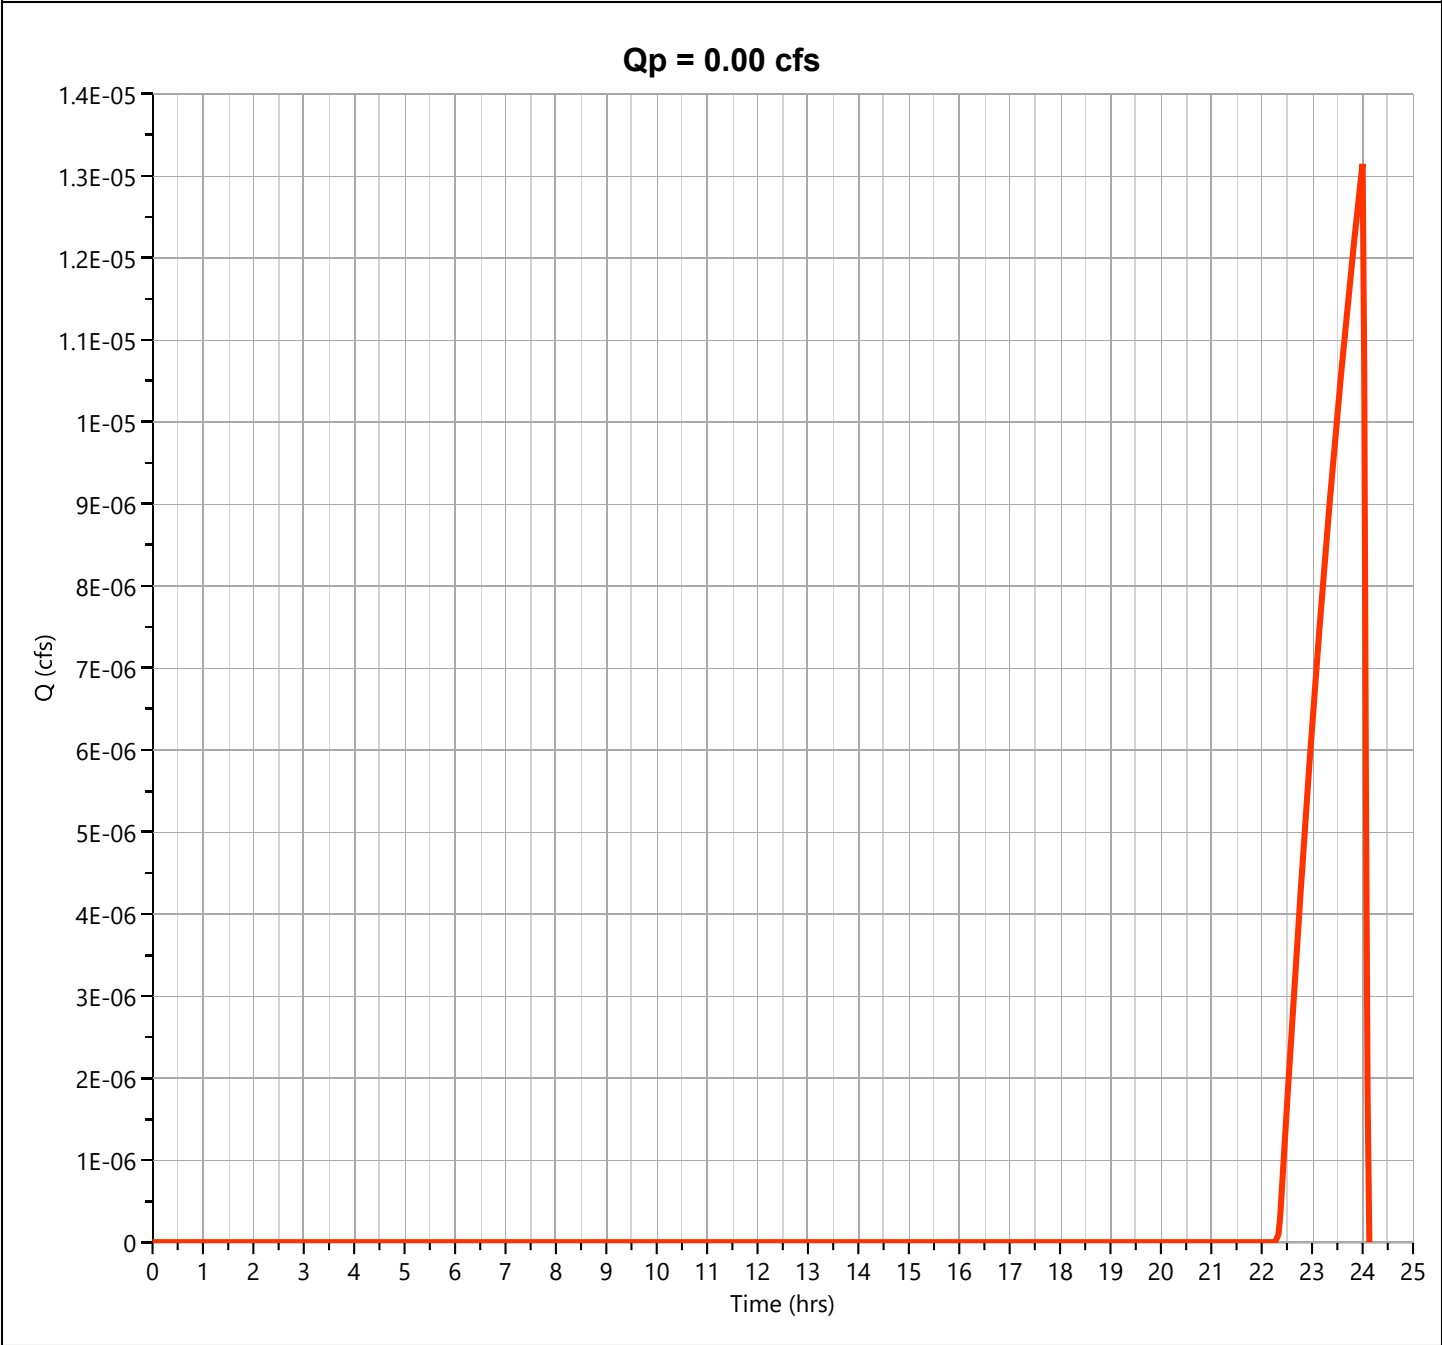



# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-2A

## Hyd. No. 10

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.002 cfs
Storm Frequency	= 10-yr	Time to Peak	= 12.47 hrs
Time Interval	= 2 min	Runoff Volume	= 49.6 cuft
Drainage Area	= 0.08 ac	Curve Number	= 39
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 4.91 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

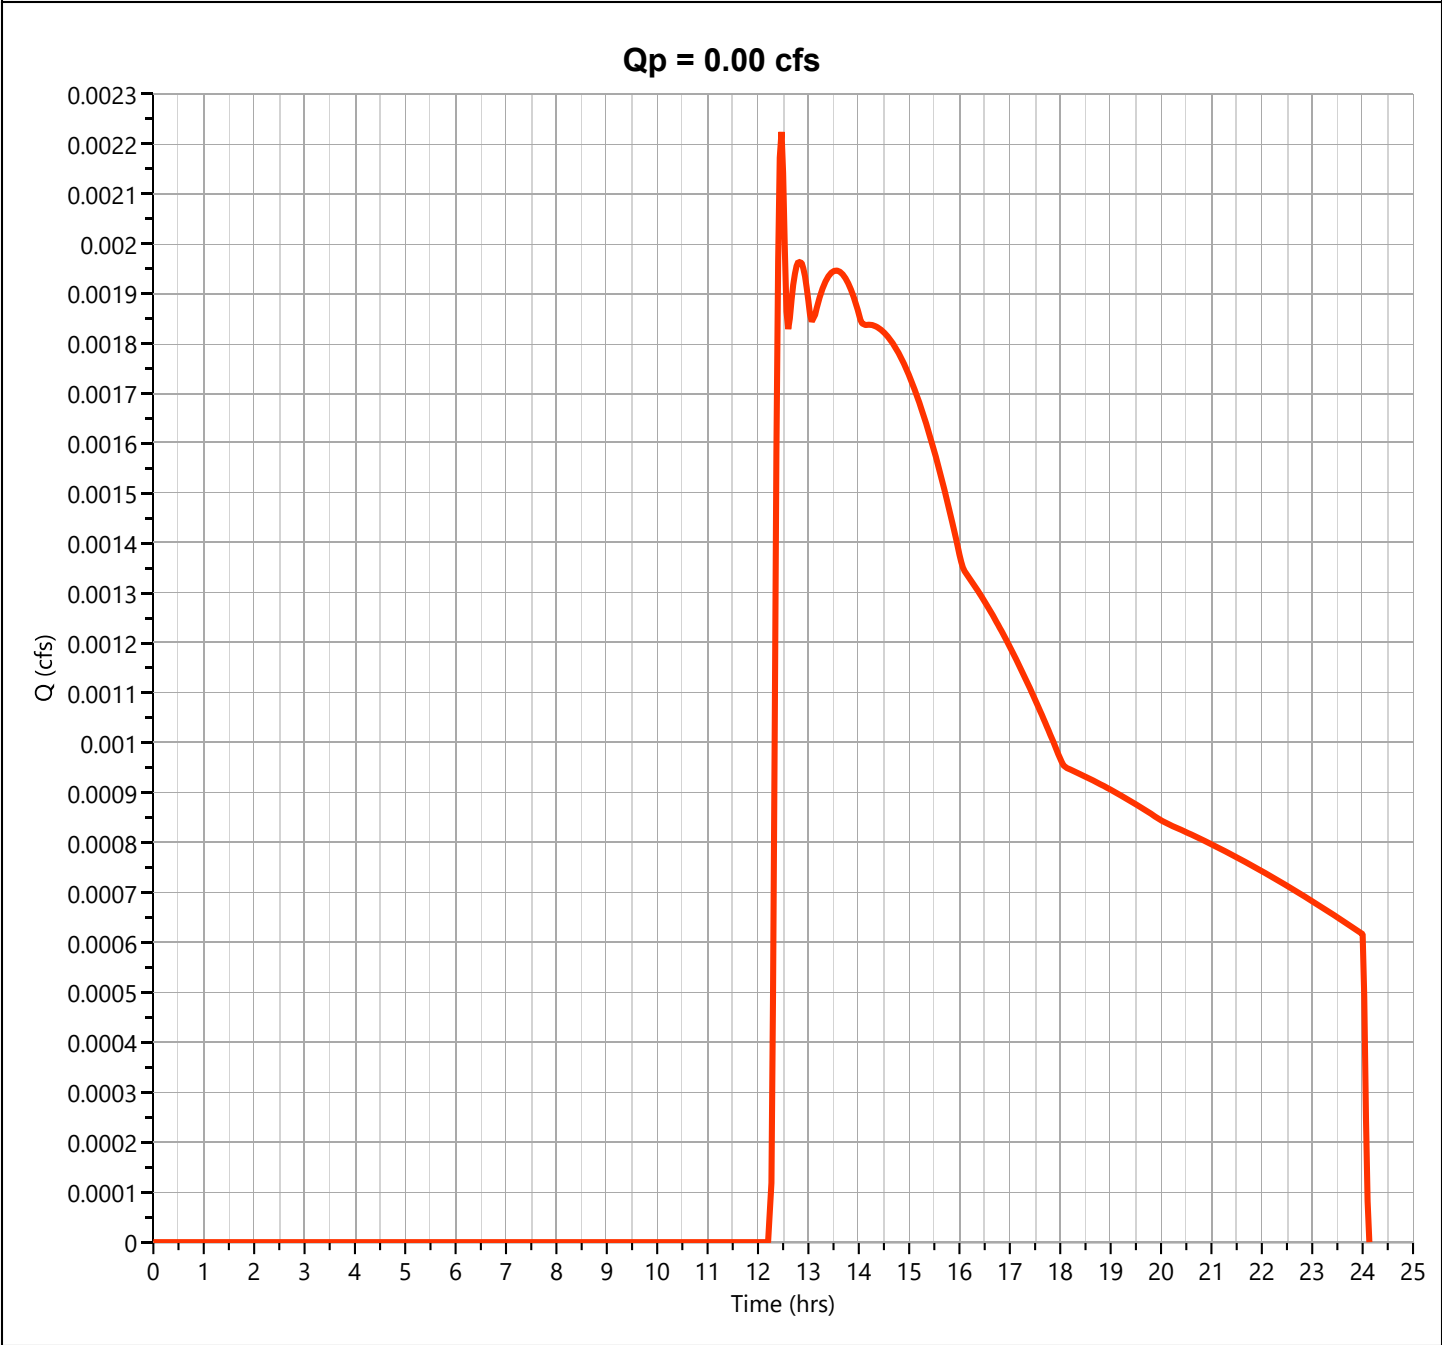

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-2A

## Hyd. No. 10

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.013 cfs
Storm Frequency	= 25-yr	Time to Peak	= 12.30 hrs
Time Interval	= 2 min	Runoff Volume	= 120 cuft
Drainage Area	= 0.08 ac	Curve Number	= 39
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 5.99 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

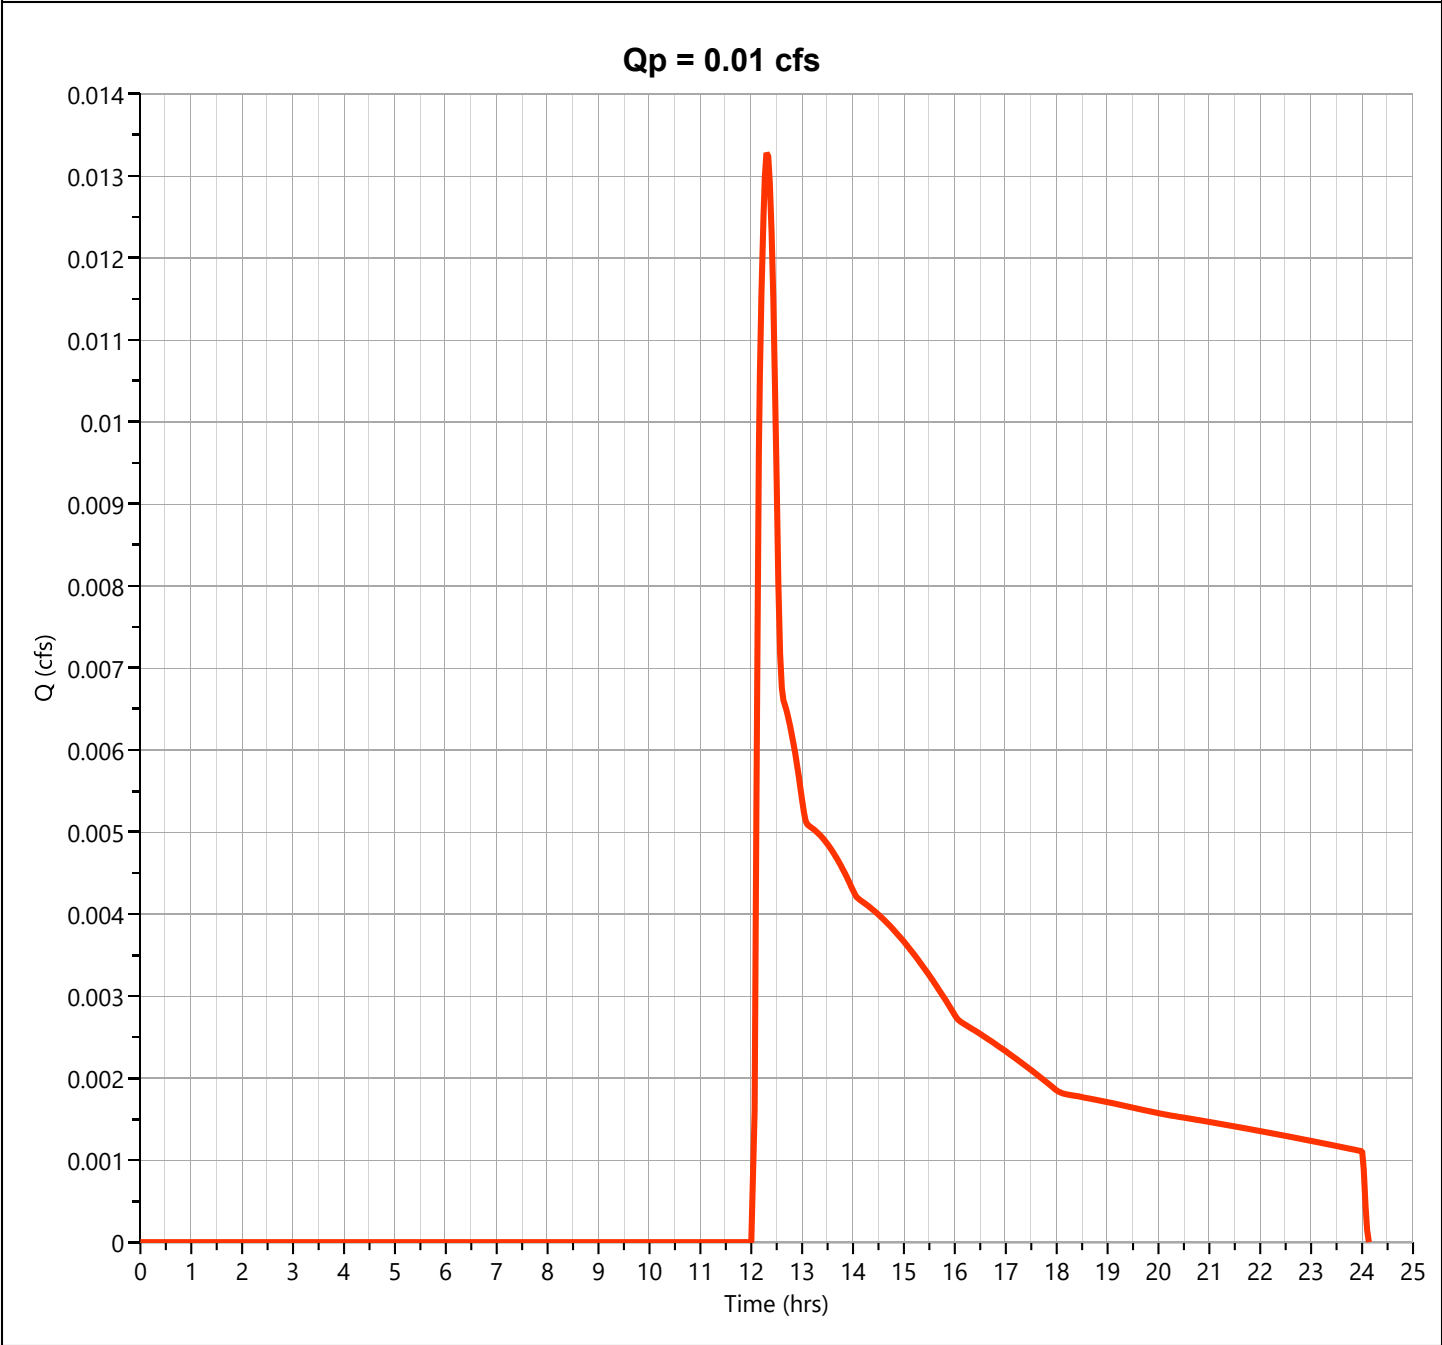

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-2A

## Hyd. No. 10

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.028 cfs
Storm Frequency	= 50-yr	Time to Peak	= 12.13 hrs
Time Interval	= 2 min	Runoff Volume	= 188 cuft
Drainage Area	= 0.08 ac	Curve Number	= 39
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 6.78 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

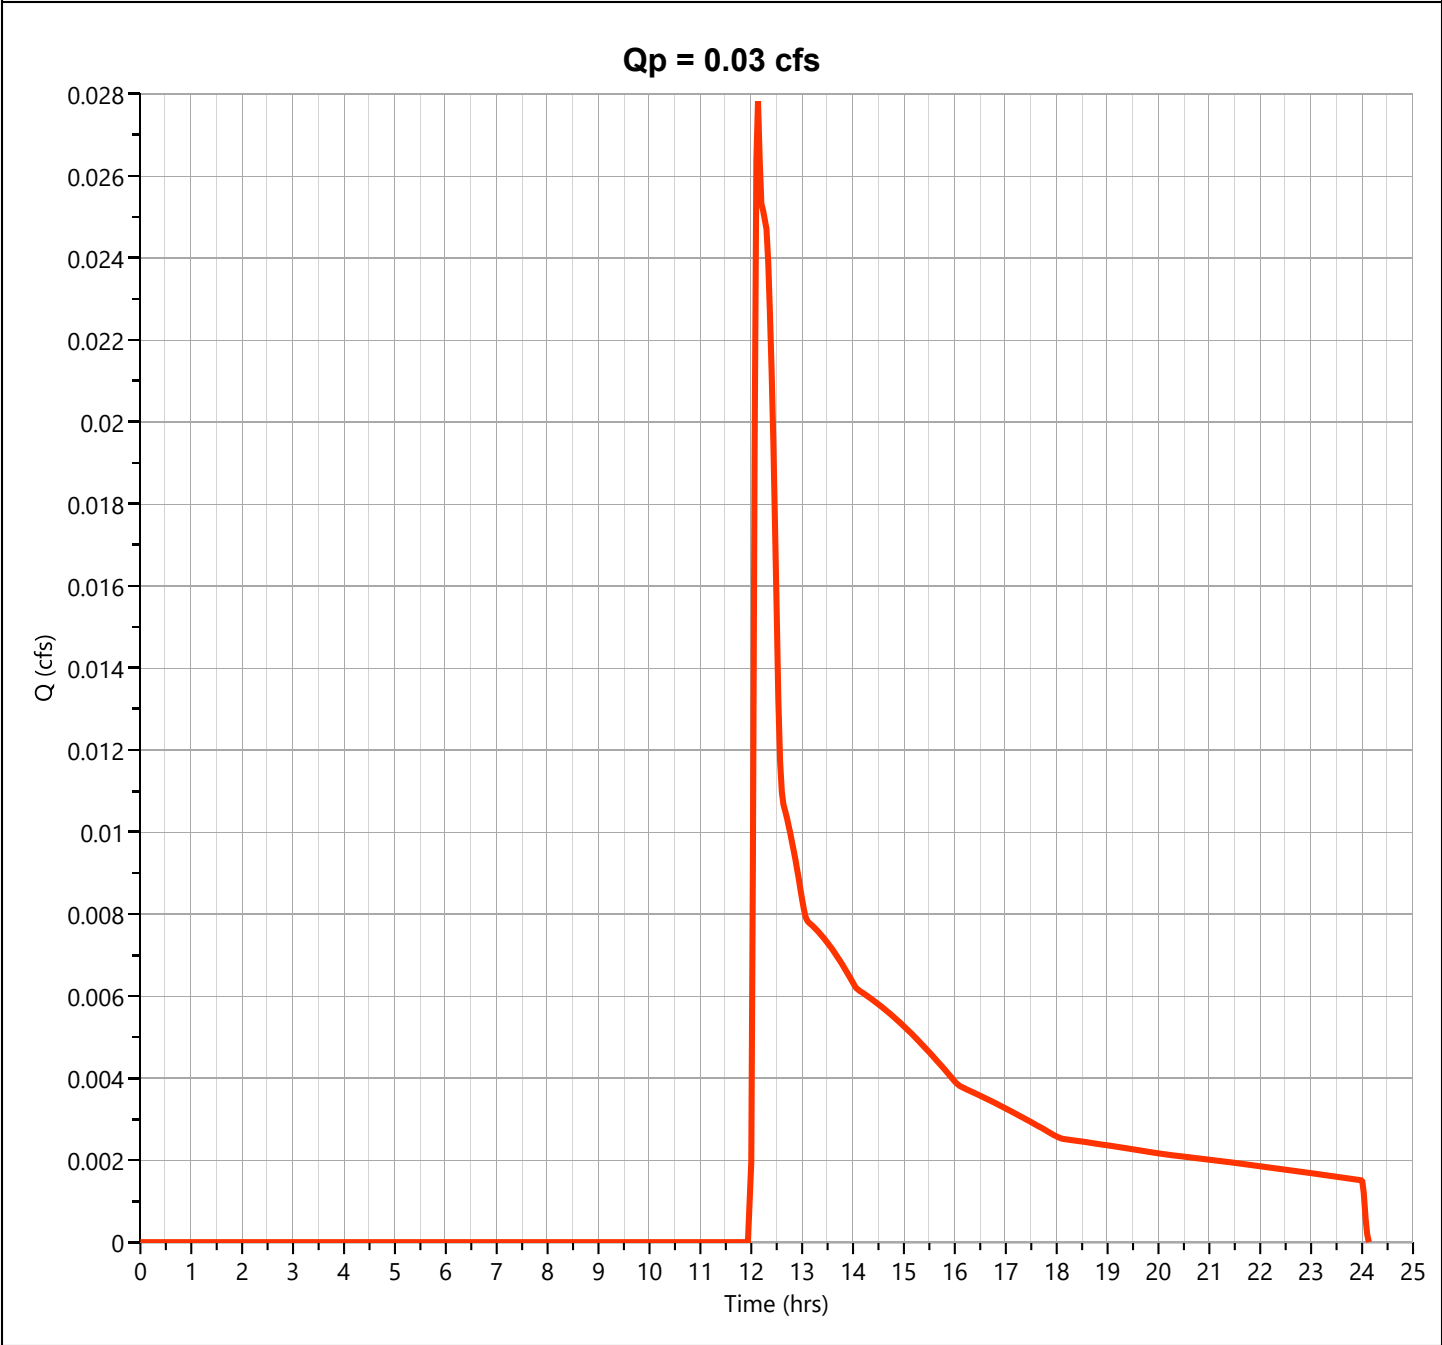

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-2A

## Hyd. No. 10

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.056 cfs
Storm Frequency	= 100-yr	Time to Peak	= 12.10 hrs
Time Interval	= 2 min	Runoff Volume	= 276 cuft
Drainage Area	= 0.08 ac	Curve Number	= 39
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 7.65 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

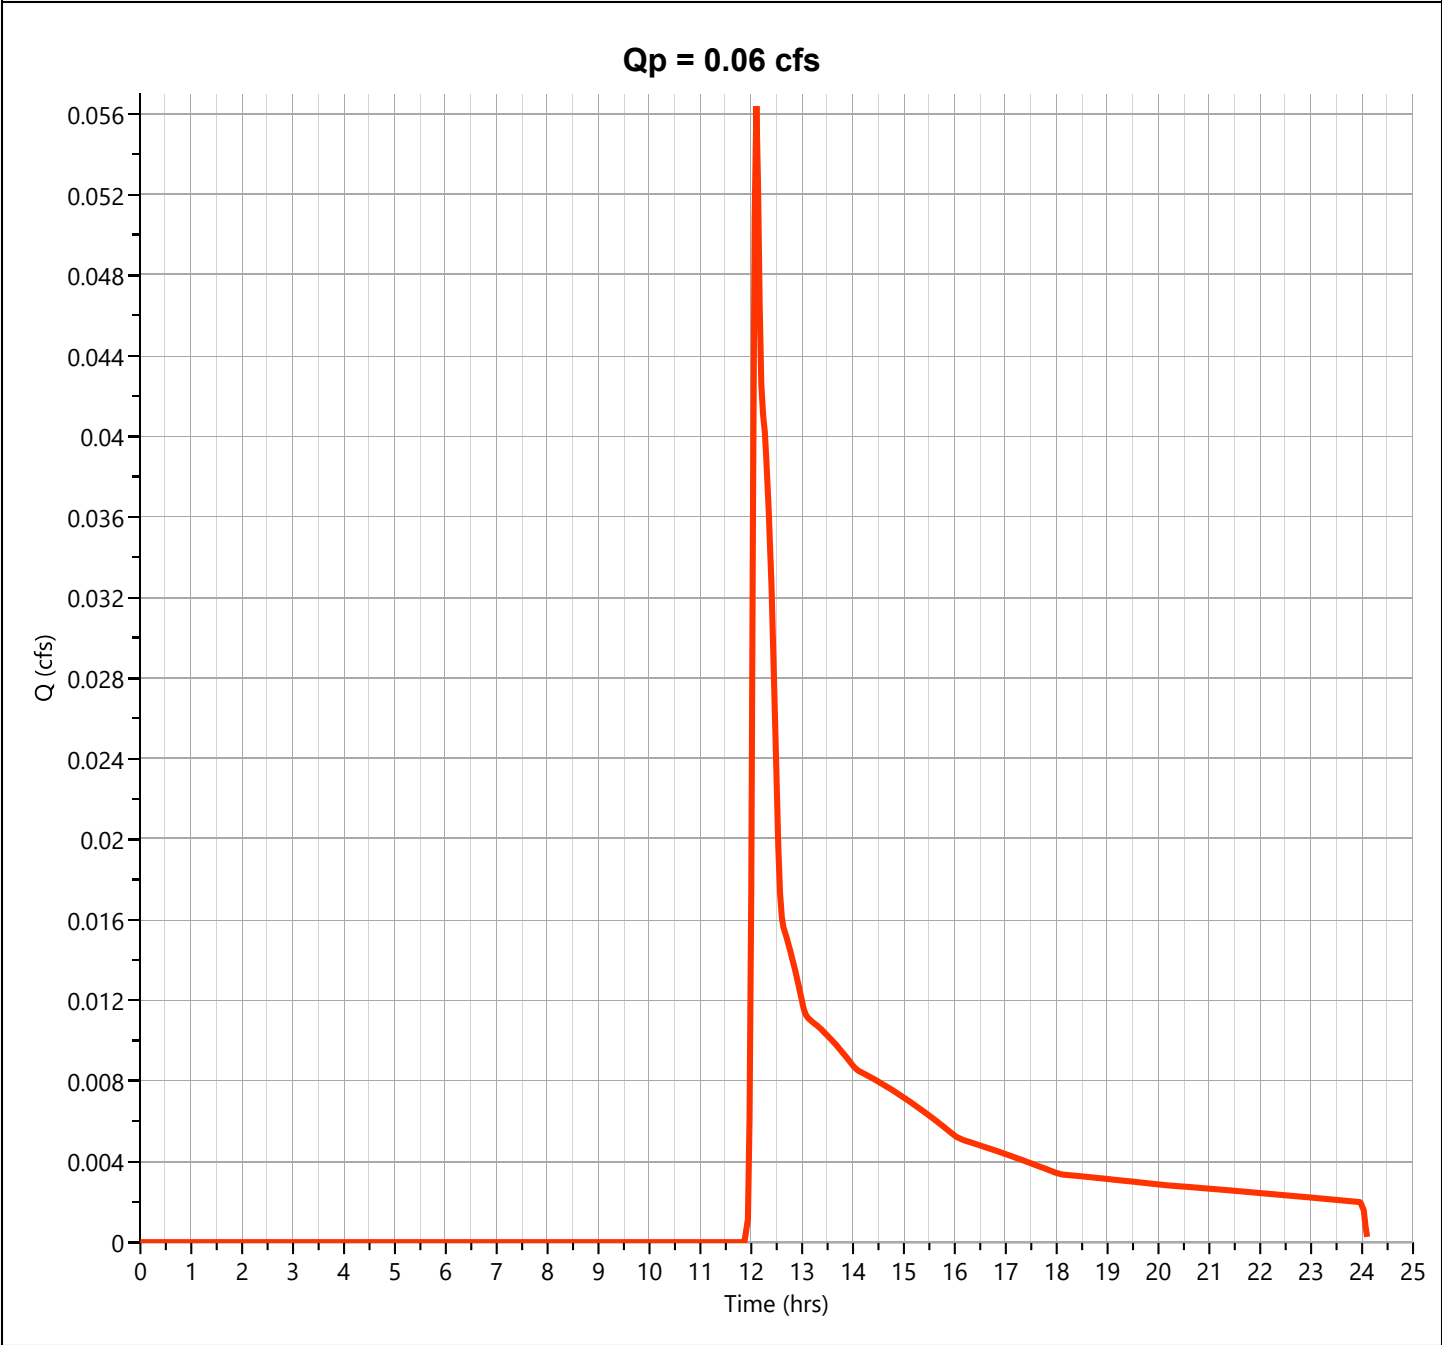

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## Infiltration Trench

Hyd. No. 11

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 2-yr	Time to Peak	= 0.00 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 10 - Subcatchment P-2A	Max. Elevation	= 230.50 ft
Pond Name	= Infiltration Trench	Max. Storage	= 0.047 cuft

Pond Routing by Storage Indication Method

Qp = 0.00 cfs

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31


02-13-2024

## Infiltration Trench

Hyd. No. 11

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 10-yr	Time to Peak	= 12.40 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 10 - Subcatchment P-2A	Max. Elevation	= 230.50 ft
Pond Name	= Infiltration Trench	Max. Storage	= 0.047 cuft

Pond Routing by Storage Indication Method

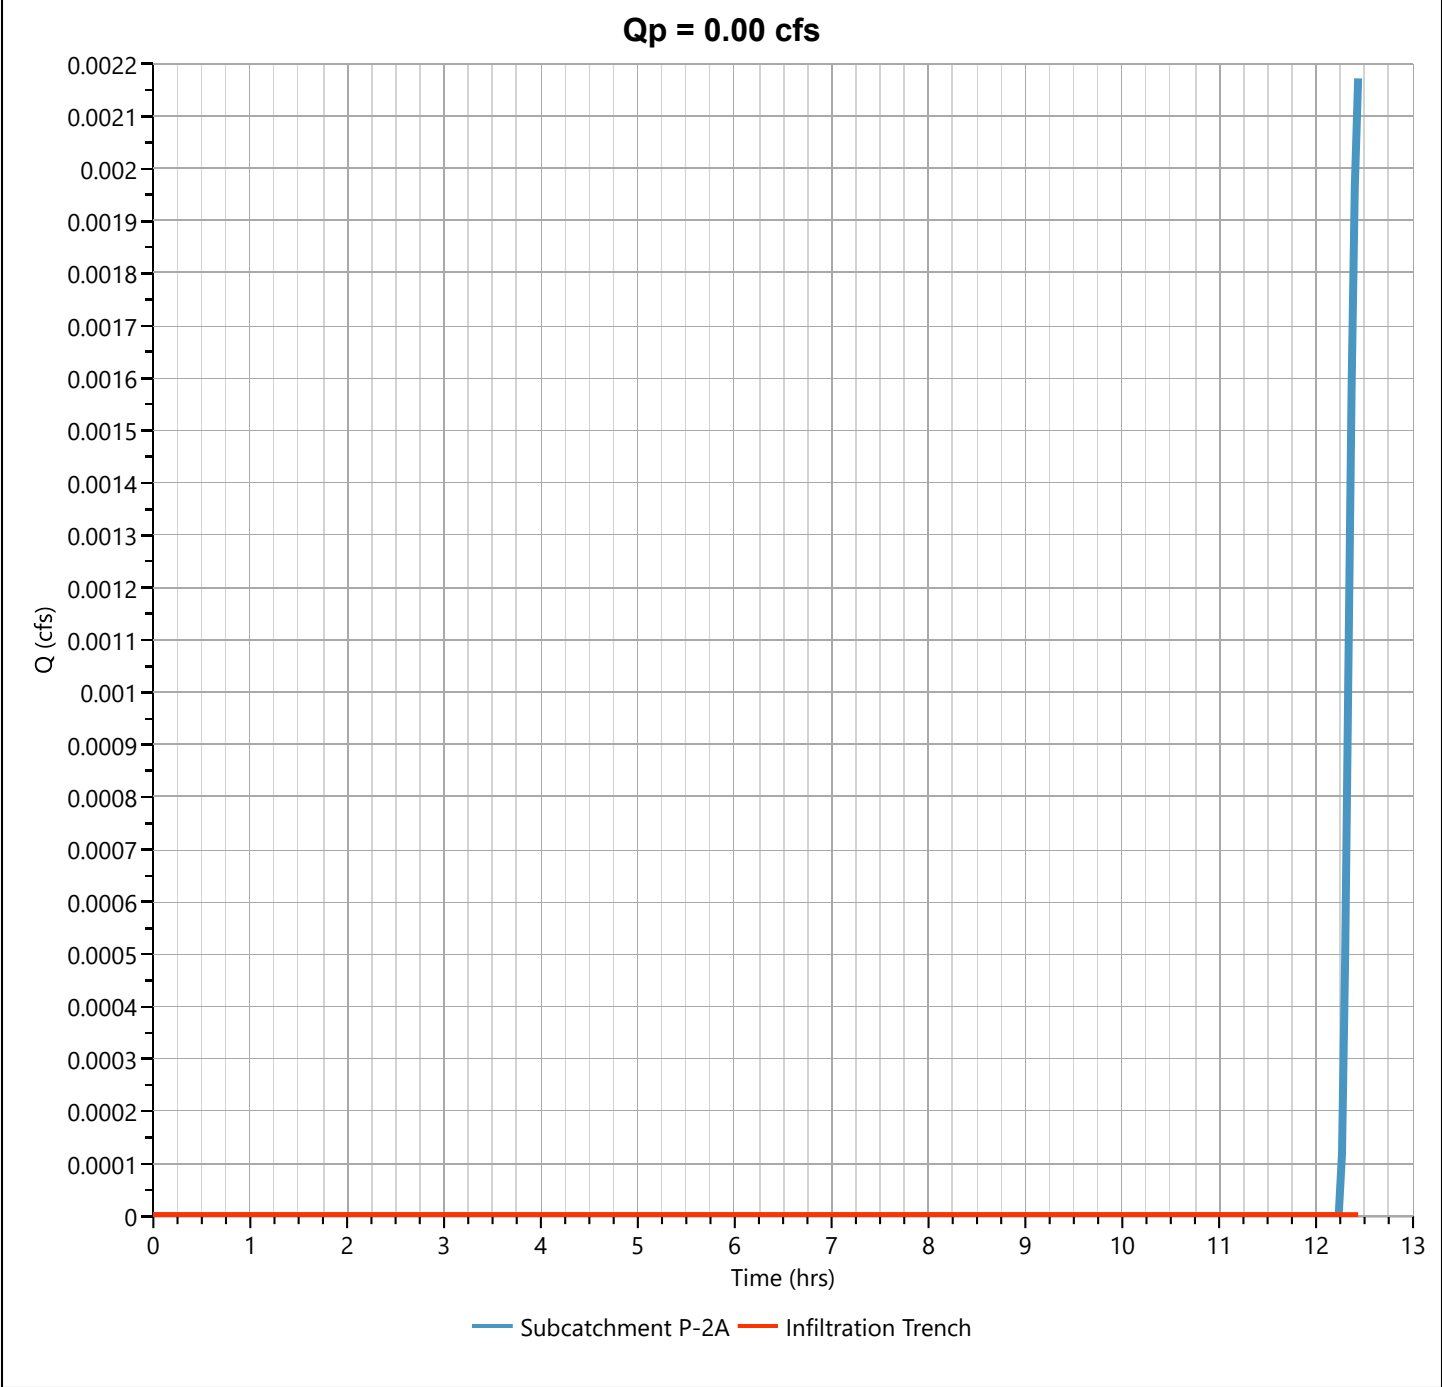

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31


02-13-2024

## Infiltration Trench

Hyd. No. 11

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 25-yr	Time to Peak	= 12.57 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 10 - Subcatchment P-2A	Max. Elevation	= 230.50 ft
Pond Name	= Infiltration Trench	Max. Storage	= 0.138 cuft

Pond Routing by Storage Indication Method

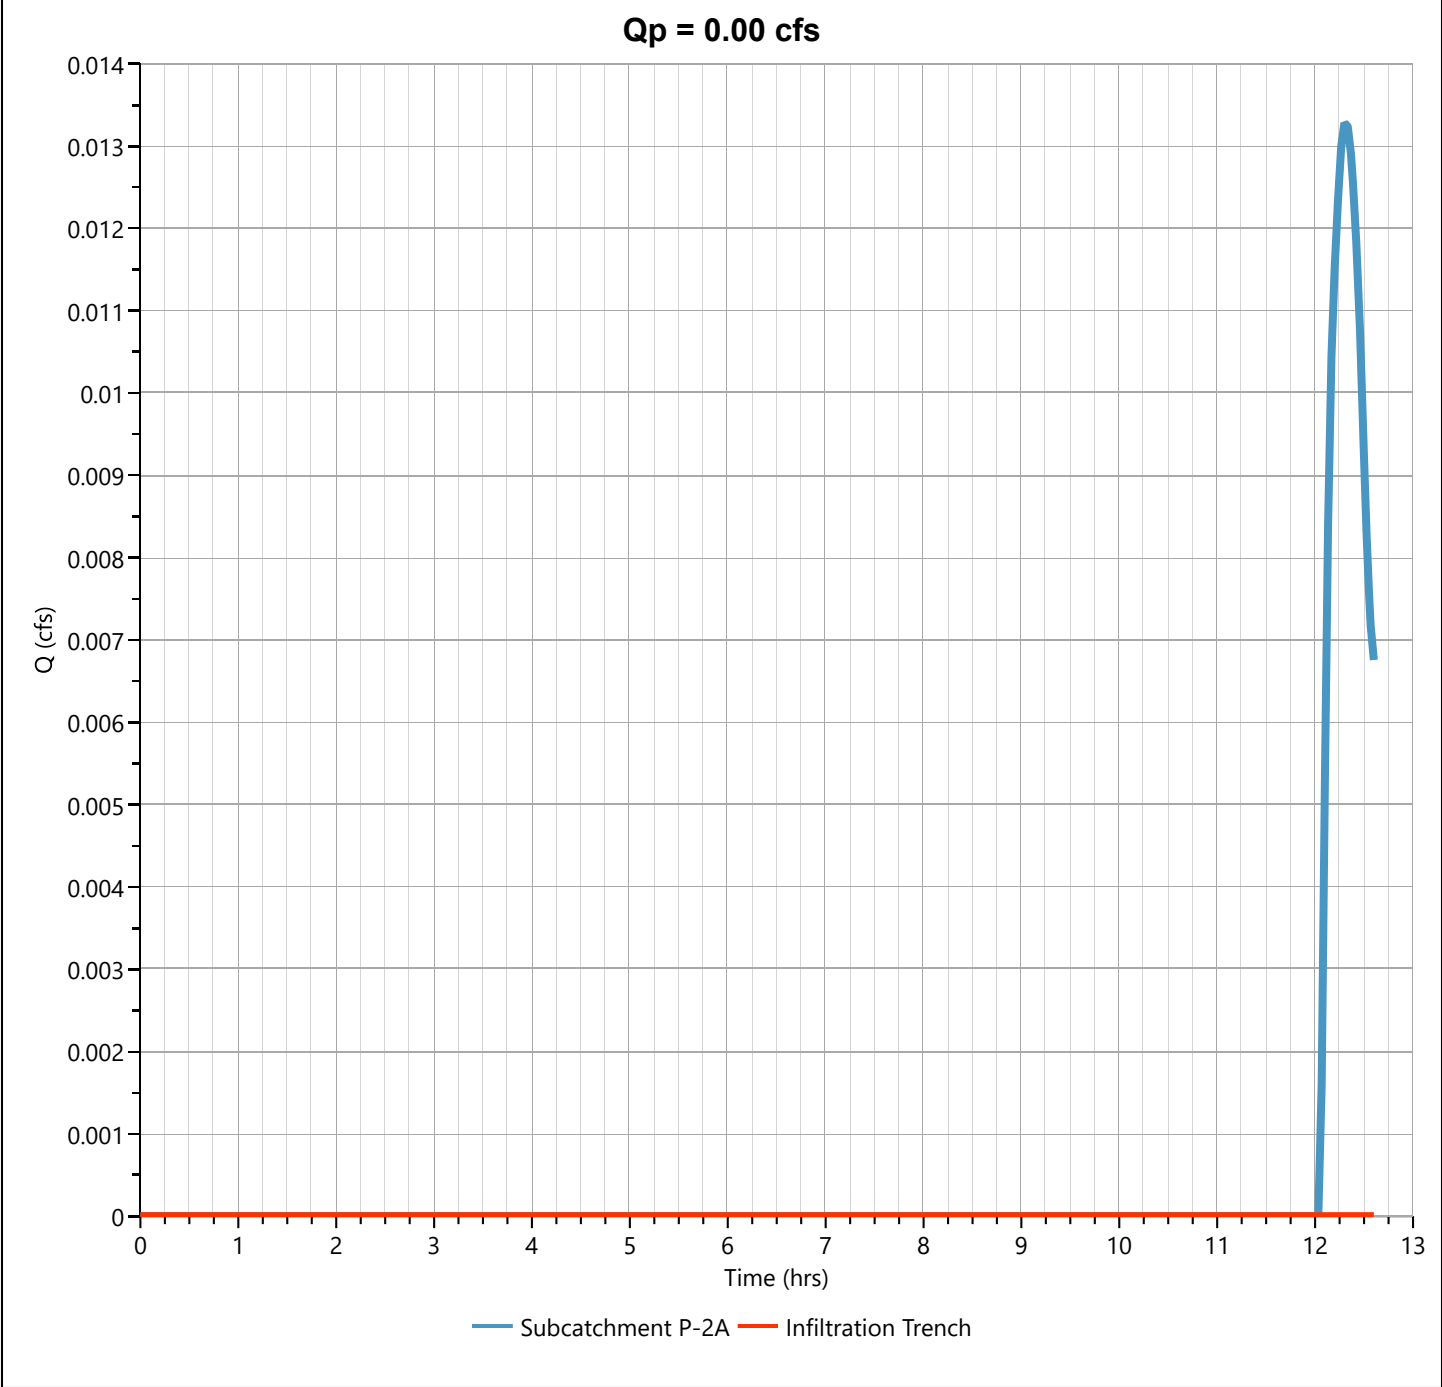

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31


02-13-2024

## Infiltration Trench

Hyd. No. 11

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 50-yr	Time to Peak	= 13.20 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 10 - Subcatchment P-2A	Max. Elevation	= 230.65 ft
Pond Name	= Infiltration Trench	Max. Storage	= 5.82 cuft

Pond Routing by Storage Indication Method

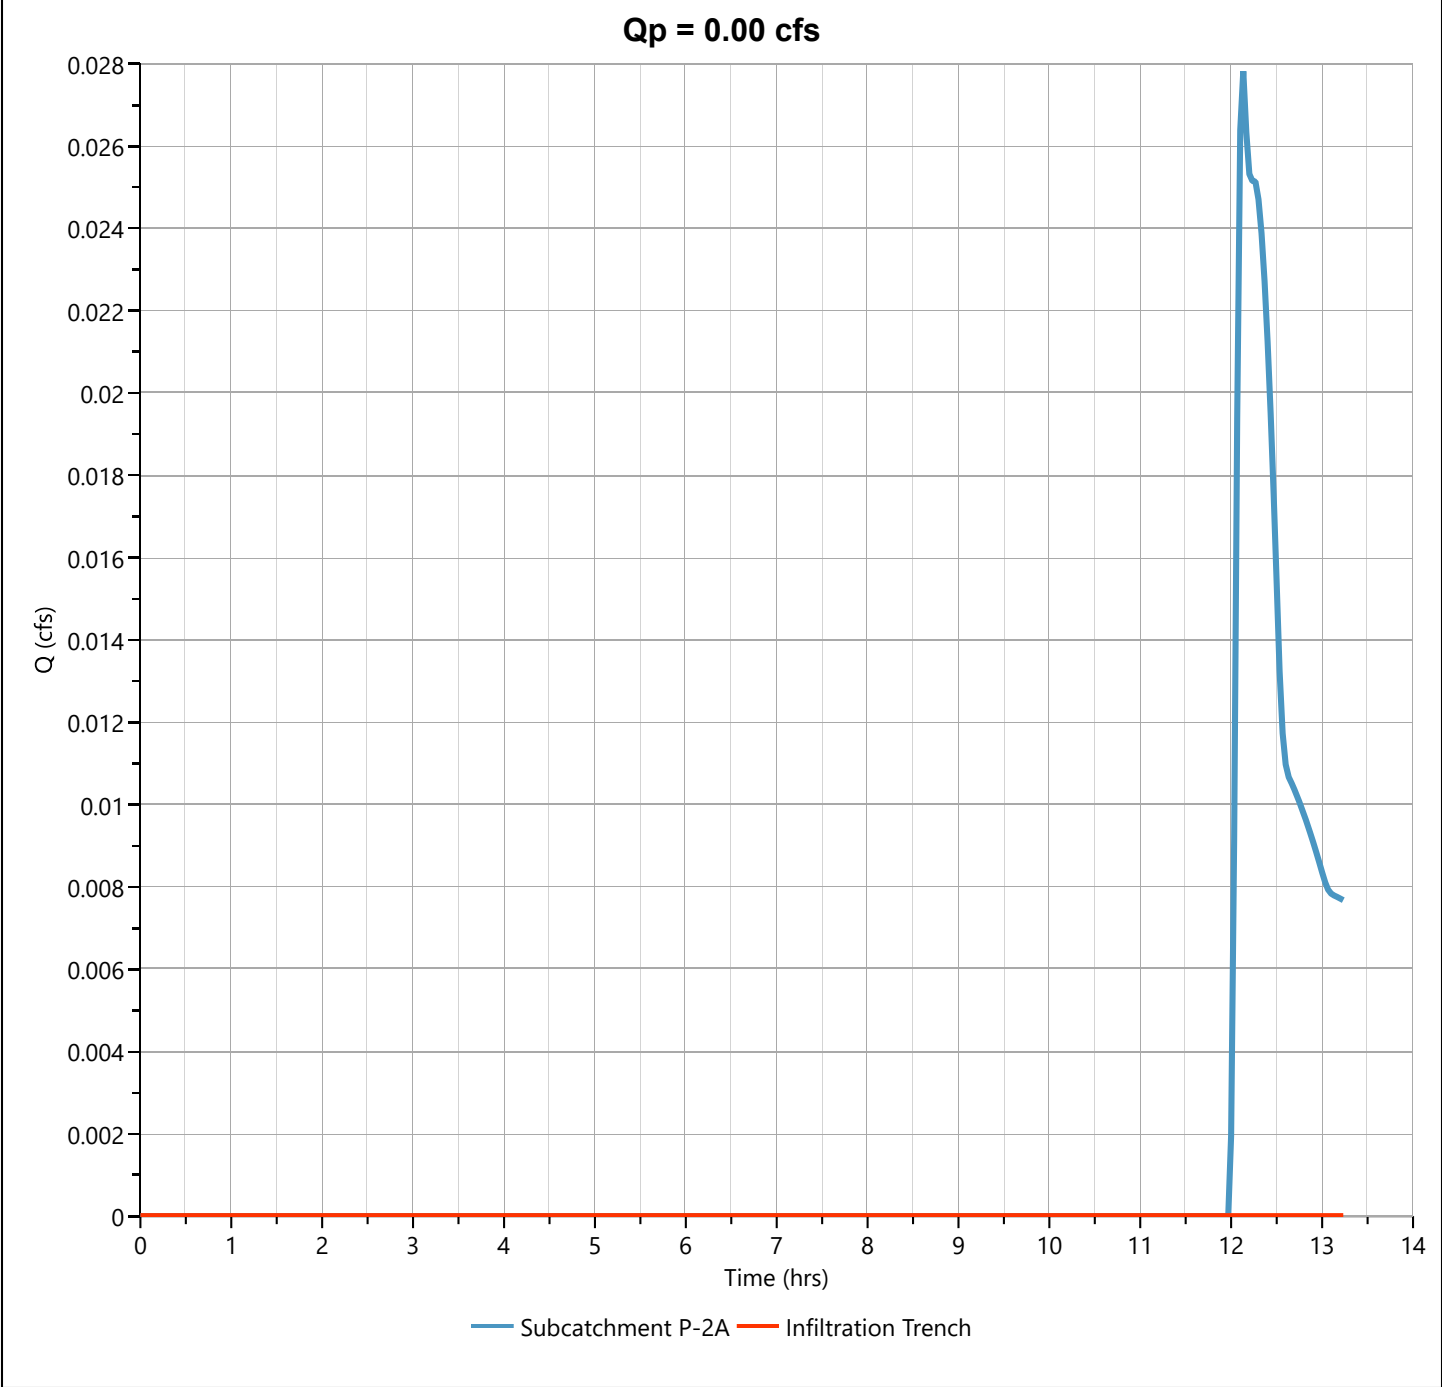



# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31


02-13-2024

## Infiltration Trench

Hyd. No. 11

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 100-yr	Time to Peak	= 14.77 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 10 - Subcatchment P-2A	Max. Elevation	= 231.11 ft
Pond Name	= Infiltration Trench	Max. Storage	= 23.3 cuft


Pond Routing by Storage Indication Method

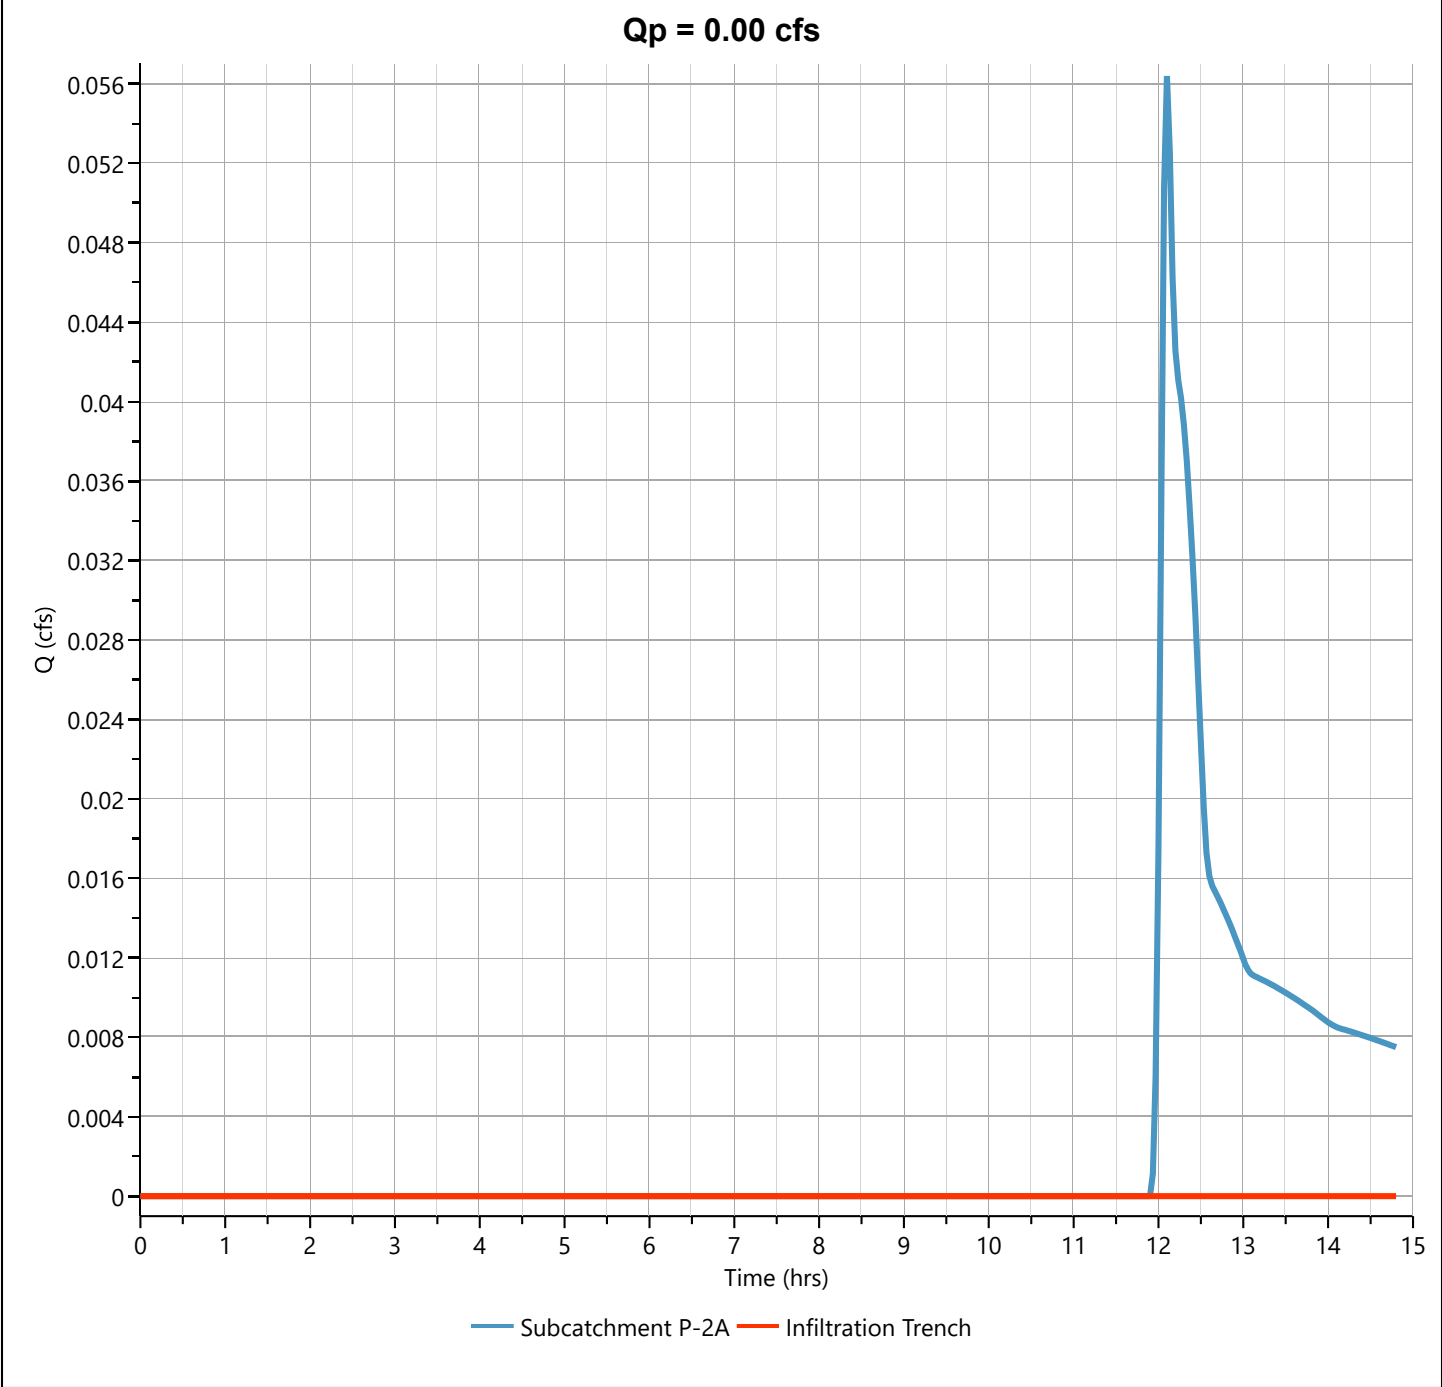

Infiltration Trench

Stage-Storage

Trapezoid		Stage / Storage Table				
Description	Input	Stage (ft)	Elevation (ft)	Contour Area (sqft)	Incr. Storage (cuft)	Total Storage (cuft)
Bottom Elevation, ft	230.50	0.00	230.50	95	0.000	0.000
Bottom Length, ft	19.00	0.05	230.55	95	1.90	1.90
Bottom Width, ft	5.00	0.10	230.60	95	1.90	3.80
Side Slope, H:1	0.00	0.15	230.65	95	1.90	5.70
Total Depth, ft	1.00	0.20	230.70	95	1.90	7.60
Voids (%)	40.00	0.25	230.75	95	1.90	9.50
		0.30	230.80	95	1.90	11.4
		0.35	230.85	95	1.90	13.3
		0.40	230.90	95	1.90	15.2
		0.45	230.95	95	1.90	17.1
		0.50	231.00	95	1.90	19.0
		0.55	231.05	95	1.90	20.9
		0.60	231.10	95	1.90	22.8
		0.65	231.15	95	1.90	24.7
		0.70	231.20	95	1.90	26.6
		0.75	231.25	95	1.90	28.5
		0.80	231.30	95	1.90	30.4
		0.85	231.35	95	1.90	32.3
		0.90	231.40	95	1.90	34.2
		0.95	231.45	95	1.90	36.1
		1.00	231.50	95	1.90	38.0

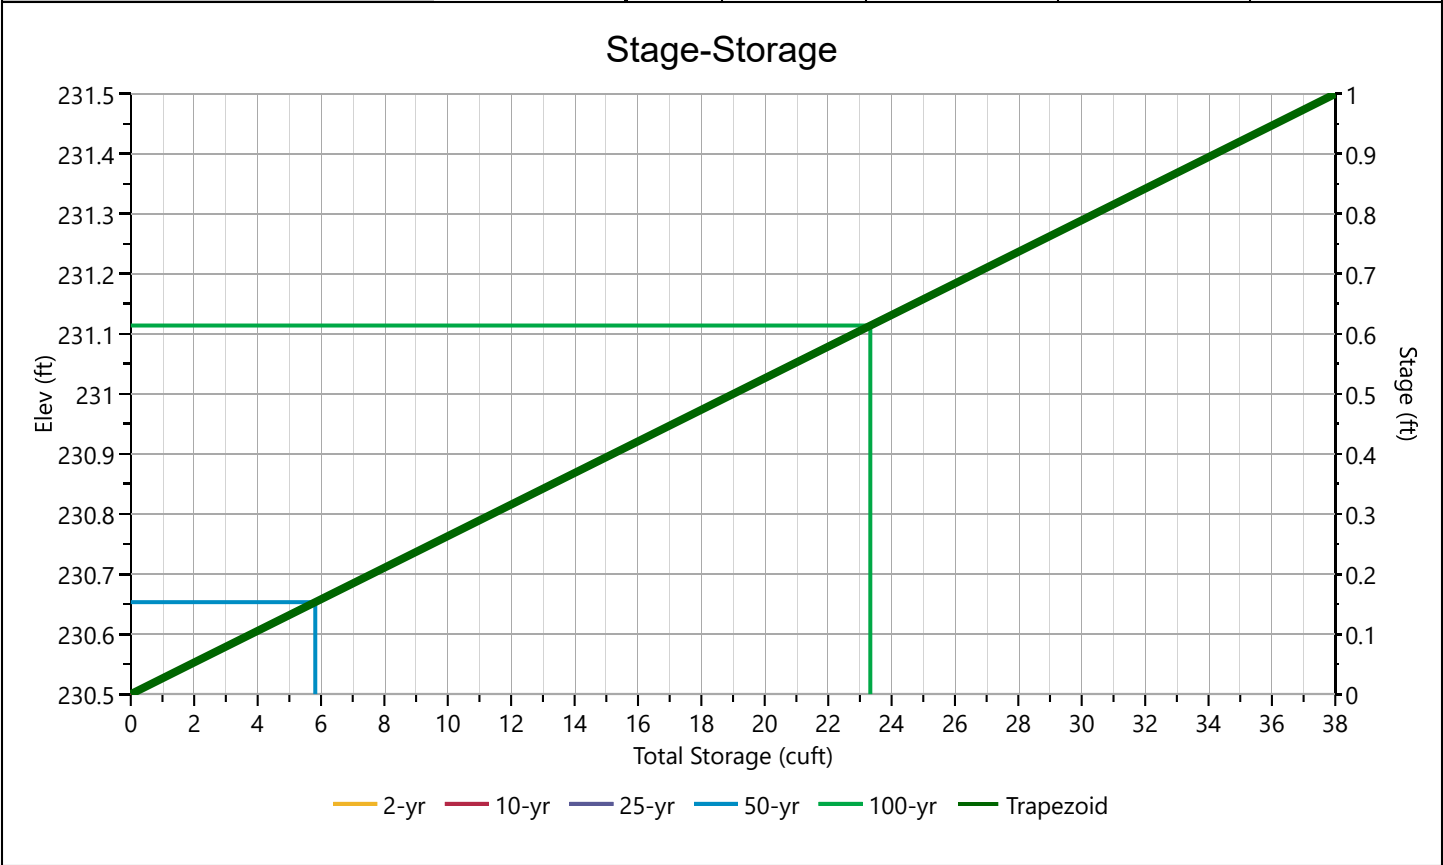


Infiltration Trench

Stage-Discharge

Culvert / Orifices	Culvert	Orifices			Perforated Riser
		1	2	3	
Rise, in					Hole Diameter, in
Span, in					No. holes
No. Barrels					Invert Elevation, ft
Invert Elevation, ft					Height, ft
Orifice Coefficient, Co					Orifice Coefficient, Co
Length, ft					
Barrel Slope, %					
N-Value, n	0.000				
Weirs	Riser*	Weirs			Ancillary
		1	2	3	
Shape / Type					Exfiltration, in/hr
Crest Elevation, ft					8.27**
Crest Length, ft					
Angle, deg					
Weir Coefficient, Cw					

\*Routes through Culvert. \*\*Exfiltration extracted from outflow hydrograph. Rate applied to contours.

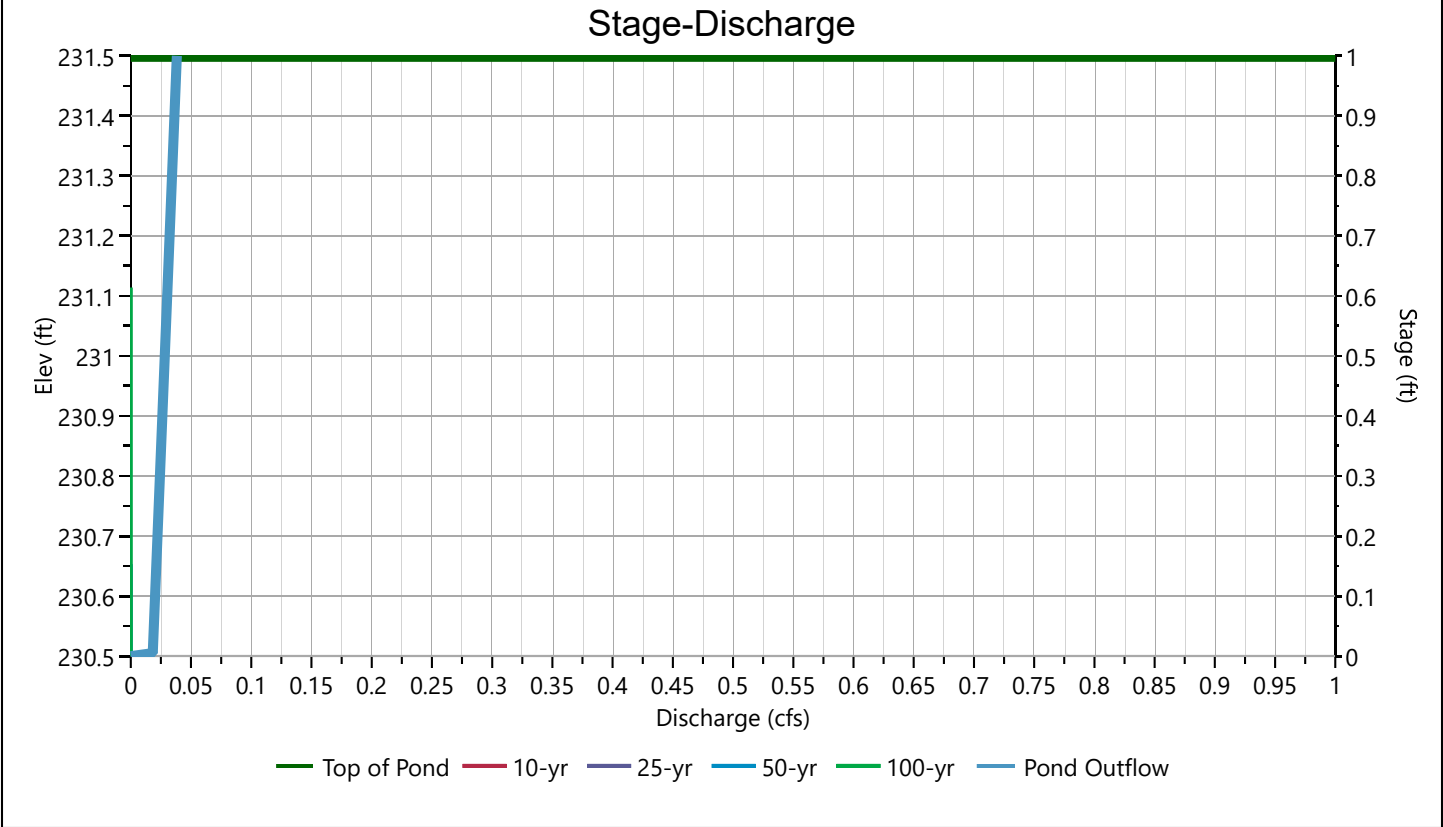

# Pond Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## Infiltration Trench


## Stage-Storage-Discharge Summary

[illegible]

Suffix key: ic = inlet control, oc = outlet control, s = submerged weir

Infiltration Trench

Pond Drawdown

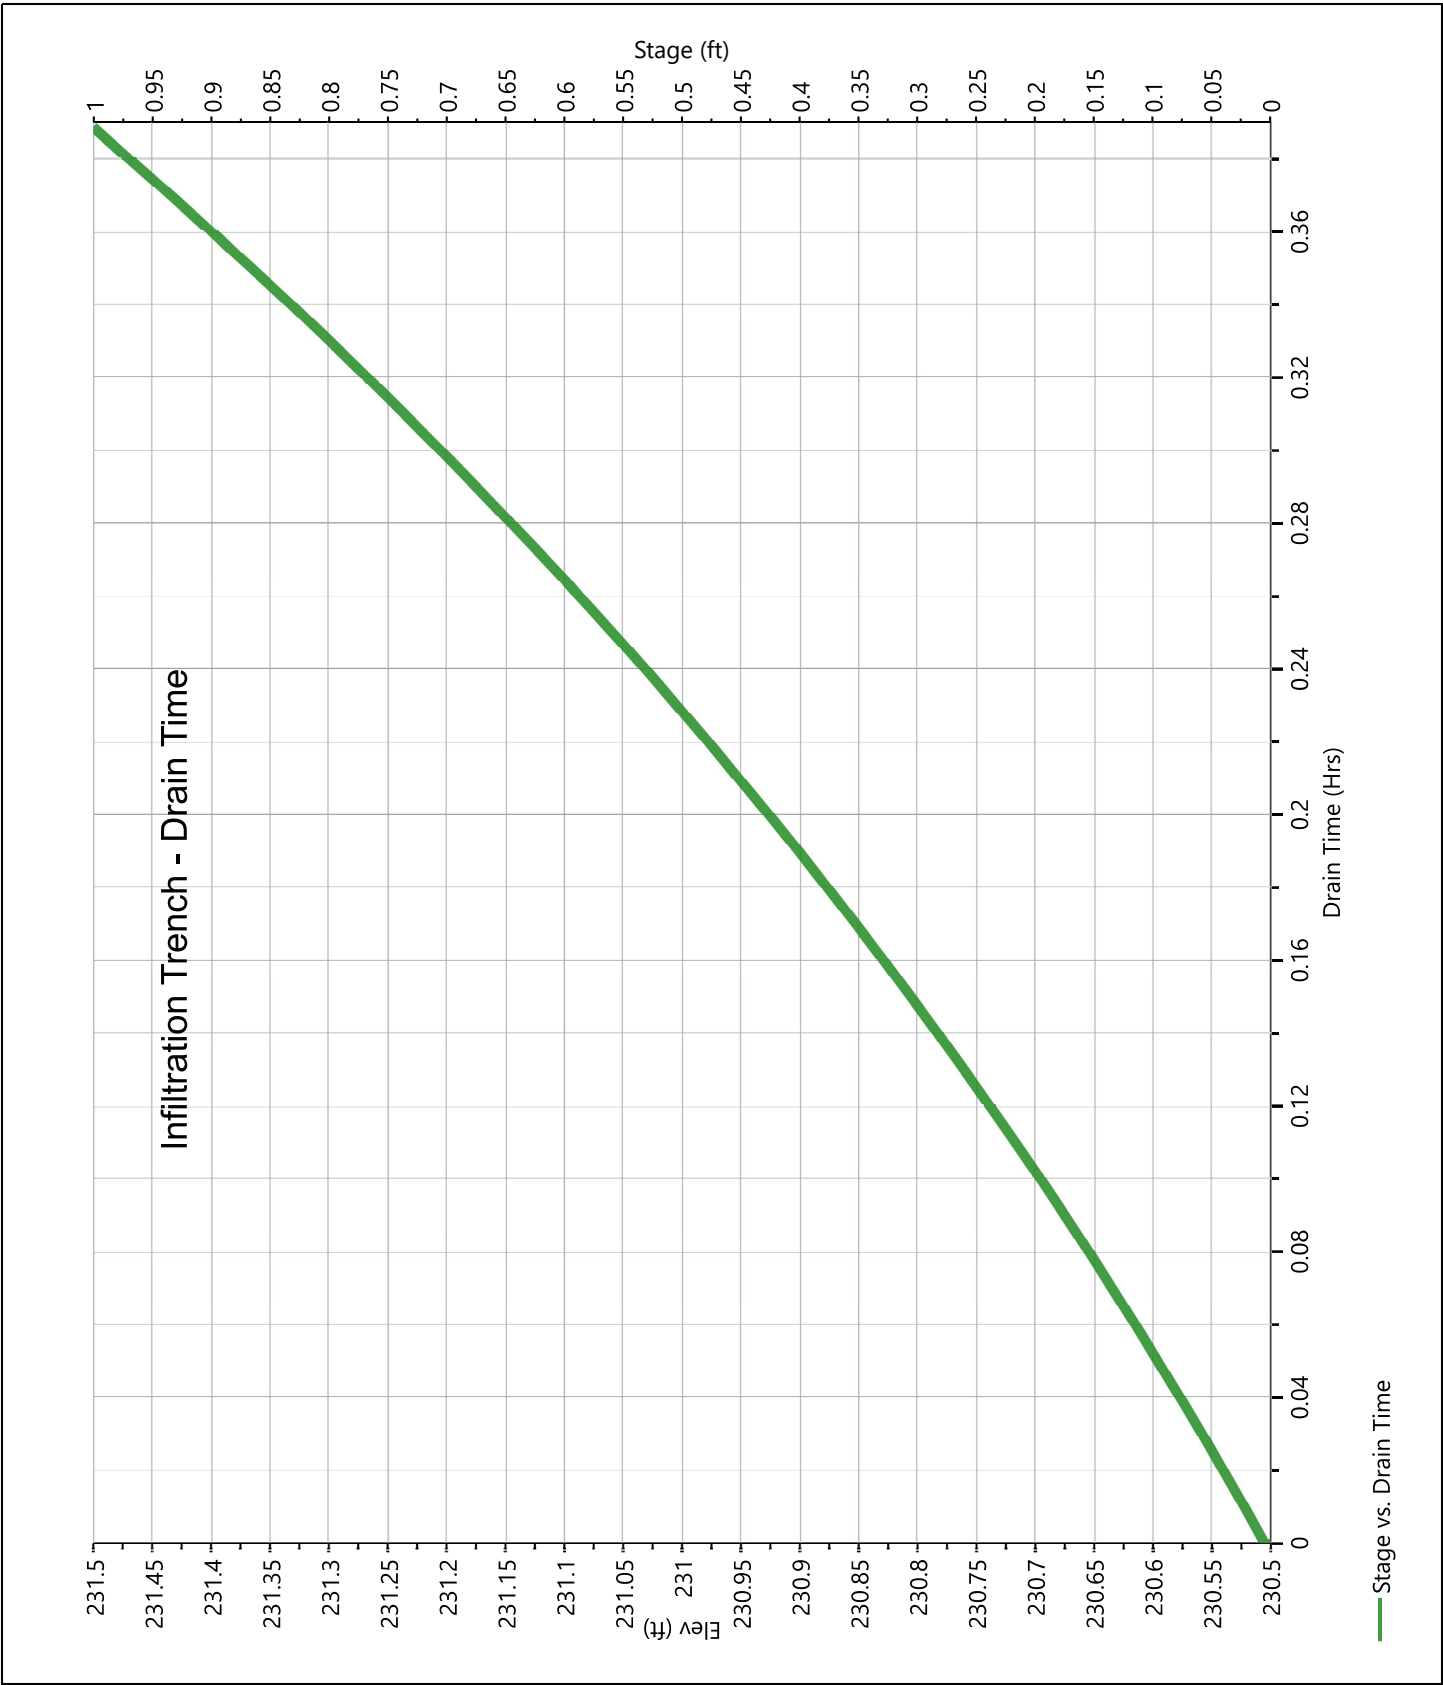

## Worksheet 2: Runoff curve number and runoff

SM-7306

Project: 95 Taylor Street By PFK Date 2/12/24Location: Littleton, MA Checked \_\_\_\_\_ Date \_\_\_\_\_Circle one: Present ☐ ☒ Developed \_\_\_\_\_ P-2B1. Runoff curve number (CN)

Soil name and hydrologic group (appendix A)	Cover description (cover type, treatment, and hydrologic condition: percent impervious: unconnected/connected impervious area ratio)	CN 1/			Area  Acres	Product of CN x Area
		Table 2-2	Fig. 2-3	Fig. 2-4		
-	Impervious	98			0.00	0.00
A	Open Space-Good Condition	39			0.03	1.30
A	Woods- Good Condition	30			0.49	14.70
A	Residential Districts - 2 acres	46			0.00	0.00
A	Gravel	76			0.00	0.00
Totals =					0.52	15.99

1/ Use only one CN source per line.

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{15.99}{0.52} = \underline{30.57} ; \quad \text{Use CN} = \underline{31}$$

2. Runoff

Frequency..... yr

Rainfall, P (24-hour)..... in

Runoff, Q..... in

(Use P and CN with table 2-1, fig. 2-1,  
or eqs. 2-3 and 2-4.)

Storm #1	Storm #2	Storm #3
2	10	100
3.1	4.5	6.5
0.10	0.00	0.16

## Worksheet 3: Time of Concentration (Tc) or travel time (Tt)

SM-7306

Project: 95 Taylor StreetBy PFKDate 2/12/2024Location: Littleton, MA

Checked \_\_\_\_\_

Date \_\_\_\_\_

Circle one: 

Present	Developed
---------	-----------

P-2B

Circle one: 

Tc	Tt
----	----

through  
subarea \_\_\_\_\_Sheet flow (Applicable to Tc only)

Segment ID

1. Surface Description (table 3-1)

2. Mannings roughness coeff., n (table 3-1)

3. Flow length, L (total L &lt;= 300 ft)

ft

4. Two-yr 24-hr rainfall, P2

in

5. Land Slope, s

ft/ft

6.  $T_t = 0.007 (nL)^{0.8} / (P2^{0.5} s^{0.4})$ 

Compute Tt hr

A-B		
WOODED		
0.6		
50		
3.1		
0.02		
0.29		

0.29

Shallow concentrated Flow

Segment ID

7. Surface Description (paved or unpaved)

8. Flow Length, L

ft

9. Watercourse slope, s

ft/ft

10. Average Velocity, V (figure 3-1)

ft/s

11.  $T_t = L / 3600V$ 

Compute Tt hr

B-C		
UNPAVED		
99		
0.03		
2.79		
0.01		

0.01

Channel flow

Segment ID

12. Cross sectional flow area, a

sf

13. Wetted perimeter, pw

ft

14. Hydraulic radius,  $r=a/wp$ 

Compute r ft

15. Channel Slope, s

ft/ft

16. Manning's roughness coeff., n

17.  $V = 1.49 r^{2/3} s^{1/2} / n$ 

Compute V ft/s

18. Flow length, L

ft

19.  $T_t = L / 3600V$ 

Compute Tt hr


0.00

20. Watershed or subarea Tc or Tt (add Tt in steps 6, 11, and 19)

hr  
min0.30  
17.9

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-2B

## Hyd. No. 12

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.000 cfs
Storm Frequency	= 2-yr	Time to Peak	= 0.00 hrs
Time Interval	= 2 min	Runoff Volume	= 0.000 cuft
Drainage Area	= 0.52 ac	Curve Number	= 31
Tc Method	= User	Time of Conc. (Tc)	= 17.9 min
Total Rainfall	= 3.18 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

**Qp = 0.00 cfs**



# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-2B

## Hyd. No. 12

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.001 cfs
Storm Frequency	= 10-yr	Time to Peak	= 23.10 hrs
Time Interval	= 2 min	Runoff Volume	= 17.5 cuft
Drainage Area	= 0.52 ac	Curve Number	= 31
Tc Method	= User	Time of Conc. (Tc)	= 17.9 min
Total Rainfall	= 4.91 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

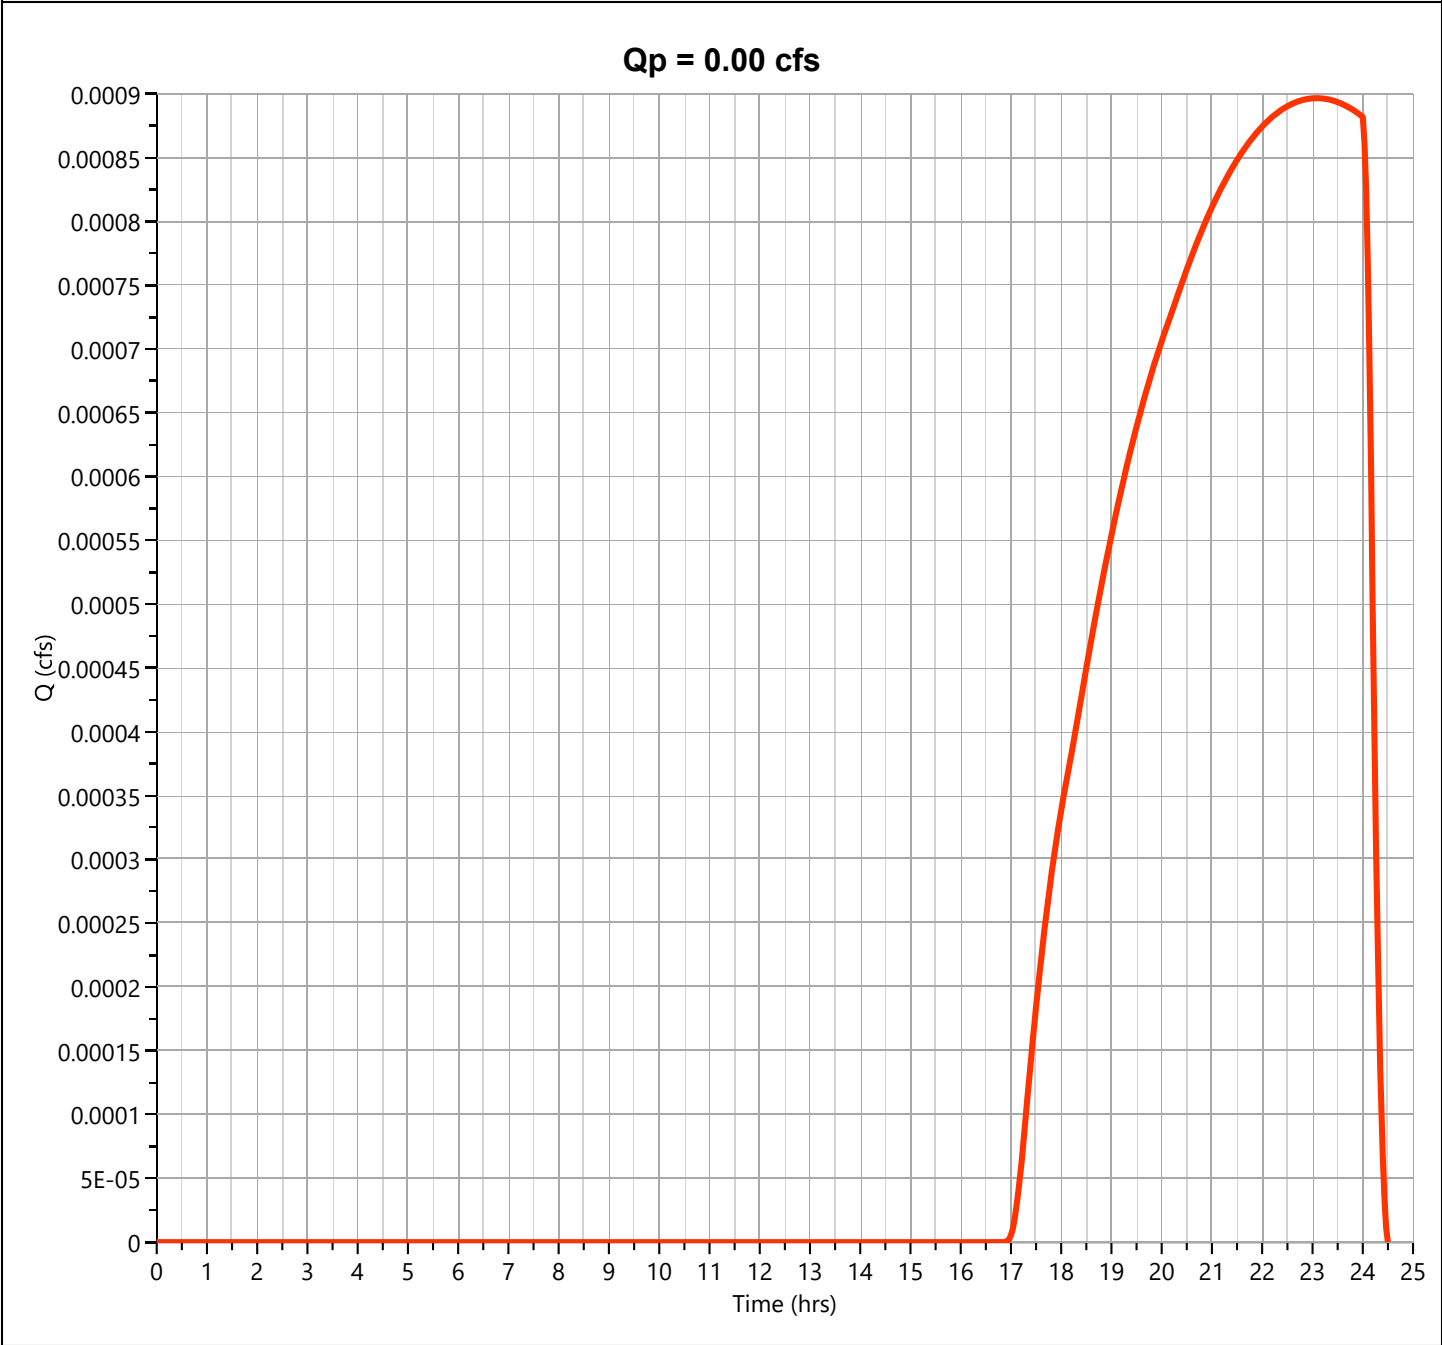

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-2B

## Hyd. No. 12

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.007 cfs
Storm Frequency	= 25-yr	Time to Peak	= 15.30 hrs
Time Interval	= 2 min	Runoff Volume	= 188 cuft
Drainage Area	= 0.52 ac	Curve Number	= 31
Tc Method	= User	Time of Conc. (Tc)	= 17.9 min
Total Rainfall	= 5.99 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

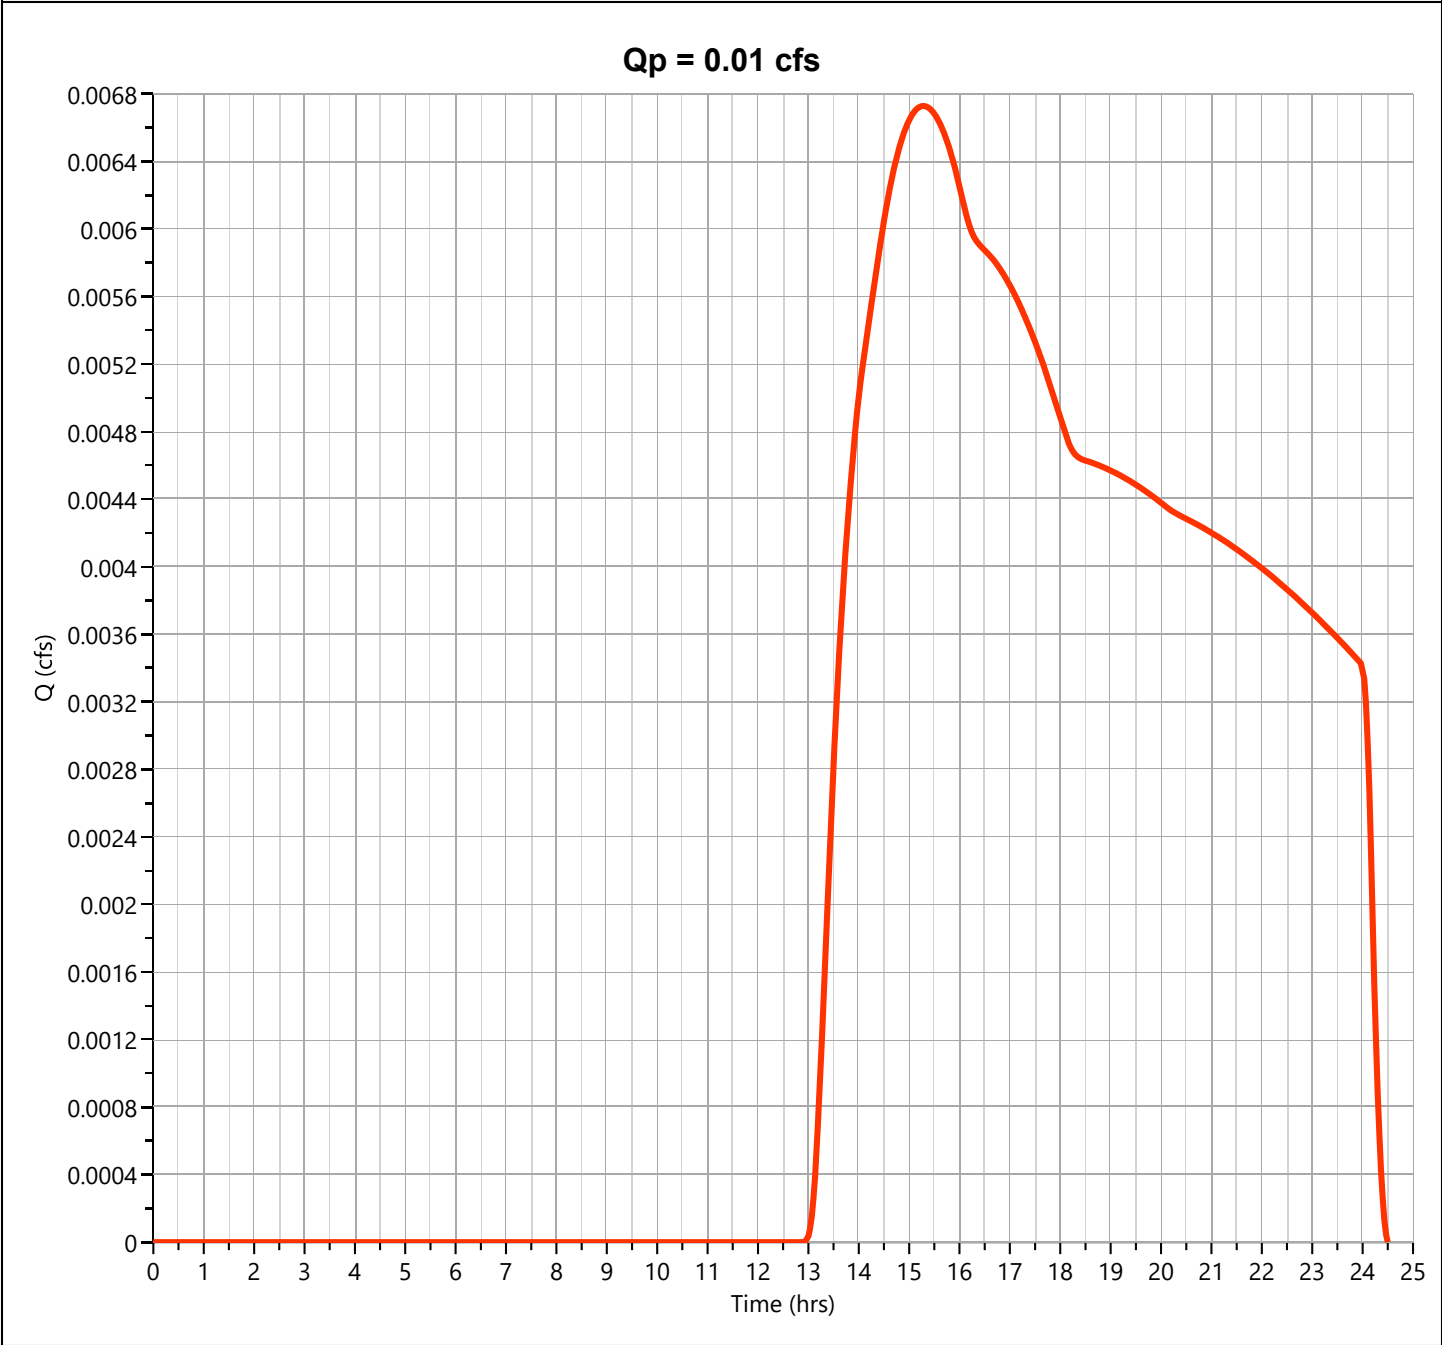

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-2B

## Hyd. No. 12

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.016 cfs
Storm Frequency	= 50-yr	Time to Peak	= 13.83 hrs
Time Interval	= 2 min	Runoff Volume	= 416 cuft
Drainage Area	= 0.52 ac	Curve Number	= 31
Tc Method	= User	Time of Conc. (Tc)	= 17.9 min
Total Rainfall	= 6.78 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

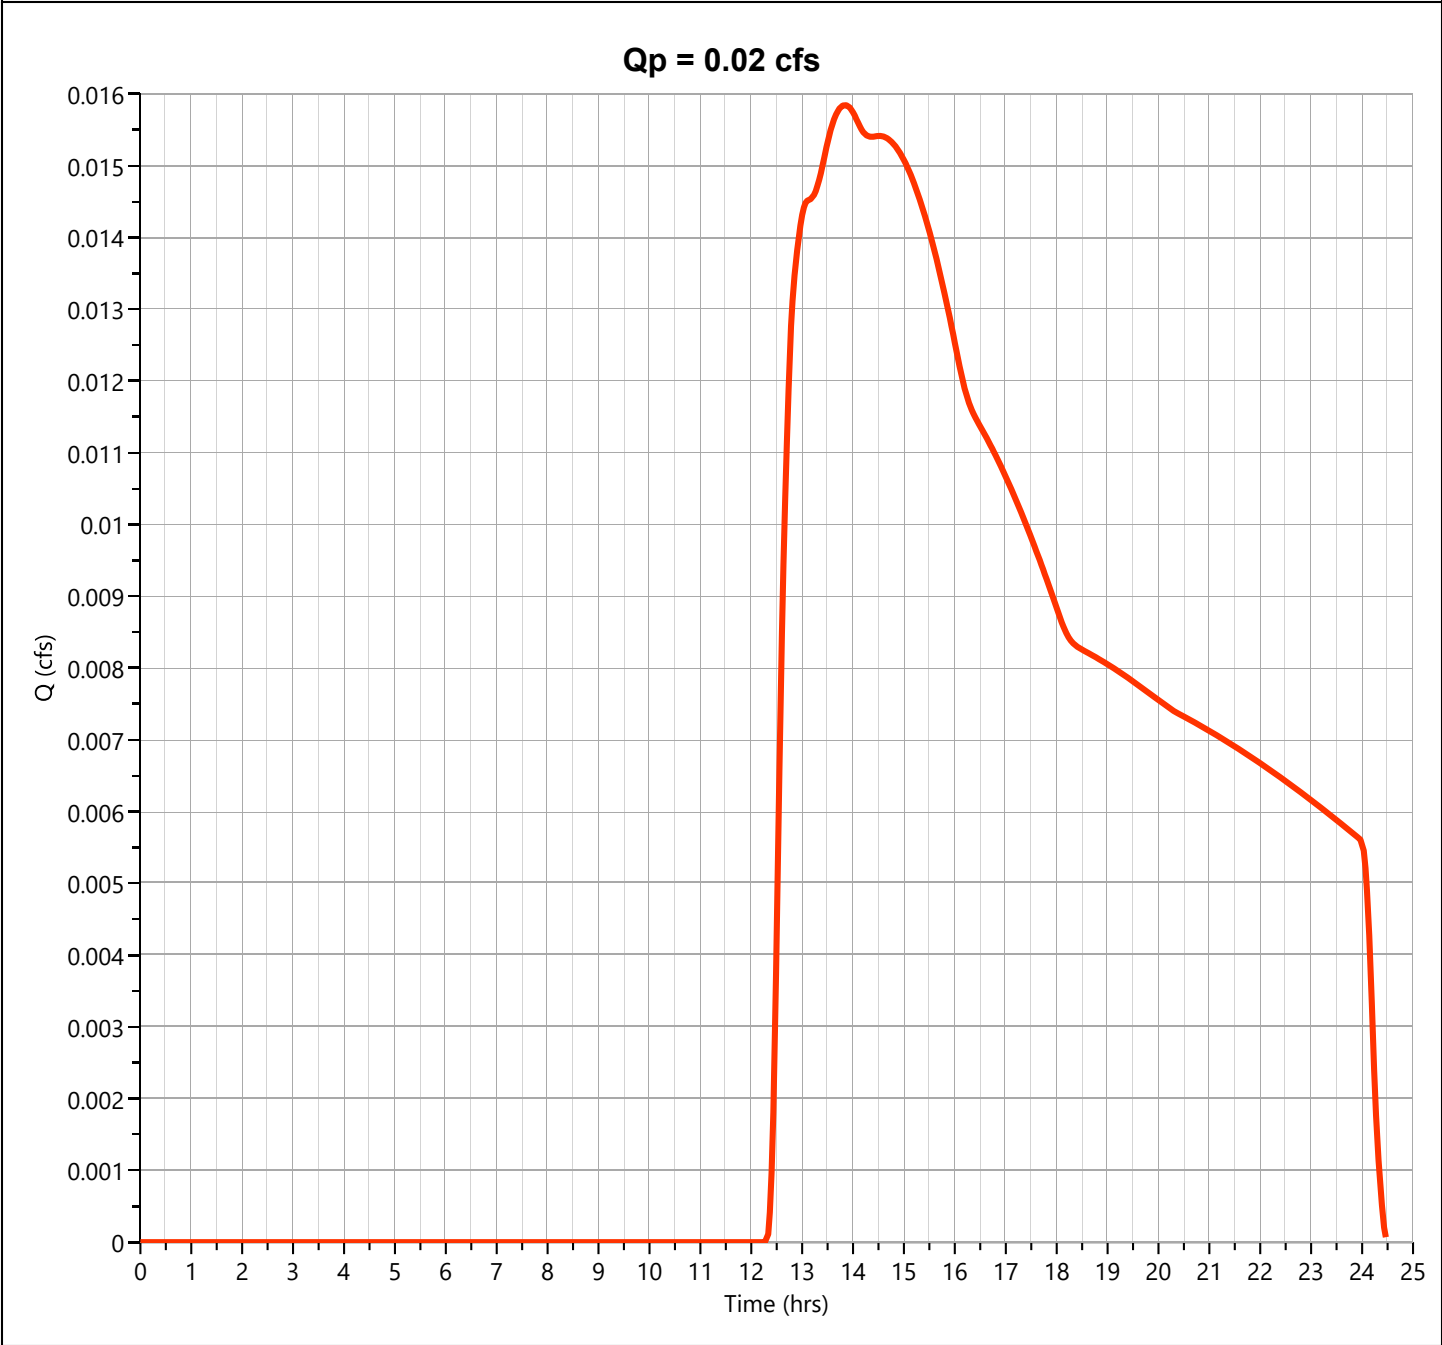

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-2B

## Hyd. No. 12

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.051 cfs
Storm Frequency	= 100-yr	Time to Peak	= 12.57 hrs
Time Interval	= 2 min	Runoff Volume	= 759 cuft
Drainage Area	= 0.52 ac	Curve Number	= 31
Tc Method	= User	Time of Conc. (Tc)	= 17.9 min
Total Rainfall	= 7.65 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

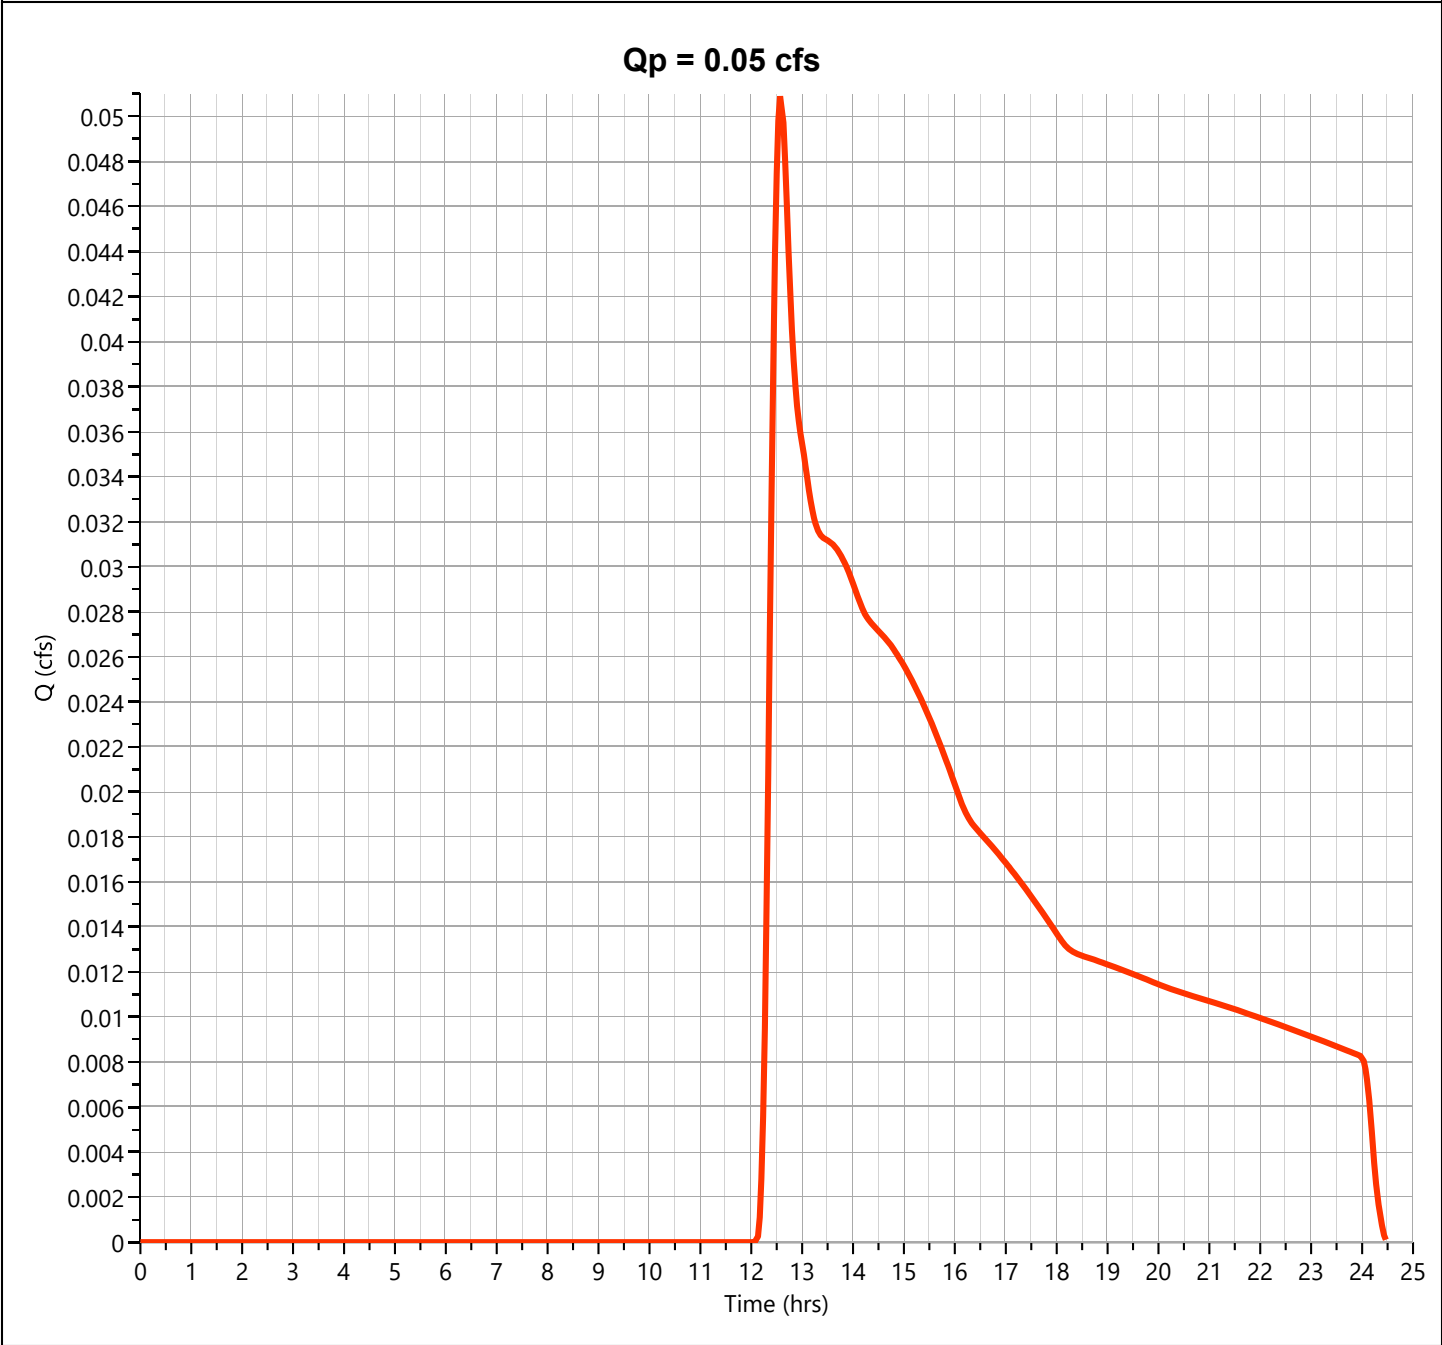

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## P-2 Total

**Hyd. No. 13**

Hydrograph Type	= Junction	Peak Flow	= 0.000 cfs
Storm Frequency	= 2-yr	Time to Peak	= 0.00 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrographs	= 11, 12	Total Contrib. Area	= 0.52 ac

**Qp = 0.00 cfs**

# Hydrograph Report


Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## P-2 Total

Hyd. No. 13

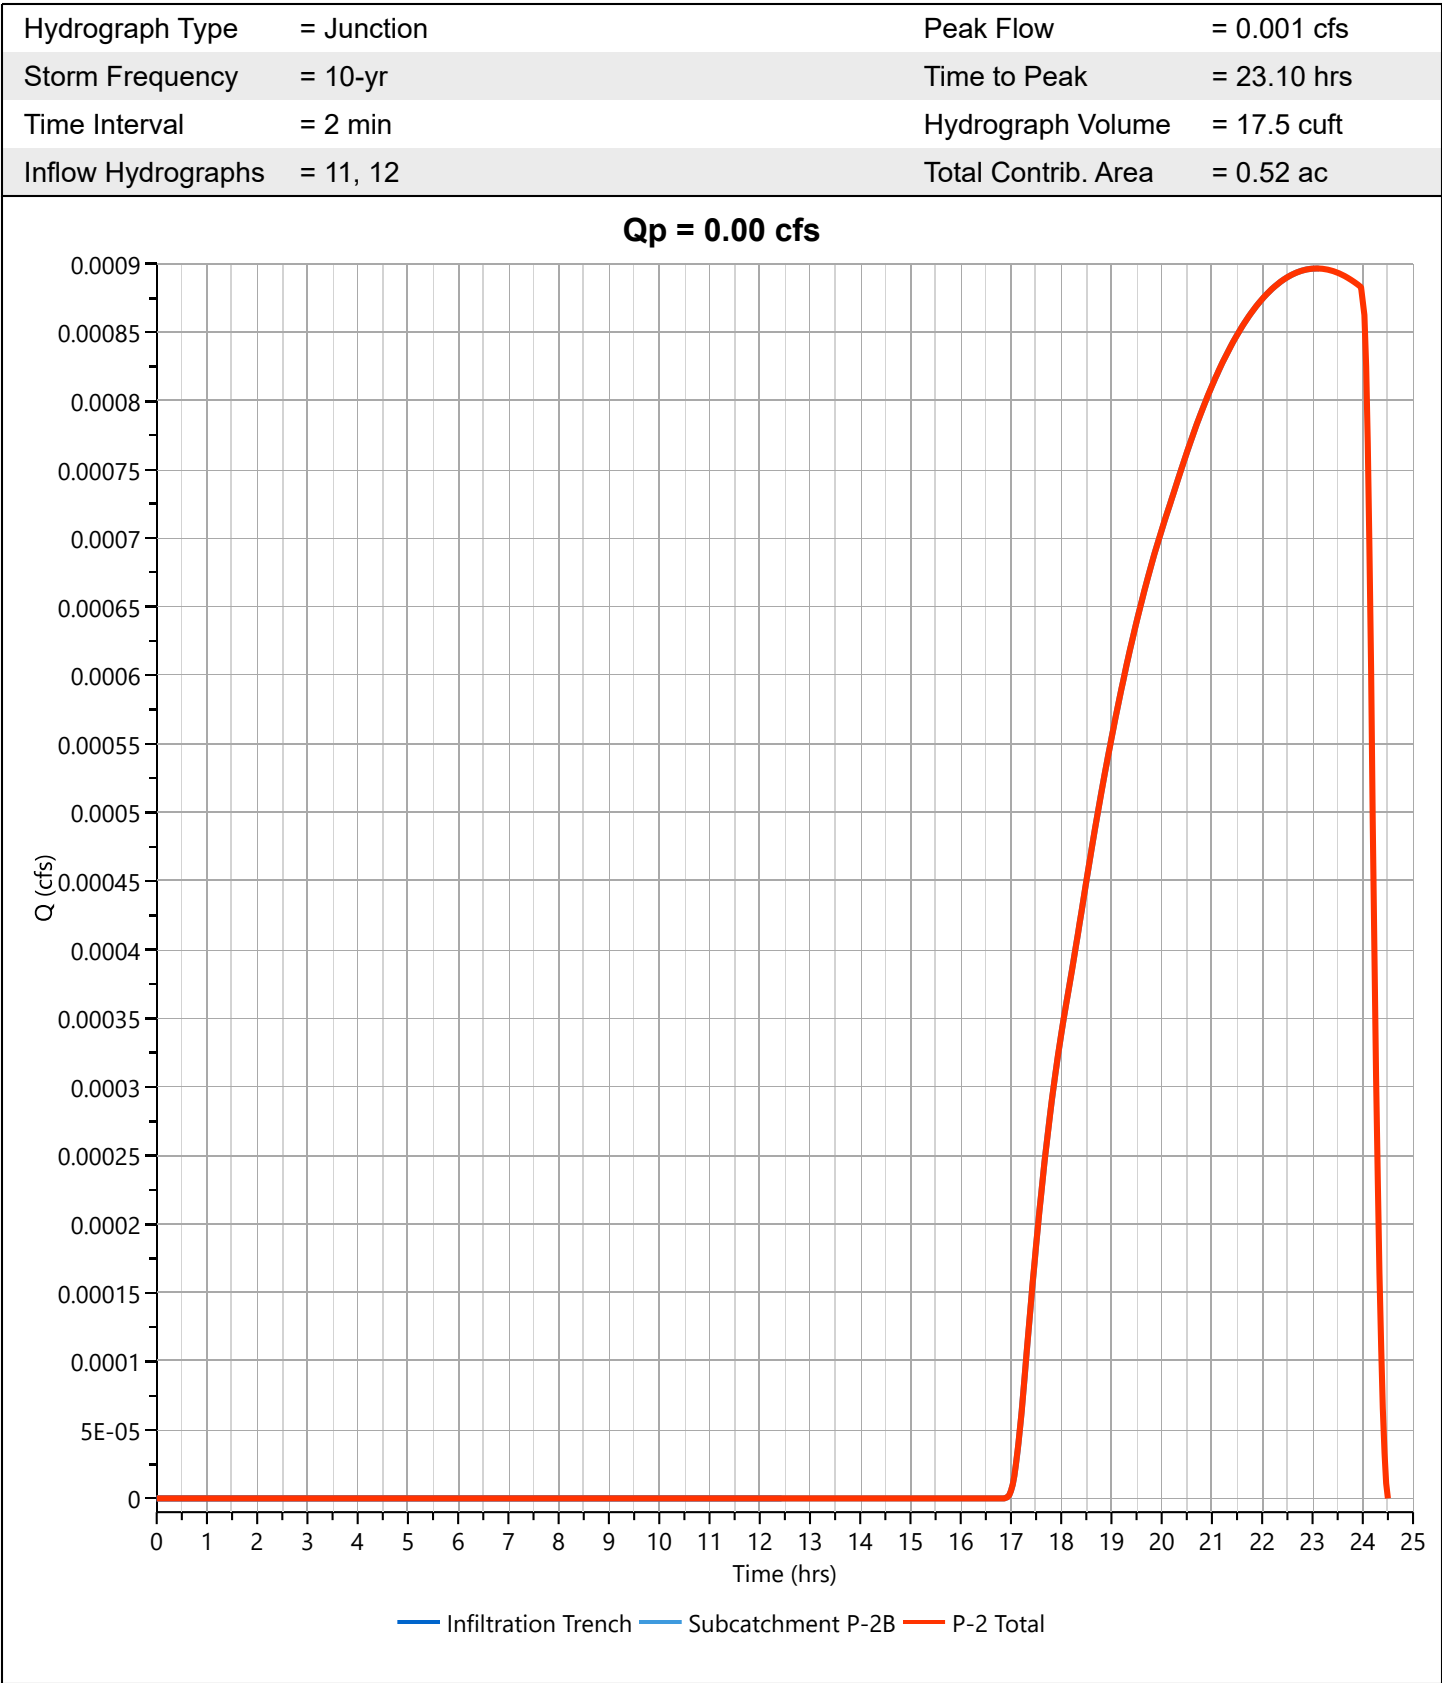

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## P-2 Total

Hyd. No. 13

Hydrograph Type	= Junction	Peak Flow	= 0.007 cfs
Storm Frequency	= 25-yr	Time to Peak	= 15.30 hrs
Time Interval	= 2 min	Hydrograph Volume	= 188 cuft
Inflow Hydrographs	= 11, 12	Total Contrib. Area	= 0.52 ac

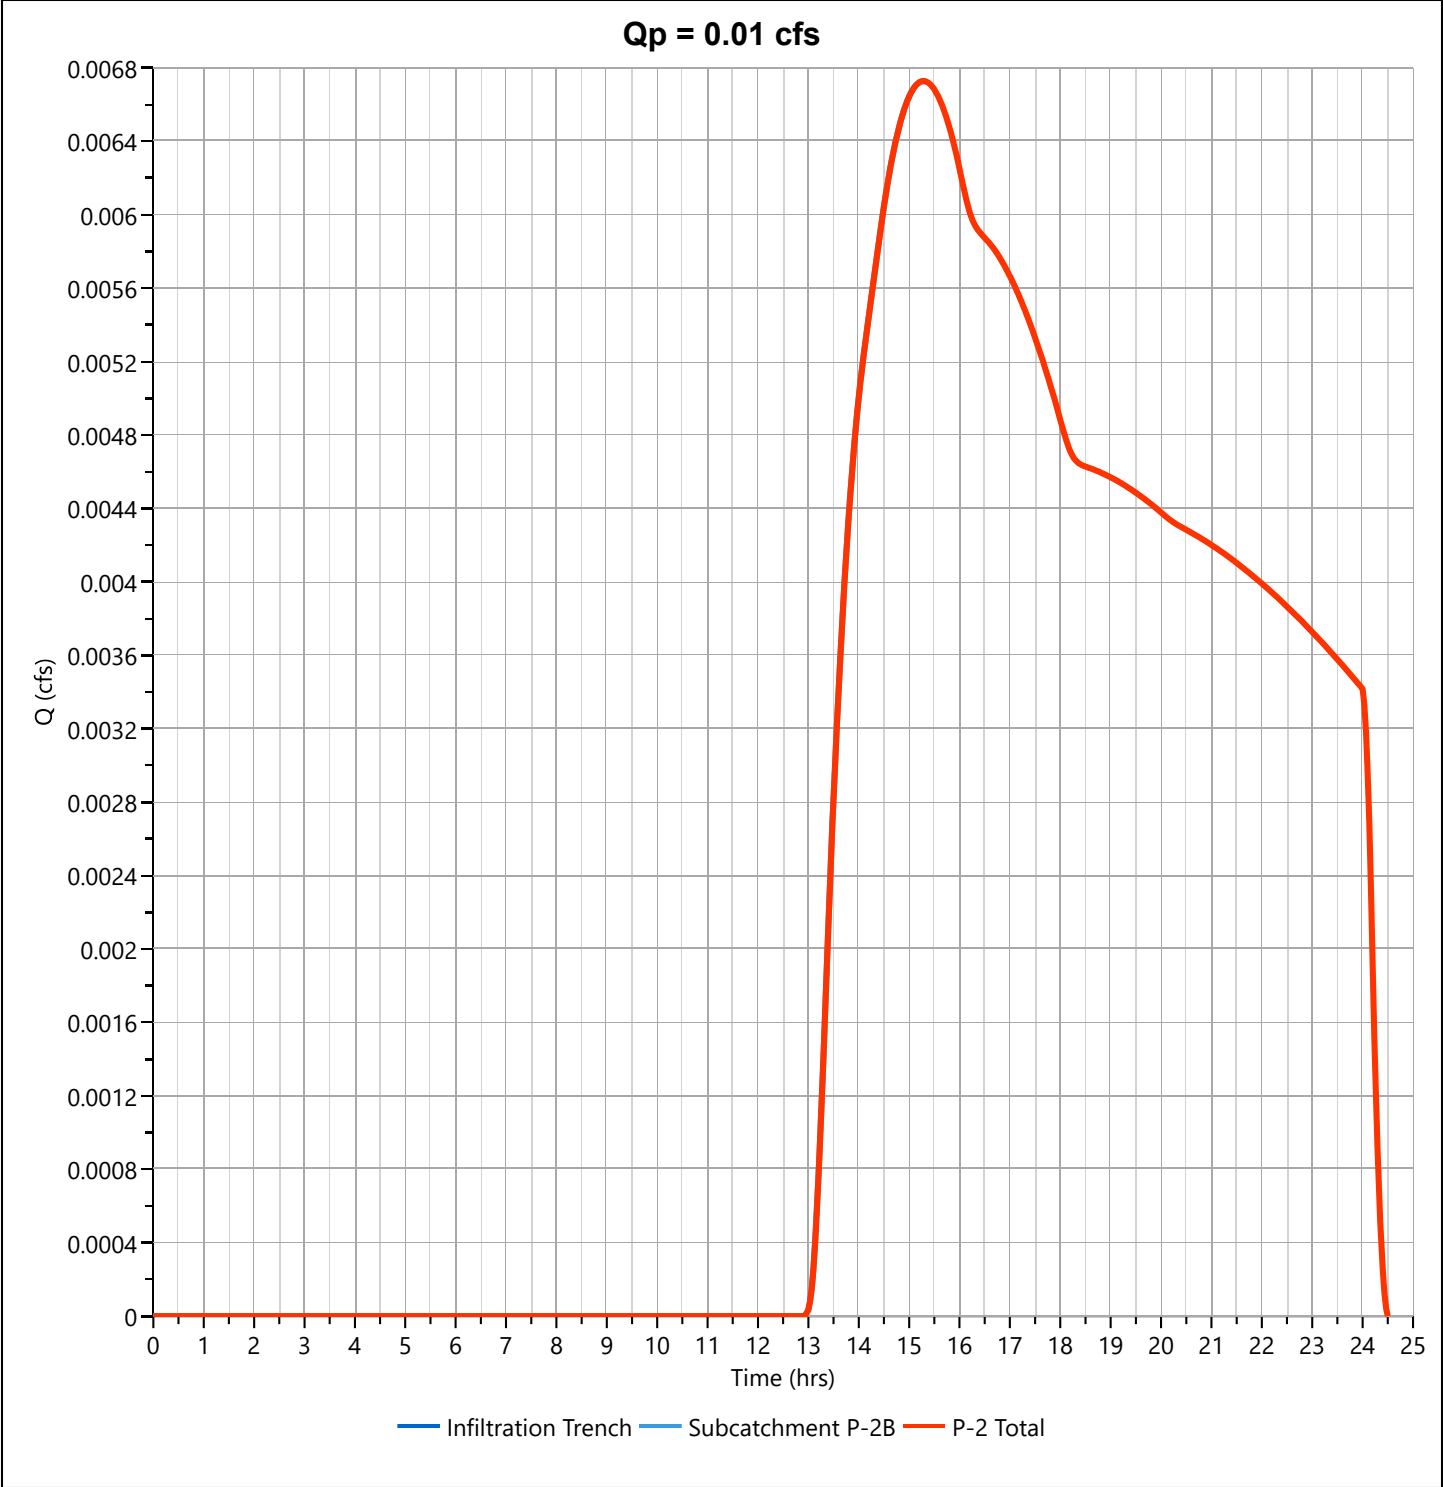

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## P-2 Total

Hyd. No. 13

Hydrograph Type	= Junction	Peak Flow	= 0.016 cfs
Storm Frequency	= 50-yr	Time to Peak	= 13.83 hrs
Time Interval	= 2 min	Hydrograph Volume	= 416 cuft
Inflow Hydrographs	= 11, 12	Total Contrib. Area	= 0.52 ac

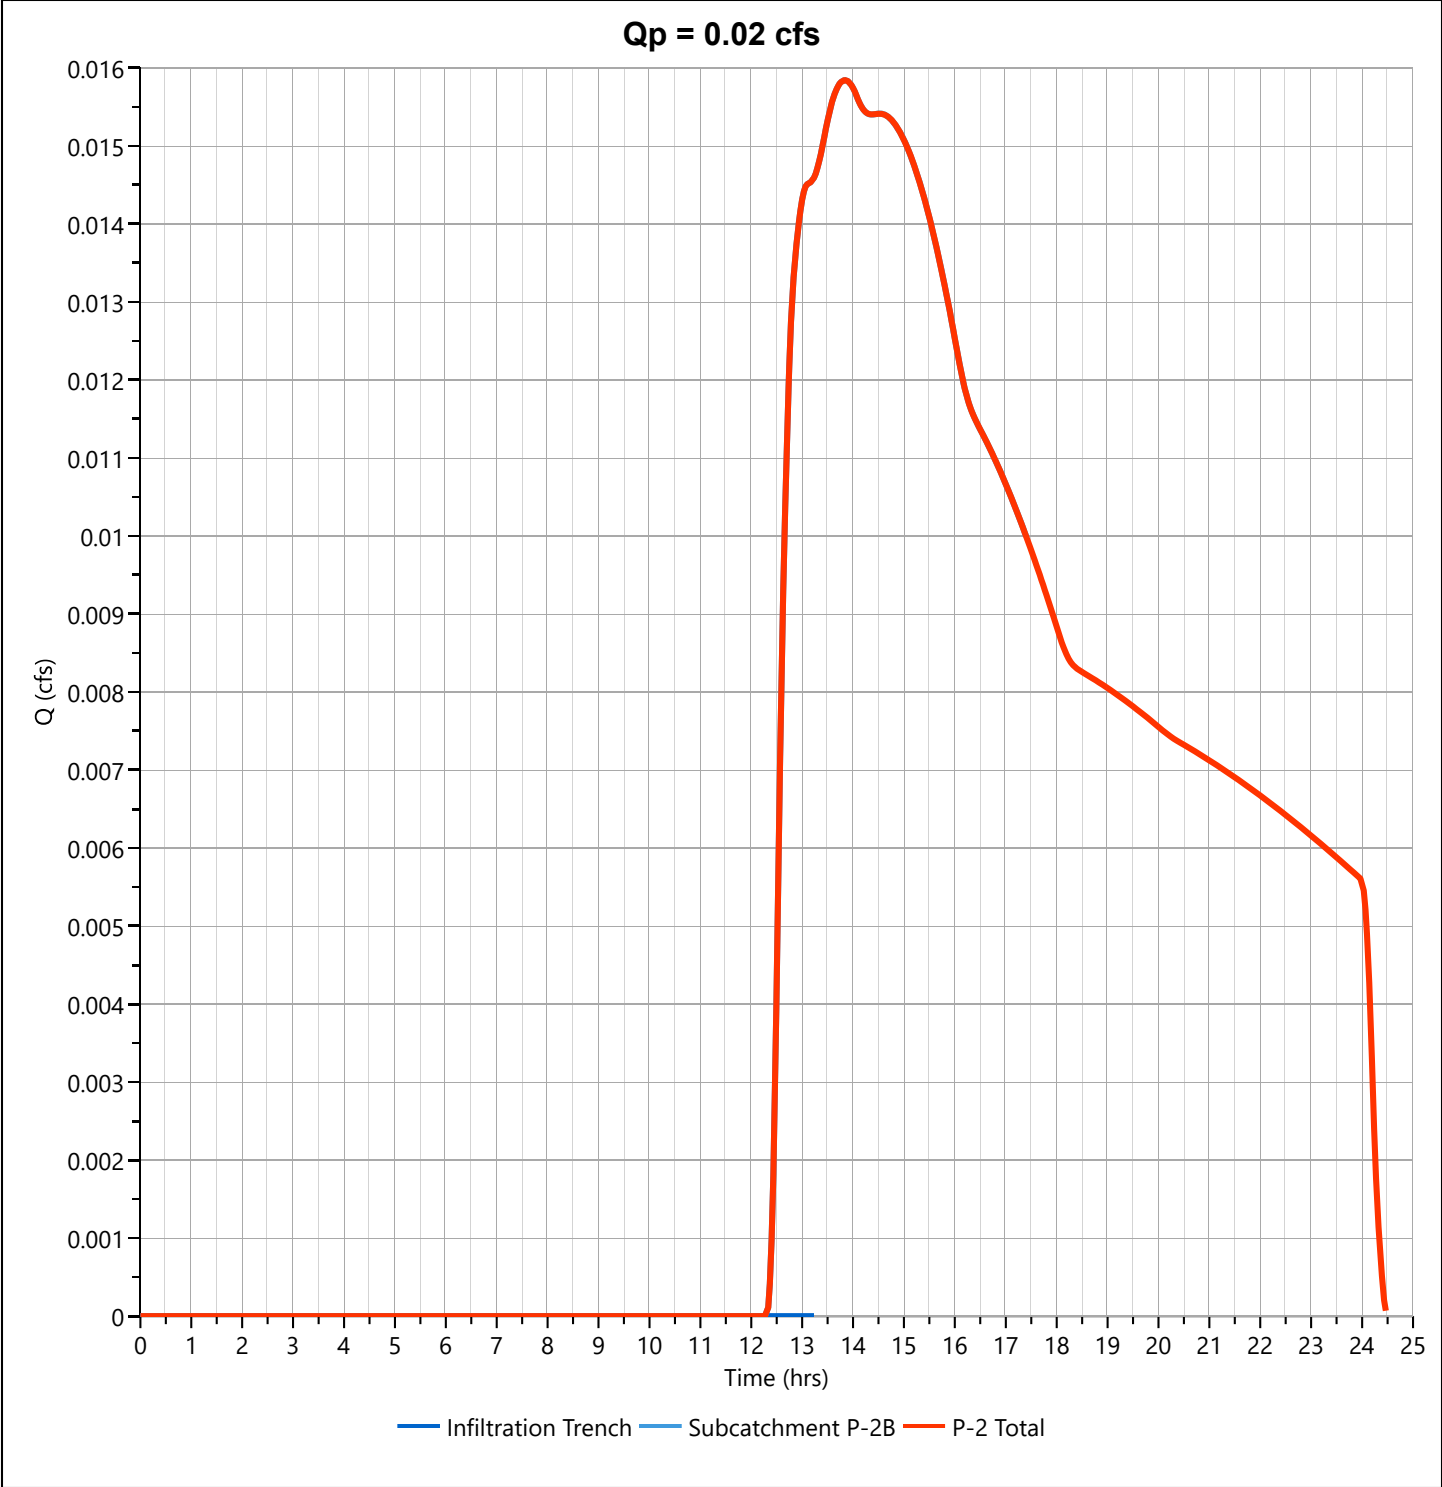



# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## P-2 Total

Hyd. No. 13

Hydrograph Type	= Junction	Peak Flow	= 0.051 cfs
Storm Frequency	= 100-yr	Time to Peak	= 12.57 hrs
Time Interval	= 2 min	Hydrograph Volume	= 759 cuft
Inflow Hydrographs	= 11, 12	Total Contrib. Area	= 0.52 ac

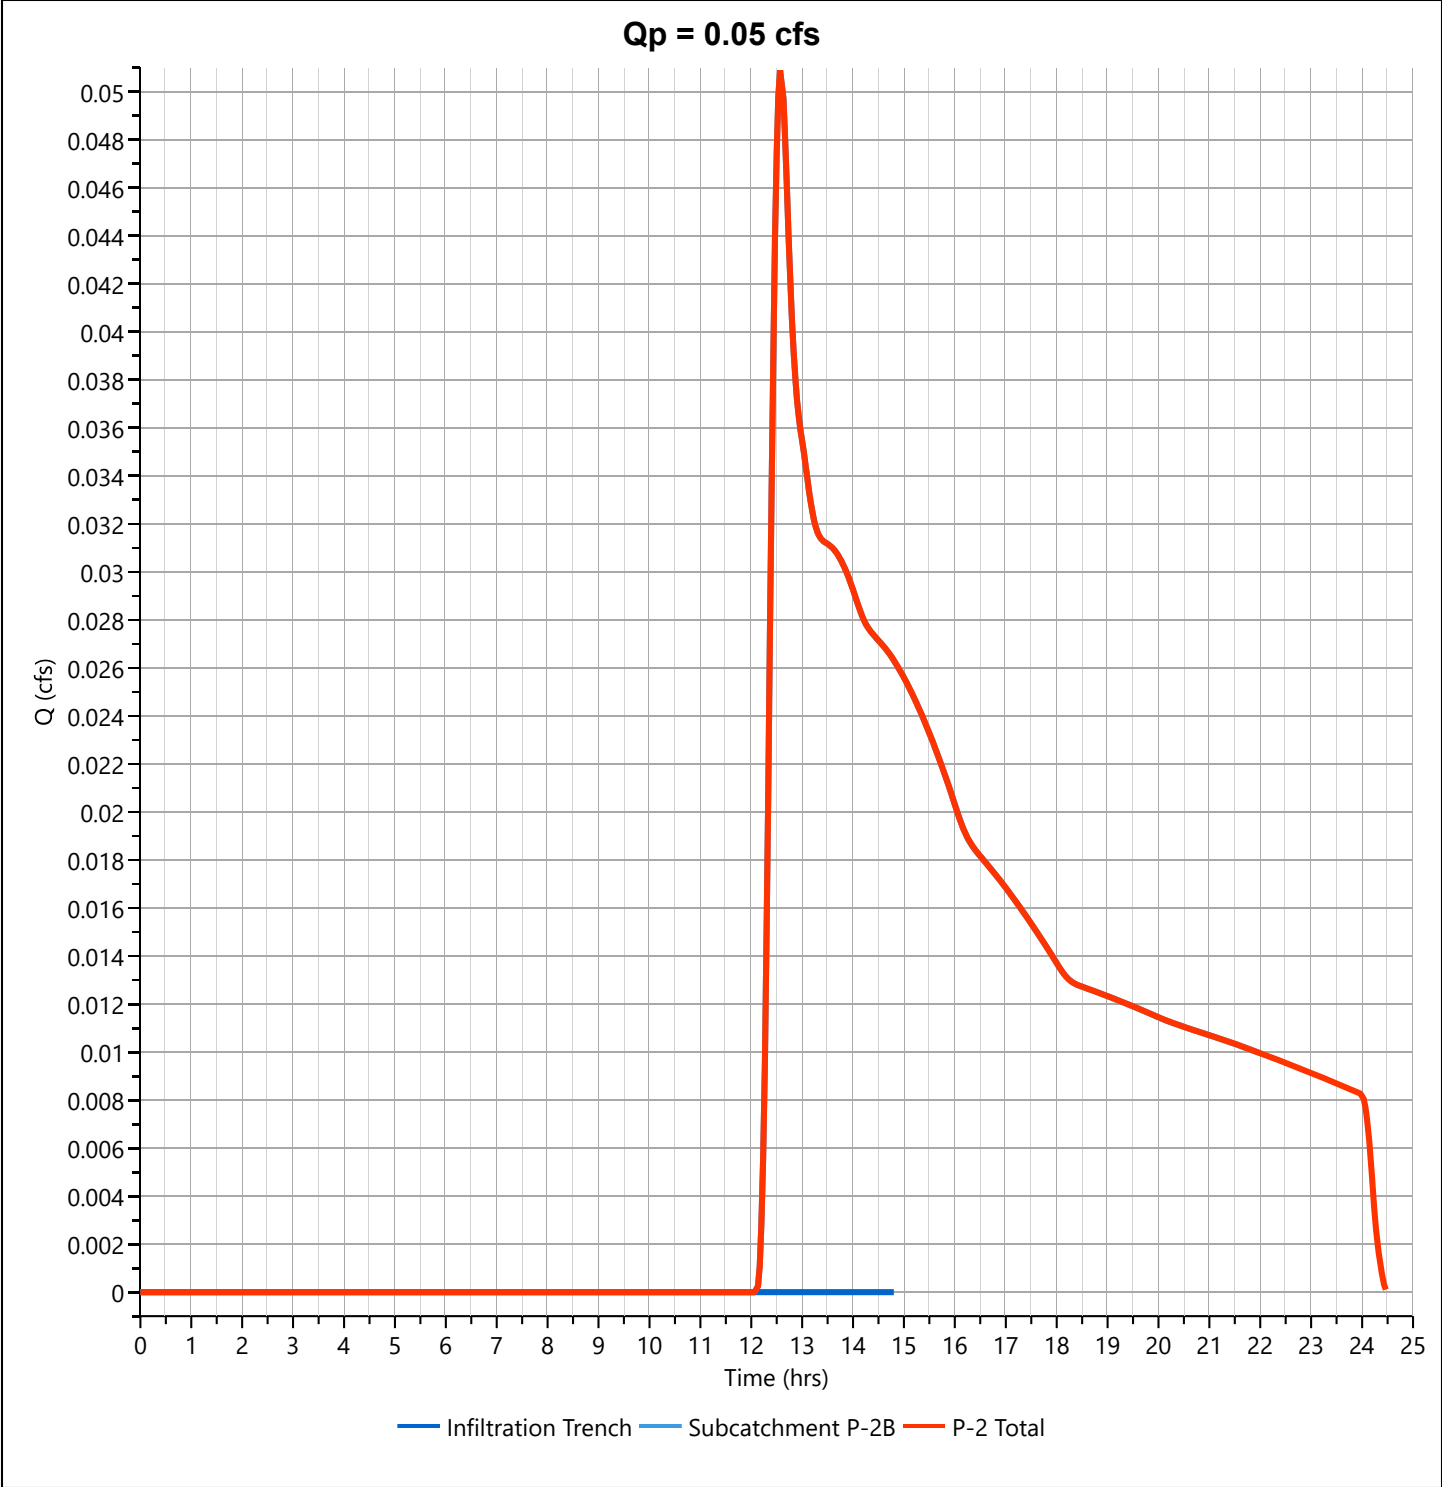

## Worksheet 2: Runoff curve number and runoff

SM-7306

Project: 95 Taylor Street By PFK Date 2/12/24Location: Littleton, MA Checked \_\_\_\_\_ Date \_\_\_\_\_Circle one: Present ☒ Developed \_\_\_\_\_ P-3 \_\_\_\_\_1. Runoff curve number (CN)

Soil name and hydrologic group (appendix A)	Cover description (cover type, treatment, and hydrologic condition: percent impervious: unconnected/connected impervious area ratio)	CN 1/			Area	Product of CN x Area
		Table 2-2	Fig. 2-3	Fig. 2-4	Acres	
-	Impervious	98			0.00	0.00
A	Open Space-Good Condition	39			0.40	15.57
A	Woods- Good Condition	30			1.20	35.90
A	Residential Districts - 2 acres	46			0.00	0.00
A	Gravel	76			0.00	0.00
Totals =					1.60	51.46

1/ Use only one CN source per line.

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{51.46}{1.60} = 32.25 ; \quad \text{Use CN} = \boxed{32}$$

2. Runoff

Frequency..... yr

Rainfall, P (24-hour)..... in

Runoff, Q..... in

(Use P and CN with table 2-1, fig. 2-1, or eqs. 2-3 and 2-4.)

Storm #1	Storm #2	Storm #3
2	10	100
3.1	4.5	6.5
0.06	0.00	0.23

## Worksheet 3: Time of Concentration (Tc) or travel time (Tt)

SM-7306

Project: 95 Taylor StreetBy PFKDate 2/12/2024Location: Littleton, MA

Checked \_\_\_\_\_

Date \_\_\_\_\_

Circle one: 

Present	Developed
---------	-----------

P-3

Circle one: 

Tc	Tt
----	----

through  
subarea \_\_\_\_\_Sheet flow (Applicable to Tc only)

Segment ID

1. Surface Description (table 3-1)

2. Mannings roughness coeff., n (table 3-1)

3. Flow length, L (total L &lt;= 300 ft)

ft

4. Two-yr 24-hr rainfall, P2

in

5. Land Slope, s

ft/ft

6.  $Tt = 0.007 (nL)^{0.8} / (P2^{0.5} s^{0.4})$ 

Compute Tt hr

A-B		
WOODS		
0.6		
50		
3.1		
0.02		
0.29		

0.29

Shallow concentrated Flow

Segment ID

7. Surface Description (paved or unpaved)

8. Flow Length, L

ft

9. Watercourse slope, s

ft/ft

10. Average Velocity, V (figure 3-1)

ft/s

11.  $Tt = L / 3600V$ 

Compute Tt hr

B-C		
UNPAVED		
259		
0.02		
2.28		
0.03		

0.03

Channel flow

Segment ID

12. Cross sectional flow area, a

sf

13. Wetted perimeter, pw

ft

14. Hydraulic radius,  $r=a/wp$ 

Compute r ft

15. Channel Slope, s

ft/ft

16. Manning's roughness coeff., n

17.  $V = 1.49 r^{2/3} s^{1/2} / n$ 

Compute V ft/s

18. Flow length, L

ft

19.  $Tt = L / 3600V$ 

Compute Tt hr


0.00

20. Watershed or subarea Tc or Tt (add Tt in steps 6, 11, and 19)

hr  
min0.32  
19.2

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-3

## Hyd. No. 15

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.000 cfs
Storm Frequency	= 2-yr	Time to Peak	= 0.00 hrs
Time Interval	= 2 min	Runoff Volume	= 0.000 cuft
Drainage Area	= 1.6 ac	Curve Number	= 32
Tc Method	= User	Time of Conc. (Tc)	= 19.2 min
Total Rainfall	= 3.18 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

**Qp = 0.00 cfs**

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-3

## Hyd. No. 15

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.004 cfs
Storm Frequency	= 10-yr	Time to Peak	= 21.73 hrs
Time Interval	= 2 min	Runoff Volume	= 115 cuft
Drainage Area	= 1.6 ac	Curve Number	= 32
Tc Method	= User	Time of Conc. (Tc)	= 19.2 min
Total Rainfall	= 4.91 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

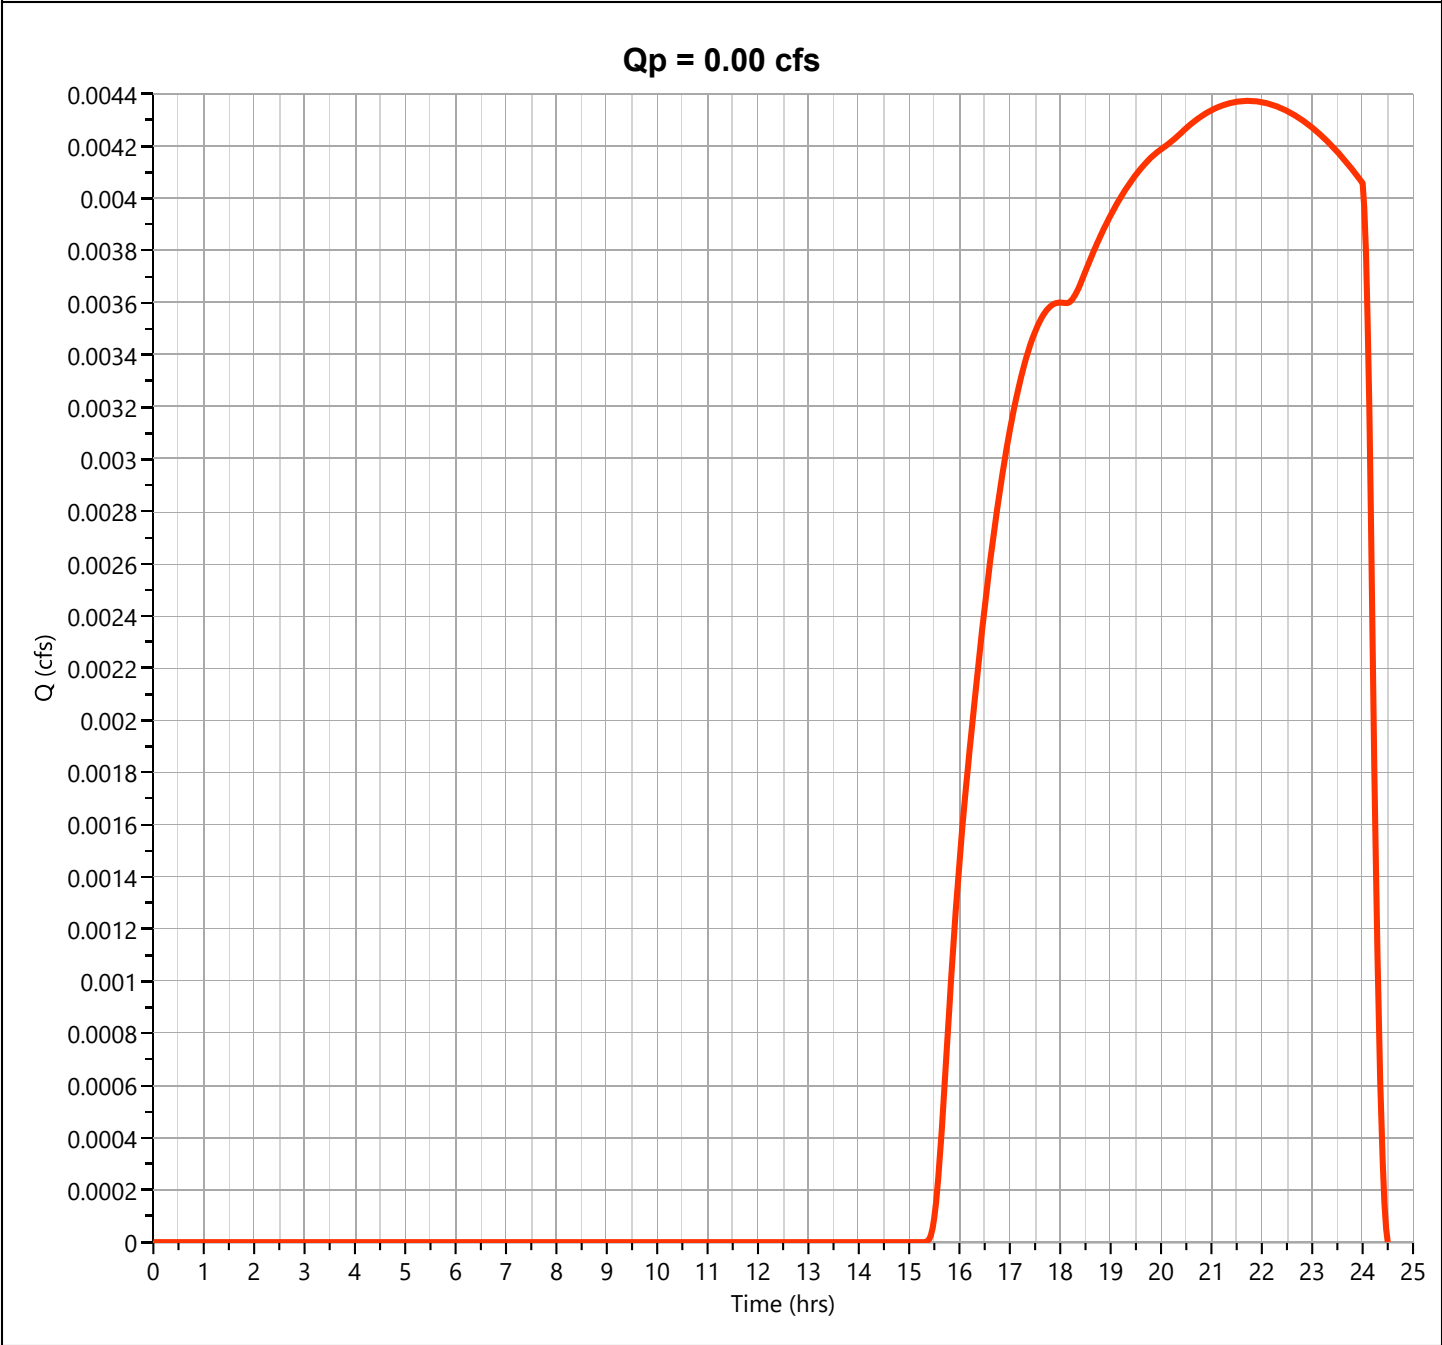

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-3

## Hyd. No. 15

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.028 cfs
Storm Frequency	= 25-yr	Time to Peak	= 14.97 hrs
Time Interval	= 2 min	Runoff Volume	= 765 cuft
Drainage Area	= 1.6 ac	Curve Number	= 32
Tc Method	= User	Time of Conc. (Tc)	= 19.2 min
Total Rainfall	= 5.99 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

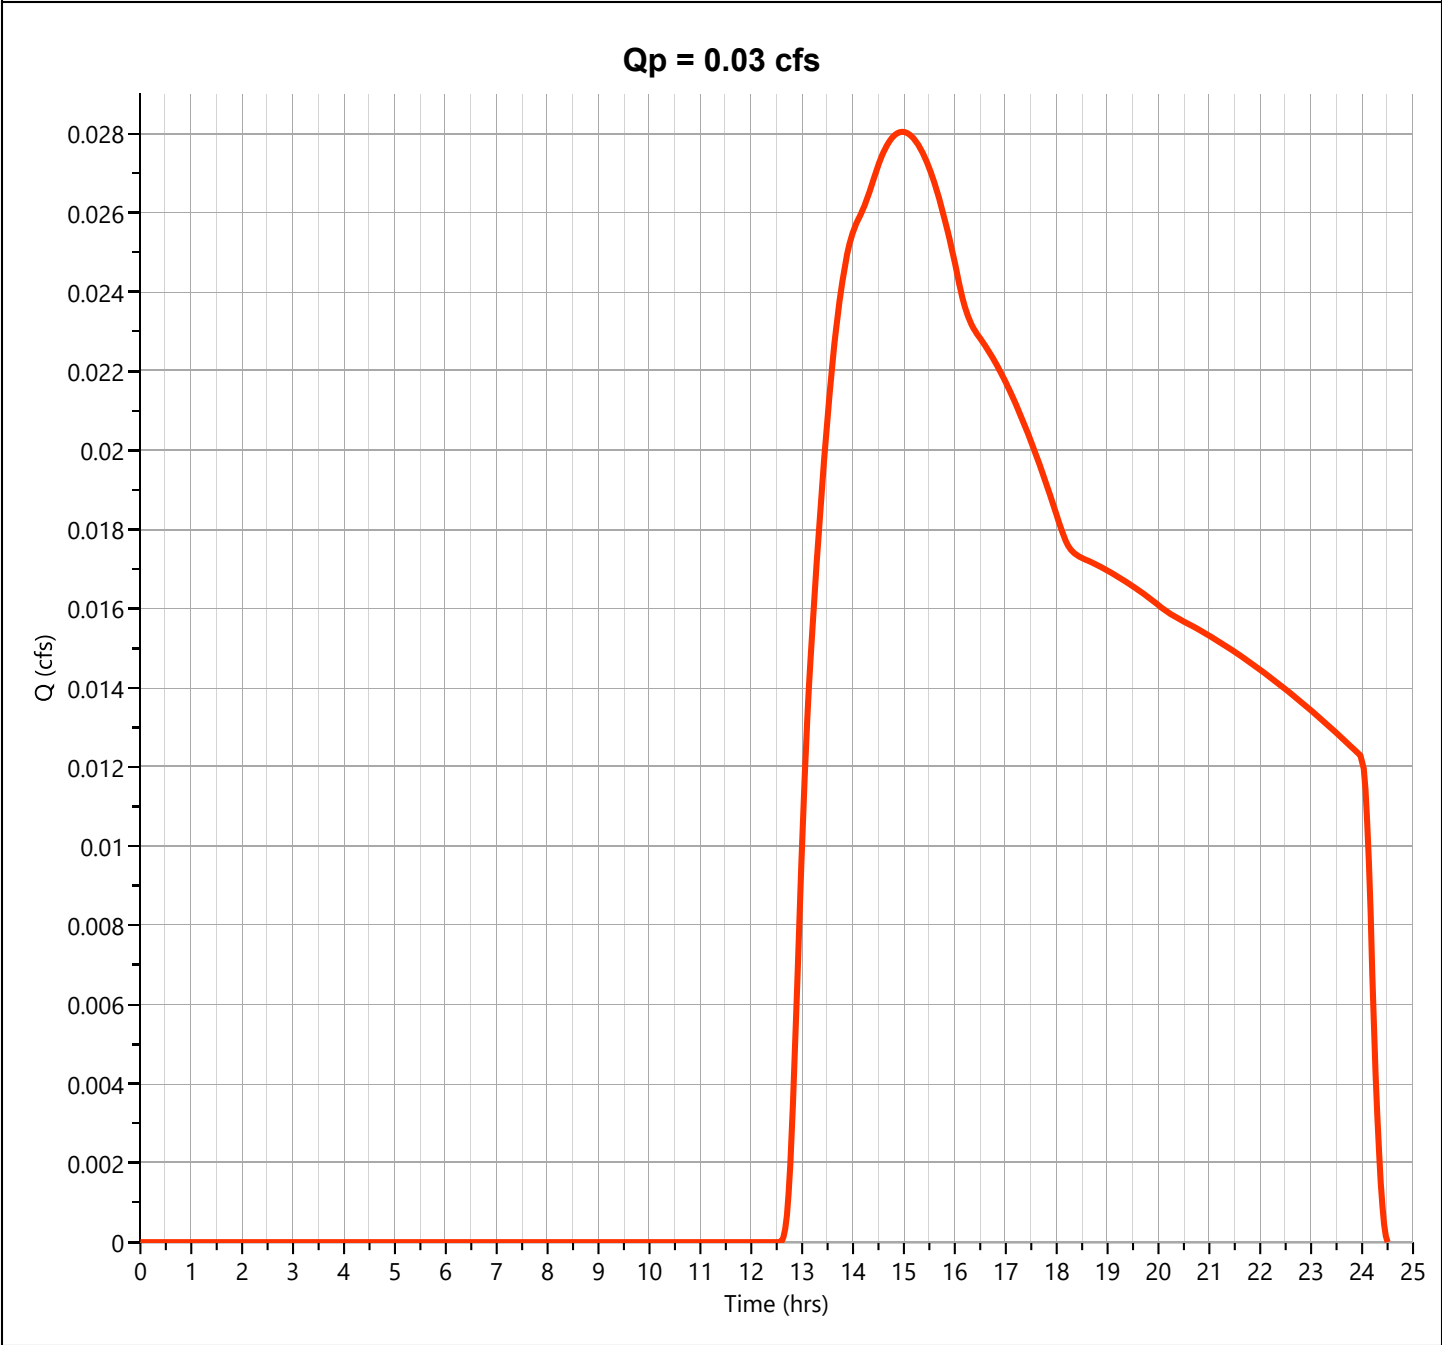

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-3

## Hyd. No. 15

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.068 cfs
Storm Frequency	= 50-yr	Time to Peak	= 12.73 hrs
Time Interval	= 2 min	Runoff Volume	= 1,563 cuft
Drainage Area	= 1.6 ac	Curve Number	= 32
Tc Method	= User	Time of Conc. (Tc)	= 19.2 min
Total Rainfall	= 6.78 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

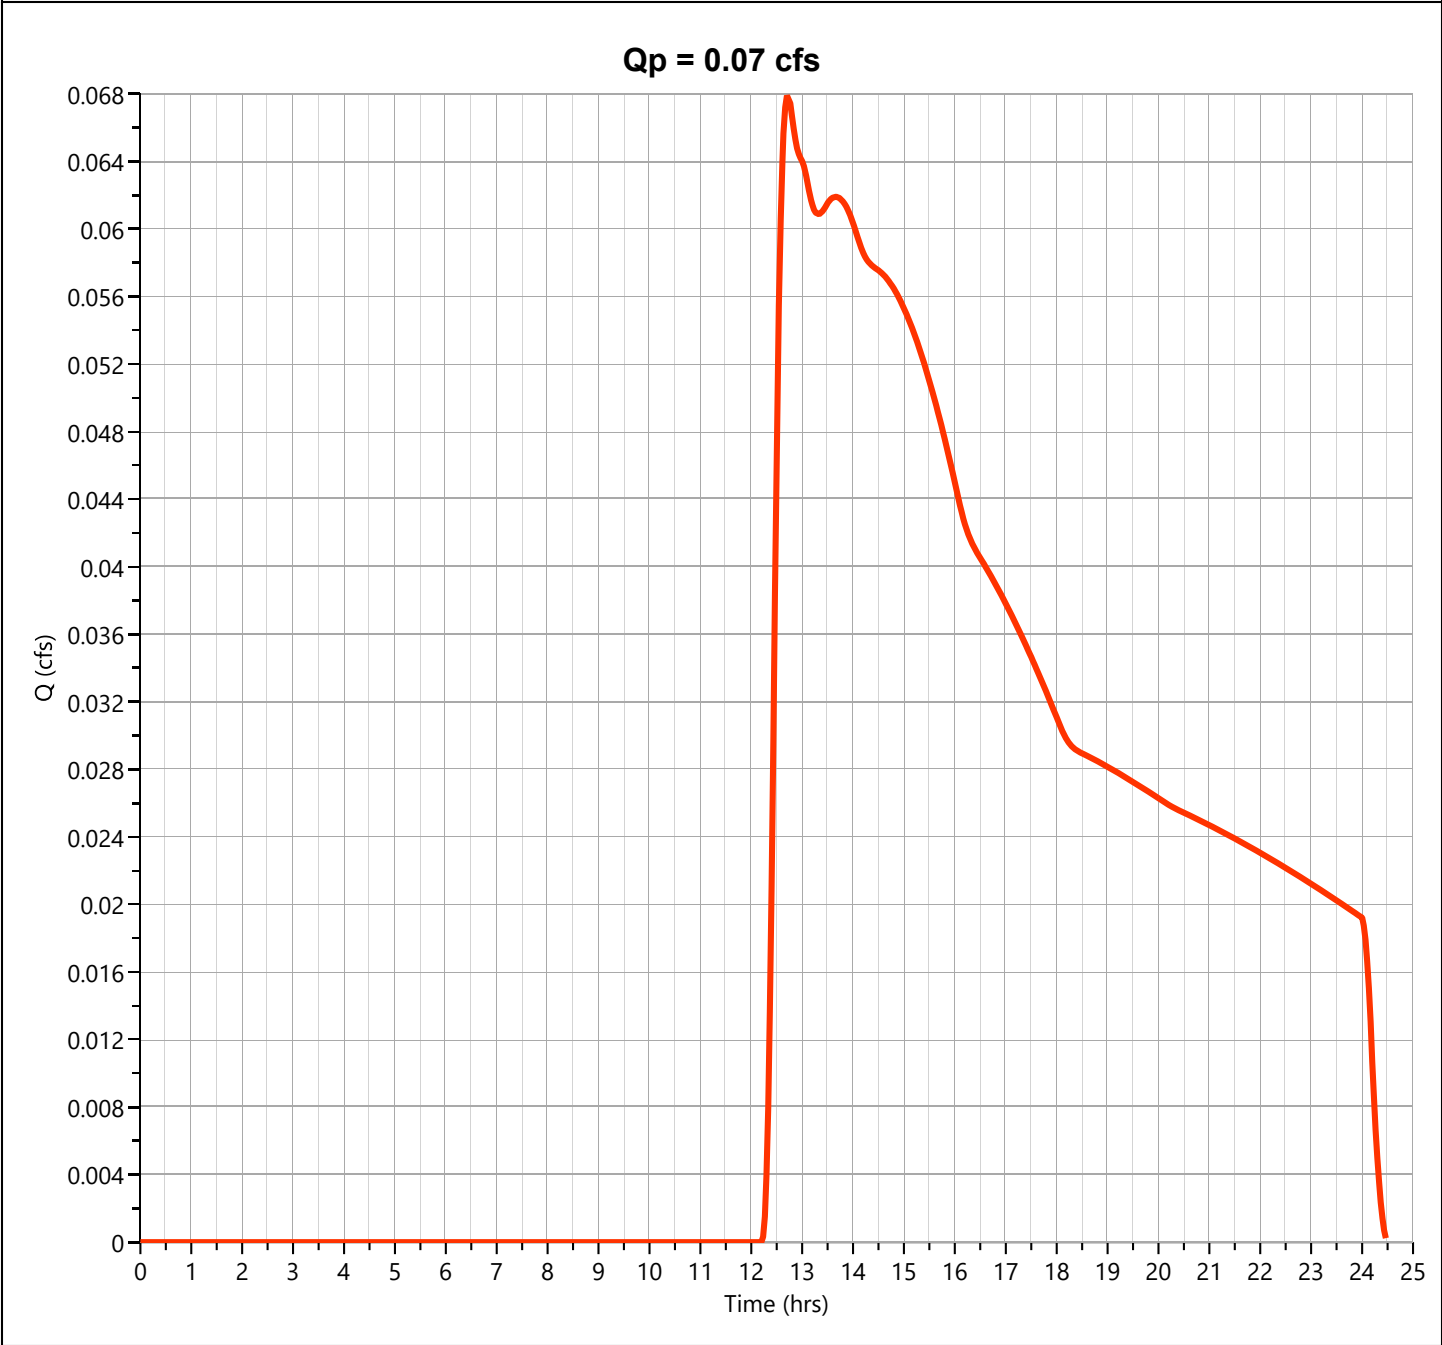

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Subcatchment P-3

## Hyd. No. 15

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.221 cfs
Storm Frequency	= 100-yr	Time to Peak	= 12.53 hrs
Time Interval	= 2 min	Runoff Volume	= 2,723 cuft
Drainage Area	= 1.6 ac	Curve Number	= 32
Tc Method	= User	Time of Conc. (Tc)	= 19.2 min
Total Rainfall	= 7.65 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

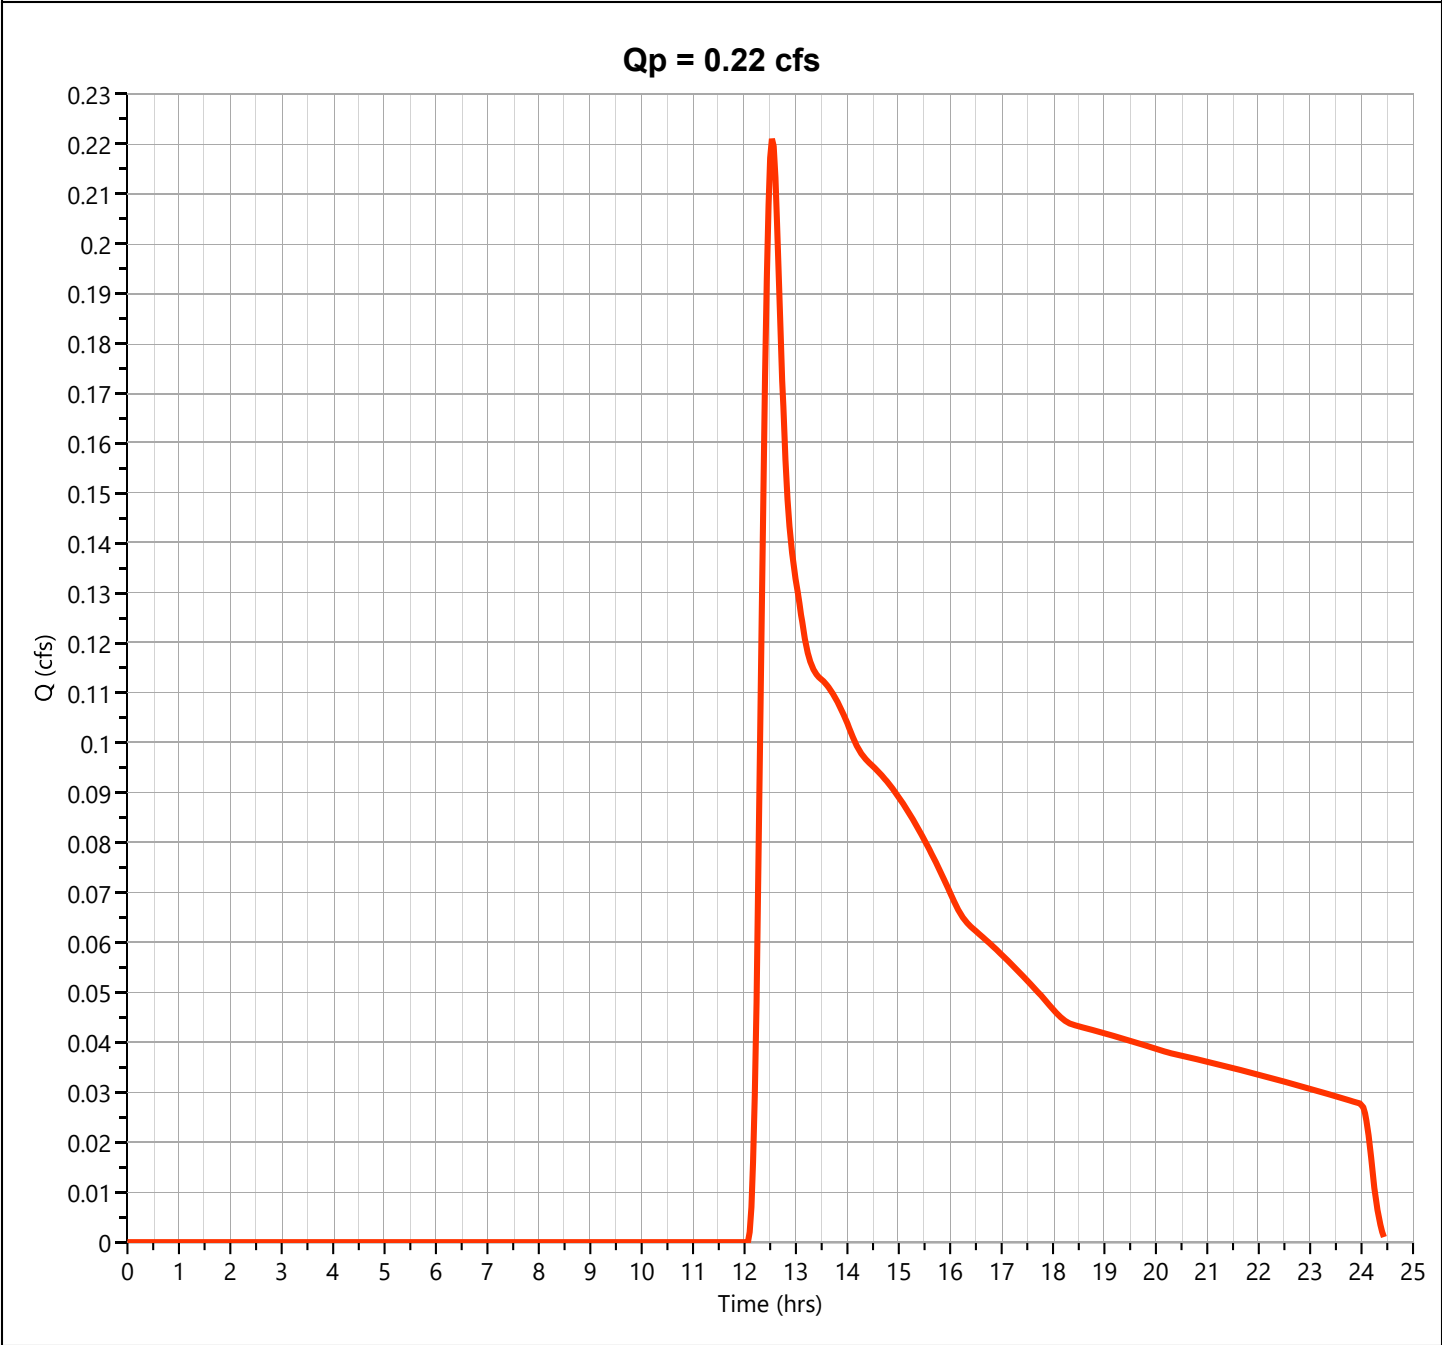



## Worksheet 2: Runoff curve number and runoff

SM-7306

Project: 95 Taylor Street By PFK Date 2/12/24Location: Littleton, MA Checked \_\_\_\_\_ Date \_\_\_\_\_Circle one: Present ☐ ☒ Developed ROOF DRYWELL A1. Runoff curve number (CN)

Soil name and hydrologic group (appendix A)	Cover description (cover type, treatment, and hydrologic condition: percent impervious: unconnected/connected impervious area ratio)	CN 1/			Area  Acres	Product of CN x Area
		Table 2-2	Fig. 2-3	Fig. 2-4		
-	Impervious	98			0.08	7.87
A	Open Space-Good Condition	39			0.00	0.00
A	Woods- Good Condition	30			0.00	0.00
A	Residential Districts - 2 acres	46			0.00	0.00
A	Gravel	76			0.00	0.00
Totals =					0.08	7.87

1/ Use only one CN source per line.

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{7.87}{0.08} = 98.00 ; \quad \text{Use CN} = \boxed{98}$$

2. Runoff

Frequency..... yr

Rainfall, P (24-hour)..... in

Runoff, Q..... in

(Use P and CN with table 2-1, fig. 2-1, or eqs. 2-3 and 2-4.)

Storm #1	Storm #2	Storm #3
2	10	100
3.1	4.5	6.5
2.87	4.26	6.26

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Roof Runoff A

Hyd. No. 17

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.238 cfs
Storm Frequency	= 2-yr	Time to Peak	= 12.07 hrs
Time Interval	= 2 min	Runoff Volume	= 802 cuft
Drainage Area	= 0.08 ac	Curve Number	= 98
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 3.18 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

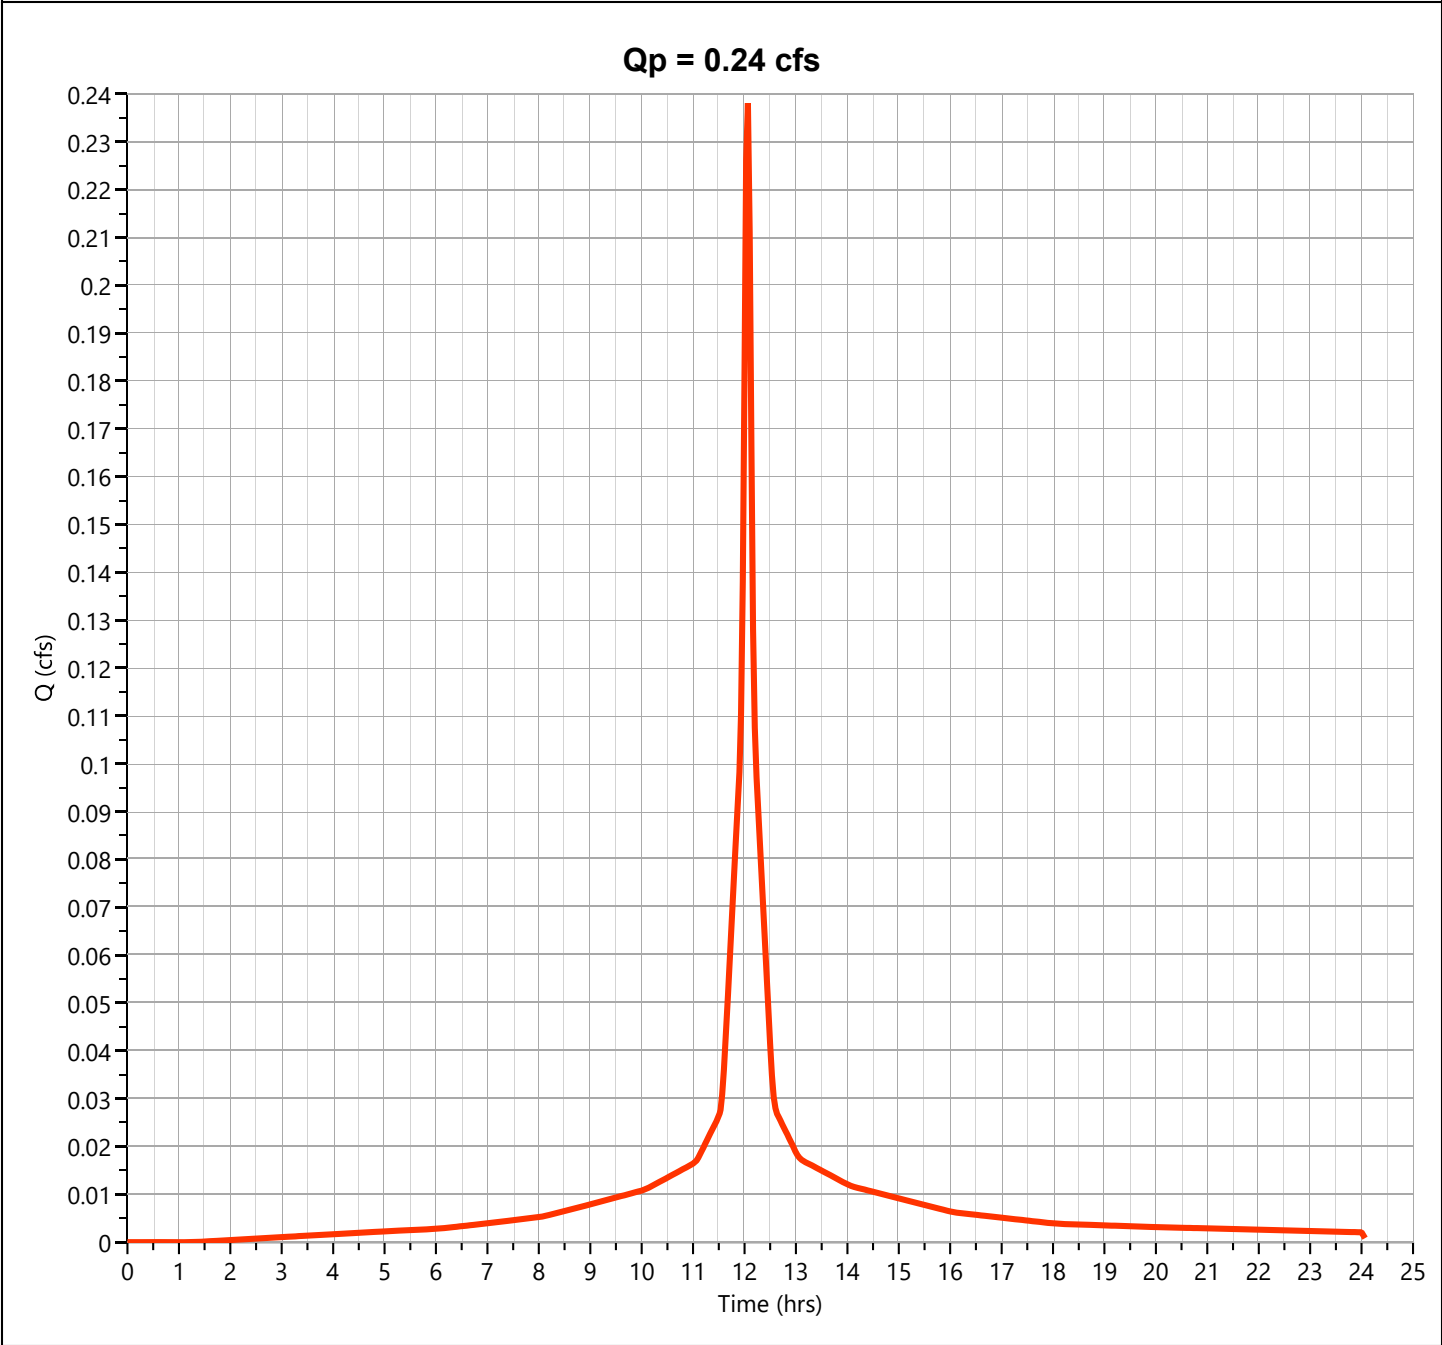

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Roof Runoff A

Hyd. No. 17

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.370 cfs
Storm Frequency	= 10-yr	Time to Peak	= 12.07 hrs
Time Interval	= 2 min	Runoff Volume	= 1,272 cuft
Drainage Area	= 0.08 ac	Curve Number	= 98
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 4.91 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

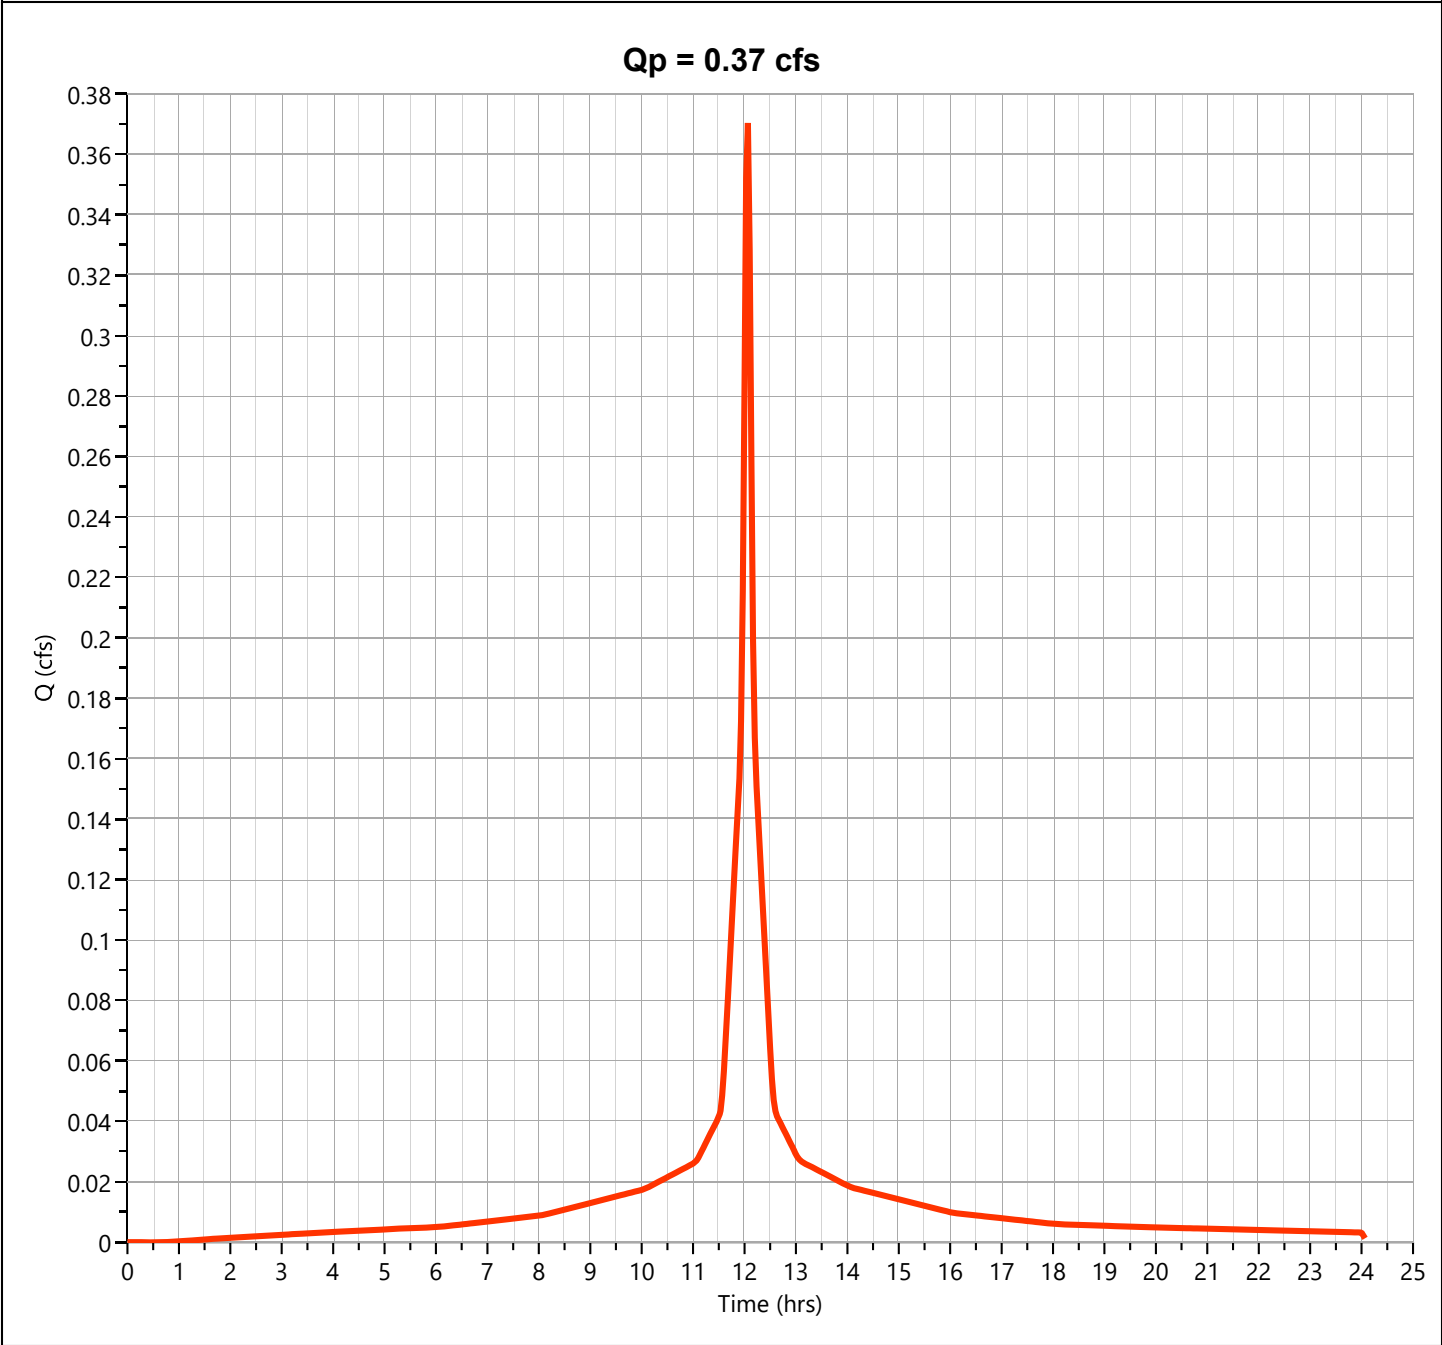

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Roof Runoff A

Hyd. No. 17

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.453 cfs
Storm Frequency	= 25-yr	Time to Peak	= 12.07 hrs
Time Interval	= 2 min	Runoff Volume	= 1,566 cuft
Drainage Area	= 0.08 ac	Curve Number	= 98
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 5.99 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

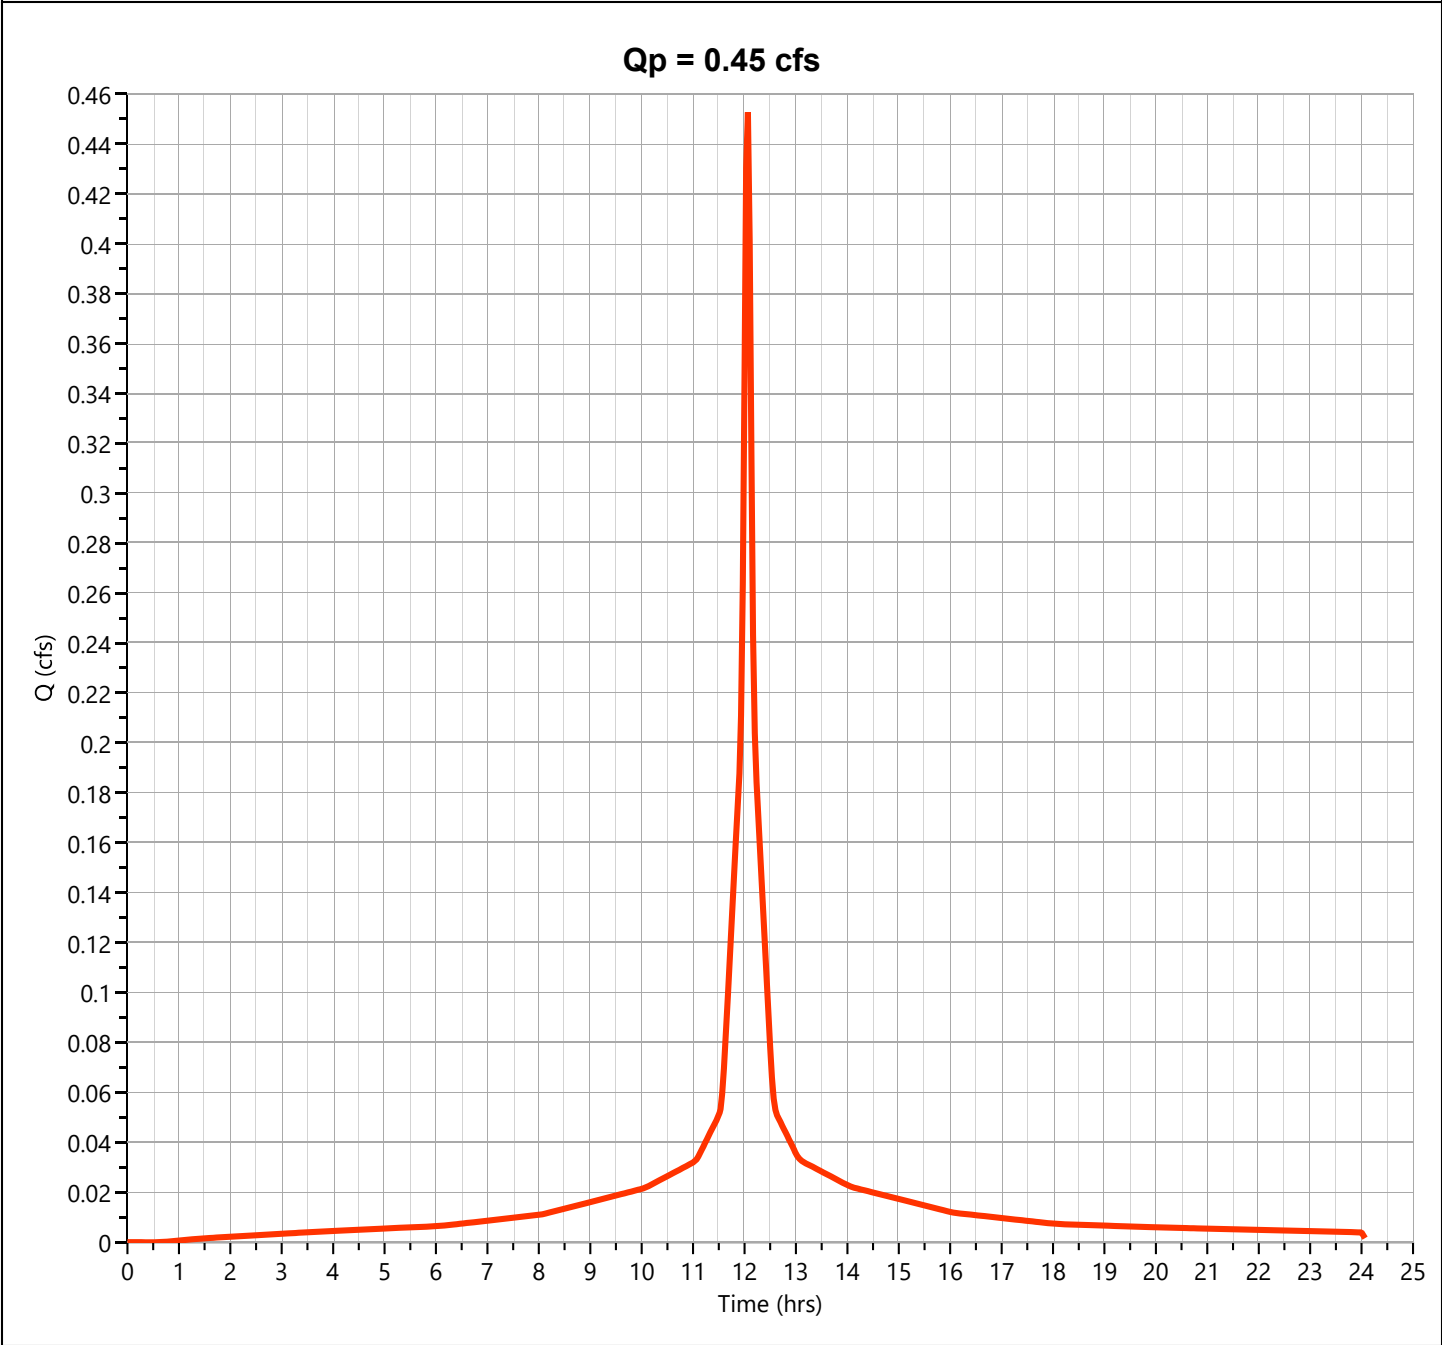

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Roof Runoff A

Hyd. No. 17

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.513 cfs
Storm Frequency	= 50-yr	Time to Peak	= 12.07 hrs
Time Interval	= 2 min	Runoff Volume	= 1,781 cuft
Drainage Area	= 0.08 ac	Curve Number	= 98
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 6.78 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

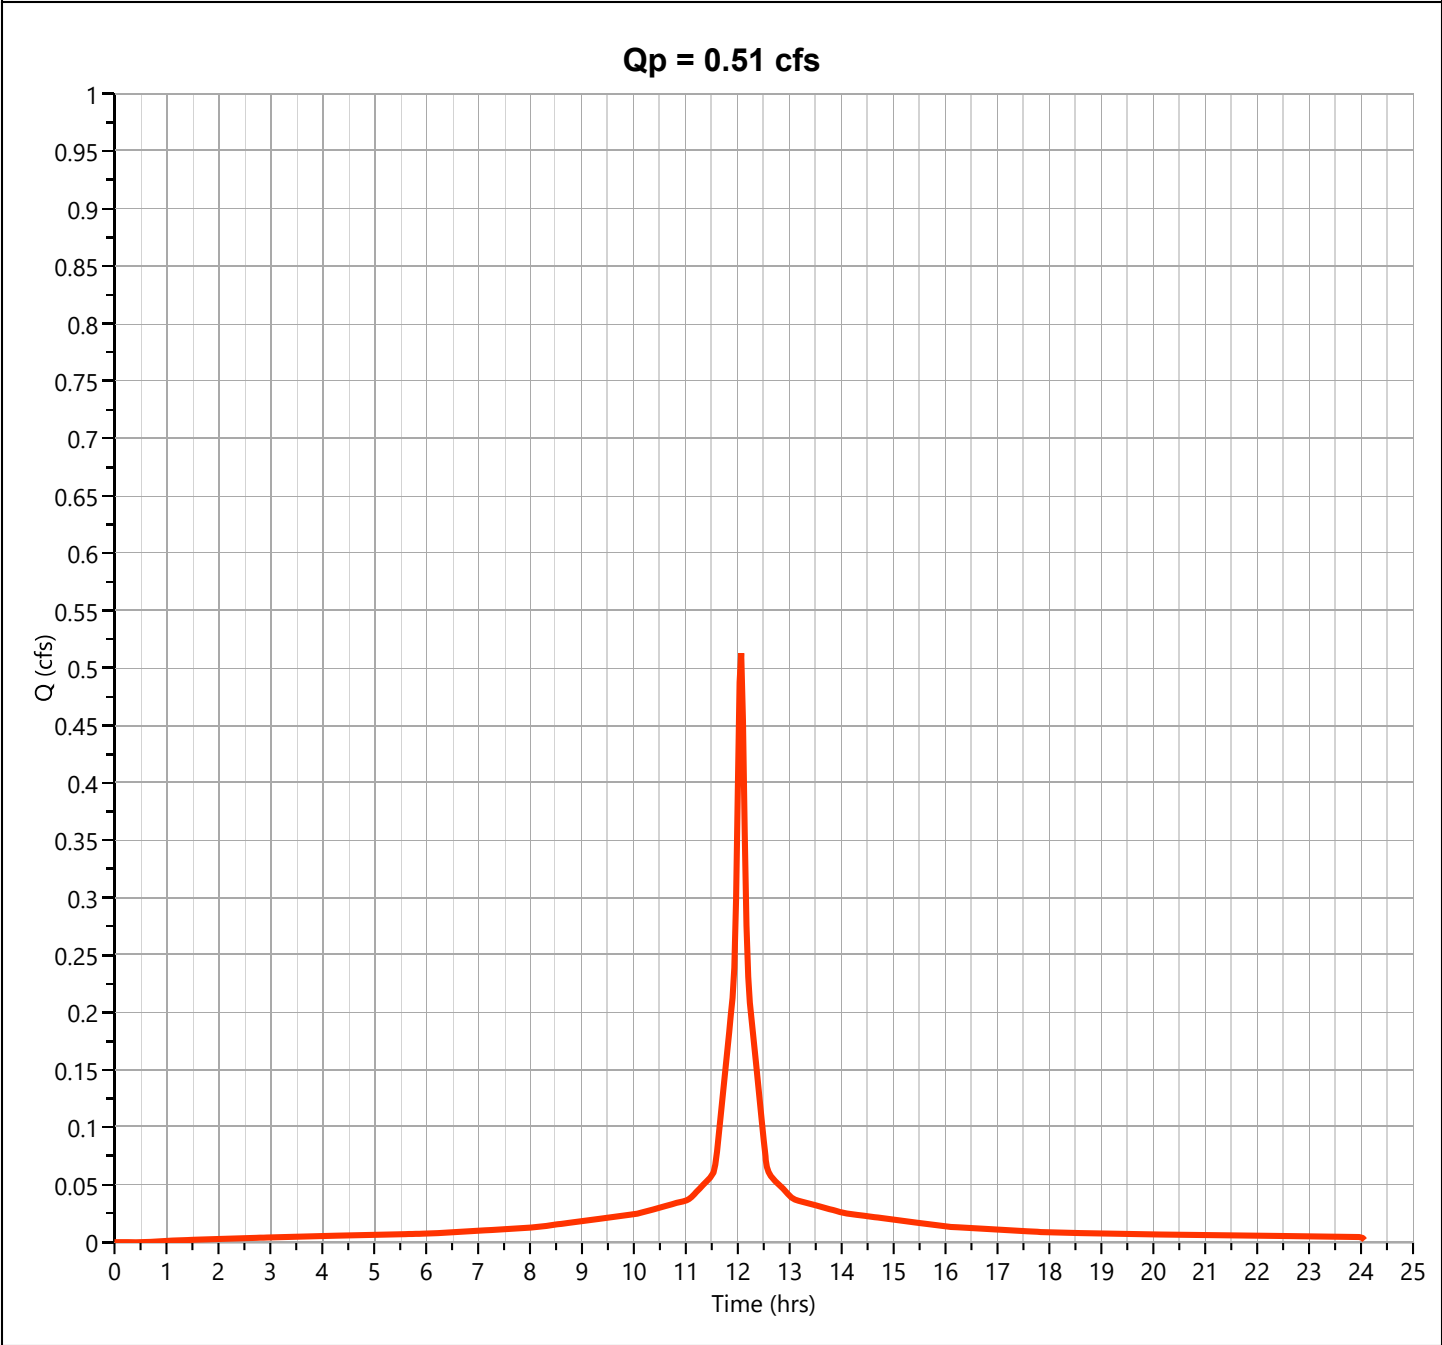

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Roof Runoff A

Hyd. No. 17

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.579 cfs
Storm Frequency	= 100-yr	Time to Peak	= 12.07 hrs
Time Interval	= 2 min	Runoff Volume	= 2,017 cuft
Drainage Area	= 0.08 ac	Curve Number	= 98
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 7.65 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

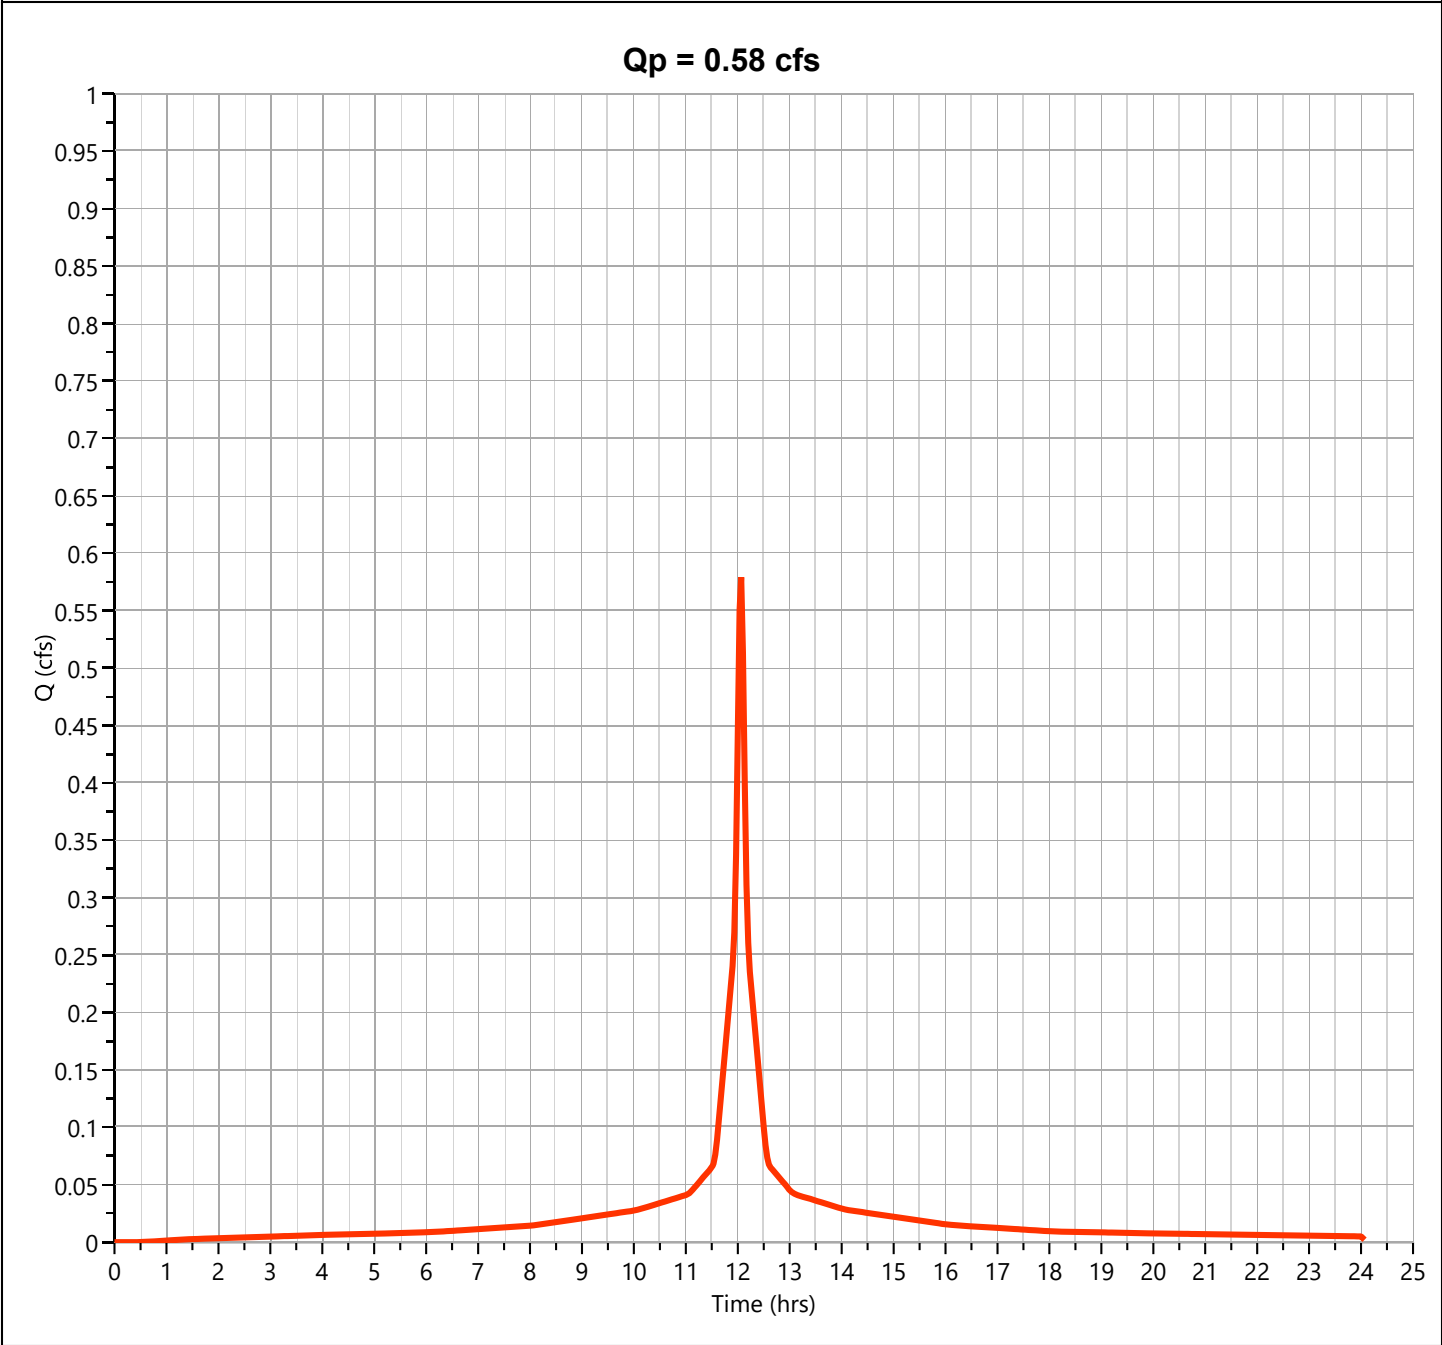

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024


## Roof Drywell A Route

Hyd. No. 18

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 2-yr	Time to Peak	= 9.43 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 17 - Roof Runoff A	Max. Elevation	= 2.27 ft
Pond Name	= Roof Drywell A	Max. Storage	= 160 cuft

Pond Routing by Storage Indication Method

Qp = 0.00 cfs

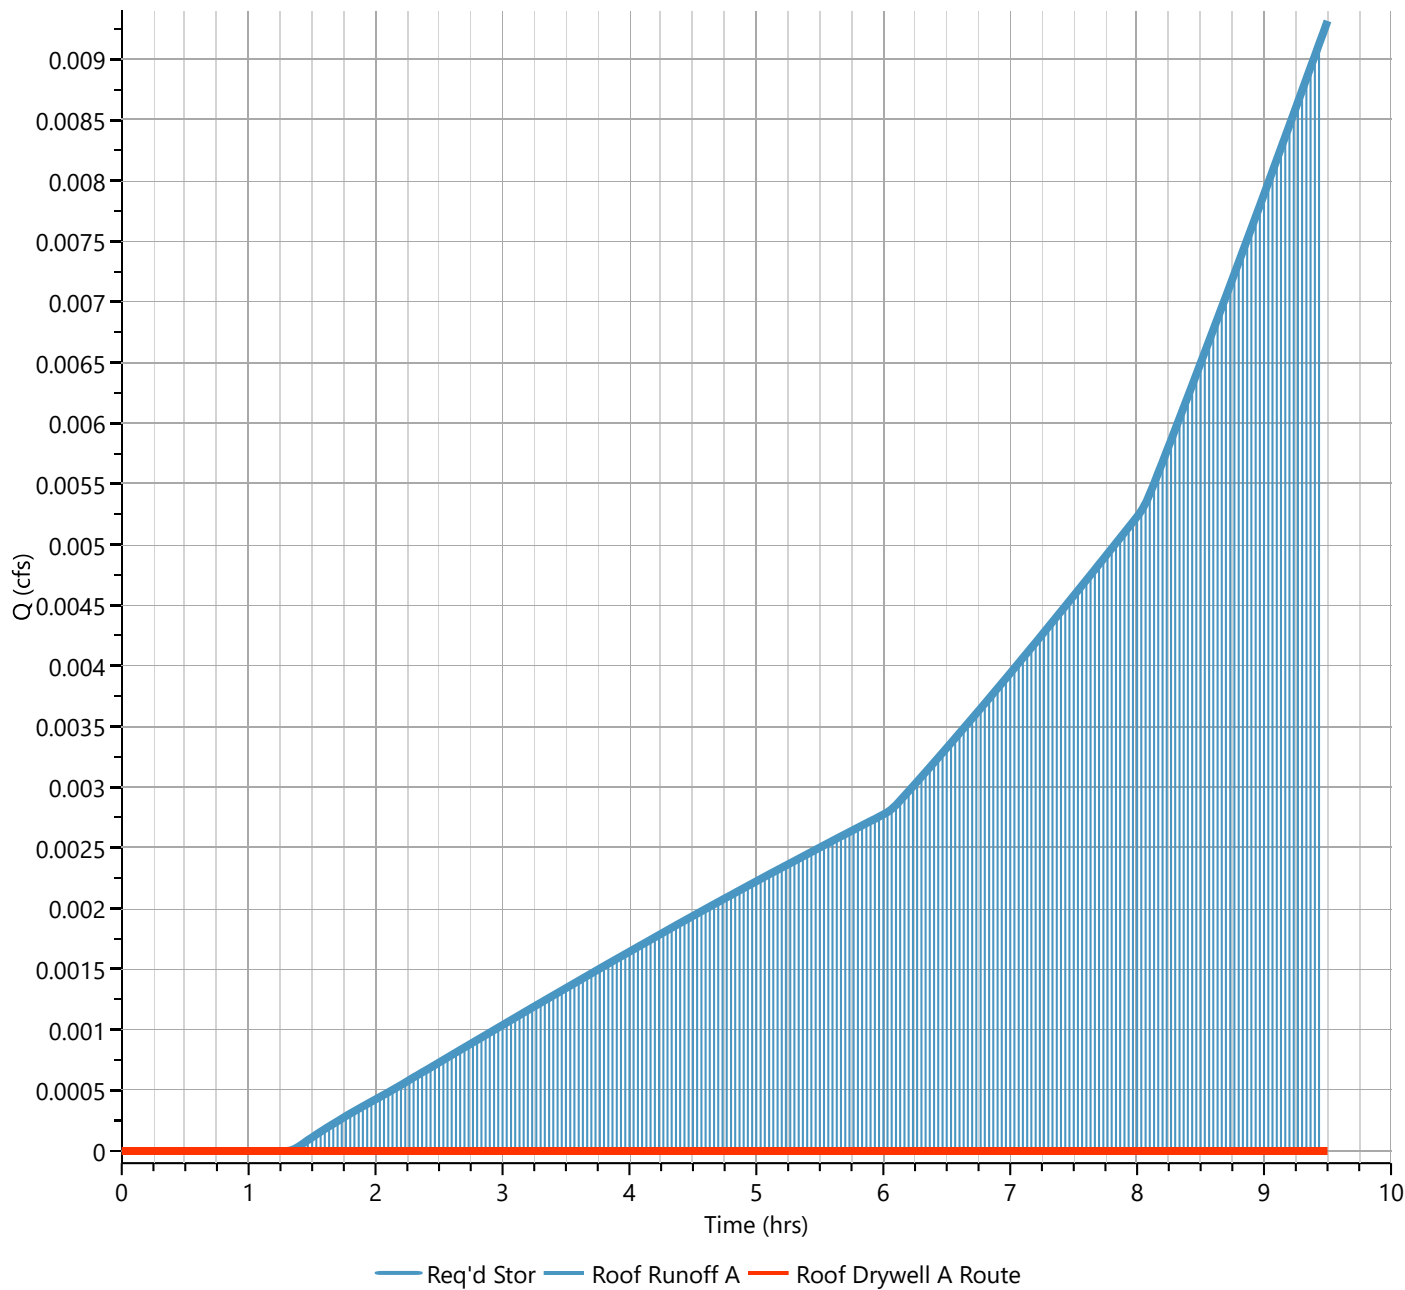

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31


02-13-2024

## Roof Drywell A Route

Hyd. No. 18

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 10-yr	Time to Peak	= 11.00 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 17 - Roof Runoff A	Max. Elevation	= 3.19 ft
Pond Name	= Roof Drywell A	Max. Storage	= 333 cuft

Pond Routing by Storage Indication Method

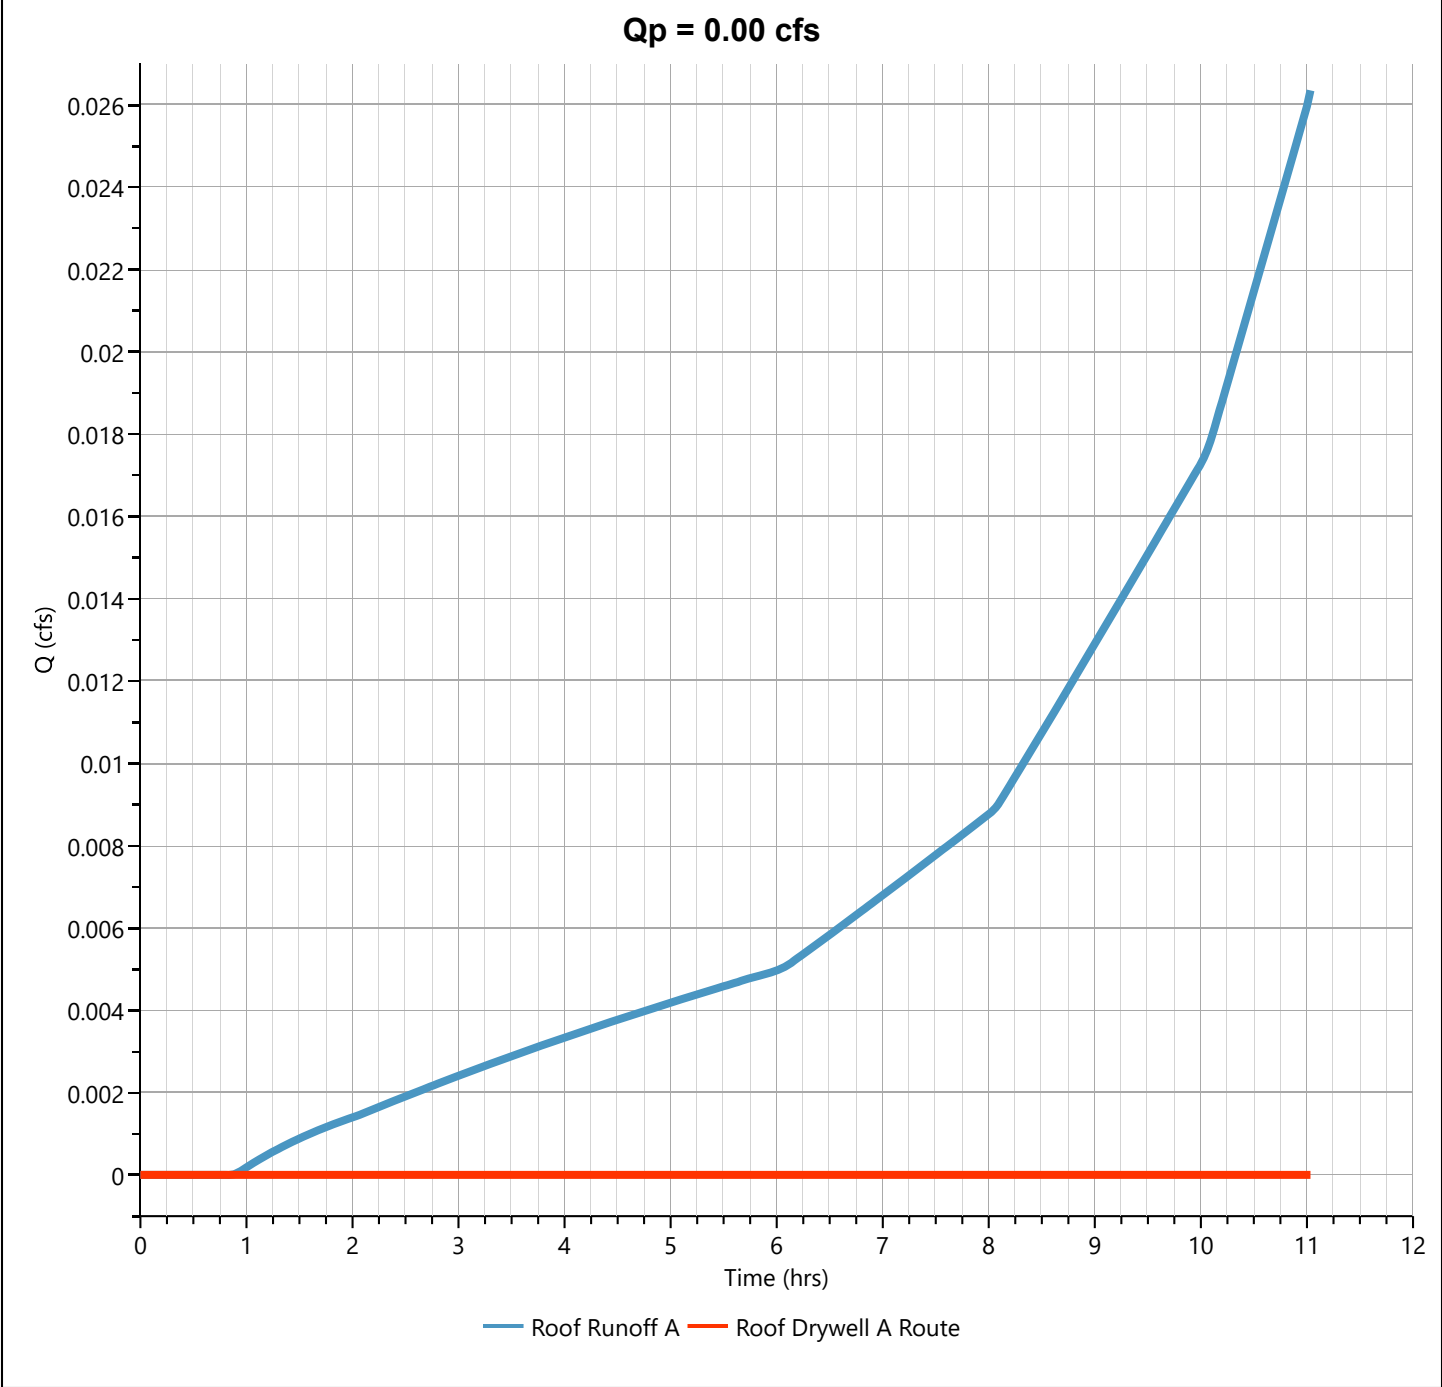



# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## Roof Drywell A Route


Hyd. No. 18

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 25-yr	Time to Peak	= 9.43 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 17 - Roof Runoff A	Max. Elevation	= 3.83 ft
Pond Name	= Roof Drywell A	Max. Storage	= 446 cuft

Pond Routing by Storage Indication Method

Center of mass detention time = 46 min

Qp = 0.00 cfs

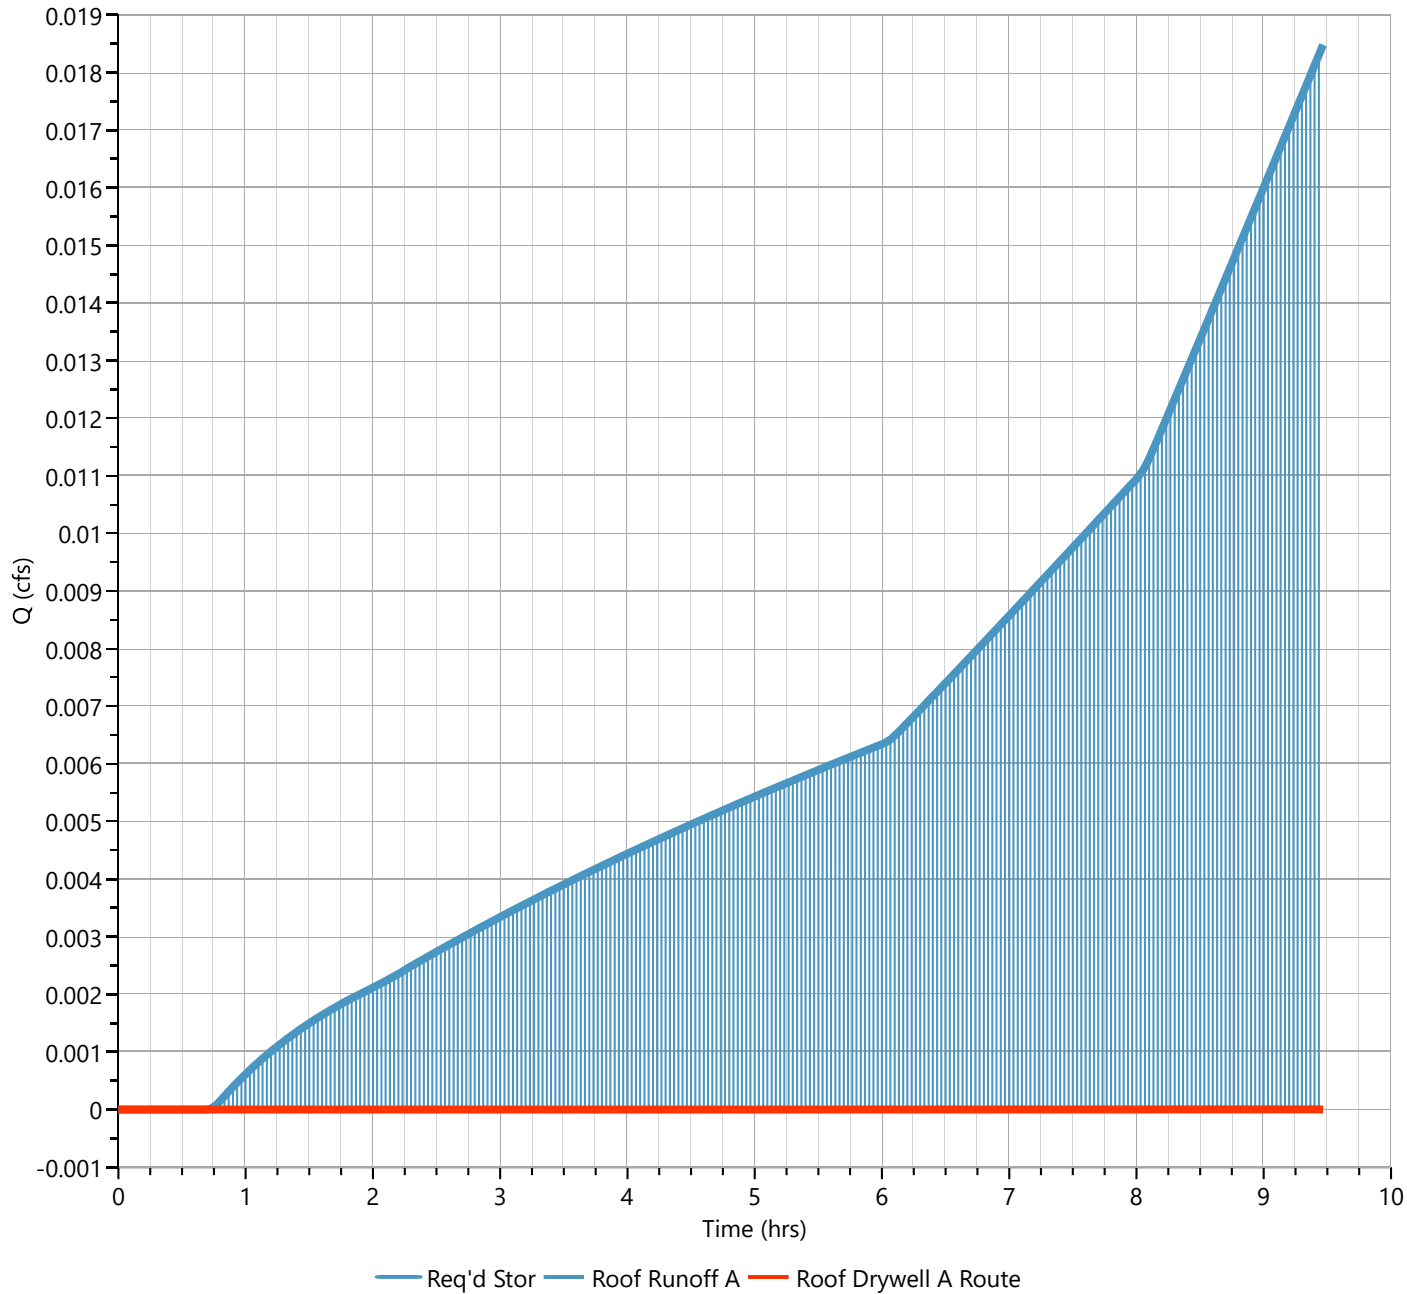

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31


02-13-2024

## Roof Drywell A Route

Hyd. No. 18

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 50-yr	Time to Peak	= 11.07 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 17 - Roof Runoff A	Max. Elevation	= 4.39 ft
Pond Name	= Roof Drywell A	Max. Storage	= 531 cuft

Pond Routing by Storage Indication Method

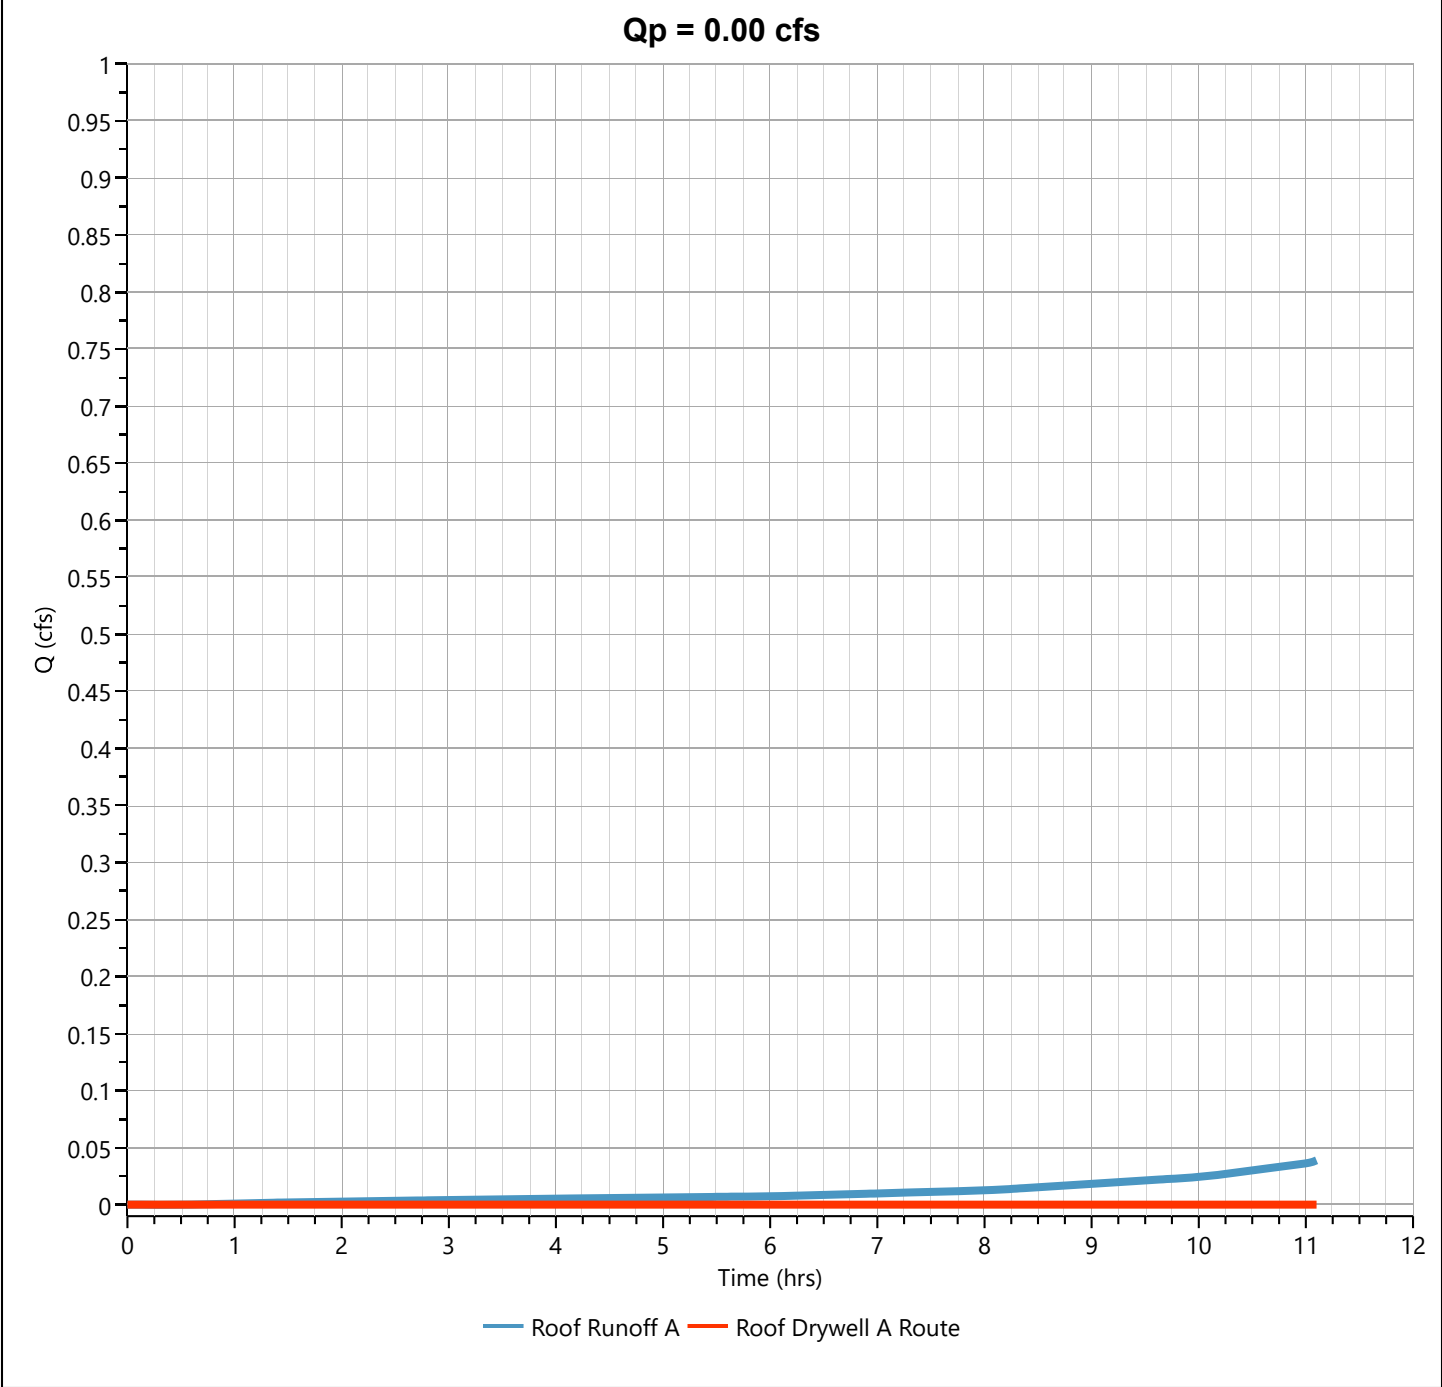

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31


02-13-2024

## Roof Drywell A Route

Hyd. No. 18

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 100-yr	Time to Peak	= 10.70 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 17 - Roof Runoff A	Max. Elevation	= 5.25 ft
Pond Name	= Roof Drywell A	Max. Storage	= 627 cuft


Pond Routing by Storage Indication Method

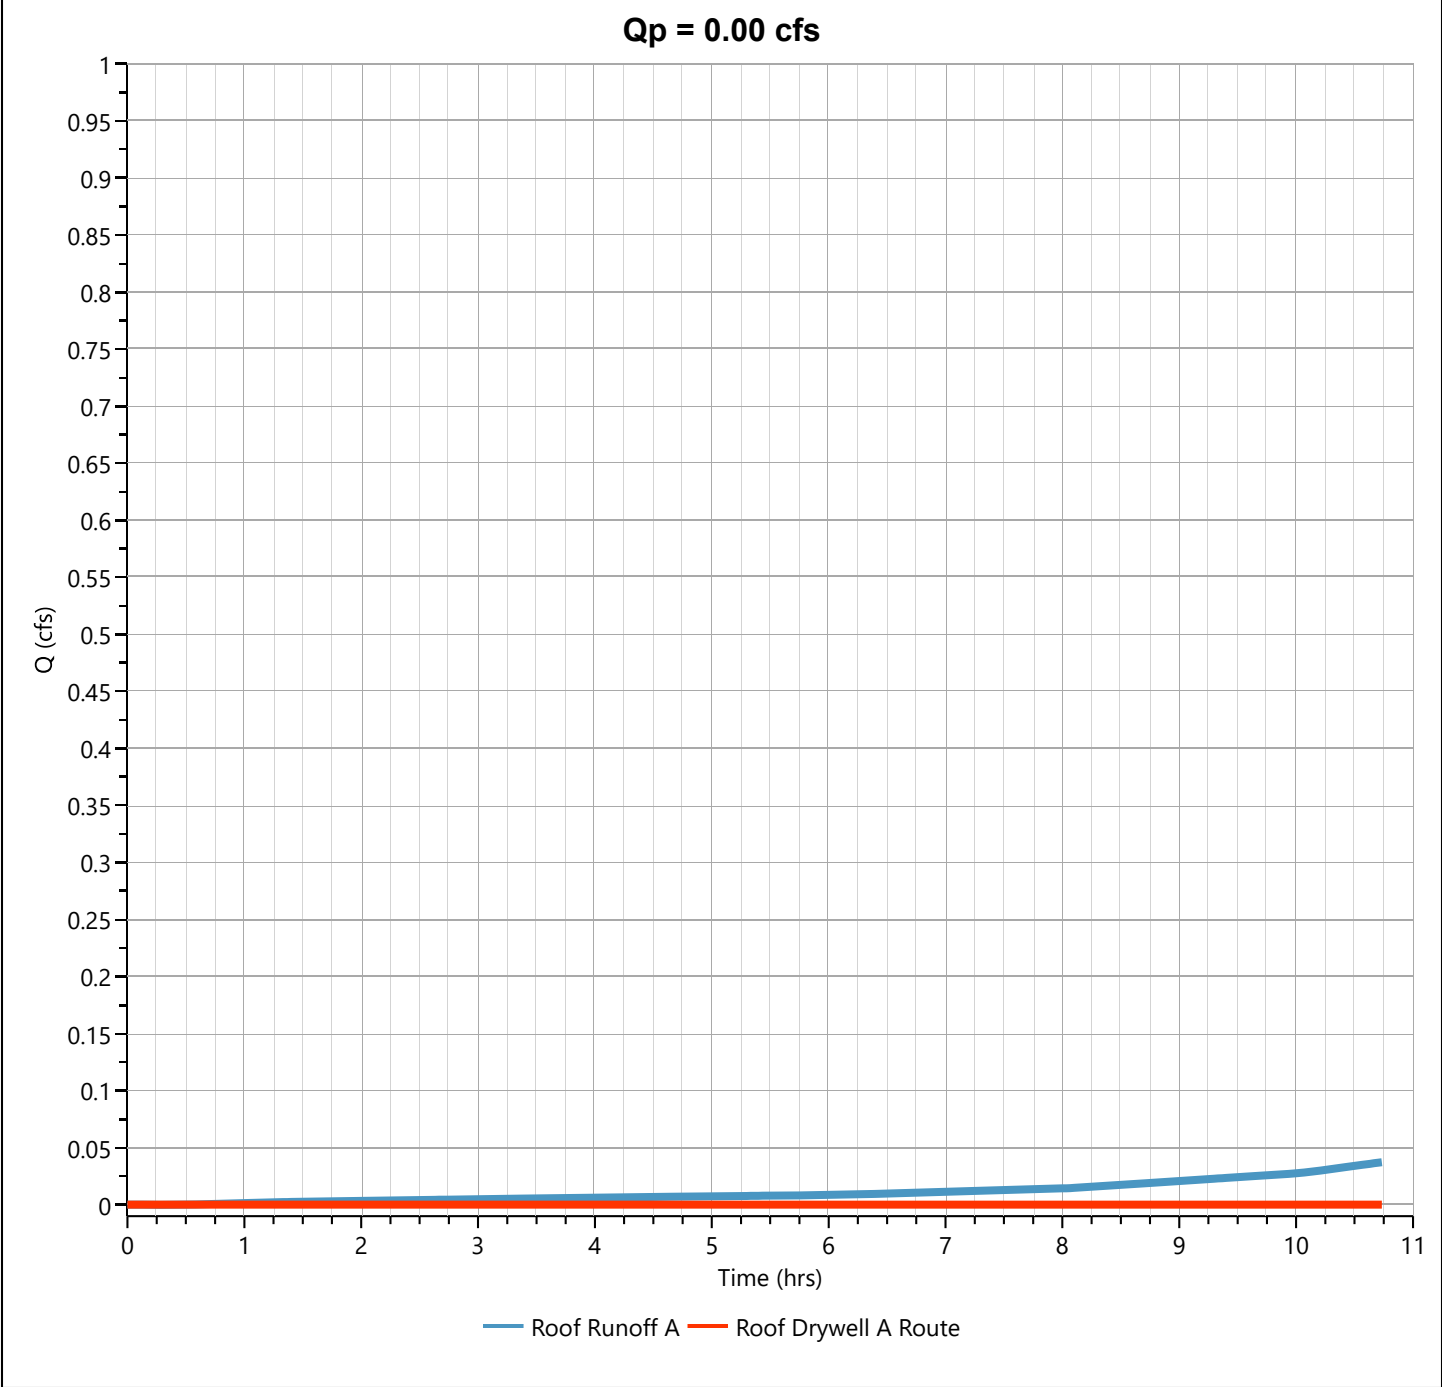

Roof Drywell A

Stage-Storage

StormTech® SC-740™ Chamber		Stage / Storage Table				
Description	Input	Stage (in)	Elevation (ft)	Contour Area (sqft)	Incr. Storage (cuft)	Total Storage (cuft)
Chamber Height, in	30	0.0	1.00	272	0.000	0.000
Chamber Shape	Arch	2.7	1.23	272	24.4	24.4
Chamber Width, in	51	5.4	1.45	272	24.4	48.9
Installed Length, ft	7.12	8.1	1.68	272	24.4	73.3
No. Chambers	6	10.8	1.90	272	24.4	97.8
Bare Chamber Stor, cuft	275	13.5	2.13	272	34.8	133
No. Rows	2	16.2	2.35	272	43.3	176
Space Between Rows, in	6	18.9	2.58	272	43.0	219
Stone Above, in	12	21.6	2.80	272	42.6	261
Stone Below, in	12	24.3	3.03	272	42.0	304
Stone Sides, in	12	27.0	3.25	272	41.3	345
Stone Ends, in	12	29.7	3.48	272	40.3	385
Encasement Voids, %	40.00	32.4	3.70	272	39.0	424
Encasement Bottom Elevation, ft	1.00	35.1	3.93	272	37.5	462
		37.8	4.15	272	35.4	497
		40.5	4.38	272	32.4	529
		43.2	4.60	272	27.0	556
		45.9	4.82	272	24.4	581
		48.6	5.05	272	24.4	605
		51.3	5.27	272	24.4	630
		54.0	5.50	272	24.4	654

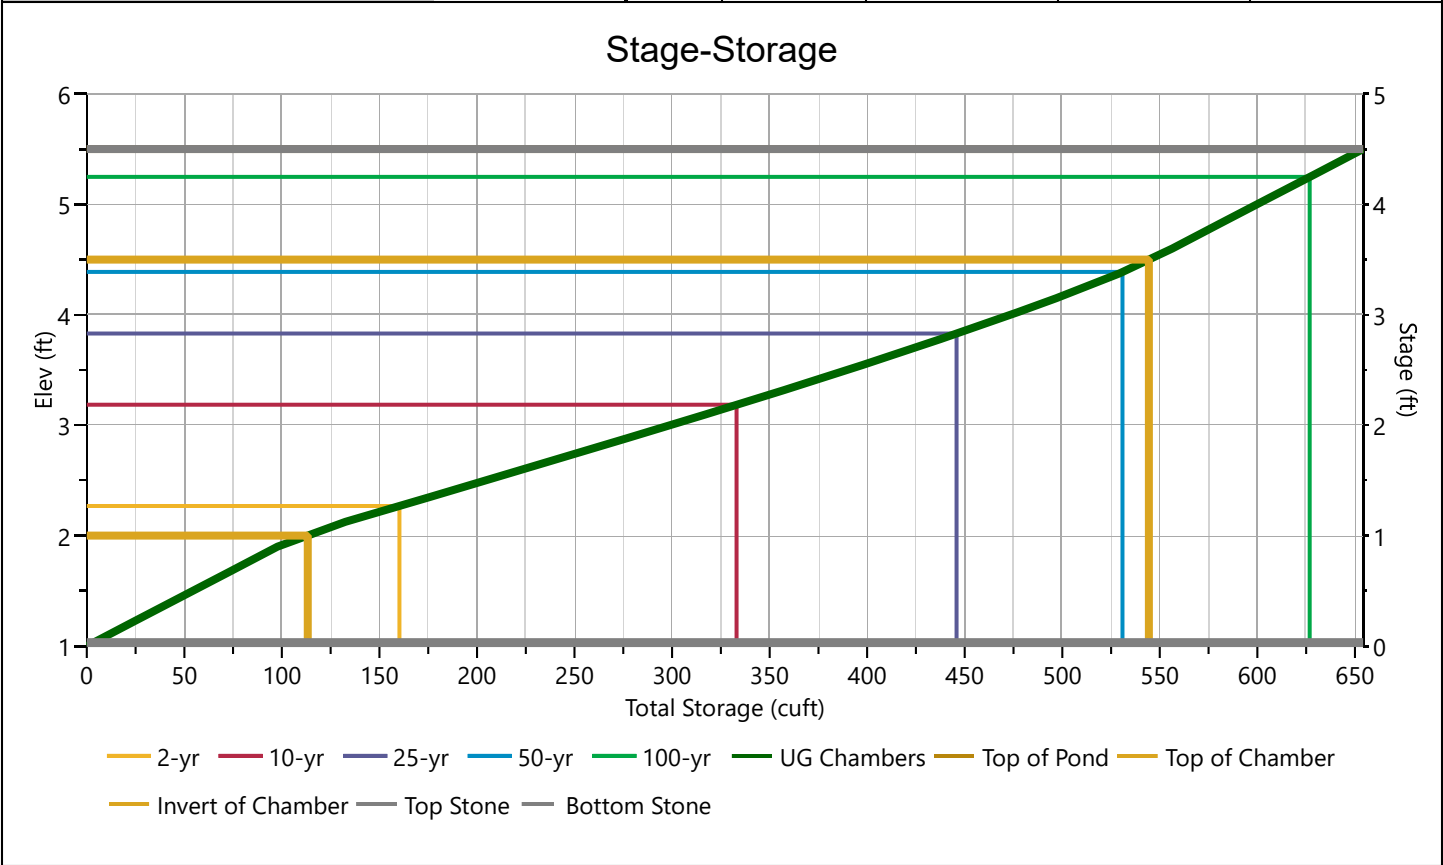


Roof Drywell A

Stage-Discharge

Culvert / Orifices	Culvert	Orifices			Perforated Riser
		1	2	3	
Rise, in					Hole Diameter, in
Span, in					No. holes
No. Barrels					Invert Elevation, ft
Invert Elevation, ft					Height, ft
Orifice Coefficient, Co					Orifice Coefficient, Co
Length, ft					
Barrel Slope, %					
N-Value, n	0.000				
Weirs	Riser*	Weirs			Ancillary
		1	2	3	
Shape / Type					Exfiltration, in/hr
Crest Elevation, ft					8.27**
Crest Length, ft					
Angle, deg					
Weir Coefficient, Cw					

\*Routes through Culvert. \*\*Exfiltration extracted from outflow hydrograph. Rate applied to contours.

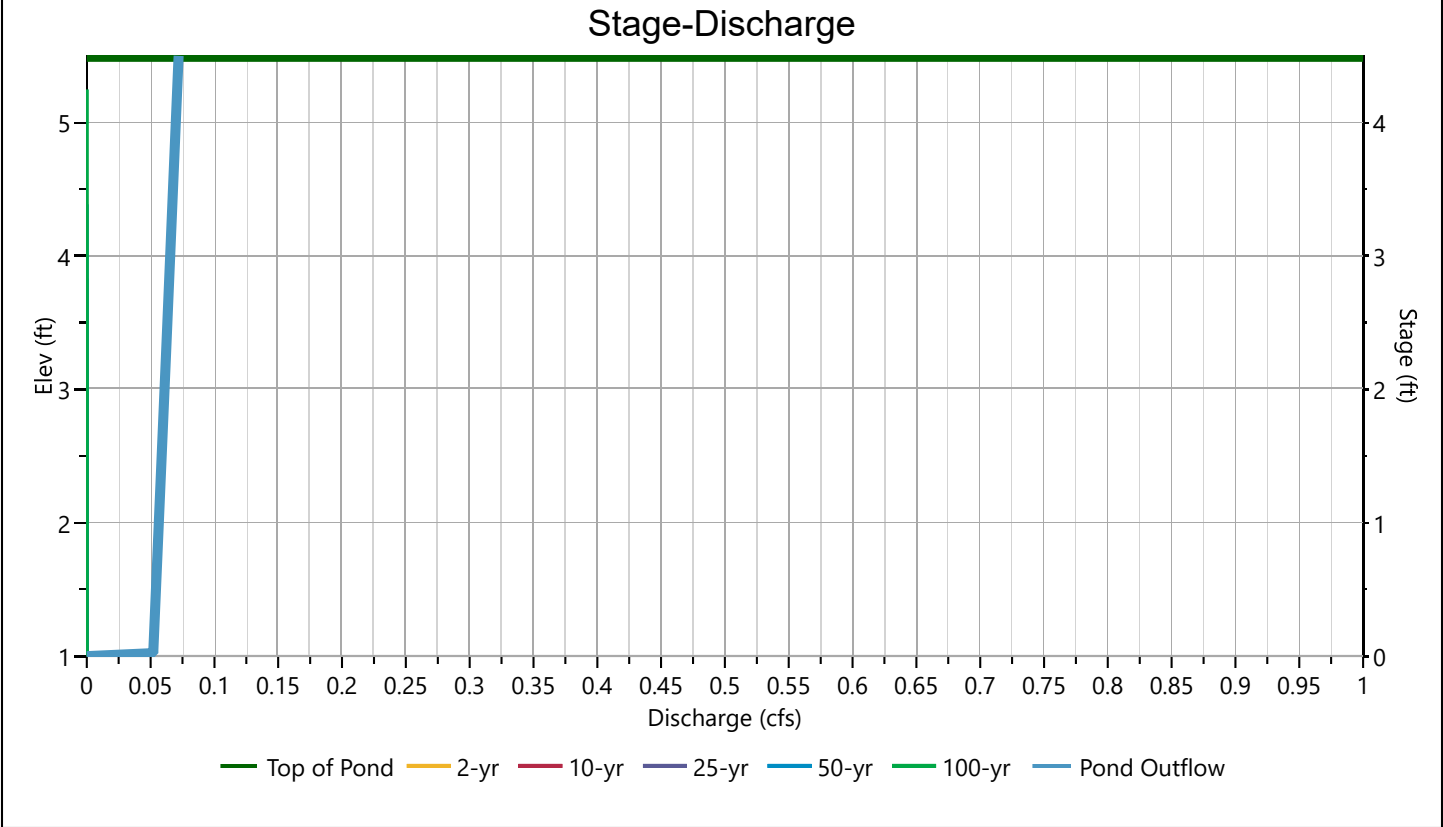

# Pond Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## Roof Drywell A


## Stage-Storage-Discharge Summary

Stage (ft)	Elev. (ft)	Storage (cuft)	Culvert (cfs)	Orifices, cfs			Riser (cfs)	Weirs, cfs			Pf Riser (cfs)	Exfil (cfs)	User (cfs)	Total (cfs)
				1	2	3		1	2	3				
0.00	1.00	0.000										0.000		0.000
0.23	1.23	24.4										0.053		0.053
0.45	1.45	48.9										0.054		0.054
0.68	1.68	73.3										0.055		0.055
0.90	1.90	97.8										0.056		0.056
1.13	2.13	133										0.057		0.057
1.35	2.35	176										0.058		0.058
1.58	2.58	219										0.059		0.059
1.80	2.80	261										0.060		0.060
2.03	3.03	304										0.061		0.061
2.25	3.25	345										0.062		0.062
2.48	3.48	385										0.063		0.063
2.70	3.70	424										0.064		0.064
2.93	3.93	462										0.065		0.065
3.15	4.15	497										0.066		0.066
3.38	4.38	529										0.067		0.067
3.60	4.60	556										0.068		0.068
3.82	4.82	581										0.069		0.069
4.05	5.05	605										0.070		0.070
4.27	5.27	630										0.071		0.071
4.50	5.50	654										0.072		0.072

Suffix key: ic = inlet control, oc = outlet control, s = submerged weir

Roof Drywell A

Pond Drawdown

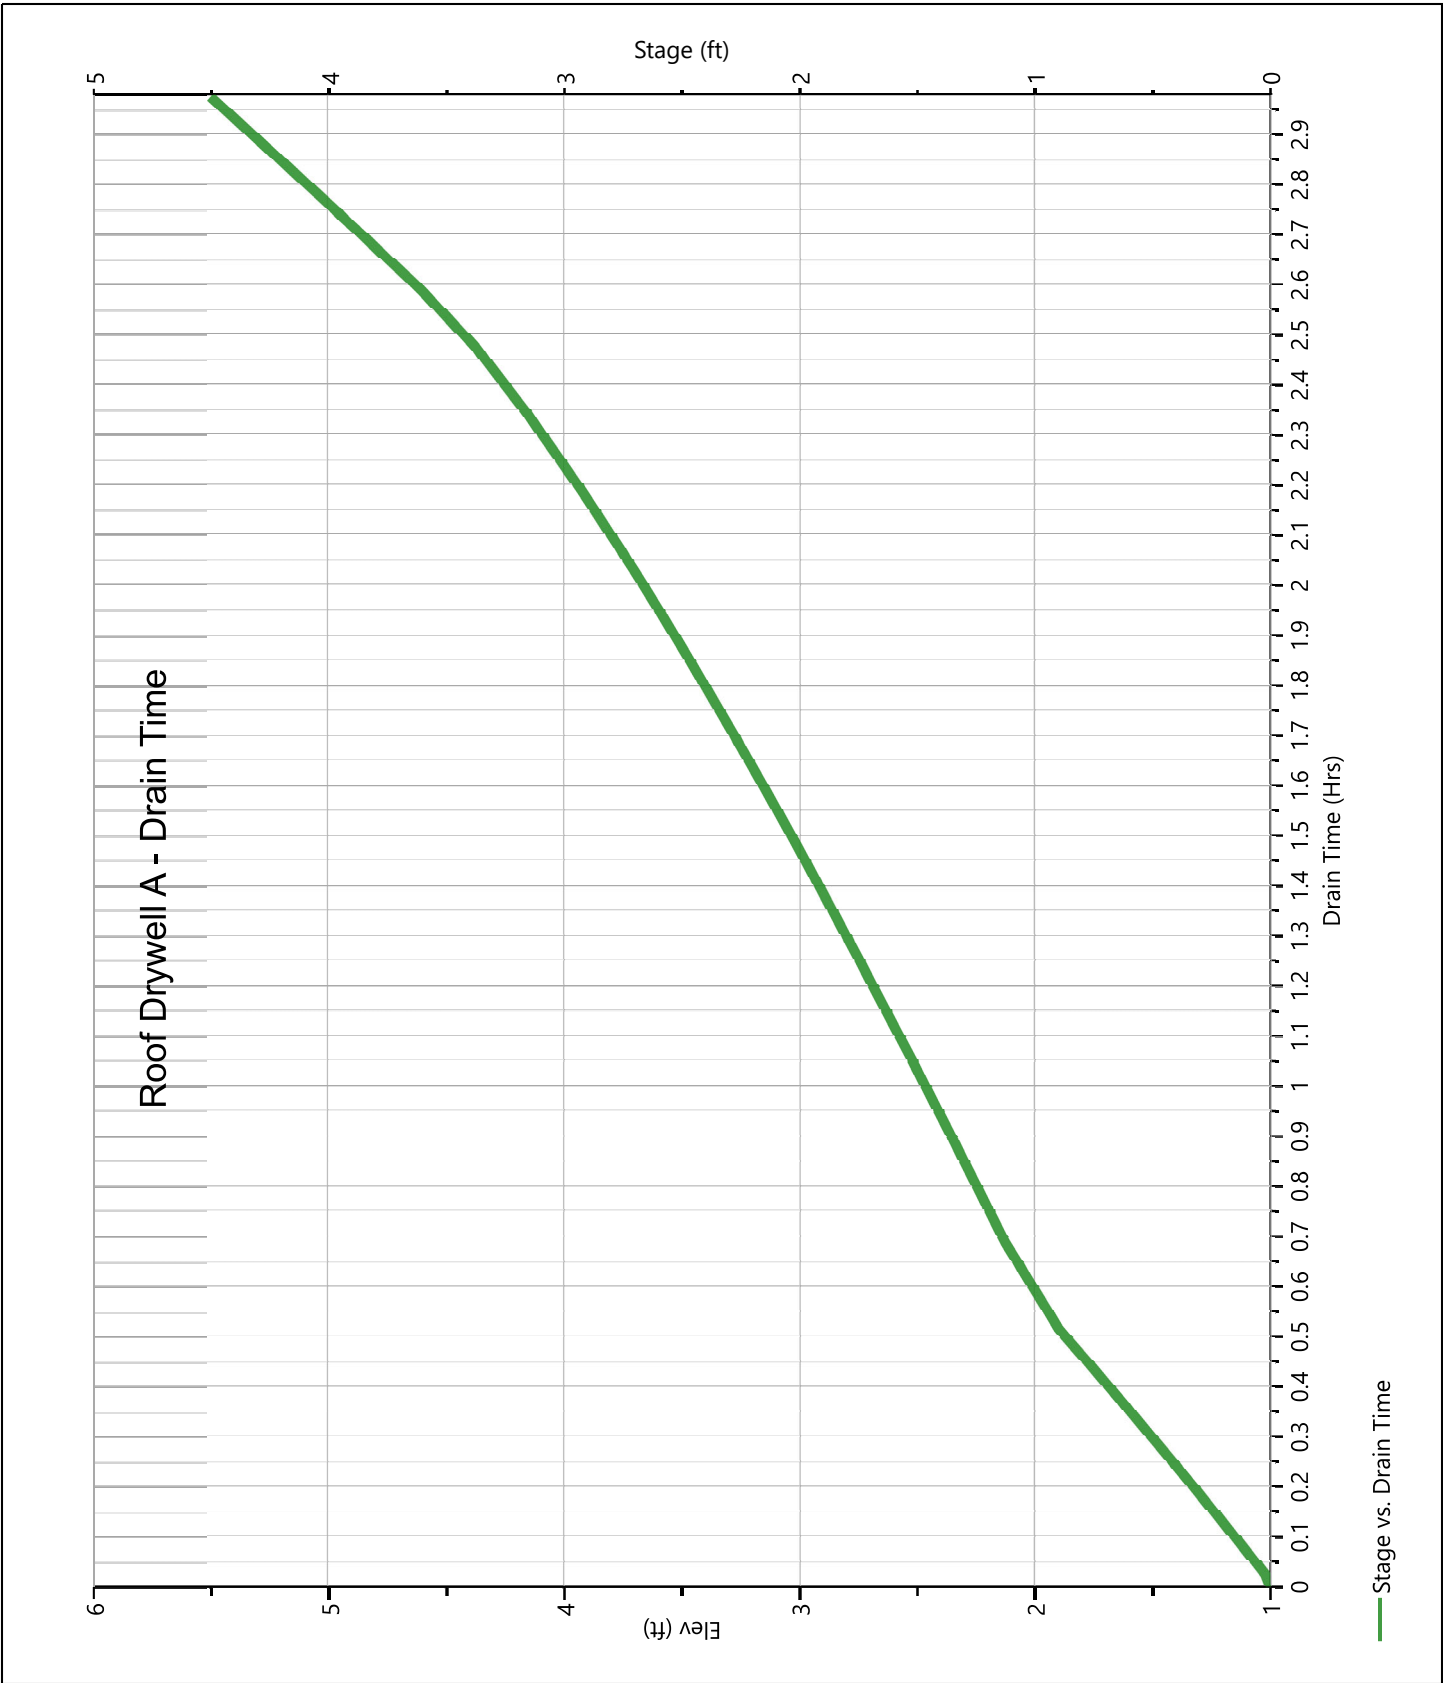

## Worksheet 2: Runoff curve number and runoff

SM-7306

Project: 95 Taylor Street By PFK Date 2/12/24Location: Littleton, MA Checked \_\_\_\_\_ Date \_\_\_\_\_Circle one: Present ☐ ☒ Developed ROOF DRYWELL A1. Runoff curve number (CN)

Soil name and hydrologic group (appendix A)	Cover description (cover type, treatment, and hydrologic condition: percent impervious: unconnected/connected impervious area ratio)	CN 1/			Area	Product of CN x Area
		Table 2-2	Fig. 2-3	Fig. 2-4	Acres	
-	Impervious	98			0.04	3.94
A	Open Space-Good Condition	39			0.00	0.00
A	Woods- Good Condition	30			0.00	0.00
A	Residential Districts - 2 acres	46			0.00	0.00
A	Gravel	76			0.00	0.00
Totals =					0.04	3.94

1/ Use only one CN source per line.

$$\text{CN (weighted)} = \frac{\text{total product}}{\text{total area}} = \frac{3.94}{0.04} = \underline{98.00} ; \quad \text{Use CN} = \underline{98}$$

2. Runoff

Frequency..... yr

Rainfall, P (24-hour)..... in

Runoff, Q..... in

(Use P and CN with table 2-1, fig. 2-1, or eqs. 2-3 and 2-4.)

Storm #1	Storm #2	Storm #3
2	10	100
3.1	4.5	6.5
2.87	4.26	6.26



# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Roof Drywell B

Hyd. No. 20

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.119 cfs
Storm Frequency	= 2-yr	Time to Peak	= 12.07 hrs
Time Interval	= 2 min	Runoff Volume	= 401 cuft
Drainage Area	= 0.04 ac	Curve Number	= 98
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 3.18 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

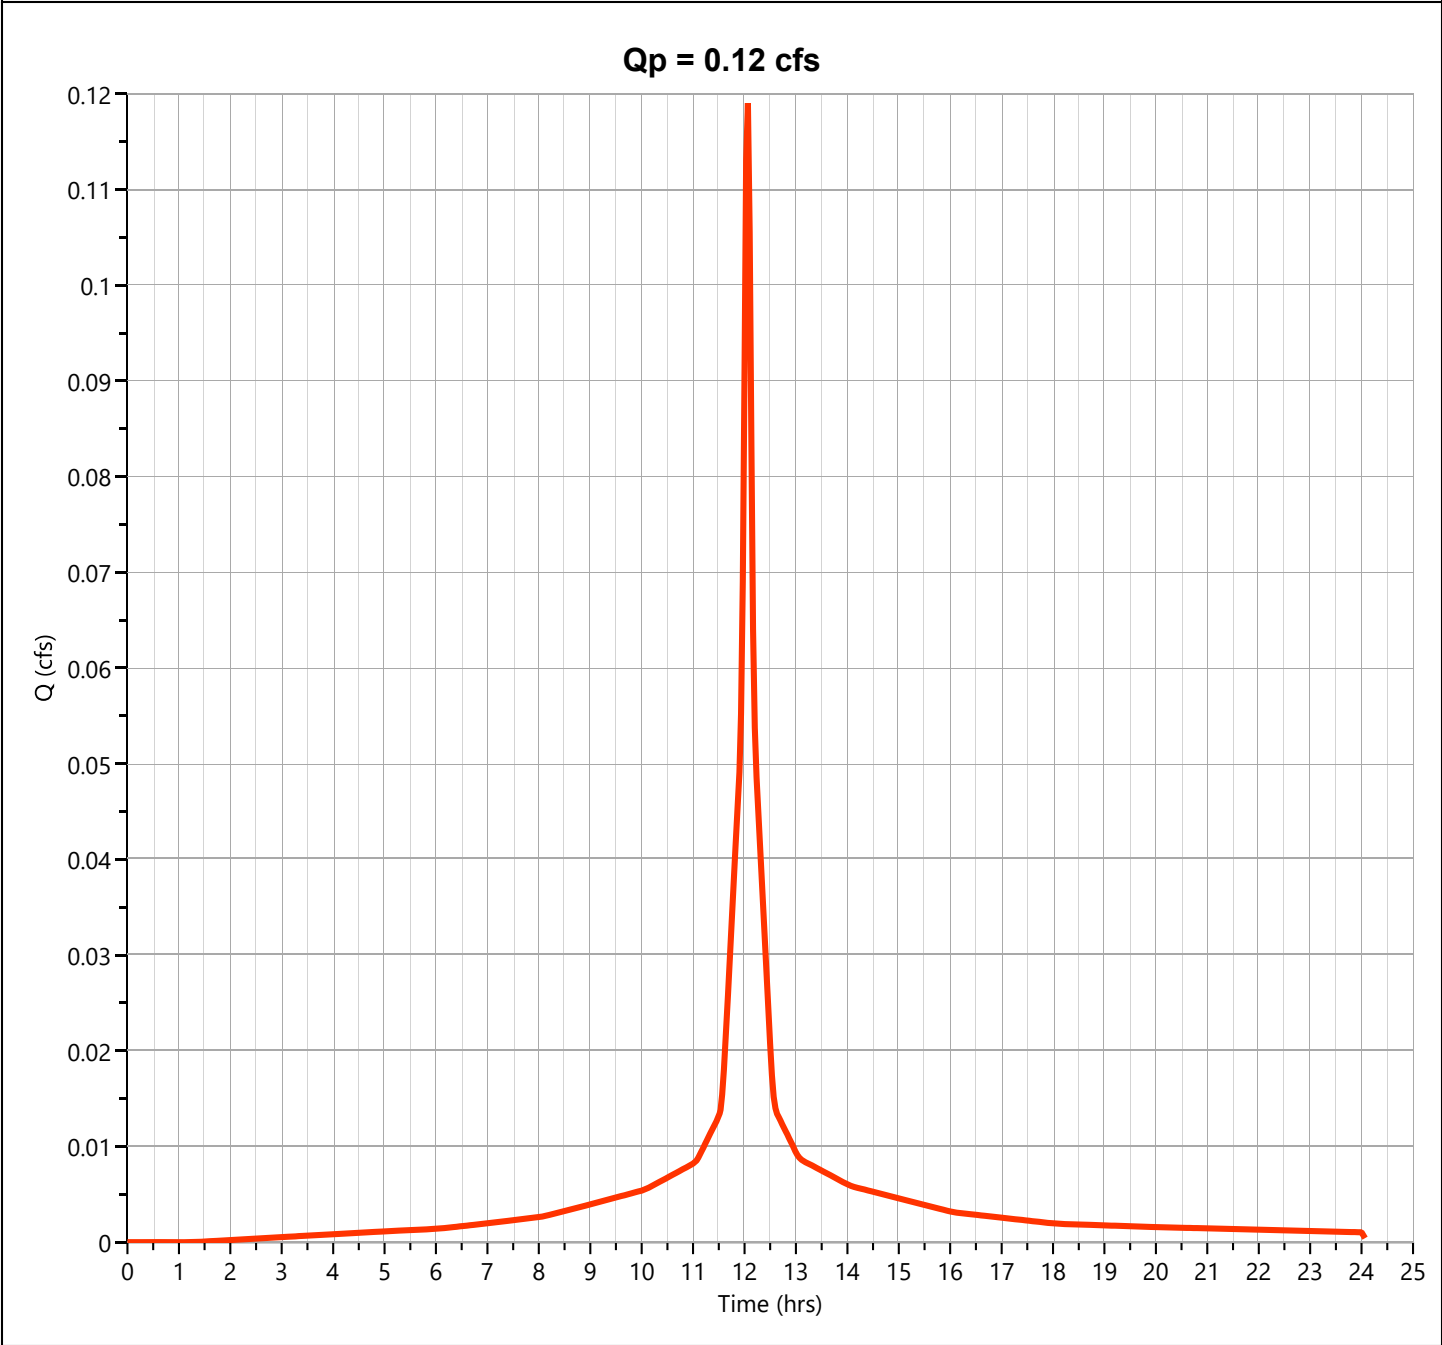

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Roof Drywell B

Hyd. No. 20

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.185 cfs
Storm Frequency	= 10-yr	Time to Peak	= 12.07 hrs
Time Interval	= 2 min	Runoff Volume	= 636 cuft
Drainage Area	= 0.04 ac	Curve Number	= 98
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 4.91 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

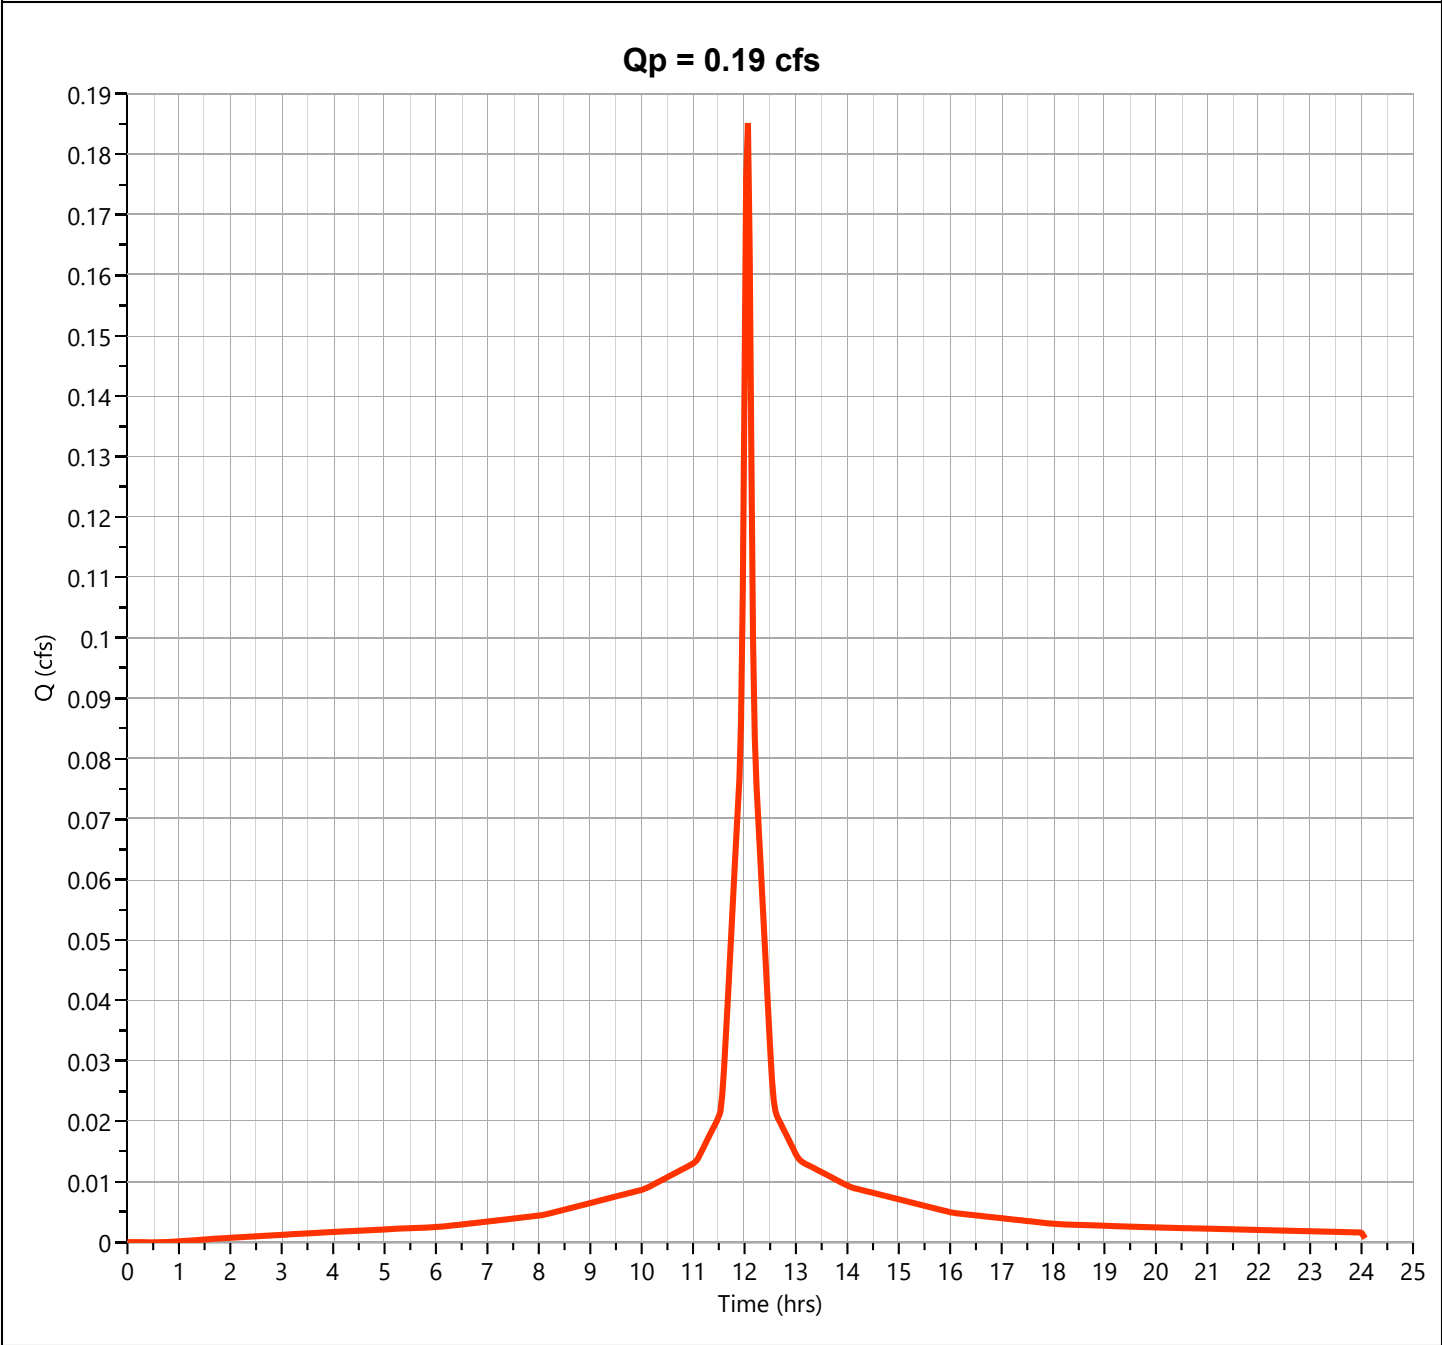

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Roof Drywell B

Hyd. No. 20

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.226 cfs
Storm Frequency	= 25-yr	Time to Peak	= 12.07 hrs
Time Interval	= 2 min	Runoff Volume	= 783 cuft
Drainage Area	= 0.04 ac	Curve Number	= 98
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 5.99 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

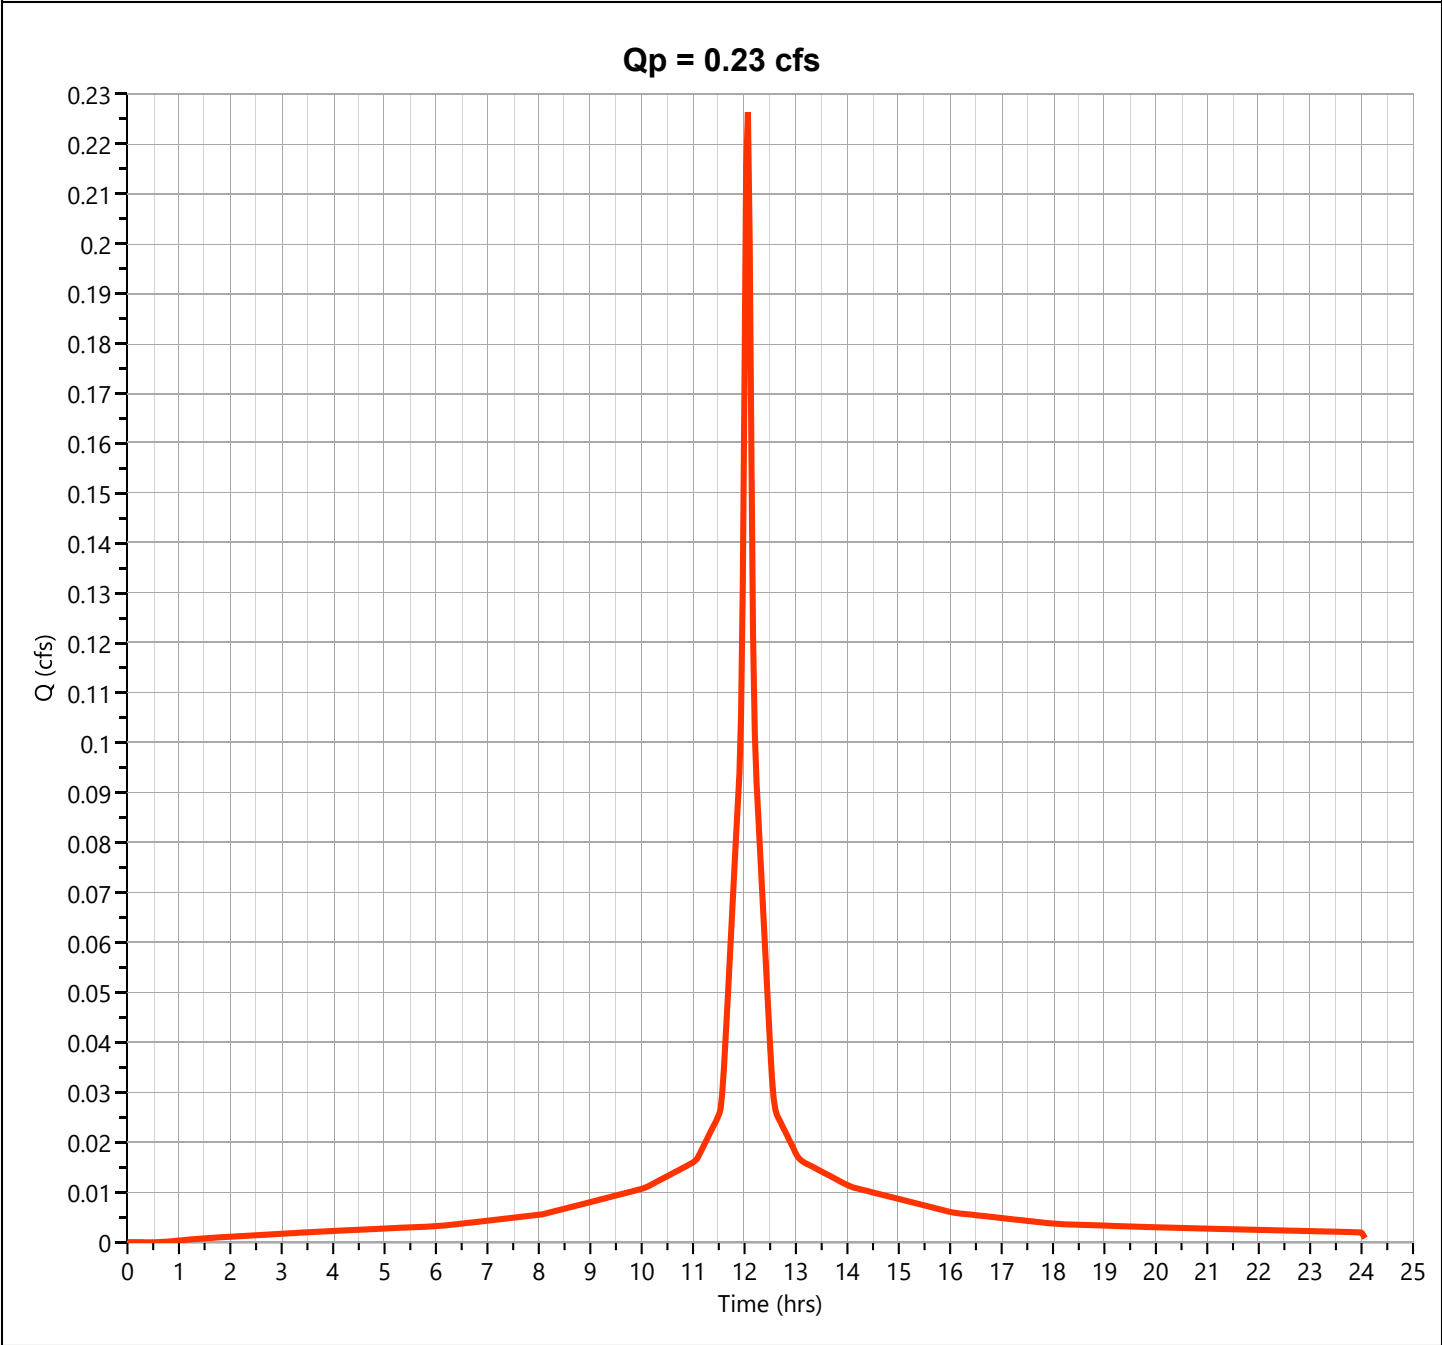

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Roof Drywell B

Hyd. No. 20

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.256 cfs
Storm Frequency	= 50-yr	Time to Peak	= 12.07 hrs
Time Interval	= 2 min	Runoff Volume	= 890 cuft
Drainage Area	= 0.04 ac	Curve Number	= 98
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 6.78 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

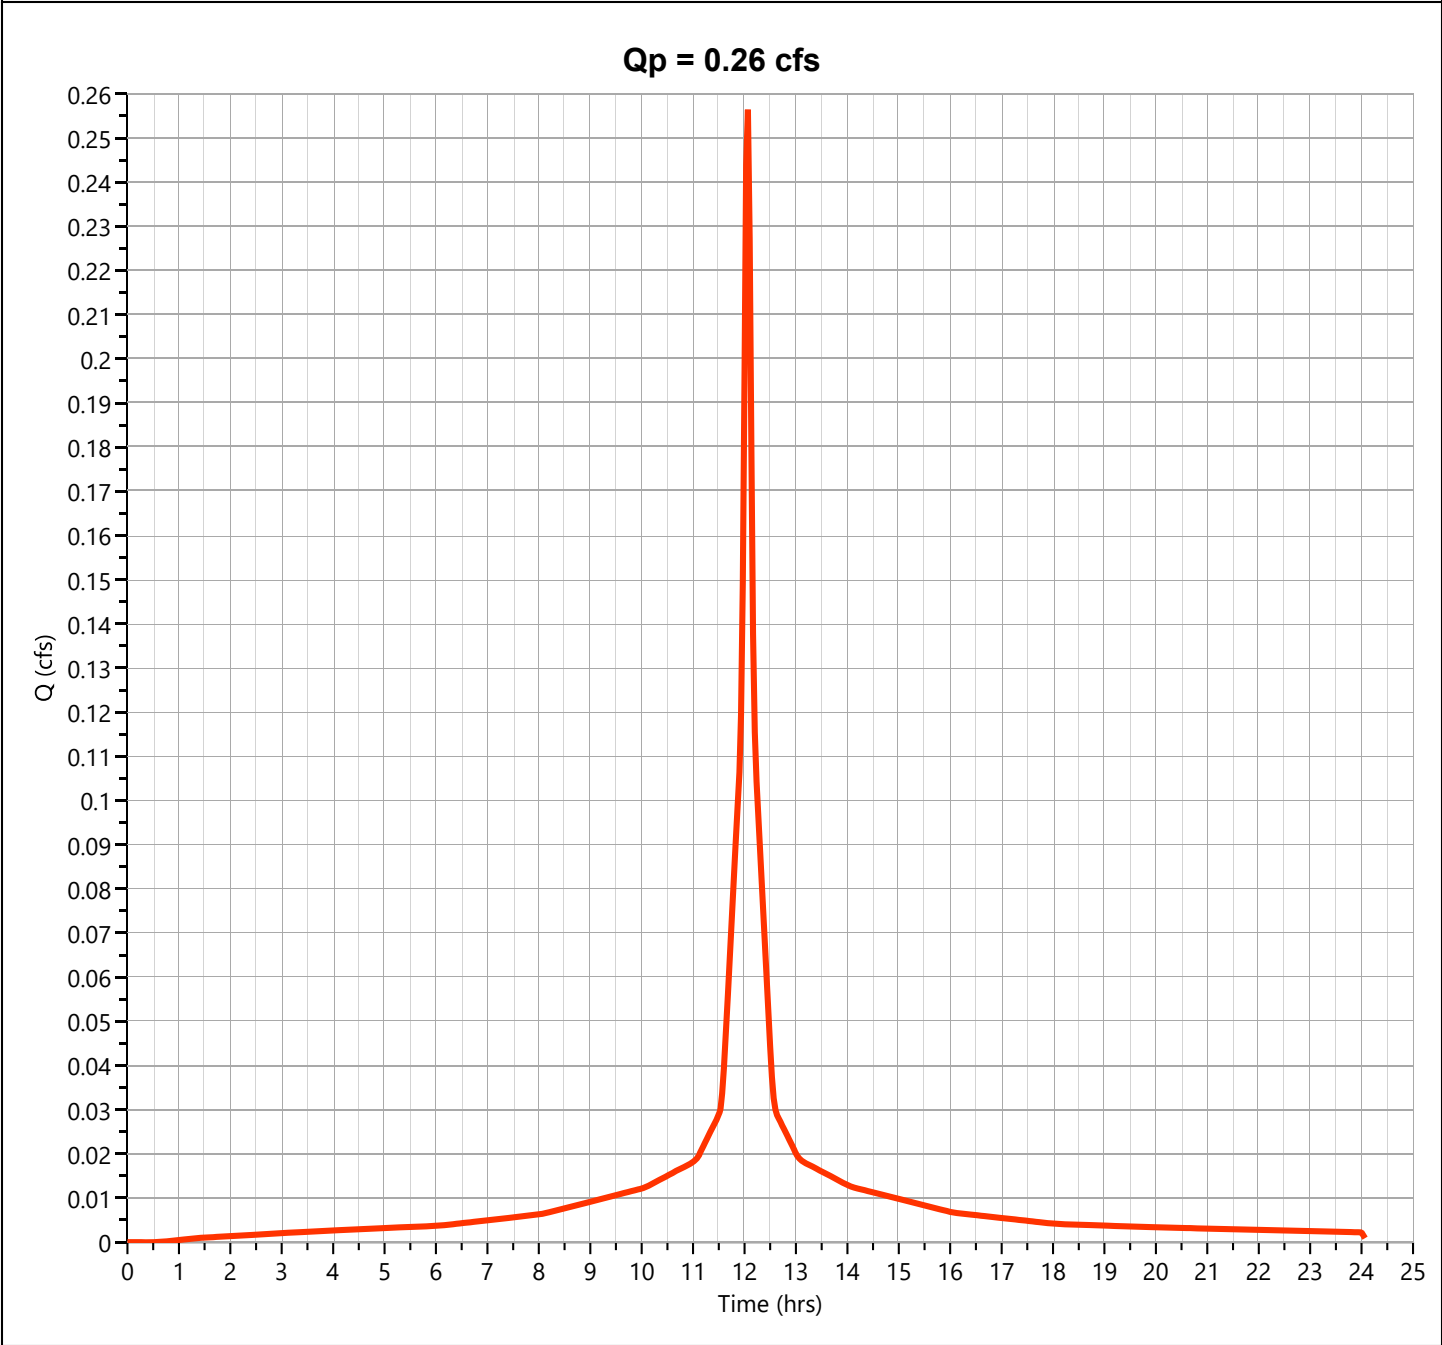

# Hydrograph Report

Project Name:


Hydrology Studio v 3.0.0.31

02-13-2024

## Roof Drywell B

Hyd. No. 20

Hydrograph Type	= NRCS Runoff	Peak Flow	= 0.290 cfs
Storm Frequency	= 100-yr	Time to Peak	= 12.07 hrs
Time Interval	= 2 min	Runoff Volume	= 1,009 cuft
Drainage Area	= 0.04 ac	Curve Number	= 98
Tc Method	= User	Time of Conc. (Tc)	= 6.0 min
Total Rainfall	= 7.65 in	Design Storm	= Type III
Storm Duration	= 24 hrs	Shape Factor	= 484

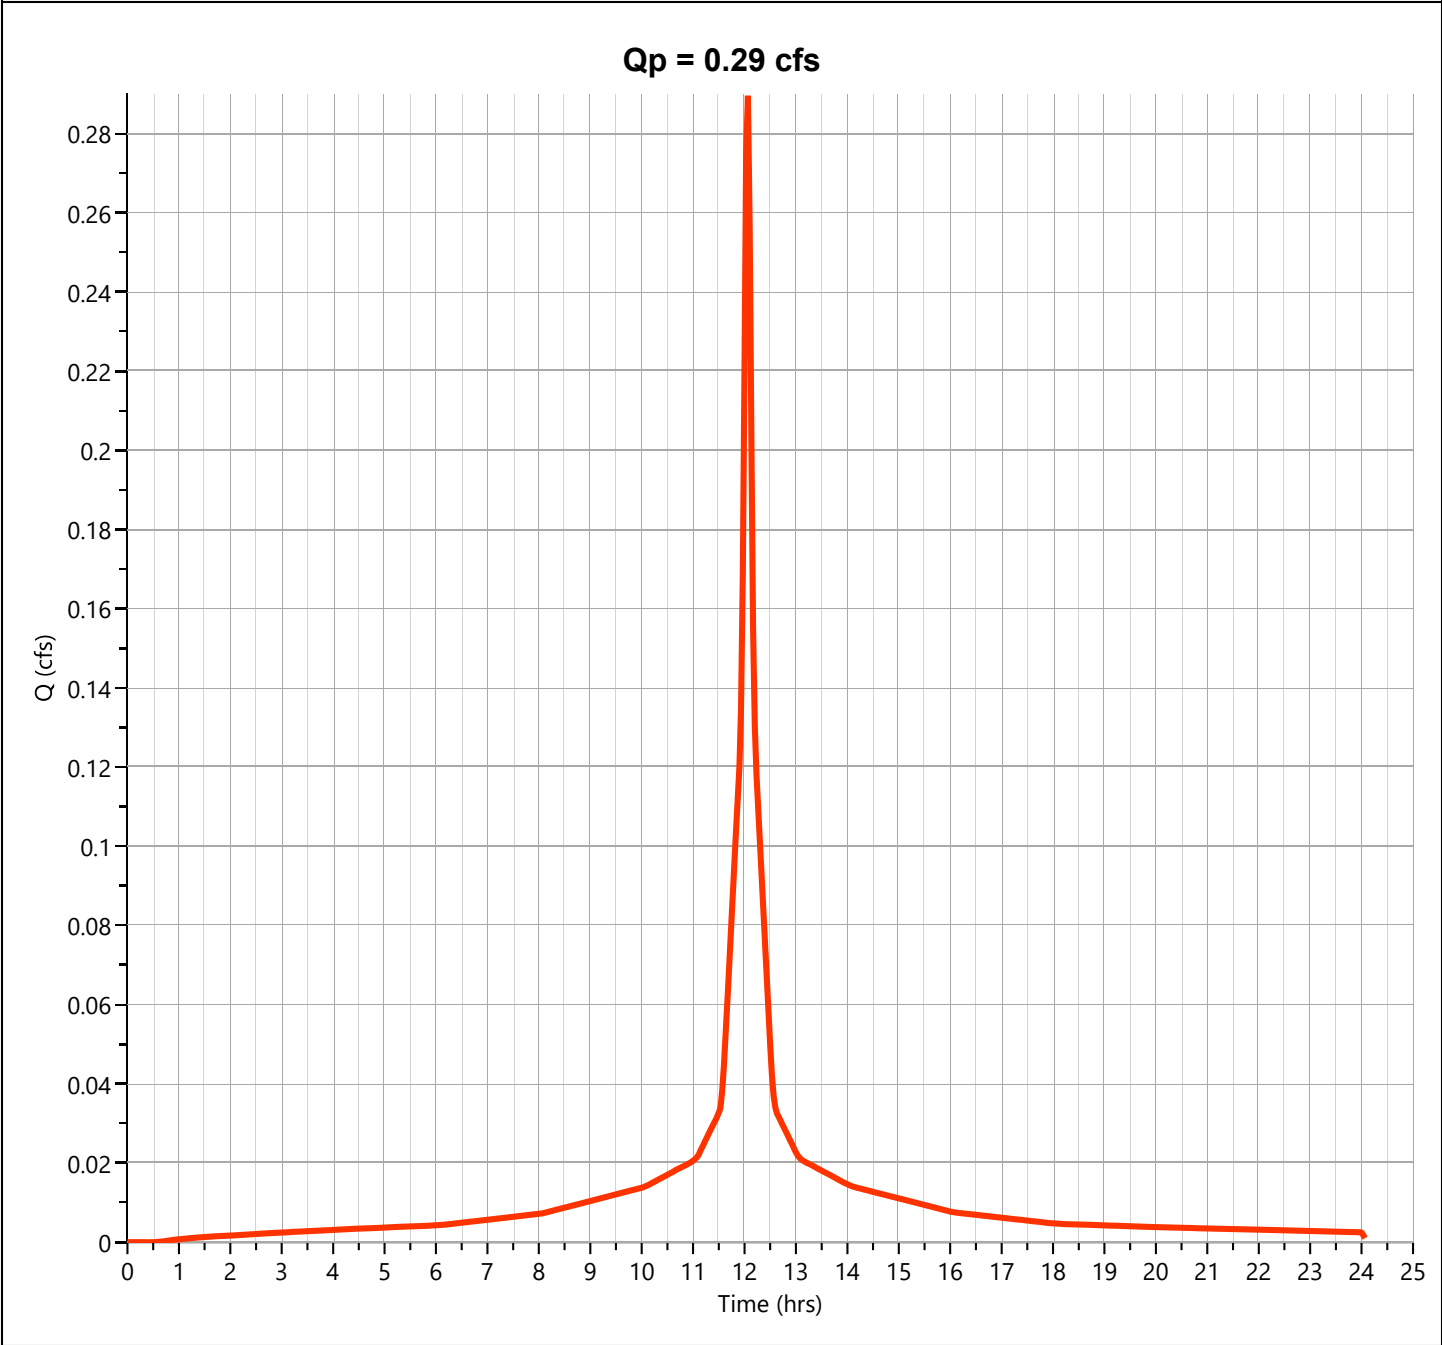


Roof Drywell B Route

Hyd. No. 21

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 2-yr	Time to Peak	= 11.57 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 20 - Roof Drywell B	Max. Elevation	= 1.86 ft
Pond Name	= Roof Drywell B	Max. Storage	= 68.2 cuft

Pond Routing by Storage Indication Method

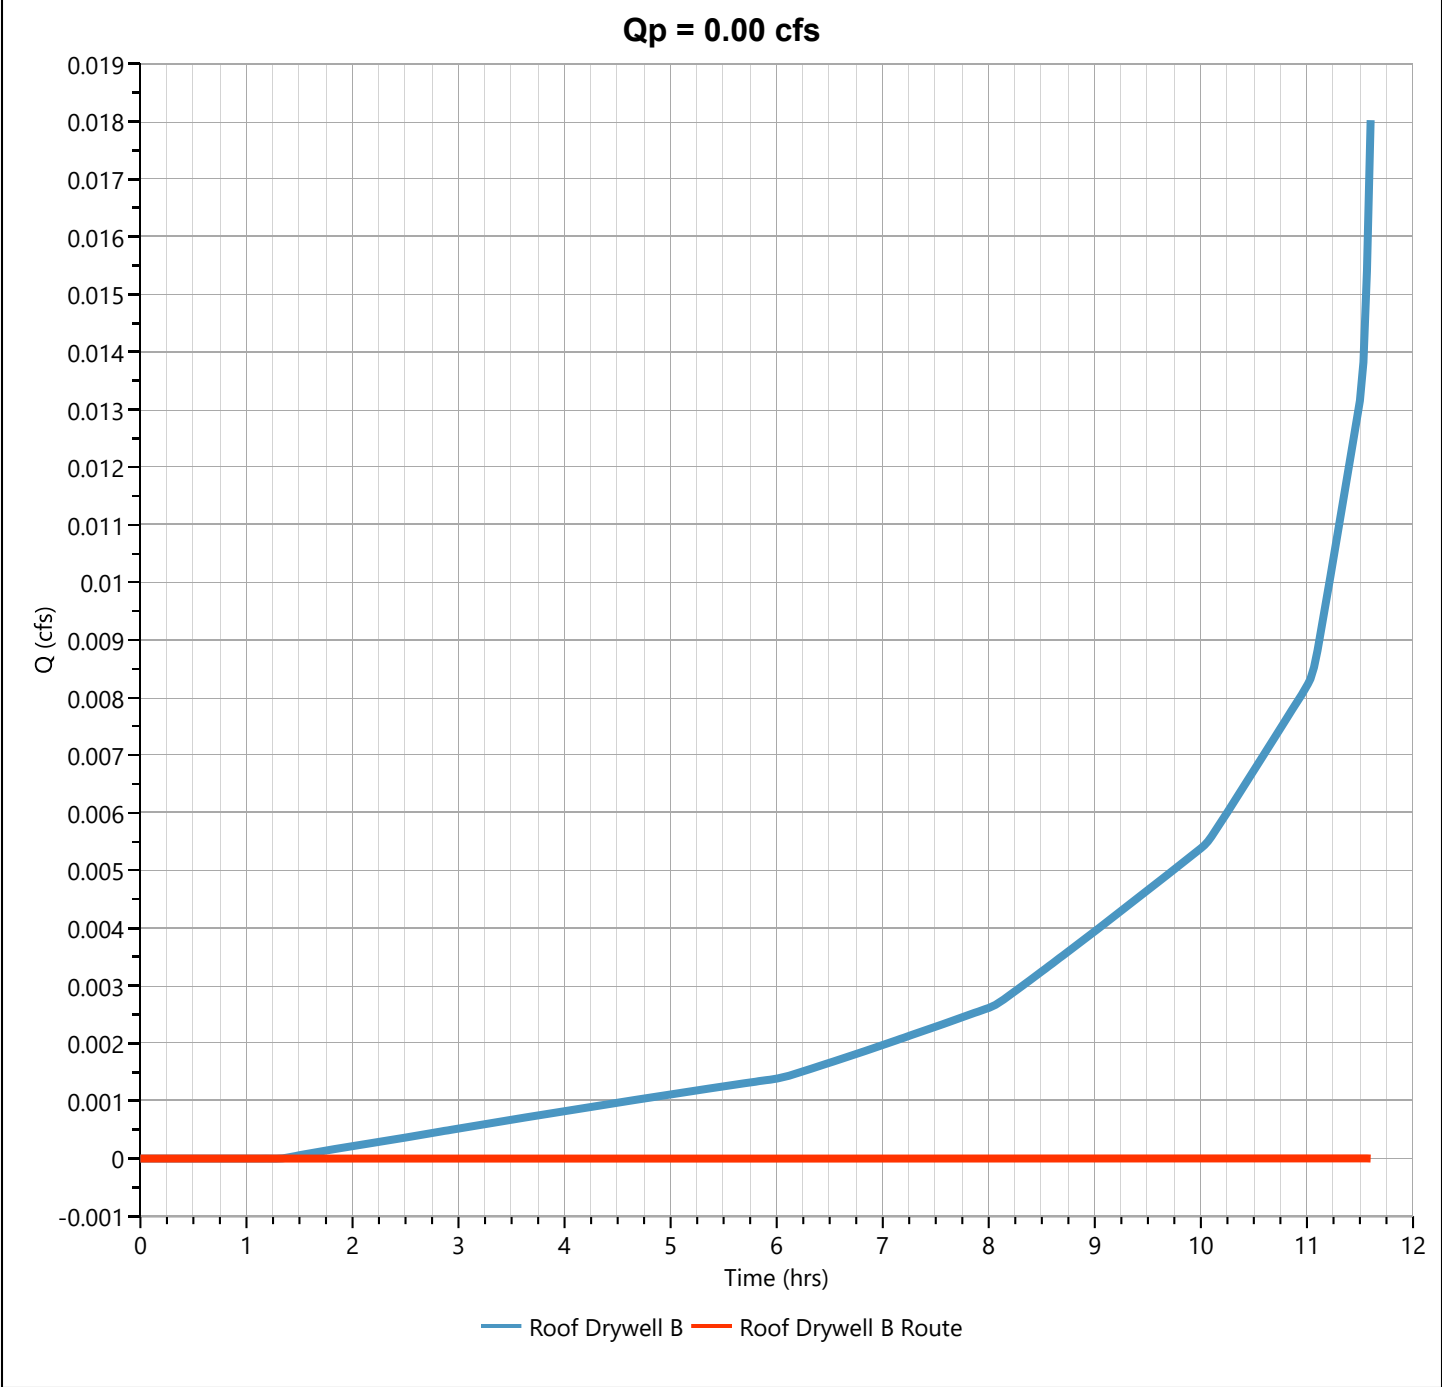

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31


02-13-2024

## Roof Drywell B Route

Hyd. No. 21

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 10-yr	Time to Peak	= 11.60 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 20 - Roof Drywell B	Max. Elevation	= 2.64 ft
Pond Name	= Roof Drywell B	Max. Storage	= 148 cuft

Pond Routing by Storage Indication Method

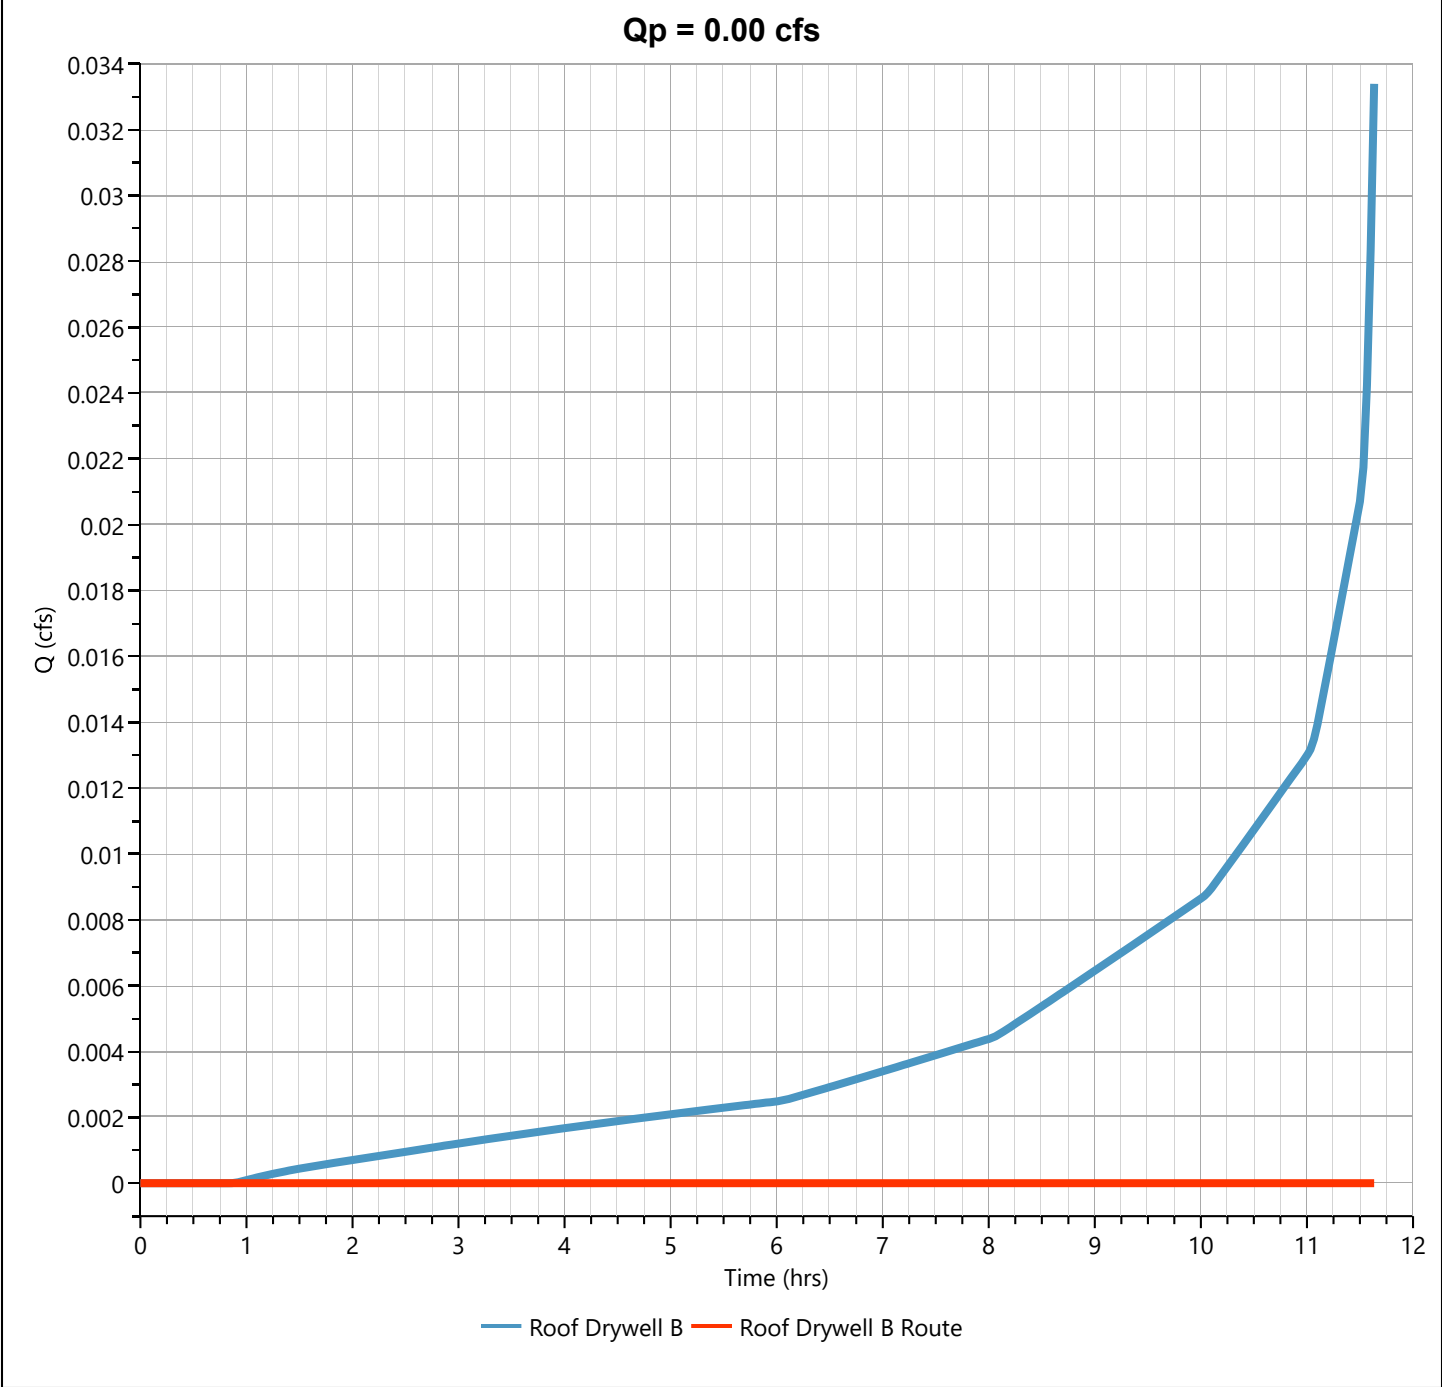

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31


02-13-2024

## Roof Drywell B Route

Hyd. No. 21

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 25-yr	Time to Peak	= 10.70 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 20 - Roof Drywell B	Max. Elevation	= 3.18 ft
Pond Name	= Roof Drywell B	Max. Storage	= 199 cuft

Pond Routing by Storage Indication Method

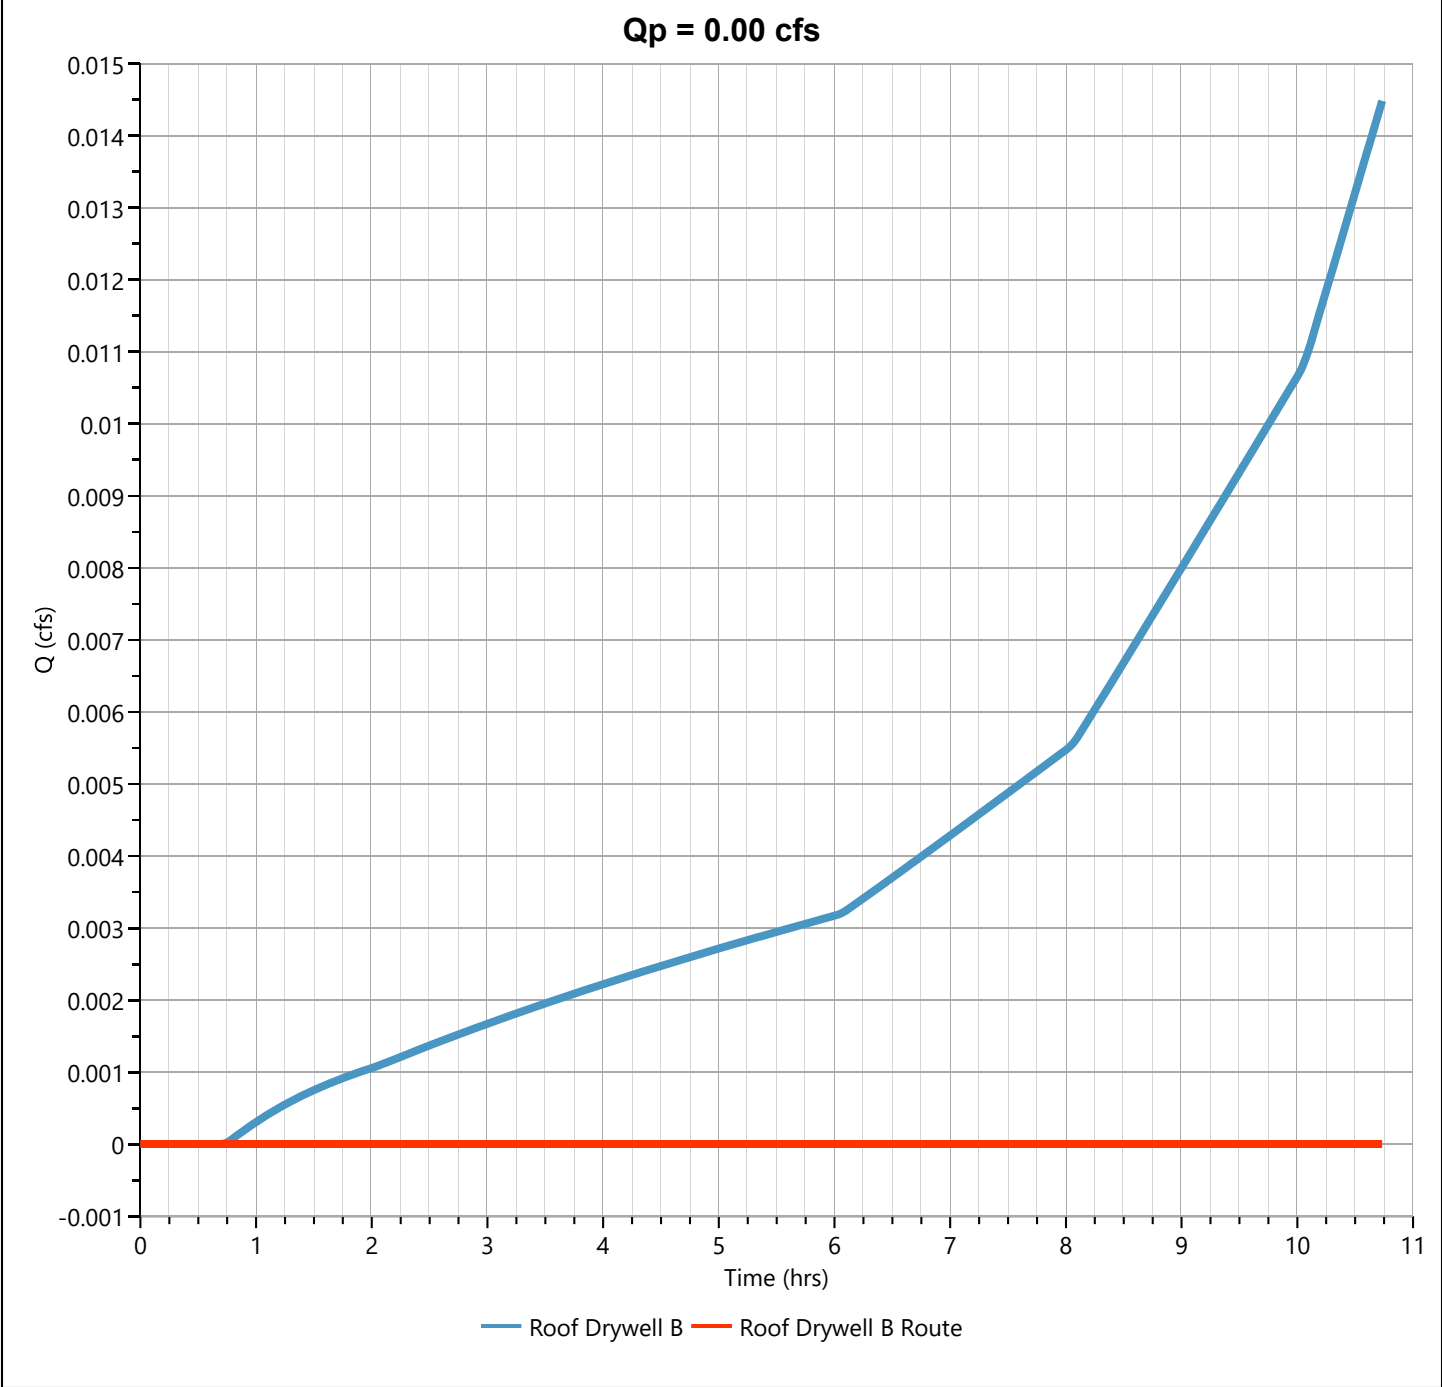




Roof Drywell B Route

Hyd. No. 21

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 50-yr	Time to Peak	= 11.50 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 20 - Roof Drywell B	Max. Elevation	= 3.62 ft
Pond Name	= Roof Drywell B	Max. Storage	= 238 cuft

Pond Routing by Storage Indication Method

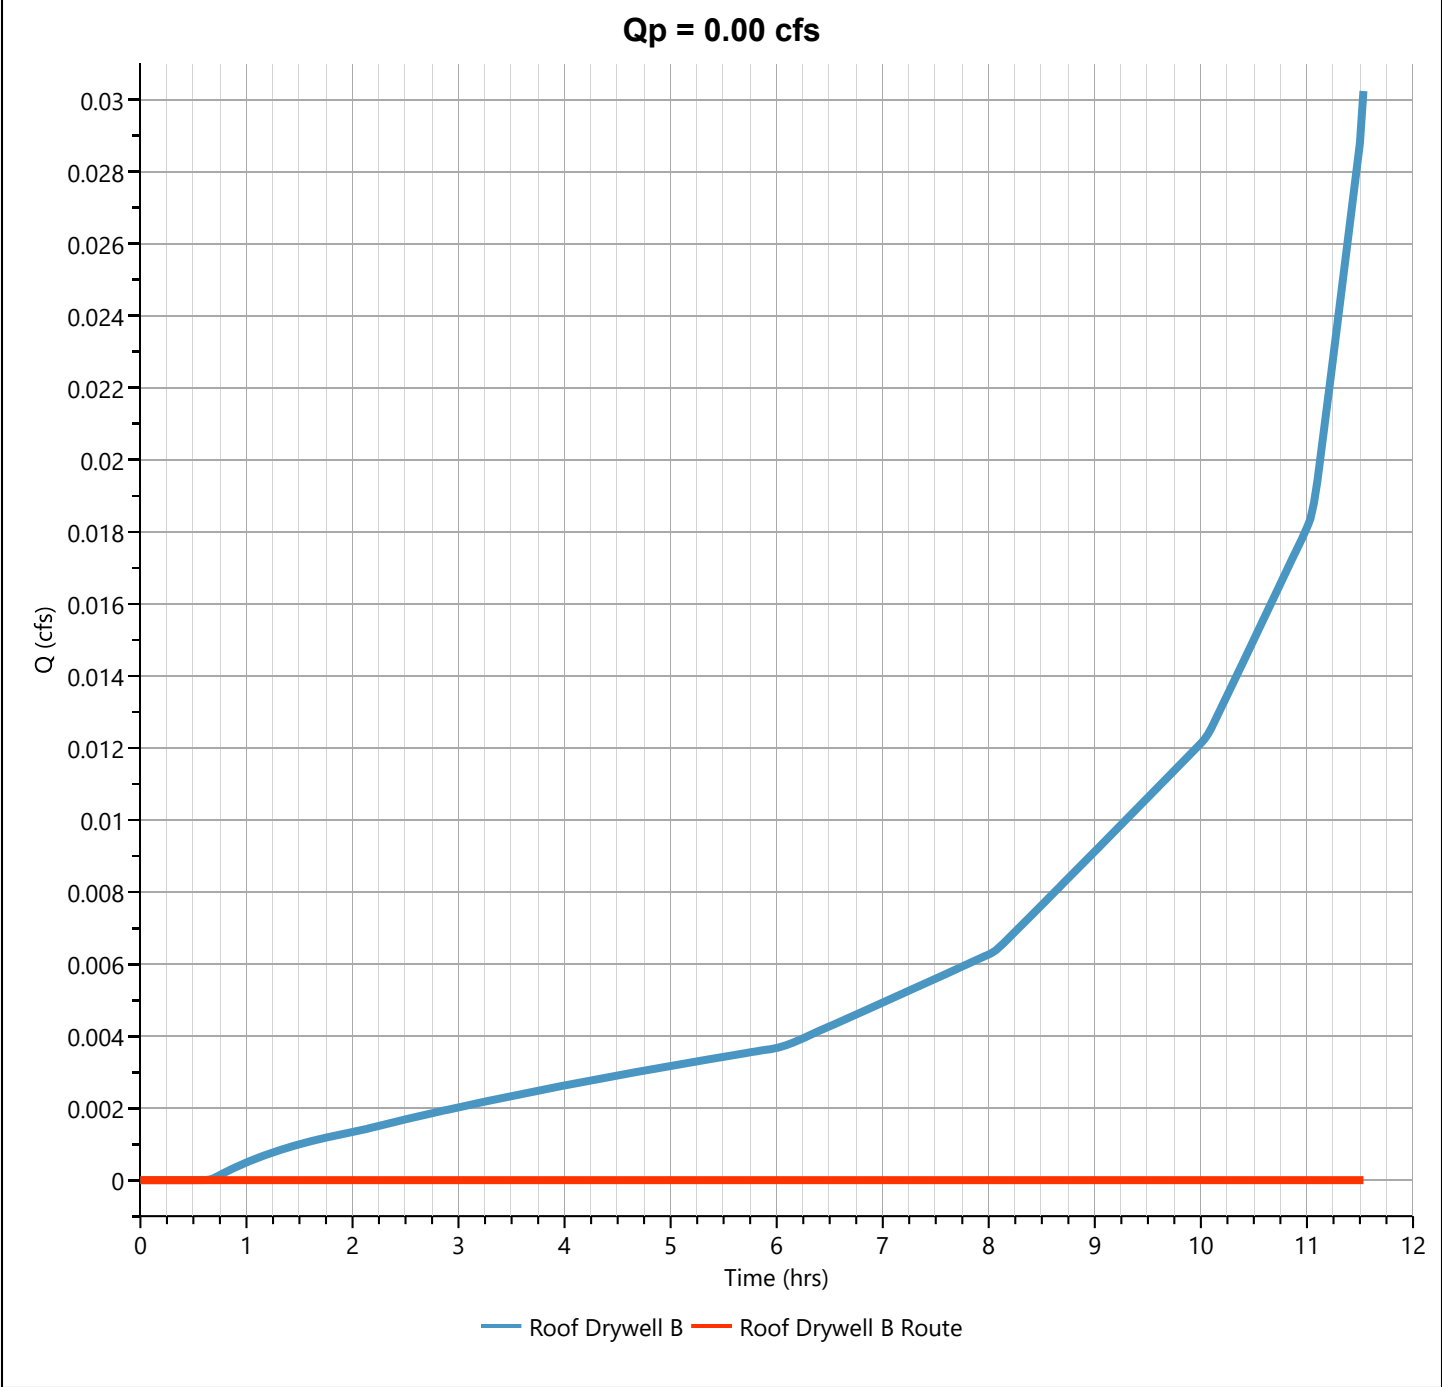

# Hydrograph Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024


## Roof Drywell B Route

Hyd. No. 21

Hydrograph Type	= Pond Route	Peak Flow	= 0.000 cfs
Storm Frequency	= 100-yr	Time to Peak	= 11.30 hrs
Time Interval	= 2 min	Hydrograph Volume	= 0.000 cuft
Inflow Hydrograph	= 20 - Roof Drywell B	Max. Elevation	= 4.22 ft
Pond Name	= Roof Drywell B	Max. Storage	= 281 cuft

Pond Routing by Storage Indication Method


Qp = 0.00 cfs

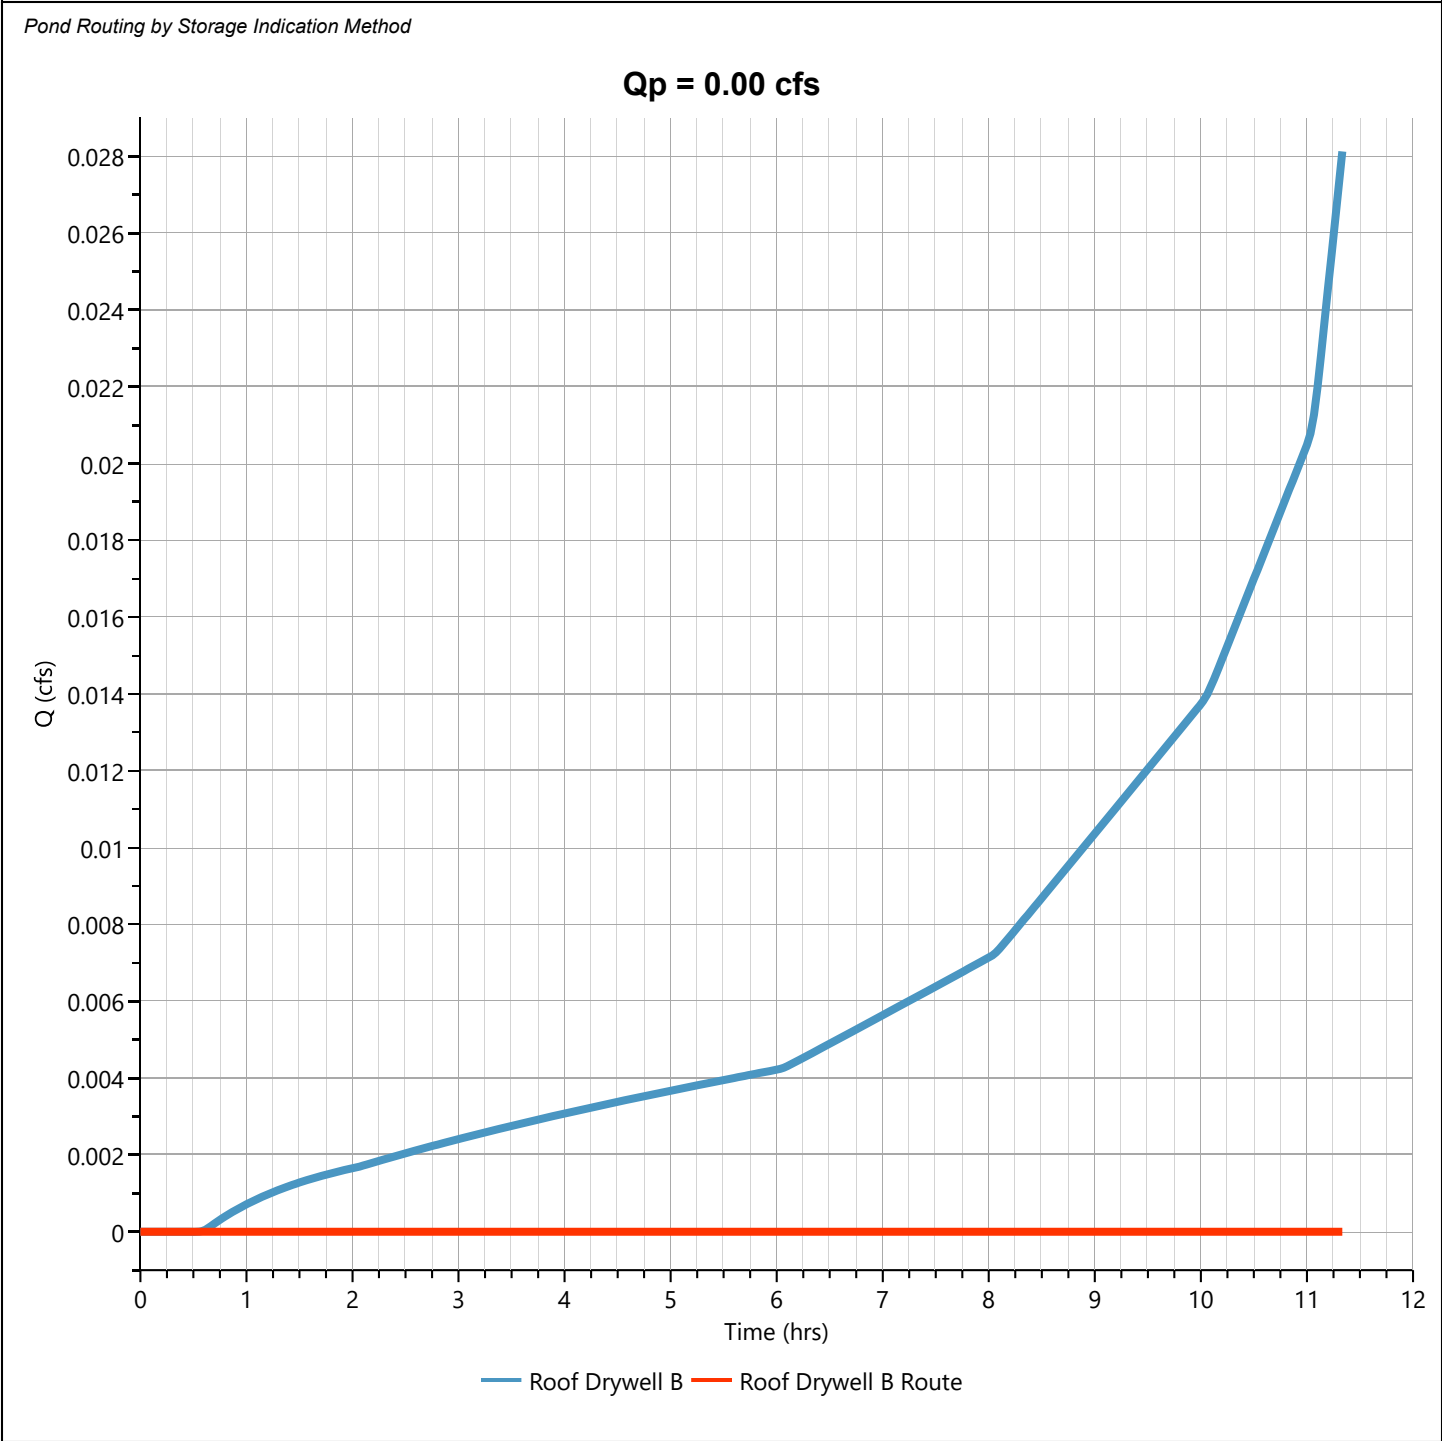

Roof Drywell B

Stage-Storage

StormTech® SC-740™ Chamber		Stage / Storage Table				
Description	Input	Stage (in)	Elevation (ft)	Contour Area (sqft)	Incr. Storage (cuft)	Total Storage (cuft)
Chamber Height, in	30	0.0	1.00	154	0.000	0.000
Chamber Shape	Arch	2.1	1.18	154	10.8	10.8
Chamber Width, in	51	4.2	1.35	154	10.8	21.6
Installed Length, ft	7.12	6.3	1.53	154	11.8	33.4
No. Chambers	3	8.4	1.70	154	18.2	51.5
Bare Chamber Stor, cuft	138	10.5	1.88	154	18.1	69.6
No. Rows	1	12.6	2.05	154	18.0	87.7
Space Between Rows, in	6	14.7	2.23	154	17.9	106
Stone Above, in	6	16.8	2.40	154	17.8	123
Stone Below, in	6	18.9	2.58	154	17.6	141
Stone Sides, in	12	21.0	2.75	154	17.3	158
Stone Ends, in	12	23.1	2.93	154	17.0	175
Encasement Voids, %	40.00	25.2	3.10	154	16.7	192
Encasement Bottom Elevation, ft	1.00	27.3	3.28	154	16.2	208
		29.4	3.45	154	15.7	224
		31.5	3.63	154	15.1	239
		33.6	3.80	154	14.2	253
		35.7	3.97	154	12.9	266
		37.8	4.15	154	11.1	277
		39.9	4.32	154	10.8	288
		42.0	4.50	154	10.8	299

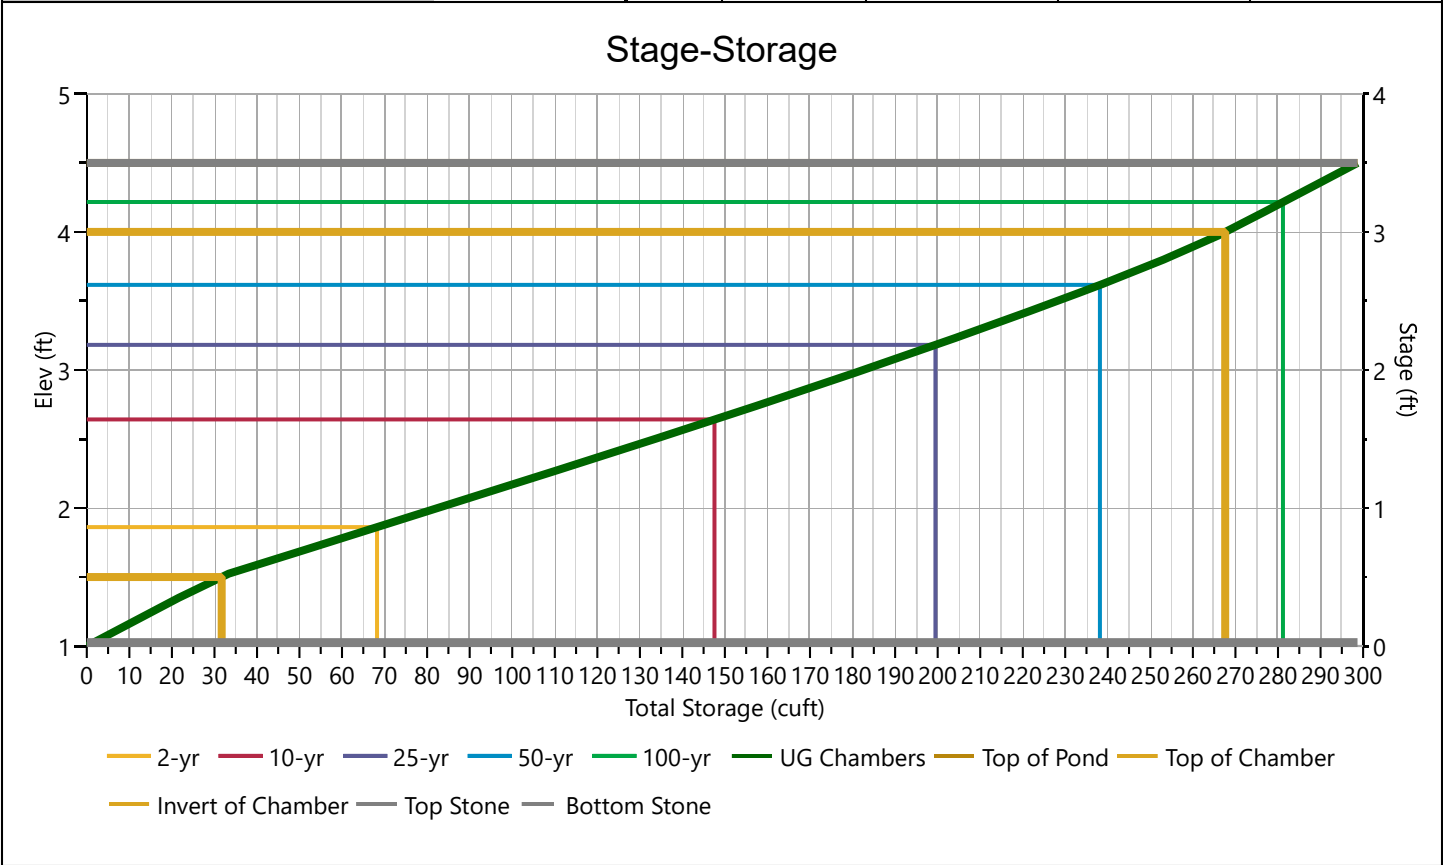


Roof Drywell B

Stage-Discharge

Culvert / Orifices	Culvert	Orifices			Perforated Riser
		1	2	3	
Rise, in					Hole Diameter, in
Span, in					No. holes
No. Barrels					Invert Elevation, ft
Invert Elevation, ft					Height, ft
Orifice Coefficient, Co					Orifice Coefficient, Co
Length, ft					
Barrel Slope, %					
N-Value, n	0.000				
Weirs	Riser*	Weirs			Ancillary
		1	2	3	
Shape / Type					Exfiltration, in/hr
Crest Elevation, ft					8.27**
Crest Length, ft					
Angle, deg					
Weir Coefficient, Cw					

\*Routes through Culvert. \*\*Exfiltration extracted from outflow hydrograph. Rate applied to contours.

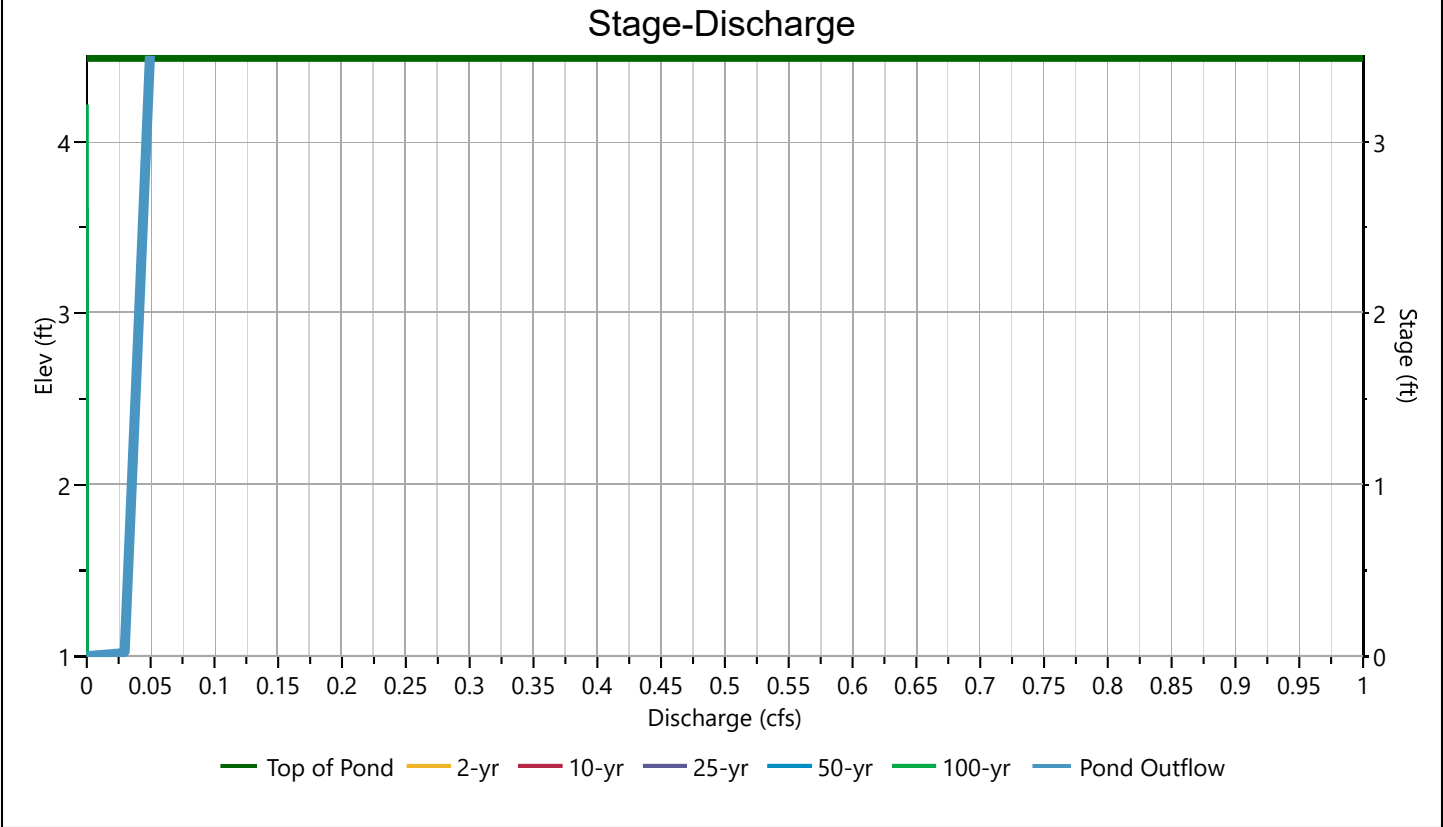

# Pond Report

Project Name:

Hydrology Studio v 3.0.0.31

02-13-2024

## Roof Drywell B


## Stage-Storage-Discharge Summary

[illegible]

Suffix key: ic = inlet control, oc = outlet control, s = submerged weir

Roof Drywell B

Pond Drawdown

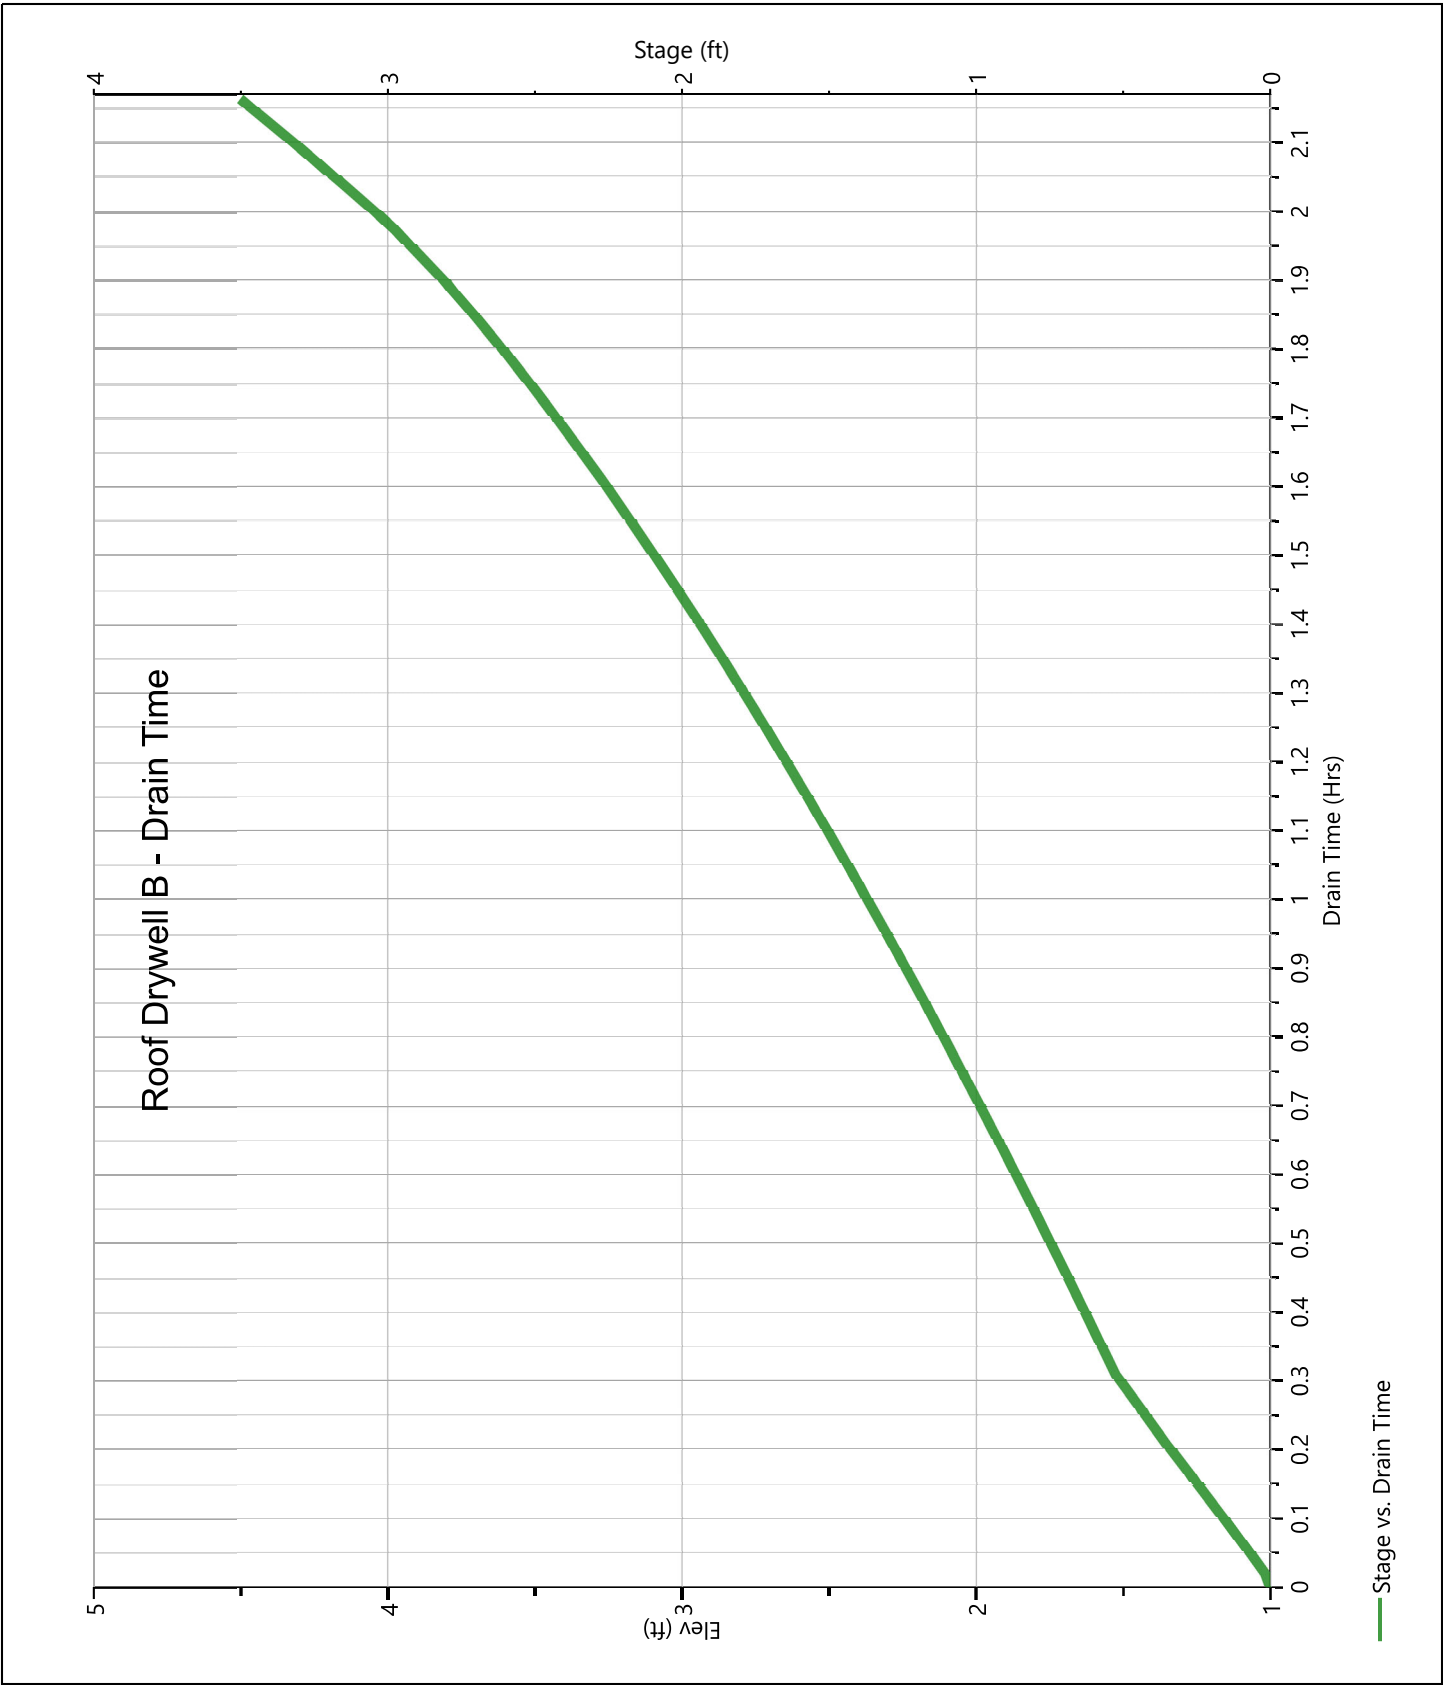

## **Recharge Volume Calculations**

## Recharge Volume Calculations

---

Job: SM-7306

Calculated PFK

Date: 2/12/2024

### INFILTRATION BASIN

Soils: Sand

Hydrologic A

Required Recharge Volume

0.6 inches of runoff x impervious area

Impervious 0.22 acres

9,482 s.f.

### Required Recharge Volume (Rv)

$$Rv = 9,482 \text{ s.f.} \times \frac{0.6}{12} = 474 \text{ c.f.}$$

### Simple Dynamic Method

$$A = Rv / (D + KT)$$

$$Rv = A(D + kT)$$

D (depth of infiltration facility): 3 ft

saturated hydraulic conductivity): 8.27 inches/hour

0.69 feet/hour

T (time): 2 hours

A= 506 s.f.

Voids= 1.00

Rv= 2,215 c.f.

Basin Volume: 4,378 c.f. (Below Outlet)

> 474 c.f.

### 72 Hour Drawdown

$Rv / (K \times \text{Bottom Area}) = 12.55 \text{ Hours}$

**12.55 < 72 hours O.K.**



## Recharge Volume Calculations

---

Job: SM-7306

Calculated PFK

Date: 2/12/2024

### Roof Drywell A

Soils: Sand

Hydrologic A

Required Recharge Volume

0.6 inches of runoff x impervious area

Impervious 0.08 acres

3,500 s.f.

### Required Recharge Volume (Rv)

$$Rv = 3,500 \text{ s.f.} \times \frac{0.6}{12} = 175 \text{ c.f.}$$

### Simple Dynamic Method

$$A = Rv / (D + KT)$$

$$Rv = A(D + kT)$$

D (depth of infiltration facility): 4.5 ft

saturated hydraulic conductivity): 8.27 inches/hour

0.69 feet/hour

T (time): 2 hours

A= 272 s.f.

Voids= 0.40

Rv= 865 c.f.

Basin Volume: 654 c.f.

> 175 c.f.

### 72 Hour Drawdown

$$Rv / (K \times \text{Bottom Area}) = 3.49 \text{ Hours}$$

**3.49 < 72 hours O.K.**

## Recharge Volume Calculations

---

Job: SM-7306

Calculated PFK

Date: 2/12/2024

### Roof Drywell B

Soils: Sand

Hydrologic A

Required Recharge Volume

0.6 inches of runoff x impervious area

Impervious 0.04 acres

1,750 s.f.

### Required Recharge Volume (Rv)

$$Rv = 1,750 \text{ s.f.} \times \frac{0.6}{12} = 88 \text{ c.f.}$$

### Simple Dynamic Method

$$A = Rv / (D + KT)$$

$$Rv = A(D + kT)$$

D (depth of infiltration facility): 3.5 ft

saturated hydraulic conductivity): 8.27 inches/hour

0.69 feet/hour

T (time): 2 hours

A= 154 s.f.

Voids= 0.40

Rv= 428 c.f.

Basin Volume: 299 c.f.

> 88 c.f.

### 72 Hour Drawdown

$$Rv / (K \times \text{Bottom Area}) = 2.82 \text{ Hours}$$

**2.82 < 72 hours O.K.**

## **Water Quality Volume Calculations**

## Water Quality Volume Calculations

---

Job: SM-7306

Calculated by: PFK

Date: 2/12/2024

### INFILTRATION BASIN

Soils: Sand

Hydrologic A

Required First Flush Volume

1 inch of runoff x impervious area

Impervious 0.22 acres

9,482 s.f.

### Required Water Quality Volume

$$V = 9,482 \text{ s.f.} \times \frac{1}{12} = 790 \text{ c.f.}$$

Volume Provided 4,378 c.f.

4,378	c.f. >	790	c.f. O.K.
-------	--------	-----	-----------

# Water Quality Volume Calculations

Job: SM-7306

Calculated by: PFK  
Date: 2/12/2024

**Roof Drywell A**

Soils: Sand

Hydrologic A

Required First Flush Volume

1 inch of runoff x impervious area

Impervious 0.08 acres  
3,500 s.f.

Required Water Quality Volume

$$V = 3,500 \text{ s.f.} \times \frac{1}{12} = 292 \text{ c.f.}$$

Volume Pr 654 c.f.

654	c.f. >	292	c.f. O.K.
-----	--------	-----	-----------

## Water Quality Volume Calculations

---

Job: SM-7306

Calculated by: PFK

Date: 2/12/2024

### Roof Drywell B

Soils: Sand

Hydrologic A

Required First Flush Volume

1 inch of runoff x impervious area

Impervious 0.04 acres

1,750 s.f.

### Required Water Quality Volume

$$V = 1,750 \text{ s.f.} \times \frac{1}{12} = 146 \text{ c.f.}$$

Volume Provided 299 c.f.

299	c.f. >	146	c.f. O.K.
-----	--------	-----	-----------

## **Pipe Sizing Calculations**

DATE: 2/12/2024  
DONE BY: PFK  
FILE: SM-7306

DATE: 2/12/2024  
DONE BY: PFK  
FILE: SM-7306

DONE BY: PFK  
FILE: SM-7306

FILE: SM-7306

DATE: 2/12/2024  
DONE BY: PFK  
FILE: SM-7306

DATE: 2/12/2024  
DONE BY: PFK  
FILE: SM-7306

DONE BY: PFK  
FILE: SM-7306

FILE: SM-7306

(ADS N-12)"n"= 0.012	12"-36"
(ADS N-12)"n"= 0.012	42"-60"
(Cast Iron)"n"= 0.011	

(ADS N-12)"n"= 0.012      42"-60"  
(Cast Iron)"n"= 0.011

(Cast Iron)"n"= 0.011

LOCATION: Littleton, MA

LOCATION: Littleton, MA

[illegible]



**Closed Drainage System****SM-7306**

1 of 2

Project: Strawberry FarmsBy PFK Date 2/12/2024Location: Littleton, MA

Checked \_\_\_\_\_ Date \_\_\_\_\_

**Rational Method**

Q = peak flow rate, (cfs)

i = rainfall intensity inches/hour

C = runoff coefficient,

A = area (ac)

C = 0.90 impervious

C = 0.20 landscaped / grass

C = 0.15 woods

**AD-1 TO DMH-1**

Surface Cover	A (ac)	C	Product A x C
impervious	0.09	0.9	0.07938
lands/grass	0.17	0.2	0.034706
woods	0.00	0.15	0
sum =	0.26	sum =	0.11

C = **0.44** = total product / total area**DMH-1 TO BASIN**

Surface Cover	A (ac)	C	Product A x C
impervious	0.09	0.9	0.07938
lands/grass	0.17	0.2	0.034706
woods	0.00	0.15	0
sum =	0.26	sum =	0.11

C = **0.44** = total product / total area

**Closed Drainage System****SM-7306**

2 of 2

Project: Strawberry FarmsBy PFK Date 2/12/2024Location: Littleton, MA

Checked \_\_\_\_\_ Date \_\_\_\_\_

**Rational Method**

Q = peak flow rate, (cfs)

i = rainfall intensity inches/hour

C = runoff coefficient,

A = area (ac)

C = 0.90 impervious

C = 0.20 landscaped / grass

C = 0.15 woods

**AD-2 TO DMH-2**

Surface Cover	A (ac)	C	Product A x C
impervious	0.04	0.9	0.032603
lands/grass	0.11	0.2	0.021217
woods	0.00	0.15	0
sum =	0.14	sum =	0.05

C = **0.38** = total product / total area**AD-3 TO DMH-2**

Surface Cover	A (ac)	C	Product A x C
impervious	0.09	0.9	0.083905
lands/grass	0.23	0.2	0.046878
woods	0.00	0.15	0
sum =	0.33	sum =	0.13

C = **0.40** = total product / total area**DMH-2 TO BASIN**

Surface Cover	A (ac)	C	Product A x C
impervious	0.13	0.9	0.116508
lands/grass	0.34	0.2	0.068095
woods	0.00	0.15	0
sum =	0.47	sum =	0.18

C = **0.39** = total product / total area

## **TSS Removal Worksheets**

**INSTRUCTIONS:**

1. Sheet is nonautomated. Print sheet and complete using hand calculations. Column A and B: See MassDEP Structural BMP Table
2. The calculations must be completed using the Column Headings specified in Chart and Not the Excel Column Headings
3. To complete Chart Column D, multiple Column B value within Row x Column C value within Row
4. To complete Chart Column E value, subtract Column D value within Row from Column C within Row
5. Total TSS Removal = Sum All Values in Column D

Non-automated: Mar. 4, 2008

Location:

A BMP <sup>1</sup>	B TSS Removal Rate <sup>1</sup>	C Starting TSS Load*	D Amount Removed (B*C)	E Remaining Load (C-D)
Deep-sump hooded area drain	25%	1.00	0.25	0.75
Sediment Forebay	25%	0.75	0.19	0.56

# TSS Removal Calculation Worksheet

**Total TSS Removal =**

Separate Form Needs to be Completed for Each Outlet or BMP Train

Project:

Prepared By:

Date:

\*Equals remaining load from previous BMP (E) which enters the BMP

**INSTRUCTIONS:**

1. Sheet is nonautomated. Print sheet and complete using hand calculations. Column A and B: See MassDEP Structural BMP Table
2. The calculations must be completed using the Column Headings specified in Chart and Not the Excel Column Headings
3. To complete Chart Column D, multiple Column B value within Row x Column C value within Row
4. To complete Chart Column E value, subtract Column D value within Row from Column C value within Row
5. Total TSS Removal = Sum All Values in Column D

Non-automated: Mar. 4, 2008

Location:

A	B	C	D	E
BMP <sup>1</sup>	TSS Removal Rate <sup>1</sup>	Starting TSS Load*	Amount Removed (B*C)	Remaining Load (C-D)
Infiltration Basin w/ pretreatment	80%	1.00	0.80	0.20

# TSS Removal Calculation Worksheet

**Total TSS Removal =**

Separate Form Needs to be Completed for Each Outlet or BMP Train

80%

Project:	7306
Prepared By:	PFK
Date:	2/12/2024

\*Equals remaining load from previous BMP (E) which enters the BMP



**INSTRUCTIONS:**

1. Sheet is nonautomated. Print sheet and complete using hand calculations. Column A and B: See MassDEP Structural BMP Table
2. The calculations must be completed using the Column Headings specified in Chart and Not the Excel Column Headings
3. To complete Chart Column D, multiple Column B value within Row x Column C value within Row
4. To complete Chart Column E value, subtract Column D value within Row from Column C value within Row
5. Total TSS Removal = Sum All Values in Column D

Non-automated: Mar. 4, 2008

Location:

A	B	C	D	E
BMP <sup>1</sup>	TSS Removal Rate <sup>1</sup>	Starting TSS Load*	Amount Removed (B*C)	Remaining Load (C-D)
Roof Drywell, from non-metal roofs	80%	1.00	0.80	0.20

## TSS Removal Calculation Worksheet

**Total TSS Removal =**

Separate Form Needs to be Completed for Each Outlet or BMP Train

80%

Project:   
 Prepared By:   
 Date:

\*Equals remaining load from previous BMP (E) which enters the BMP

## **Soil Evaluation**



Commonwealth of Massachusetts

City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### A. Facility Information

Owner Name VILENA T. FRIBERG

Street Address 95 TAYLOR STREET Map/Lot # MAP 040, PARCEL 8

City LITTLETON State MA Zip Code 01460

### B. Site Information

1. (Check one) ☒ New Construction ☐ Upgrade
2. Soil Survey WEB SOIL SURVEY 202B QUONSET SANDY LOAM  
Source Soil Map Unit Soil Series
- TERRACE, KAMES, ESKERS  
Landform
- OUTWASH  
Soil Parent material
3. Surficial Geological Report MASS MAPPER SAND AND GRAVEL  
Year Published/Source Map Unit
- Description of Geologic Map Unit:
4. Flood Rate Insurance Map Within a regulatory floodway? ☐ Yes ☒ No
5. Within a velocity zone? ☐ Yes ☒ No
6. Within a Mapped Wetland Area? ☐ Yes ☒ No If yes, MassGIS Wetland Data Layer: \_\_\_\_\_  
Wetland Type
7. Current Water Resource Conditions (USGS): 8/30/23 Range: ☒ Above Normal ☐ Normal ☐ Below Normal  
Month/Day/Year
8. Other references reviewed:  
(Zone II, IWPA, Zone A, EEA Data Portal, etc.) \_\_\_\_\_





Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: TP-1 Hole # 8/28/23 Date 8:30 AM Time 80° CLEAR Weather Latitude Longitude 0-5 Slope (%)

1. Land Use WOODLAND (e.g., woodland, agricultural field, vacant lot, etc.) WOODS Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.)

Description of Location: REAR OF SITE IN HISTORIC GRAVEL PIT

2. Soil Parent Material: OUTWASH Landform TERRACE Position on Landscape (SU, SH, BS, FS, TS, Plain) BS

3. Distances from: Open Water Body >100 feet Drainage Way >750 feet Wetlands >100 feet  
Property Line >710 feet Drinking Water Well >7100 feet Other        feet

4. Unsuitable Materials Present: ☐ Yes ☒ No If Yes: ☐ Disturbed Soil/Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No If yes:        Depth to Weeping in Hole        Depth to Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	—	Cnc : Dpl:	—	—	—	M	F	
12	B	S	10YR 5/6	✓	Cnc : Dpl:	—	—	—	SG	L	
72	C1	S	10YR 5/3	✓	Cnc : Dpl:	—	—	—	SG	L	
120	C2	CS	10YR 5/1	~	Cnc : Dpl:	—	10	—	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: TP-2      8/28/23      \_\_\_\_\_      \_\_\_\_\_      \_\_\_\_\_      \_\_\_\_\_  
Hole #      Date      Time      Weather      Latitude      Longitude

1. Land Use: \_\_\_\_\_  
(e.g., woodland, agricultural field, vacant lot, etc.)      Vegetation \_\_\_\_\_      Surface Stones (e.g., cobbles, stones, boulders, etc.) \_\_\_\_\_      Slope (%) \_\_\_\_\_

Description of Location: \_\_\_\_\_

2. Soil Parent Material: \_\_\_\_\_  
Landform \_\_\_\_\_      Position on Landscape (SU, SH, BS, FS, TS, Plain) \_\_\_\_\_

3. Distances from:      Open Water Body \_\_\_\_\_ feet      Drainage Way \_\_\_\_\_ feet      Wetlands \_\_\_\_\_ feet  
Property Line \_\_\_\_\_ feet      Drinking Water Well \_\_\_\_\_ feet      Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No      If Yes: ☐ Disturbed Soil/Fill Material      ☐ Weathered/Fractured Rock      ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No      If yes: \_\_\_\_\_ Depth to Weeping in Hole      \_\_\_\_\_ Depth Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	—	Cnc : Dpl:	—	—	—	M	F	
16	B	S	10YR 5/6	—	Cnc : Dpl:	—	—	—	SG	L	
96	C1	CS	10YR 5/1	—	Cnc : Dpl:	—	15	15	SG	L	
132	C2	S	10YR 5/3	—	Cnc : Dpl:	—	—	—	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes: \_\_\_\_\_



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: TP-3

Hole #

Date

8/28/23

Time

Weather

Latitude

Longitude

1. Land Use

(e.g., woodland, agricultural field, vacant lot, etc.)

Vegetation

Surface Stones (e.g., cobbles, stones, boulders, etc.)

Slope (%)

Description of Location:

2. Soil Parent Material:

Landform

Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from:

Open Water Body \_\_\_\_\_ feet

Drainage Way \_\_\_\_\_ feet

Wetlands \_\_\_\_\_ feet

Property Line \_\_\_\_\_ feet

Drinking Water Well \_\_\_\_\_ feet

Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No

If Yes: ☐ Disturbed Soil/Fill Material

☐ Weathered/Fractured Rock

☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No

If yes: \_\_\_\_\_ Depth to Weeping in Hole

\_\_\_\_\_ Depth to Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR <sup>3/3</sup>	—	Cnc : Dpl:	—	—	—	M	F	
22	B	S	10YR <sup>5/6</sup>	—	Cnc : Dpl:	—	—	—	SG	L	
38	C1	CS	10YR <sup>5/1</sup>	—	Cnc : Dpl:	—	15	15	SG	L	
126	C2	S	10YR <sup>5/3</sup>	—	Cnc : Dpl:	—	—	—	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number:

JP-4  
Hole #

8/28/23  
Date

Time

Weather

Latitude

Longitude

1. Land Use:

(e.g., woodland, agricultural field, vacant lot, etc.)

Vegetation

Surface Stones (e.g., cobbles, stones, boulders, etc.)

Slope (%)

Description of Location:

2. Soil Parent Material:

Landform

Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from:

Open Water Body \_\_\_\_\_ feet

Drainage Way \_\_\_\_\_ feet

Wetlands \_\_\_\_\_ feet

Property Line \_\_\_\_\_ feet

Drinking Water Well \_\_\_\_\_ feet

Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No

If Yes: ☐ Disturbed Soil/Fill Material

☐ Weathered/Fractured Rock

☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No

If yes: \_\_\_\_\_ Depth to Weeping in Hole

\_\_\_\_\_ Depth Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	-	Cnc : Dpl:				M	F	
18	B	S	10YR 5/6	-	Cnc : Dpl:				SG	L	
72	C1	S	10YR 5/3	-	Cnc : Dpl:				SG	L	
138	C2	CS	10YR 5/1	-	Cnc : Dpl:		15	15	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: TP-5 8/28/23  
Hole # Date Time Weather Latitude Longitude

1. Land Use (e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.) Slope (%)

Description of Location: \_\_\_\_\_

2. Soil Parent Material: \_\_\_\_\_ Landform Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from: Open Water Body \_\_\_\_\_ feet Drainage Way \_\_\_\_\_ feet Wetlands \_\_\_\_\_ feet  
Property Line \_\_\_\_\_ feet Drinking Water Well \_\_\_\_\_ feet Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No If Yes: ☐ Disturbed Soil/Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No If yes: \_\_\_\_\_ Depth to Weeping in Hole \_\_\_\_\_ Depth to Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	—	Cnc : Dpl:	—	—	—	M	F	
16	B	S	10YR 5/6	—	Cnc : Dpl:	—	—	—	SG	L	
32	C1	CS	10YR 5/1	—	Cnc : Dpl:	—	10	—	SG	L	
126	C2	S	10YR 5/3	—	Cnc : Dpl:	—	—	—	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes: \_\_\_\_\_



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: IP-6 8/28/23 \_\_\_\_\_  
Hole # Date Time Weather Latitude Longitude

1. Land Use: \_\_\_\_\_  
(e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.) Slope (%)

Description of Location: \_\_\_\_\_

2. Soil Parent Material: \_\_\_\_\_  
Landform Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from: Open Water Body \_\_\_\_\_ feet Drainage Way \_\_\_\_\_ feet Wetlands \_\_\_\_\_ feet  
Property Line \_\_\_\_\_ feet Drinking Water Well \_\_\_\_\_ feet Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No If Yes: ☐ Disturbed Soil/Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No If yes: \_\_\_\_\_ Depth to Weeping in Hole \_\_\_\_\_ Depth Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	—	Cnc : Dpl:	—	—	—	M	F	
16	B	S	10YR 5/6	—	Cnc : Dpl:	—	—	—	SG	L	
40	C1	CS	10YR 5/1	—	Cnc : Dpl:	—	20	20	SG	L	
120	C2	S	10YR 5/3	—	Cnc : Dpl:	—	—	—	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes: \_\_\_\_\_



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: TP-7 8/28/23 \_\_\_\_\_  
Hole # Date Time Weather Latitude Longitude

1. Land Use \_\_\_\_\_  
(e.g., woodland, agricultural field, vacant lot, etc.) Vegetation \_\_\_\_\_ Surface Stones (e.g., cobbles, stones, boulders, etc.) \_\_\_\_\_ Slope (%) \_\_\_\_\_

Description of Location: \_\_\_\_\_

2. Soil Parent Material: \_\_\_\_\_  
Landform \_\_\_\_\_ Position on Landscape (SU, SH, BS, FS, TS, Plain) \_\_\_\_\_

3. Distances from: Open Water Body \_\_\_\_\_ feet Drainage Way \_\_\_\_\_ feet Wetlands \_\_\_\_\_ feet  
Property Line \_\_\_\_\_ feet Drinking Water Well \_\_\_\_\_ feet Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No If Yes: ☐ Disturbed Soil/Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No If yes: \_\_\_\_\_ Depth to Weeping in Hole \_\_\_\_\_ Depth to Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	-	Cnc : Dpl:				M	F	
16	B	S	10YR 5/6	-	Cnc : Dpl:				SG	L	
120	C	CS	10YR 5/3	-	Cnc : Dpl:		20	20	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes: \_\_\_\_\_



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review *(minimum of two holes required at every proposed primary and reserve disposal area)*

Deep Observation Hole Number:

TP-8

Hole #

8/28/23

Date

Time

Weather

Latitude

Longitude

1. Land Use:

(e.g., woodland, agricultural field, vacant lot, etc.)

Vegetation

Surface Stones (e.g., cobbles, stones, boulders, etc.)

Slope (%)

Description of Location:

2. Soil Parent Material:

Landform

Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from:

Open Water Body \_\_\_\_\_ feet

Drainage Way \_\_\_\_\_ feet

Wetlands \_\_\_\_\_ feet

Property Line \_\_\_\_\_ feet

Drinking Water Well \_\_\_\_\_ feet

Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No

If Yes: ☐ Disturbed Soil/Fill Material

☐ Weathered/Fractured Rock

☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No

If yes: \_\_\_\_\_ Depth to Weeping in Hole

\_\_\_\_\_ Depth Standing Water in Hole

### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	-	Cnc : Dpl:	-	-	-	M	F	
18	B	S	10YR 5/6	-	Cnc : Dpl:	-	-	-	SG	L	
84	C1	S	10YR 5/3	-	Cnc : Dpl:	-	-	-	SG	L	
120	C2	CS	10YR 5/1	-	Cnc : Dpl:	-	20	20	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:





Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review *(minimum of two holes required at every proposed primary and reserve disposal area)*

Deep Observation Hole Number: TP-9

Hole #

Date

8/28/23

Time

Weather

Latitude

Longitude

1. Land Use

(e.g., woodland, agricultural field, vacant lot, etc.)

Vegetation

Surface Stones (e.g., cobbles, stones, boulders, etc.)

Slope (%)

Description of Location:

2. Soil Parent Material:

Landform

Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from:

Open Water Body \_\_\_\_\_ feet

Drainage Way \_\_\_\_\_ feet

Wetlands \_\_\_\_\_ feet

Property Line \_\_\_\_\_ feet

Drinking Water Well \_\_\_\_\_ feet

Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☐ No

If Yes: ☐ Disturbed Soil/Fill Material

☐ Weathered/Fractured Rock

☐ Bedrock

5. Groundwater Observed: ☐ Yes ☐ No

If yes: \_\_\_\_\_ Depth to Weeping in Hole

\_\_\_\_\_ Depth to Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	-	Cnc : Dpl:	-	-	-	M	F	
14	B	S	10YR 5/6	-	Cnc : Dpl:	-	-	-	SG	L	
32	C1	CS	10YR 5/3	-	Cnc : Dpl:	-	10	-	SG	L	
132	C2	S	10YR 5/3	-	Cnc : Dpl:	-	-	-	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: DP-10

Hole #

Date

8/25/23

Time

Weather

Latitude

Longitude

1. Land Use:

(e.g., woodland, agricultural field, vacant lot, etc.)

Vegetation

Surface Stones (e.g., cobbles, stones, boulders, etc.)

Slope (%)

Description of Location:

2. Soil Parent Material:

Landform

Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from:

Open Water Body \_\_\_\_\_ feet

Drainage Way \_\_\_\_\_ feet

Wetlands \_\_\_\_\_ feet

Property Line \_\_\_\_\_ feet

Drinking Water Well \_\_\_\_\_ feet

Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No

If Yes: ☐ Disturbed Soil/Fill Material

☐ Weathered/Fractured Rock

☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No

If yes: \_\_\_\_\_ Depth to Weeping in Hole

\_\_\_\_\_ Depth Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	-	Cnc : Dpl:	-	-	-	M	F	
14	B	S	10YR 5/6	-	Cnc : Dpl:	-	-	-	SG	L	
78	C1	S	10YR 5/3	-	Cnc : Dpl:	-	-	-	SG	L	
120	C2	CS	10YR 5/1	-	Cnc : Dpl:	-	15	15	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: TP-11 8/28/23      
Hole # Date Time Weather Latitude Longitude

1. Land Use  (e.g., woodland, agricultural field, vacant lot, etc.)  Vegetation  Surface Stones (e.g., cobbles, stones, boulders, etc.)  Slope (%)

Description of Location:

2. Soil Parent Material:  Landform  Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from: Open Water Body  feet Drainage Way  feet Wetlands  feet  
Property Line  feet Drinking Water Well  feet Other  feet

4. Unsuitable Materials Present: ☐ Yes ☒ No If Yes: ☐ Disturbed Soil/Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No If yes:  Depth to Weeping in Hole  Depth to Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	-	Cnc : Dpl:	-	-	-	M	F	
16	B	S	10YR 5/6	-	Cnc : Dpl:	-	-	-	SG	L	
120	C	CS	10YR 5/3	-	Cnc : Dpl:	-	10	-	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: IP-12 8/28/23  
Hole # Date Time Weather Latitude Longitude

1. Land Use: \_\_\_\_\_  
(e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.) Slope (%)

Description of Location: \_\_\_\_\_

2. Soil Parent Material: \_\_\_\_\_  
Landform Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from: Open Water Body \_\_\_\_\_ feet Drainage Way \_\_\_\_\_ feet Wetlands \_\_\_\_\_ feet  
Property Line \_\_\_\_\_ feet Drinking Water Well \_\_\_\_\_ feet Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No If Yes: ☐ Disturbed Soil/Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No If yes: \_\_\_\_\_ Depth to Weeping in Hole \_\_\_\_\_ Depth Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	-	Cnc : Dpl:	-	-	-	M	F	
10	B	S	10YR 5/6	-	Cnc : Dpl:	-	-	-	SG	L	
40	C1	CS	10YR 5/3	-	Cnc : Dpl:	-	10	-	SG	L	
78	C2	S	10YR 5/3	-	Cnc : Dpl:	-	-	-	SG	L	
120	C3	CS	10YR 5/1	-	Cnc : Dpl:	-	15	15	SG	L	
					Cnc : Dpl:						

Additional Notes: \_\_\_\_\_

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

**C. On-Site Review** *(minimum of two holes required at every proposed primary and reserve disposal area)*

Deep Observation Hole Number: TP-13

Hole #	Date	Time	Weather	Latitude	Longitude
	<u>8/28/23</u>				

1. Land Use \_\_\_\_\_ (e.g., woodland, agricultural field, vacant lot, etc.) \_\_\_\_\_ Vegetation \_\_\_\_\_ Surface Stones (e.g., cobbles, stones, boulders, etc.) \_\_\_\_\_ Slope (%) \_\_\_\_\_
- Description of Location: \_\_\_\_\_
2. Soil Parent Material: \_\_\_\_\_ Landform \_\_\_\_\_ Position on Landscape (SU, SH, BS, FS, TS, Plain) \_\_\_\_\_
3. Distances from: Open Water Body \_\_\_\_\_ feet Drainage Way \_\_\_\_\_ feet Wetlands \_\_\_\_\_ feet  
Property Line \_\_\_\_\_ feet Drinking Water Well \_\_\_\_\_ feet Other \_\_\_\_\_ feet
4. Unsuitable Materials Present: ☐ Yes ☒ No If Yes: ☐ Disturbed Soil/Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock
5. Groundwater Observed: ☐ Yes ☒ No If yes: \_\_\_\_\_ Depth to Weeping in Hole \_\_\_\_\_ Depth to Standing Water in Hole

## Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	-	Cnc : Dpl:	-	-	-	M	F	
16	B	S	10YR 5/6	-	Cnc : Dpl:	-	-	-	SG	L	
48	C1	CS	10YR 5/3	-	Cnc : Dpl:	-	10	-	SG	L	
132	C2	S	10YR 5/3	-	Cnc : Dpl:	-	-	-	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: TP-14

Hole #

8/28/23  
Date

Time

Weather

Latitude

Longitude

1. Land Use:

(e.g., woodland, agricultural field, vacant lot, etc.)

Vegetation

Surface Stones (e.g., cobbles, stones, boulders, etc.)

Slope (%)

Description of Location:

2. Soil Parent Material:

Landform

Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from:

Open Water Body \_\_\_\_\_ feet

Drainage Way \_\_\_\_\_ feet

Wetlands \_\_\_\_\_ feet

Property Line \_\_\_\_\_ feet

Drinking Water Well \_\_\_\_\_ feet

Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No

If Yes: ☐ Disturbed Soil/Fill Material

☐ Weathered/Fractured Rock

☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No

If yes: \_\_\_\_\_ Depth to Weeping in Hole

\_\_\_\_\_ Depth Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	—	Cnc : Dpl:	—	—	—	M	F	
18	B	S	10YR 5/6	—	Cnc : Dpl:	—	—	—	SG	L	
120	C	CS	10YR 5/3	—	Cnc : Dpl:	—	15	15	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: TP-15 8/28/23 \_\_\_\_\_  
Hole # Date Time Weather Latitude Longitude

1. Land Use \_\_\_\_\_  
(e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.) Slope (%)

Description of Location: \_\_\_\_\_

2. Soil Parent Material: \_\_\_\_\_  
Landform Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from: Open Water Body \_\_\_\_\_ feet Drainage Way \_\_\_\_\_ feet Wetlands \_\_\_\_\_ feet  
Property Line \_\_\_\_\_ feet Drinking Water Well \_\_\_\_\_ feet Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No If Yes: ☐ Disturbed Soil/Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No If yes: \_\_\_\_\_ Depth to Weeping in Hole \_\_\_\_\_ Depth to Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	—	Cnc : Dpl:	—	—	—	M	F	
24	B	S	10YR 5/6	—	Cnc : Dpl:	—	—	—	SG	L	
120	C	CS	10YR 5/3	—	Cnc : Dpl:	—	15	15	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes: \_\_\_\_\_



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: TP-16 8/28/23  
Hole # Date Time Weather Latitude Longitude

1. Land Use: \_\_\_\_\_  
(e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.) Slope (%)
- Description of Location: \_\_\_\_\_
2. Soil Parent Material: \_\_\_\_\_  
Landform Position on Landscape (SU, SH, BS, FS, TS, Plain)
3. Distances from: Open Water Body \_\_\_\_\_ feet Drainage Way \_\_\_\_\_ feet Wetlands \_\_\_\_\_ feet  
Property Line \_\_\_\_\_ feet Drinking Water Well \_\_\_\_\_ feet Other \_\_\_\_\_ feet
4. Unsuitable Materials Present: ☐ Yes ☒ No If Yes: ☐ Disturbed Soil/Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock
5. Groundwater Observed: ☒ Yes ☐ No If yes: \_\_\_\_\_ Depth to Weeping in Hole 142 Depth Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	-	Cnc : Dpl:	-	-	-	M	F	
16	B	S	10YR 5/6	-	Cnc : Dpl:	-	-	-	SG	L	
144	C	CS	10YR 5/3	-	Cnc : Dpl:	-	15	15	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:





Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: TP-17 8/28/23 \_\_\_\_\_  
Hole # Date Time Weather Latitude Longitude

1. Land Use \_\_\_\_\_  
(e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.) Slope (%)

Description of Location: \_\_\_\_\_

2. Soil Parent Material: \_\_\_\_\_  
Landform Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from: Open Water Body \_\_\_\_\_ feet Drainage Way \_\_\_\_\_ feet Wetlands \_\_\_\_\_ feet  
Property Line \_\_\_\_\_ feet Drinking Water Well \_\_\_\_\_ feet Other \_\_\_\_\_ feet


4. Unsuitable Materials Present: ☐ Yes ☒ No If Yes: ☐ Disturbed Soil/Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No If yes: \_\_\_\_\_ Depth to Weeping in Hole \_\_\_\_\_ Depth to Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
8	A	SL	10YR 3/3	—	Cnc : Dpl:	—	—	—	M	F	
24	B	S	10YR 5/8	—	Cnc : Dpl:	—	—	—	SG	L	
78	C1	S	10YR 5/5	—	Cnc : Dpl:	—	10	10	SG	L	
120	C2	S	10YR 5/3	—	Cnc : Dpl:	—	—	—	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: TP-18

Hole #

Date

8/20/23

Time

Weather

Latitude

Longitude

1. Land Use:

(e.g., woodland, agricultural field, vacant lot, etc.)

Vegetation

Surface Stones (e.g., cobbles, stones, boulders, etc.)

Slope (%)

Description of Location:

2. Soil Parent Material:

Landform

Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from:

Open Water Body \_\_\_\_\_ feet

Drainage Way \_\_\_\_\_ feet

Wetlands \_\_\_\_\_ feet

Property Line \_\_\_\_\_ feet

Drinking Water Well \_\_\_\_\_ feet

Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No

If Yes: ☐ Disturbed Soil/Fill Material

☐ Weathered/Fractured Rock

☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No

If yes: \_\_\_\_\_ Depth to Weeping in Hole

\_\_\_\_\_ Depth Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
15	A	SL	10YR 3/3	-	Cnc : Dpl:	-	-	-	M	F	
36	B	S	10YR 5/8	-	Cnc : Dpl:	-	-	-	SG	L	
132	C	S	10YR 5/3	-	Cnc : Dpl:	-	-	-	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: TR 19 8/28/23  
Hole # Date Time Weather Latitude Longitude

1. Land Use (e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.) Slope (%)

Description of Location: \_\_\_\_\_

2. Soil Parent Material: \_\_\_\_\_  
Landform \_\_\_\_\_ Position on Landscape (SU, SH, BS, FS, TS, Plain) \_\_\_\_\_

3. Distances from: Open Water Body \_\_\_\_\_ feet Drainage Way \_\_\_\_\_ feet Wetlands \_\_\_\_\_ feet  
Property Line \_\_\_\_\_ feet Drinking Water Well \_\_\_\_\_ feet Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No If Yes: ☐ Disturbed Soil/Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No If yes: \_\_\_\_\_ Depth to Weeping in Hole \_\_\_\_\_ Depth to Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
18	A	SL	10YR 3/3	-	Cnc : Dpl:	-	-	-	M	F	
38	B	S	10YR 5/8	-	Cnc : Dpl:	-	-	-	SG	L	
80	C1	CS	10YR 5/5	-	Cnc : Dpl:	-	10	10	SG	L	
132	C2	S	10YR 5/3	-	Cnc : Dpl:	-	-	-	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes: \_\_\_\_\_



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: DP-20

Hole #

Date

8/28/23

Time

Weather

Latitude

Longitude

1. Land Use:

(e.g., woodland, agricultural field, vacant lot, etc.)

Vegetation

Surface Stones (e.g., cobbles, stones, boulders, etc.)

Slope (%)

Description of Location:

2. Soil Parent Material:

Landform

Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from:

Open Water Body \_\_\_\_\_ feet

Drainage Way \_\_\_\_\_ feet

Wetlands \_\_\_\_\_ feet

Property Line \_\_\_\_\_ feet

Drinking Water Well \_\_\_\_\_ feet

Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No

If Yes: ☐ Disturbed Soil/Fill Material

☐ Weathered/Fractured Rock

☐ Bedrock

5. Groundwater Observed: ☒ Yes ☐ No

If yes: 154 Depth to Weeping in Hole

\_\_\_\_\_ Depth Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
18	A	SL	10YR 3/3	—	Cnc : Dpl:	—	—	—	M	F	
36	B	S	10YR 5/6	—	Cnc : Dpl:	—	—	—	SG	L	
154	C	S	10YR 5/3	114	Cnc : Dpl:	2	10	10	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:



Commonwealth of Massachusetts  
City/Town of \_\_\_\_\_

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### D. Determination of High Groundwater Elevation

1. Method Used (Choose one):

- ☒ Depth to soil redoximorphic features
- ☐ Depth to observed standing water in observation hole
- ☐ Depth to adjusted seasonal high groundwater ( $S_h$ )  
(USGS methodology)

Obs. Hole # \_\_\_\_\_

\_\_\_\_\_ inches

Obs. Hole # \_\_\_\_\_

\_\_\_\_\_ inches

\_\_\_\_\_ inches

\_\_\_\_\_ inches

\_\_\_\_\_ inches

\_\_\_\_\_ inches

SEE LOGS

Index Well Number \_\_\_\_\_

Reading Date \_\_\_\_\_

$$S_h = S_c - [S_r \times (OW_c - OW_{max}) / OW_r]$$

Obs. Hole/Well# \_\_\_\_\_  $S_c$  \_\_\_\_\_  $S_r$  \_\_\_\_\_  $OW_c$  \_\_\_\_\_  $OW_{max}$  \_\_\_\_\_  $OW_r$  \_\_\_\_\_  $S_h$  \_\_\_\_\_

### E. Depth of Pervious Material

1. Depth of Naturally Occurring Pervious Material

SEE LOGS

a. Does at least four feet of naturally occurring pervious material exist in all areas observed throughout the area proposed for the soil absorption system?

☒ Yes ☐ No

b. If yes, at what depth was it observed (exclude O, A, and E Horizons)?

Upper boundary: \_\_\_\_\_

\_\_\_\_\_ inches

Lower boundary: \_\_\_\_\_

\_\_\_\_\_ inches

c. If no, at what depth was impervious material observed?

Upper boundary: \_\_\_\_\_

\_\_\_\_\_ inches

Lower boundary: \_\_\_\_\_

\_\_\_\_\_ inches



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### F. Certification

I certify that I am currently approved by the Department of Environmental Protection pursuant to 310 CMR 15.017 to conduct soil evaluations and that the above analysis has been performed by me consistent with the required training, expertise and experience described in 310 CMR 15.017. I further certify that the results of my soil evaluation, as indicated in the attached Soil Evaluation Form, are accurate and in accordance with 310 CMR 15.100 through 15.107.

Signature of Soil Evaluator

PAUL KIRCHNER, SE#14237

Typed or Printed Name of Soil Evaluator / License #

JAMES GARREFFI

Name of Approving Authority Witness

Date

8/30/23

Expiration Date of License


6/30/24


Approving Authority

NASHOBA

**Note:** In accordance with 310 CMR 15.018(2) this form must be submitted to the approving authority within 60 days of the date of field testing, and to the designer and the property owner with Percolation Test Form 12.

**Field Diagrams:** Use this area for field diagrams:

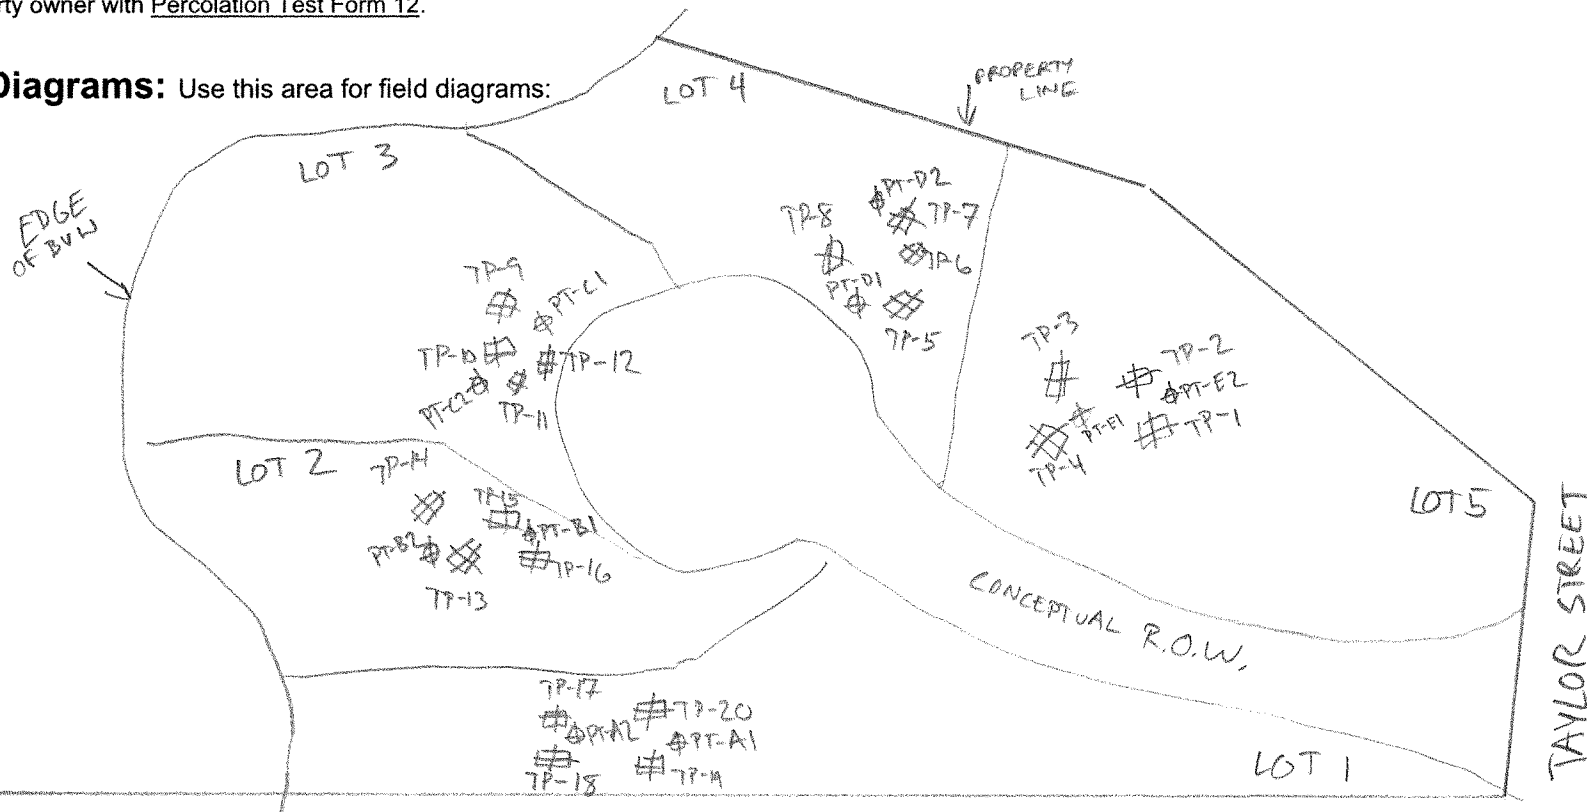



Commonwealth of Massachusetts  
City/Town of  
**Percolation Test**  
Form 12

Percolation test results must be submitted with the Soil Suitability Assessment for On-site Sewage Disposal. DEP has provided this form for use by local Boards of Health. Other forms may be used, but the information must be substantially the same as that provided here. Before using this form, check with the local Board of Health to determine the form they use.

**A. Site Information**

Owner Name VILENA T. FRIBERG  
Street Address or Lot # 95 TAYLOR ST  
LITTLETON  
City/Town MA State 01460  
MARK GALLAGHER Zip Code 781-424-7250  
Contact Person (if different from Owner) Telephone Number

**Important:** When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



**B. Test Results**

Observation Hole #	Date	Time	Date	Time
Depth of Perc	8/30/23	1:07	8/30/23	1:10
Start Pre-Soak	PT-A1		PT-A2	
	55"		55"	
	1:07		1:10	
End Pre-Soak	-		-	
Time at 12"	UNABLE		UNABLE	
Time at 9"	TO		TO	
Time at 6"	SATURATE		SATURATE	
Time (9"-6")				
Rate (Min./Inch)	42 MP1		42 MP1	
Test Passed:	<input checked="" type="checkbox"/>	Test Passed:	<input checked="" type="checkbox"/>	
Test Failed:	<input type="checkbox"/>	Test Failed:	<input type="checkbox"/>	


Test Performed By:

PAUL KIRCHNER

Board of Health Witness

JAMES GARRETTI

Comments:



Commonwealth of Massachusetts  
City/Town of  
**Percolation Test**  
Form 12

Percolation test results must be submitted with the Soil Suitability Assessment for On-site Sewage Disposal. DEP has provided this form for use by local Boards of Health. Other forms may be used, but the information must be substantially the same as that provided here. Before using this form, check with the local Board of Health to determine the form they use.

**A. Site Information**

Owner Name VILENA T. FRIBERG  
Street Address or Lot # 95 TAYLOR ST  
LITTLETON City/Town MA State 01460 Zip Code  
MARK GALLAGHER Contact Person (if different from Owner) 781-424-9250 Telephone Number

**Important:** When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



**B. Test Results**

Observation Hole #	Date	Time	Date	Time
Depth of Perc	<u>8/30/23</u>	<u>1:16</u>	<u>8/30/23</u>	<u>1:18</u>
Start Pre-Soak	<u>PT-B1</u>		<u>PT-B2</u>	
End Pre-Soak	<u>40"</u>		<u>40"</u>	
Time at 12"	<u>1:16</u>		<u>1:18</u>	
Time at 9"	<u>UNABLE</u>		<u>UNABLE</u>	
Time at 6"	<u>TO</u>		<u>TO</u>	
Time (9"-6")	<u>SATURATE</u>		<u>SATURATE</u>	
Rate (Min./Inch)	<u>L2 MP1</u>		<u>L2 MP1</u>	


Test Performed By:

PAUL KIRCHNER  
JAMES GARRETT

Board of Health Witness

Comments:





Commonwealth of Massachusetts  
City/Town of  
**Percolation Test**  
Form 12

Percolation test results must be submitted with the Soil Suitability Assessment for On-site Sewage Disposal. DEP has provided this form for use by local Boards of Health. Other forms may be used, but the information must be substantially the same as that provided here. Before using this form, check with the local Board of Health to determine the form they use.

**A. Site Information**

Owner Name VILENA T. TRIBERG  
Street Address or Lot # 95 TAYLOR ST  
LITTLETON  
City/Town MA State MA Zip Code 01460  
Contact Person (if different from Owner) MARK GALLAGHER Telephone Number 781-424-9250

**Important:** When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



**B. Test Results**


Observation Hole #	Date	Time	Date	Time
Depth of Perc	8/30/23	1:21	8/30/23	1:23
Start Pre-Soak	PT-C1		PT-C2	
End Pre-Soak	45"		45"	
Time at 12"	1:21		1:23	
Time at 9"	UNABLE		UNABLE	
Time at 6"	TO		TO	
Time (9"-6")	SATURATE		SATURATE	
Rate (Min./Inch)	12 MP1		12 MP1	
Test Passed:	<input checked="" type="checkbox"/>		Test Passed:	<input checked="" type="checkbox"/>
Test Failed:	<input type="checkbox"/>		Test Failed:	<input type="checkbox"/>

Test Performed By:

PAUL KIRCHNER  
JAMES GARRETT

Board of Health Witness

Comments:




Commonwealth of Massachusetts  
City/Town of  
**Percolation Test**  
Form 12

Percolation test results must be submitted with the Soil Suitability Assessment for On-site Sewage Disposal. DEP has provided this form for use by local Boards of Health. Other forms may be used, but the information must be substantially the same as that provided here. Before using this form, check with the local Board of Health to determine the form they use.

**A. Site Information**

Important: When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



Owner Name WILENA T. FRIBERG  
Street Address or Lot # 95 TAYLOR ST  
City/Town LITTLETON State MA Zip Code 01460  
Contact Person (if different from Owner) MARK GALLAGHER Telephone Number 781-424-9250

**B. Test Results**

	Date <u>8/30/23</u>	Time <u>1:25</u>	Date <u>8/30/23</u>	Time <u>1:27</u>
Observation Hole #	<u>PT-D1</u>		<u>PT-D2</u>	
Depth of Perc	<u>38"</u>		<u>38"</u>	
Start Pre-Soak	<u>1:25</u>		<u>1:27</u>	
End Pre-Soak	<u>UNABLE</u>		<u>UNABLE</u>	
Time at 12"	<u>TO</u>		<u>TO</u>	
Time at 9"	<u>SATURATE</u>		<u>SATURATE</u>	
Time at 6"				
Time (9"-6")				
Rate (Min./Inch)	<u>42 MP1</u>		<u>42 MP1</u>	
Test Passed:	<input checked="" type="checkbox"/>		<input checked="" type="checkbox"/>	
Test Failed:	<input type="checkbox"/>		<input type="checkbox"/>	


Test Performed By:

PAUL KIRCHNER

Board of Health Witness

JAMES GARRETT

Comments:




Commonwealth of Massachusetts  
City/Town of  
**Percolation Test**  
Form 12

Percolation test results must be submitted with the Soil Suitability Assessment for On-site Sewage Disposal. DEP has provided this form for use by local Boards of Health. Other forms may be used, but the information must be substantially the same as that provided here. Before using this form, check with the local Board of Health to determine the form they use.

**A. Site Information**

**Important:** When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



Owner Name WLENA J. FRIBERG  
City/Town LEVERON State MA Zip Code 01460  
Street Address or Lot # 95 TAYLOR ST  
Contact Person (if different from Owner) MARK GALLAGHER Telephone Number 781-424-7250


**B. Test Results**

Observation Hole #	Date	Time	Date	Time
Depth of Perc	<u>8/30/23</u>	<u>1:33</u>	<u>8/30/23</u>	<u>1:35</u>
	<u>PT-E1</u>		<u>PT-E2</u>	
	<u>30"</u>		<u>30"</u>	
Start Pre-Soak	<u>1:33</u>		<u>1:35</u>	
End Pre-Soak	<u>UNABLE</u>		<u>UNABLE</u>	
Time at 12"	<u>To</u>		<u>To</u>	
Time at 9"	<u>SATURATE</u>		<u>SATURATE</u>	
Time at 6"				
Time (9"-6")				
Rate (Min./Inch)	<u>42 MPI</u>		<u>42 MPI</u>	
Test Passed:	<input checked="" type="checkbox"/>		Test Passed:	<input checked="" type="checkbox"/>
Test Failed:	<input type="checkbox"/>		Test Failed:	<input type="checkbox"/>

Test Performed By: PAUL KIRCHNER

Board of Health Witness JAMES GARRETT

Comments:



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### A. Facility Information

Vilena T. Friberg

Owner Name

95 Taylor Street

Street Address

Littleton

City

MA

State

U40-8

Map/Lot #

01460

Zip Code

### B. Site Information

1. (Check one) ☒ New Construction ☐ Upgrade

2. Soil Survey

Web Soil Survey

Source

262B

Soil Map Unit

Quonset sandy loam

Soil Series

Terraces, kames, eskers

Landform

Soil Limitations

outwash

Soil Parent material

3. Surficial Geological Report

Mass Mapper

Year Published/Source

Sand and Gravel

Map Unit

Description of Geologic Map Unit:

4. Flood Rate Insurance Map Within a regulatory floodway? ☐ Yes ☒ No

5. Within a velocity zone? ☐ Yes ☒ No

6. Within a Mapped Wetland Area? ☐ Yes ☒ No

If yes, MassGIS Wetland Data Layer:

Wetland Type

7. Current Water Resource Conditions (USGS):

1/8/24

Month/Day/ Year

Range: ☒ Above Normal

☐ Normal

☐ Below Normal

8. Other references reviewed:

Zone II

(Zone II, IWPA, Zone A, EEA Data Portal, etc.)



Commonwealth of Massachusetts  
City/Town of

# Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

## C. On-Site Review *(minimum of two holes required at every proposed primary and reserve disposal area)*

Deep Observation Hole Number: TP-24-1 1/8/2024 8:00am 30d, clear  
Hole # Date Time Weather Latitude Longitude

1. Land Use single-family dwelling wooded - 0-5  
(e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.) Slope (%)

Description of Location: rear of site in historic gravel pit

2. Soil Parent Material: outwash terrace BS  
Landform Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from: Open Water Body        feet Drainage Way        feet Wetlands >100 feet  
Property Line >>10 feet Drinking Water Well >>100 feet Other        feet

4. Unsuitable Materials Present: ☐ Yes ☒ No If Yes: ☐ Disturbed Soil/Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No If yes:        Depth to Weeping in Hole        Depth to Standing Water in Hole

### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	-	Cnc : Dpl:	-	-	-	M	F	
16	B	S	10YR 5/6	-	Cnc : Dpl:	-	-	-	SG	L	
50	C1	S	10YR 5/3	-	Cnc : Dpl:	-	-	-	SG	L	
132	C2	CS	10YR 5/1	-	Cnc : Dpl:	-	15	5	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review *(minimum of two holes required at every proposed primary and reserve disposal area)*

Deep Observation Hole Number: TP-24-2      1/8/2024      8:15am      \_\_\_\_\_  
Hole #      Date      Time      Weather      Latitude      Longitude

1. Land Use: \_\_\_\_\_  
(e.g., woodland, agricultural field, vacant lot, etc.)      Vegetation      Surface Stones (e.g., cobbles, stones, boulders, etc.)      Slope (%)

Description of Location: \_\_\_\_\_

2. Soil Parent Material: \_\_\_\_\_  
Landform      Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from:      Open Water Body      \_\_\_\_\_ feet      Drainage Way      \_\_\_\_\_ feet      Wetlands      \_\_\_\_\_ feet  
Property Line      \_\_\_\_\_ feet      Drinking Water Well      \_\_\_\_\_ feet      Other      \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☒ No      If Yes: ☐ Disturbed Soil/Fill Material      ☐ Weathered/Fractured Rock      ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No      If yes: \_\_\_\_\_ Depth to Weeping in Hole      \_\_\_\_\_ Depth Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
4	A	SL	10YR 3/3	-	Cnc : Dpl:	-	-	-	M	F	
14	B	S	10YR 5/6	-	Cnc : Dpl:	-	-	-	SG	L	
62	C1	S	10YR 5/3	-	Cnc : Dpl:	-	-	-	SG	L	
132	C2	CS	10YR 5/1	-	Cnc : Dpl:	-	15	5	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes: \_\_\_\_\_



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review *(minimum of two holes required at every proposed primary and reserve disposal area)*

Deep Observation Hole Number: TP-24-3      1/8/2024      8:40  
Hole #      Date      Time      Weather      Latitude      Longitude

1. Land Use: lawn  
(e.g., woodland, agricultural field, vacant lot, etc.)      Vegetation      Surface Stones (e.g., cobbles, stones, boulders, etc.)      Slope (%)

Description of Location: rear of dwelling around existing vegetable garden

2. Soil Parent Material: outwash  
Landform      Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from:      Open Water Body      feet      Drainage Way      feet      Wetlands      >>100 feet  
Property Line      >10 feet      Drinking Water Well      feet      Other      feet

4. Unsuitable Materials Present: ☐ Yes ☒ No      If Yes: ☐ Disturbed Soil/Fill Material      ☐ Weathered/Fractured Rock      ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☒ No      If yes:      Depth to Weeping in Hole      Depth Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
24	A	SL	10YR 3/2	-	Cnc : Dpl:	-	-	-	M	F	
42	B	LS	10YR 5/8	-	Cnc : Dpl:	-	-	-	M	F	
120	C	S	10YR 6/4	-	Cnc : Dpl:	-	10	-	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes:



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### C. On-Site Review *(minimum of two holes required at every proposed primary and reserve disposal area)*

Deep Observation Hole Number: TP-24-4 1/8/2024 8:50  
Hole # Date Time Weather Latitude Longitude

1. Land Use (e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Surface Stones (e.g., cobbles, stones, boulders, etc.) Slope (%)

Description of Location: \_\_\_\_\_

2. Soil Parent Material: \_\_\_\_\_  
Landform \_\_\_\_\_ Position on Landscape (SU, SH, BS, FS, TS, Plain) \_\_\_\_\_

3. Distances from: Open Water Body \_\_\_\_\_ feet Drainage Way \_\_\_\_\_ feet Wetlands \_\_\_\_\_ feet  
Property Line \_\_\_\_\_ feet Drinking Water Well \_\_\_\_\_ feet Other \_\_\_\_\_ feet

4. Unsuitable Materials Present: ☐ Yes ☐ No If Yes: ☐ Disturbed Soil/Fill Material ☐ Weathered/Fractured Rock ☐ Bedrock

5. Groundwater Observed: ☐ Yes ☐ No If yes: \_\_\_\_\_ Depth to Weeping in Hole \_\_\_\_\_ Depth to Standing Water in Hole

#### Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
12	A	SL	10YR 3/2	-	Cnc : Dpl:	-	-	-	M	F	
24	B	LS	10YR 5/8	-	Cnc : Dpl:	-	-	-	M	F	
126	C	S	10YR 6/4	-	Cnc : Dpl:	-	10	-	SG	L	
					Cnc : Dpl:						
					Cnc : Dpl:						
					Cnc : Dpl:						

Additional Notes: \_\_\_\_\_





## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### D. Determination of High Groundwater Elevation

1. Method Used (Choose one):

☒ Depth to soil redoximorphic features

Obs. Hole # \_\_\_\_\_

\_\_\_\_\_ inches

Obs. Hole # \_\_\_\_\_

\_\_\_\_\_ inches

☐ Depth to observed standing water in observation hole

\_\_\_\_\_ inches

\_\_\_\_\_ inches

SEE LOGS

☐ Depth to adjusted seasonal high groundwater ( $S_h$ )  
(USGS methodology)

\_\_\_\_\_ inches

\_\_\_\_\_ inches

Index Well Number \_\_\_\_\_

Reading Date \_\_\_\_\_

$$S_h = S_c - [S_r \times (OW_c - OW_{max}) / OW_r]$$

Obs. Hole/Well# \_\_\_\_\_  $S_c$  \_\_\_\_\_  $S_r$  \_\_\_\_\_  $OW_c$  \_\_\_\_\_  $OW_{max}$  \_\_\_\_\_  $OW_r$  \_\_\_\_\_  $S_h$  \_\_\_\_\_

### E. Depth of Pervious Material

1. Depth of Naturally Occurring Pervious Material

SEE LOGS

a. Does at least four feet of naturally occurring pervious material exist in all areas observed throughout the area proposed for the soil absorption system?

☒ Yes ☐ No

b. If yes, at what depth was it observed (exclude O, A, and E Horizons)?

Upper boundary: \_\_\_\_\_

\_\_\_\_\_ inches

Lower boundary: \_\_\_\_\_

\_\_\_\_\_ inches

c. If no, at what depth was impervious material observed?

Upper boundary: \_\_\_\_\_

\_\_\_\_\_ inches

Lower boundary: \_\_\_\_\_

\_\_\_\_\_ inches



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### F. Certification

I certify that I am currently approved by the Department of Environmental Protection pursuant to 310 CMR 15.017 to conduct soil evaluations and that the above analysis has been performed by me consistent with the required training, expertise and experience described in 310 CMR 15.017. I further certify that the results of my soil evaluation, as indicated in the attached Soil Evaluation Form, are accurate and in accordance with 310 CMR 15.100 through 15.107.

Signature of Soil Evaluator

Paul Kirchner, SE 14237

Typed or Printed Name of Soil Evaluator / License #

James Garreffo

Name of Approving Authority Witness

1/8/2024

Date

6/30/2024


Expiration Date of License

Nashoba

Approving Authority

**Note:** In accordance with 310 CMR 15.018(2) this form must be submitted to the approving authority within 60 days of the date of field testing, and to the designer and the property owner with [Percolation Test Form 12](#).

**Field Diagrams:** Use this area for field diagrams:

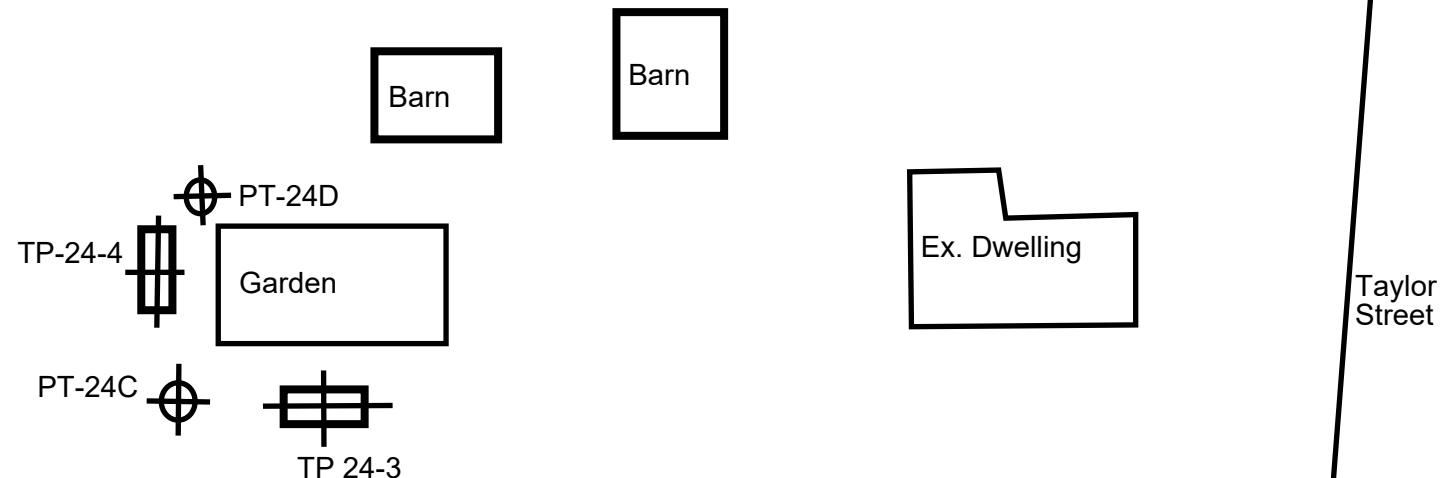



Commonwealth of Massachusetts  
City/Town of

## Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

### F. Certification

I certify that I am currently approved by the Department of Environmental Protection pursuant to 310 CMR 15.017 to conduct soil evaluations and that the above analysis has been performed by me consistent with the required training, expertise and experience described in 310 CMR 15.017. I further certify that the results of my soil evaluation, as indicated in the attached Soil Evaluation Form, are accurate and in accordance with 310 CMR 15.100 through 15.107.

Signature of Soil Evaluator

Paul Kirchner, SE 14237

Typed or Printed Name of Soil Evaluator / License #

James Garreffo

Name of Approving Authority Witness

1/8/2024

Date

6/30/2024


Expiration Date of License

Nashoba

Approving Authority

**Note:** In accordance with 310 CMR 15.018(2) this form must be submitted to the approving authority within 60 days of the date of field testing, and to the designer and the property owner with [Percolation Test Form 12](#).


**Field Diagrams:** Use this area for field diagrams:

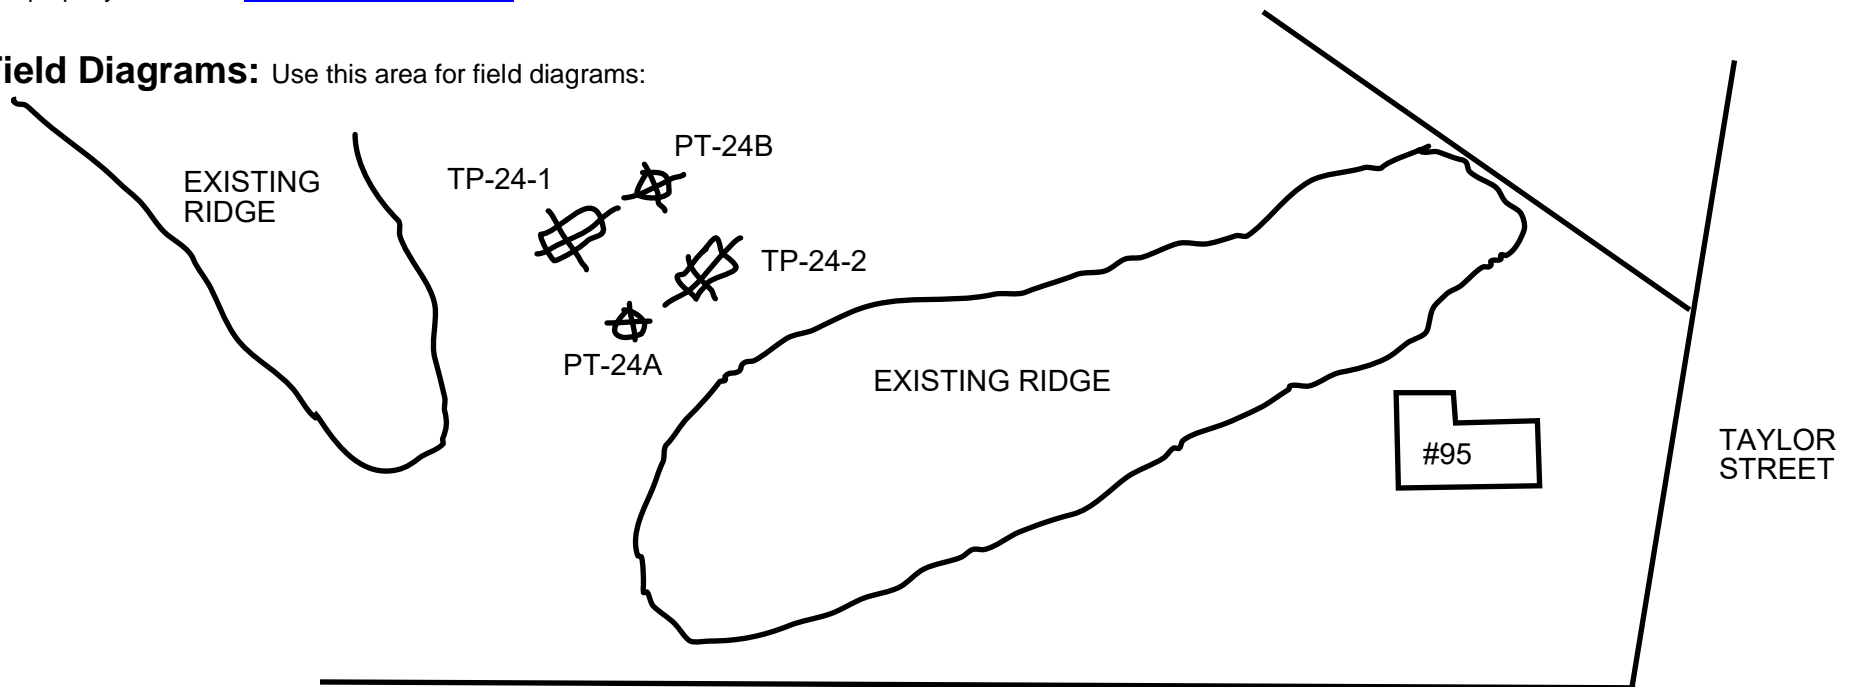

## **Drainage Maps**

**LEGEND:**

A ● B TIME OF CONCENTRATION  
— SUBCATCHMENT DIVIDE  
← ANALYSIS POINT

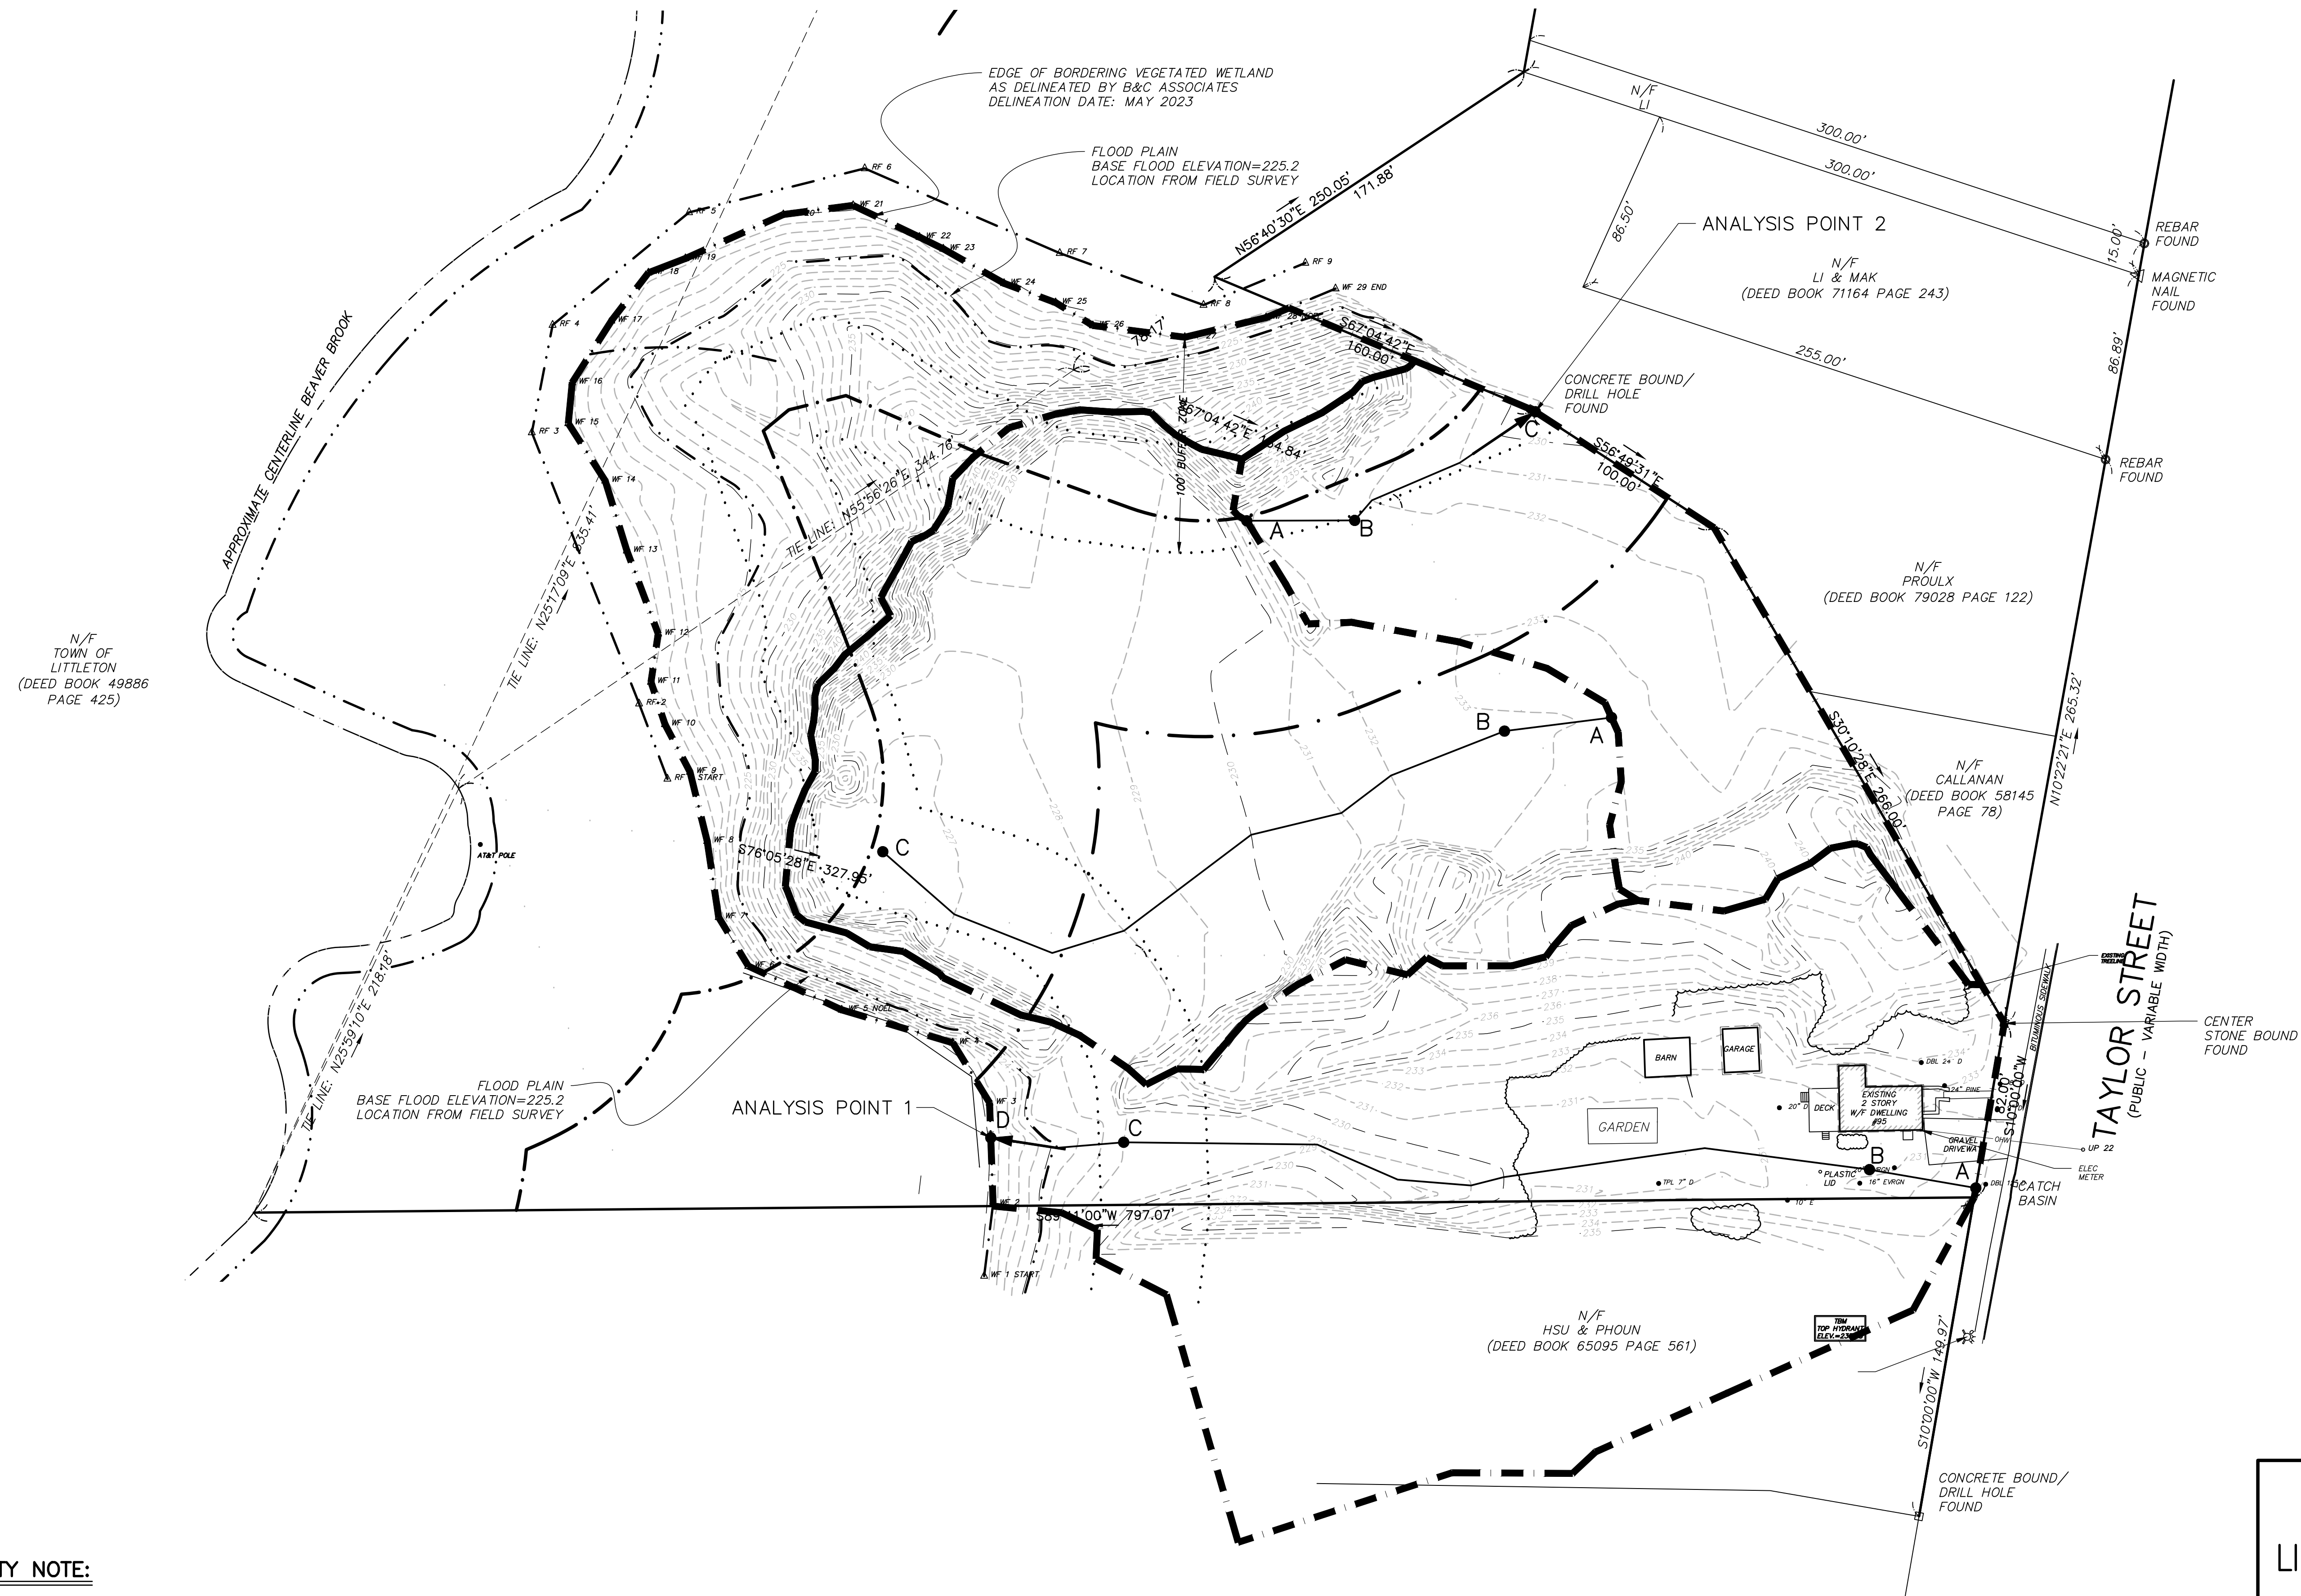


**UTILITY NOTE:**

ALL UNDERGROUND UTILITIES SHOWN HERE WERE COMPILED ACCORDING TO AVAILABLE RECORD PLANS FROM VARIOUS UTILITY COMPANIES AND PUBLIC AGENCIES AND ARE APPROXIMATE ONLY. ACTUAL LOCATIONS MUST BE DETERMINED IN THE FIELD BEFORE DESIGNING, EXCAVATING, BLASTING, INSTALLING, BACKFILLING, GRADING, PAVEMENT RESTORATION OR REPAIRING. ALL UTILITY COMPANIES, PUBLIC AND PRIVATE, MUST BE CONTACTED INCLUDING THOSE IN CONTROL OF UTILITIES NOT SHOWN ON THIS PLAN. SEE CHAPTER 370, ACTS OF 1963 MASS. WE ASSUME NO RESPONSIBILITY FOR DAMAGES INCURRED AS A RESULT OF UTILITIES OMITTED OR INACCURATELY SHOWN. BEFORE PLANNING FUTURE CONNECTIONS THE APPROPRIATE PUBLIC UTILITY ENGINEERING DEPARTMENT MUST BE CONSULTED. DIG SAFE TELEPHONE No. 1-888-344-7233.

DEFINITIVE SUBDIVISION  
STRAWBERRY FARMS  
IN  
LITTLETON, MASSACHUSETTS  
(MIDDLESEX COUNTY)

PRE-DEVELOPMENT DRAINAGE MAP  
FOR: SEAL HARBOR COMPANIES, LLC  
SCALE: 1"=40' FEBRUARY 20, 2024

STAMSKI AND McNARY, INC.  
1000 MAIN STREET ACTON, MASSACHUSETTS  
ENGINEERING - PLANNING - SURVEYING  
0 20 40 80 120 160 FT  
(7306.DEFSUB.1C.dwg) SM-7306 SHEET OF 8

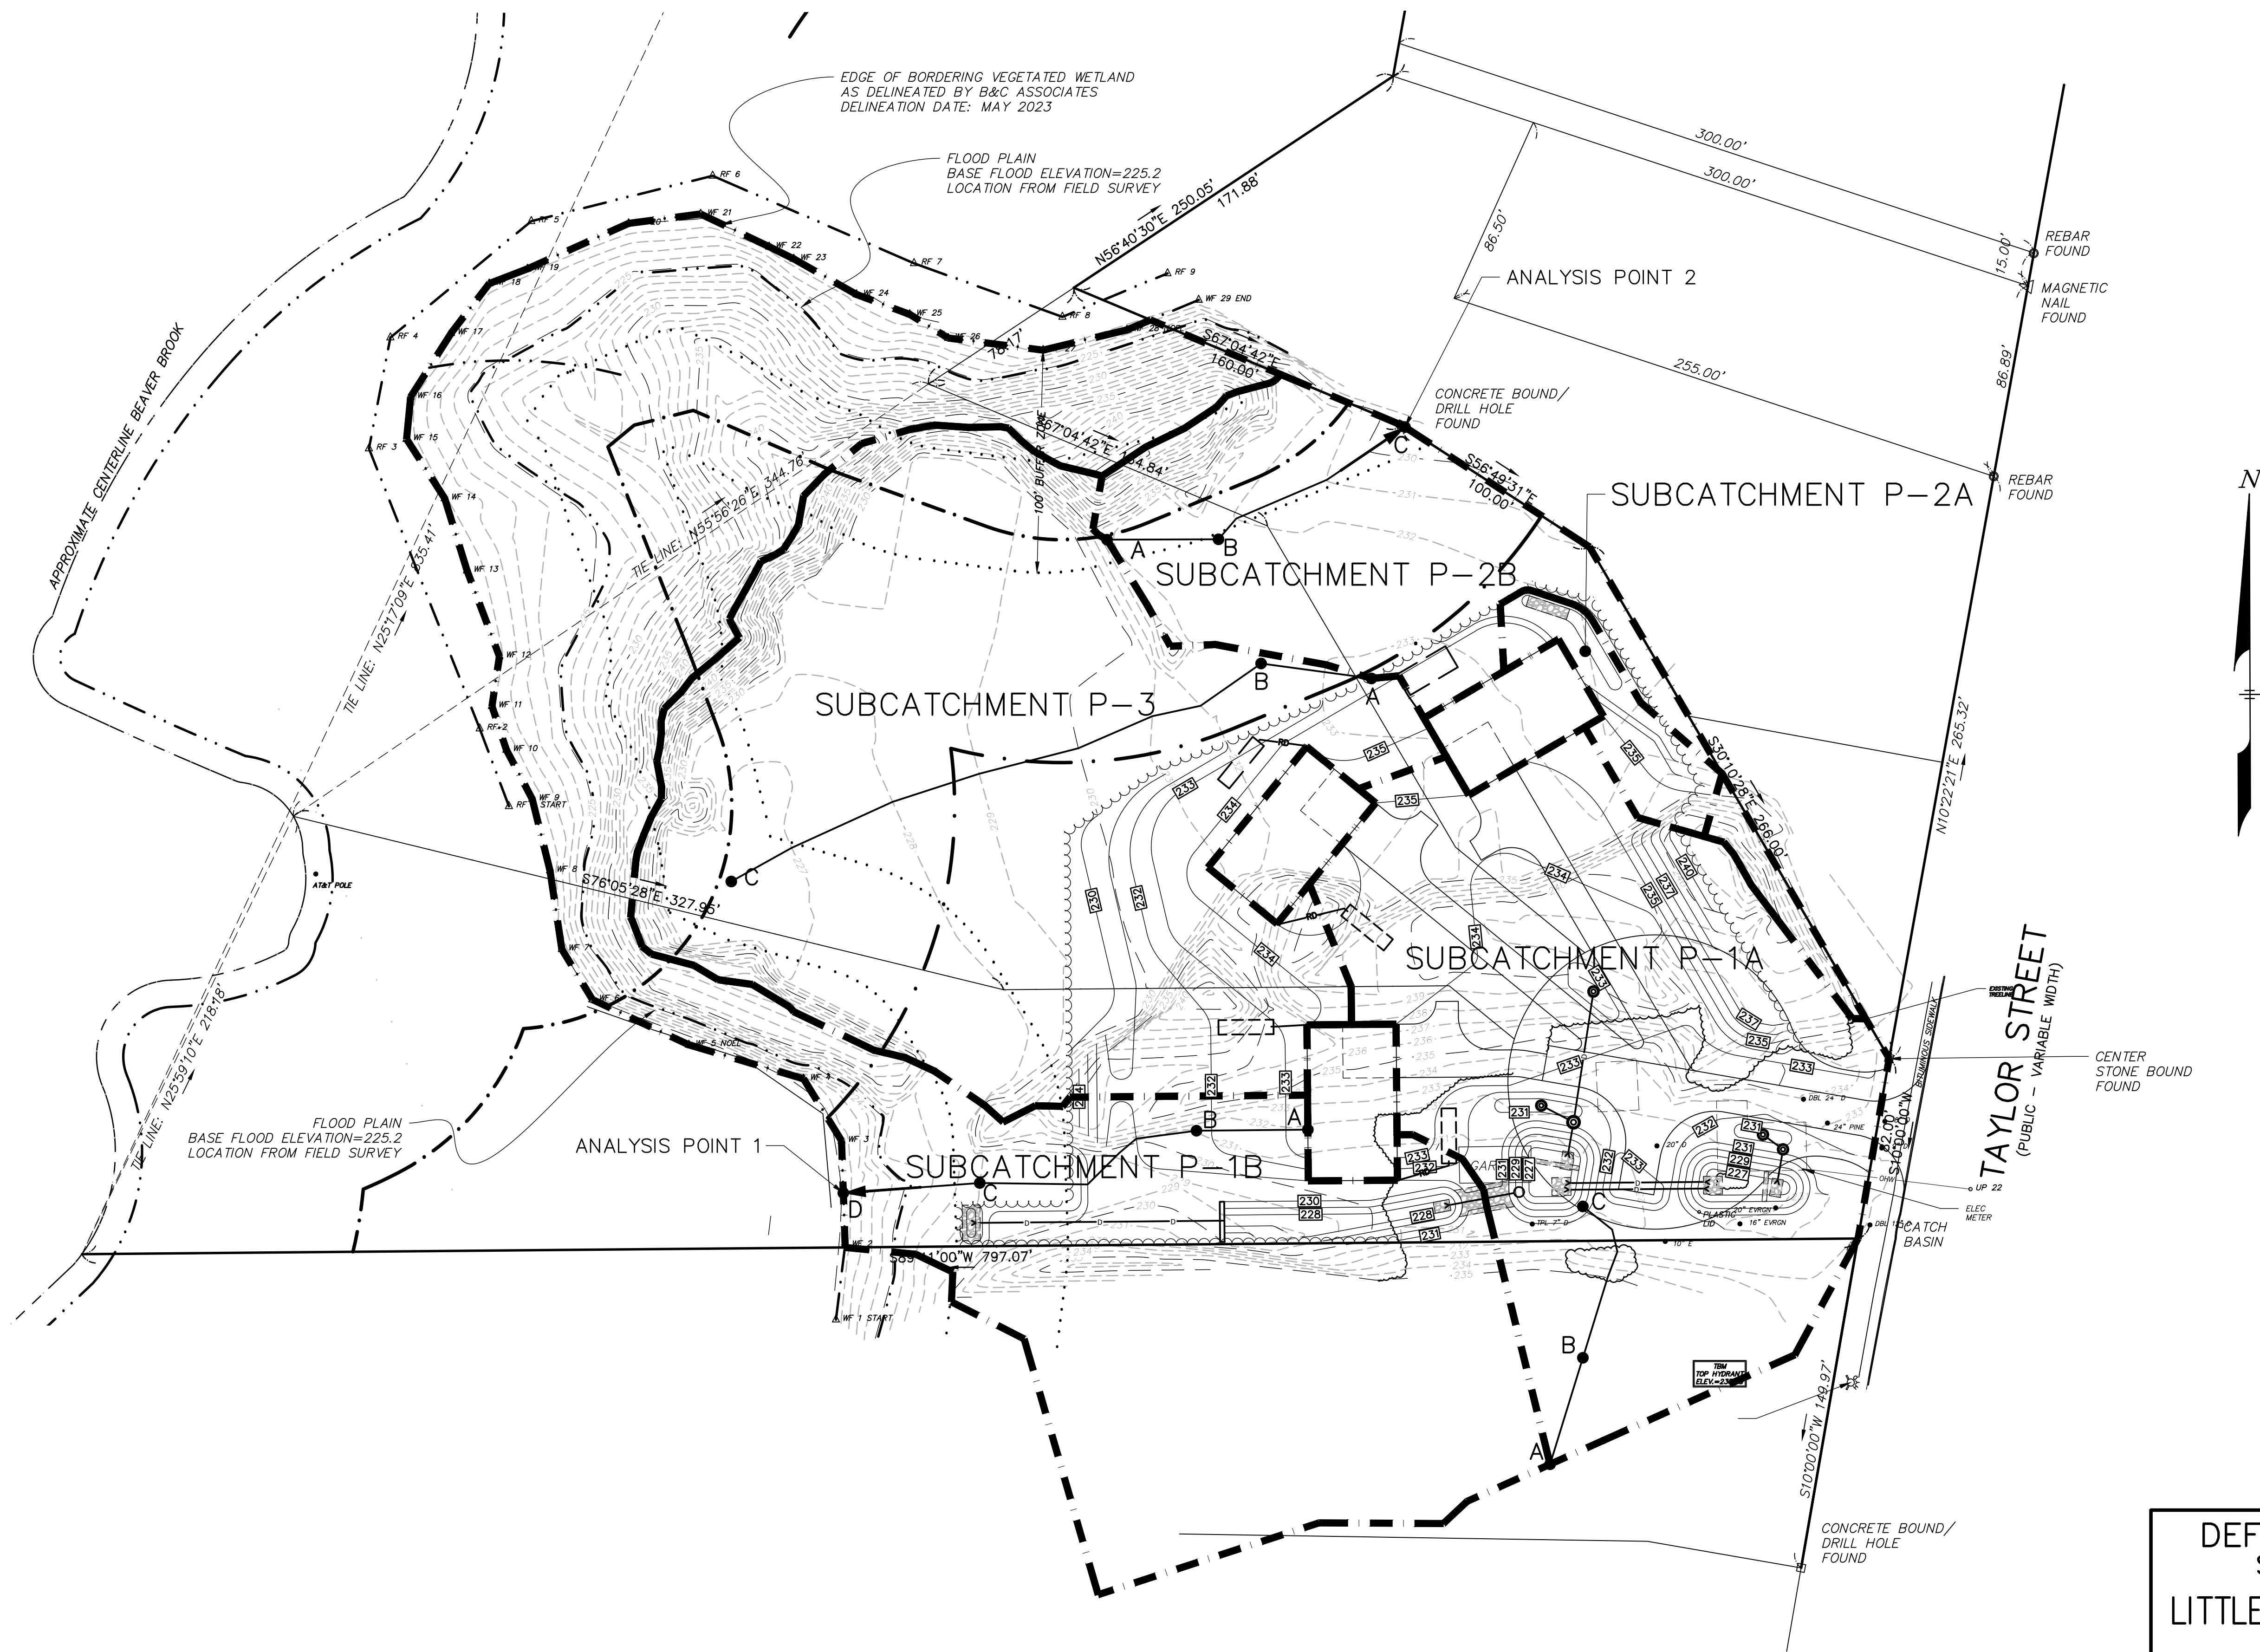

**LEGEND:**

A — B TIME OF CONCENTRATION  
— SUBCATCHMENT DIVIDE  
← ANALYSIS POINT

**UTILITY NOTE:**

ALL UNDERGROUND UTILITIES SHOWN HERE WERE COMPILED ACCORDING TO AVAILABLE RECORD PLANS FROM VARIOUS UTILITY COMPANIES AND PUBLIC AGENCIES AND ARE APPROXIMATE ONLY. ACTUAL LOCATIONS MUST BE DETERMINED IN THE FIELD BEFORE DESIGNING, EXCAVATING, BLASTING, INSTALLING, BACKFILLING, GRADING, PAVEMENT RESTORATION OR REPAIRING. ALL UTILITY COMPANIES, PUBLIC AND PRIVATE, MUST BE CONTACTED INCLUDING THOSE IN CONTROL OF UTILITIES NOT SHOWN ON THIS PLAN. SEE CHAPTER 370, ACTS OF 1963 MASS. WE ASSUME NO RESPONSIBILITY FOR DAMAGES INCURRED AS A RESULT OF UTILITIES OMITTED OR INACCURATELY SHOWN. BEFORE PLANNING FUTURE CONNECTIONS THE APPROPRIATE PUBLIC UTILITY ENGINEERING DEPARTMENT MUST BE CONSULTED. DIG SAFE TELEPHONE No. 1-888-344-7233.

DEFINITIVE SUBDIVISION  
STRAWBERRY FARMS  
IN  
LITTLETON, MASSACHUSETTS  
(MIDDLESEX COUNTY)

POST-DEVELOPMENT DRAINAGE MAP  
FOR: SEAL HARBOR COMPANIES, LLC  
SCALE: 1"=40' FEBRUARY 20, 2024

STAMSKI AND McNARY, INC.  
1000 MAIN STREET ACTON, MASSACHUSETTS  
ENGINEERING - PLANNING - SURVEYING  
0 20 40 80 120 160 FT  
(7306.DEFSUB.1C.dwg) SM-7306 SHEET OF 8

# **Stormwater Operation and Maintenance Manual**



# **Stormwater Operation and Maintenance Manual**

For

## **Strawberry Farms**

Map U40, Parcel 8  
95 Taylor Street  
Littleton, MA

February 12, 2024

### **Responsible Party:**

Applicant:

Seal Harbor, LLC.  
P.O. Box 2857  
Acton, MA 01720

SM-7306



## **Table of Contents**

Long Term Operation and Maintenance Plan

Operation and Maintenance Sample Inspection Log

## **Long Term Operation and Maintenance Plan**

## **Schedule for Inspection and Maintenance:**

### **Street Sweeping:**

It is recommended that the pavement shall be properly swept twice a year, with concentrations in the spring and the fall.

### **Deep Sump and Hooded Catch Basins and Drain Manholes:**

During construction, catch basin grates shall be wrapped with filter fabric. Catch basins shall be cleaned upon the completion of construction. After construction, the deep sumps for all catch basins and drain manholes shall be inspected four times a year and cleaned four times a year. Sediment removed shall be disposed of in accordance with applicable local, state, and federal guidelines and regulations. The depth of the sediment in a basin shall not exceed a depth of 18 inches as determined by probing with a stick. If the stick hits the bottom within 30 inches of the water level, more than 18 inches of sediment has accumulated and must be removed. Licensed persons should remove and dispose of the contents of the sump in accordance with applicable regulations.

### **Roof Drywells:**

Inspect the system after every major storm for the first few months to ensure proper stabilization and function. Thereafter, inspect and clean it at least twice per year. Water levels should be recorded over several days to check the structures drainage. Also mosquito controls may be necessary.

### **Sediment Forebays:**

The floor and sidewalls of the sediment forebay must be stabilized before use. Sediment forebays shall be inspected monthly and cleaned a minimum of four times per year and when sediment depth is between 3-6 inches. After sediment removal, any damaged vegetation must be replaced. Grass in the forebay shall not exceed 6 inches in length and any scouring and gullying shall be repaired as necessary.

### **Infiltration Basin:**

Preventative maintenance should be performed at least twice a year, and ideally sediment should be removed from the sediment forebay after every major storm event. Sediment shall be disposed of in accordance with applicable local, state, and federal guidelines and regulations.

Once online, the basins shall be inspected after every major storm event (1" in 24 hours), for the first 3 months. Thereafter, the basin should be inspected at least twice per year. Important items to check for include: differential settlement, cracking, erosion, leakage, or tree growth on the embankments, condition of riprap, sediment accumulation and the health of the turf.

At least twice a year, the buffer area and side slopes of the basin should be mowed. Grass clippings and accumulated organic matter should be removed to prevent the formation of an impervious organic mat. Trash and debris should also be removed at this time. Scarify bottom area and add additional sand if necessary.

Sediment should be removed from the basin as necessary. Removal procedures should not take place until the floor of the basin is thoroughly dry. Pretreatment devices associated with basins should be inspected and cleaned at least twice a year and ideally every other month.

**Infiltration Trenches:**

Trenches shall be inspected annually. The filter fabric shall be inspected for excessive sediment build up. If appreciable amounts of sediment are observed the top layer of stone shall be moved aside and the filter fabric cleaned or replaced. The top layer of stone shall then be washed and placed over the filter fabric.

**Emergency Contacts:**

In the event of a hazardous materials spill on the site the following parties shall be contacted:

Fire Department: ph: 978-540-2302

**Records:**

The developer shall maintain an inspection log of all elements of the storm water management plan during construction and until the road is accepted by the Town. A copy of the erosion control and storm water maintenance plan and inspection logs shall be kept onsite at all times until acceptance of the road. Each individual lot owner shall also maintain records for private structures on their lot.

**Responsible Party:**

The individual homeowners shall be responsible for the inspection and maintenance of the infiltration trenches and drywells on their lots. The developer shall be responsible for the inspection and maintenance of the infiltration basins and sediment forebays until street acceptance. The developer shall be responsible for the inspection and maintenance of the street sweeping, snow removal, catch basins, and drainage manholes until street acceptance.

**Budget:** The estimated annual operation and maintenance budget is \$1,500.

**Illicit Discharges:** THERE WILL BE NO ILLICIT DISCHARGES ON SITE.

Name: \_\_\_\_\_

Signature: \_\_\_\_\_

Date: \_\_\_\_\_

## **Operation and Maintenance Sample Inspection Log**

**Strawberry Farms**  
Operation and Maintenance Inspection Log

Year: \_\_\_\_\_

**Inspection Items:**

**Street Sweeping:**

**Catch Basins:**

**Drywells:**

**Infiltration Basins and forebays:**

**Infiltration Trench:**

**Frequency:**

**Twice per year**

**Four times per year**

**Twice per year**

**Monthly**

**Twice per year**

**Street Sweeping:**

Previous Inspection Date: \_\_\_\_\_

Inspection Date: \_\_\_\_\_

Inspector Name: \_\_\_\_\_

Comments: \_\_\_\_\_

Action Required:

**Infiltration Basin and forebays:**

Previous Inspection Date: \_\_\_\_\_

Inspection Date: \_\_\_\_\_

Inspector Name: \_\_\_\_\_

Comments: \_\_\_\_\_

Action Required:

**AD-1**

Previous Inspection Date: \_\_\_\_\_

Inspection Date: \_\_\_\_\_

Inspector Name: \_\_\_\_\_

Sediment Depth: \_\_\_\_\_ (Remove if depth greater than 18")

Comments: \_\_\_\_\_

Action Required:

**AD-2**

Previous Inspection Date: \_\_\_\_\_

Inspection Date: \_\_\_\_\_

Inspector Name: \_\_\_\_\_

Sediment Depth: \_\_\_\_\_ (Remove if depth greater than 18")

Comments:

Action Required:

**AD-3**

Previous Inspection Date: \_\_\_\_\_

Inspection Date: \_\_\_\_\_

Inspector Name: \_\_\_\_\_

Sediment Depth: \_\_\_\_\_ (Remove if depth greater than 18")

Comments:

Action Required:

**Roof Drywell**

Previous Inspection Date: \_\_\_\_\_

Inspection Date: \_\_\_\_\_

Inspector Name: \_\_\_\_\_

Sediment Depth: \_\_\_\_\_ (Remove if depth greater than 18")

Comments:

Action Required:

**Infiltration Trench**

Previous Inspection Date: \_\_\_\_\_

Inspection Date: \_\_\_\_\_

Inspector Name: \_\_\_\_\_

Sediment Depth: \_\_\_\_\_ (Remove if depth greater than 18")

Comments:

Action Required: