

**INSET A**  
SCALE: 1"=10'

**WASTE WATER FLOW CALCULATION DATA**

BUILDING AREA= 143,640 SF WAREHOUSE  
+ 15,960 SF OFFICE  
159,600 SF TOTAL

WAREHOUSE FLOWS:  
170 EMPLOYEES @ 15 GPD/EMPLOYEE=2,550 GPD


OFFICE FLOWS:  
15,960 SF OFFICE @ 75 GPD/1000 SF = 1,197 GPD

TOTAL BUILDING FLOW:  
2,550 GPD + 1,197 GPD = 3,747 GPD



SEPTIC TANK SIZING:  
3,747 GPD x 3 = 11,241 GPD, USE 11,500 GPD

USE TWO (2) COMMERCIAL 2-COMPARTMENT TANKS  
TANK "A" = 3,747 GPD x 2 = 7,494 GPD  
USE 7,500 GAL. TANK

TANK "B" = 3,747 GPD x 1 = 3,747 GPD  
USE 4,000 GAL. TANK

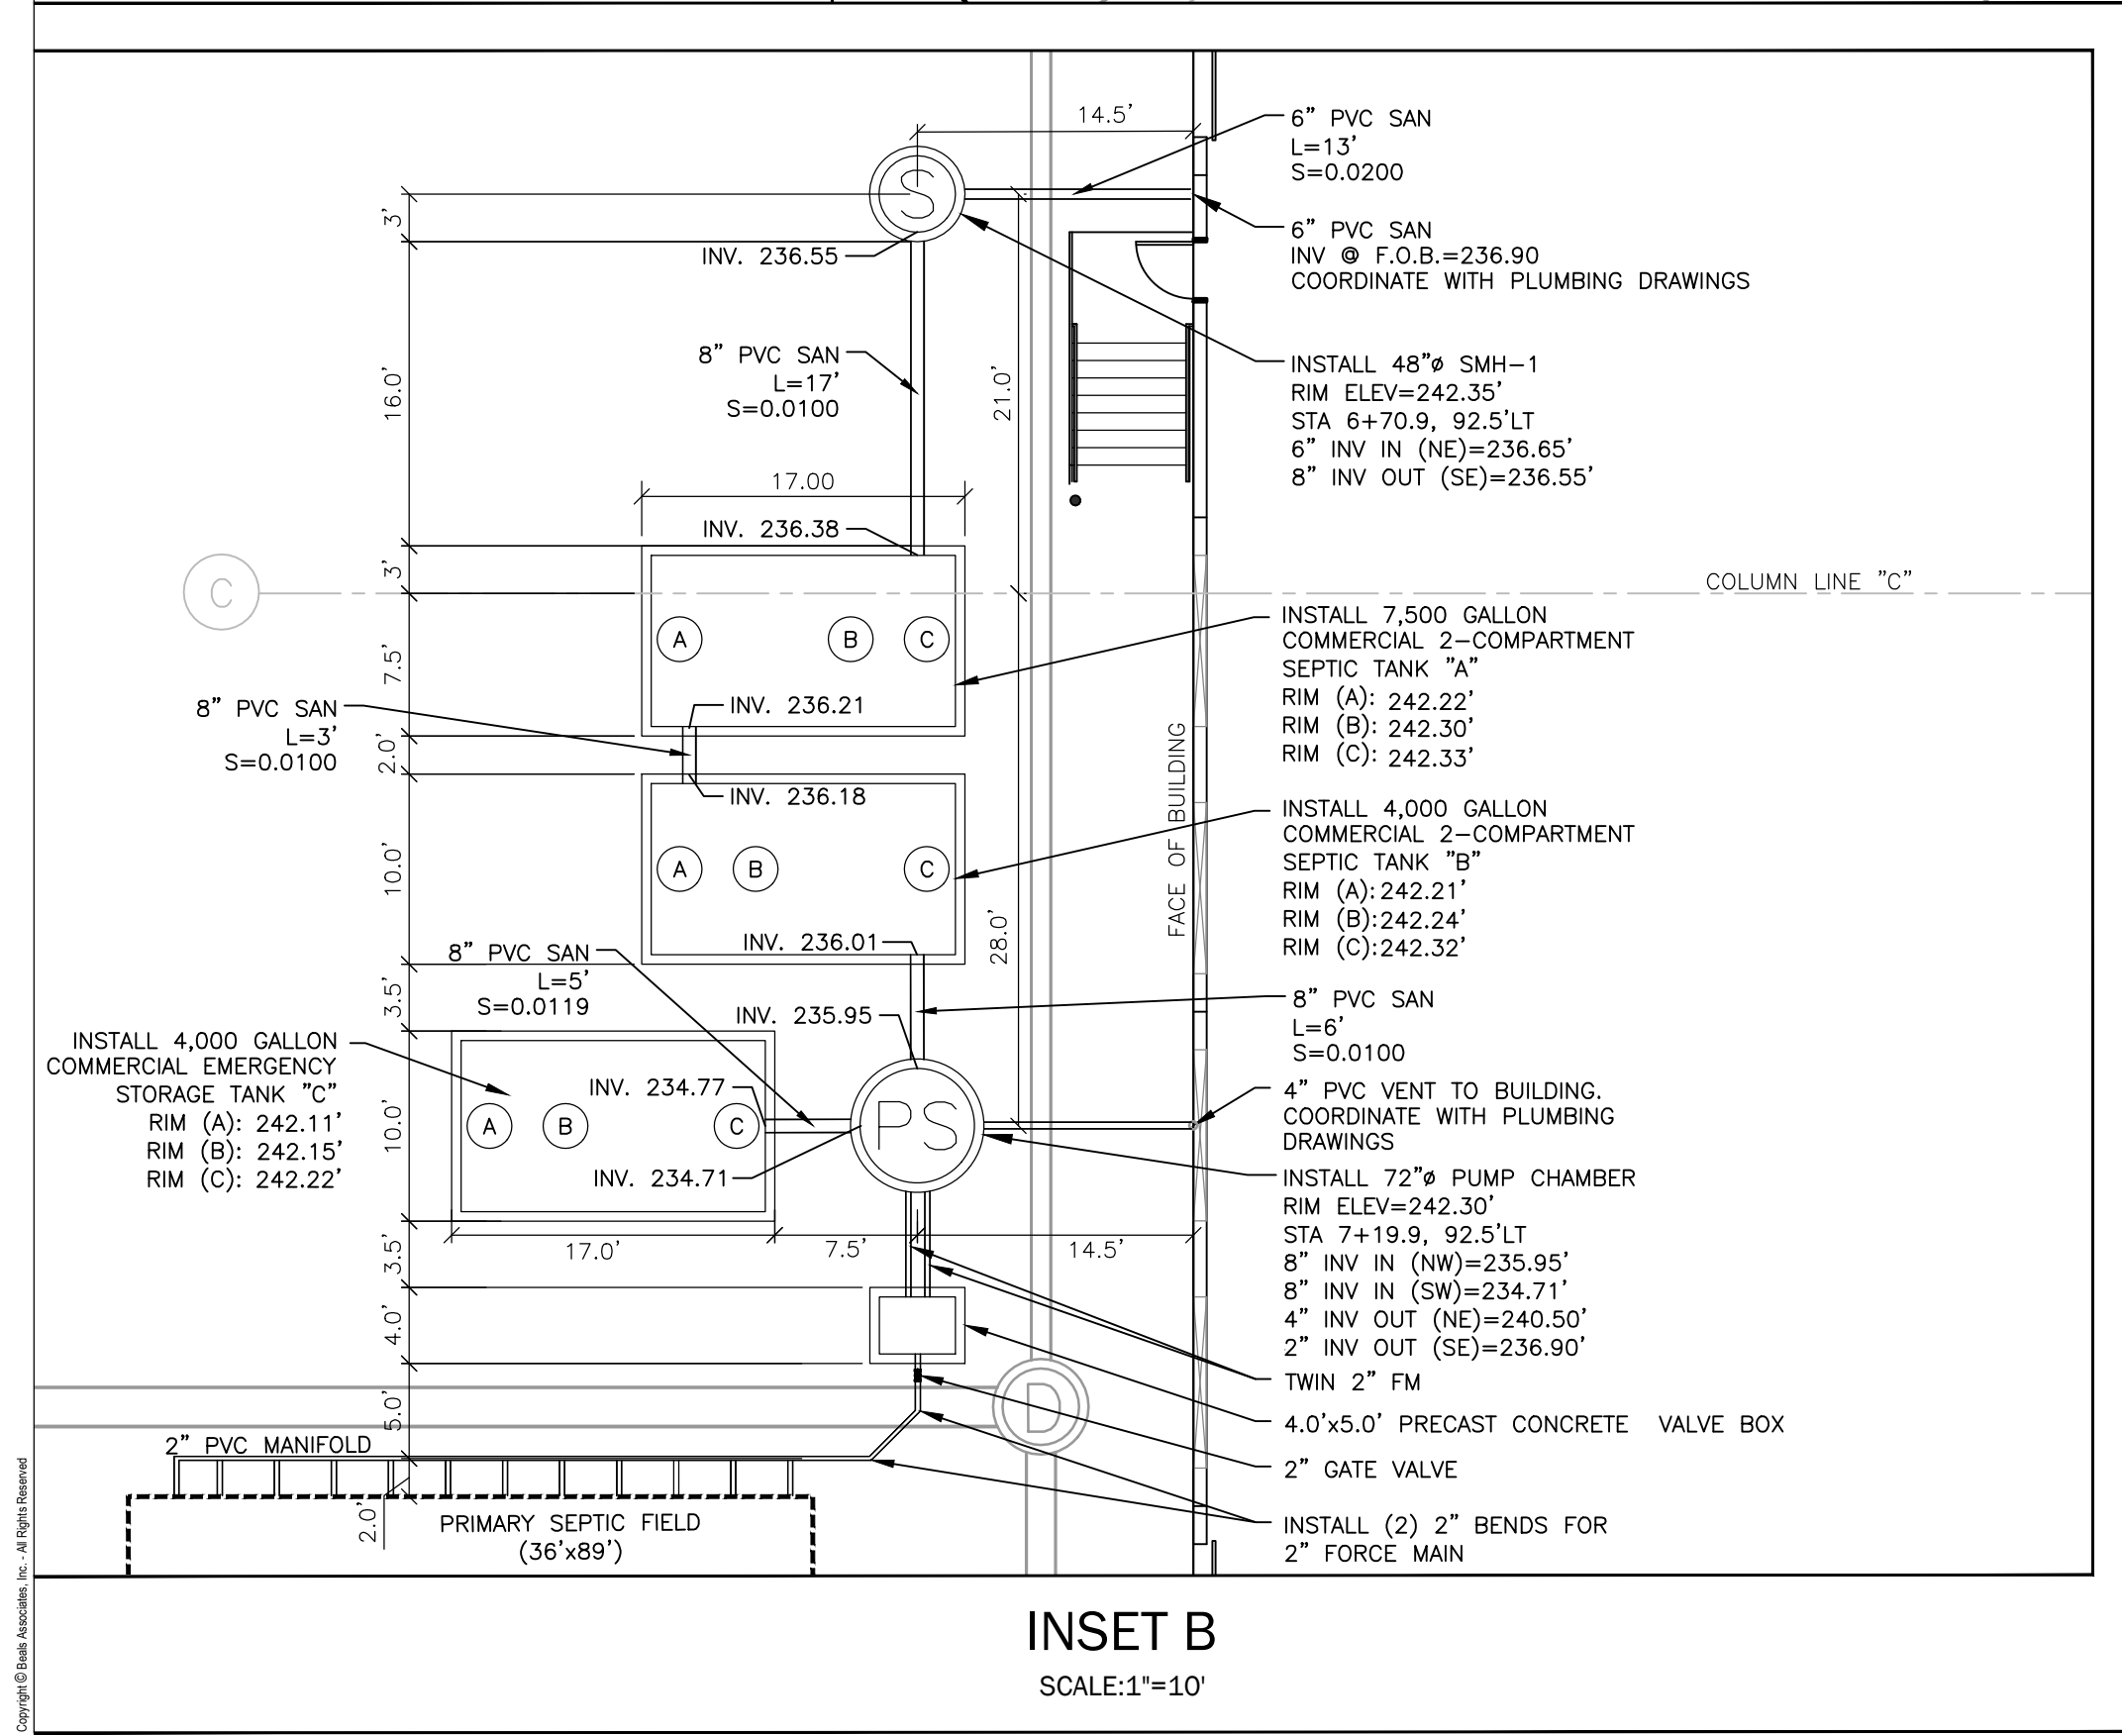

**INSET B**  
SCALE: 1"=10'

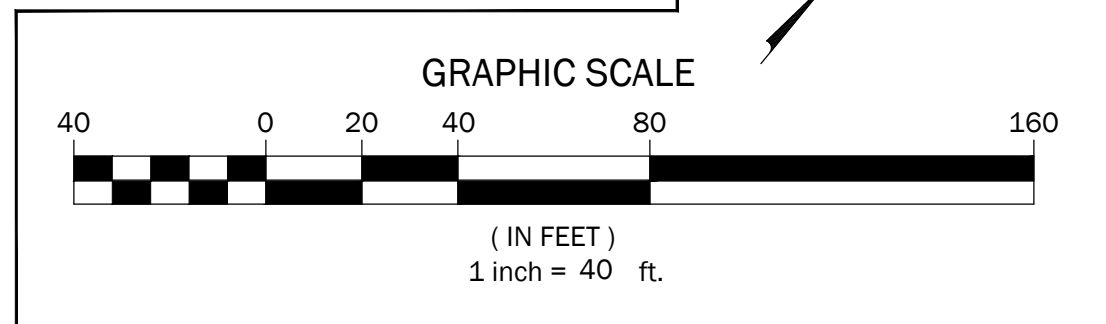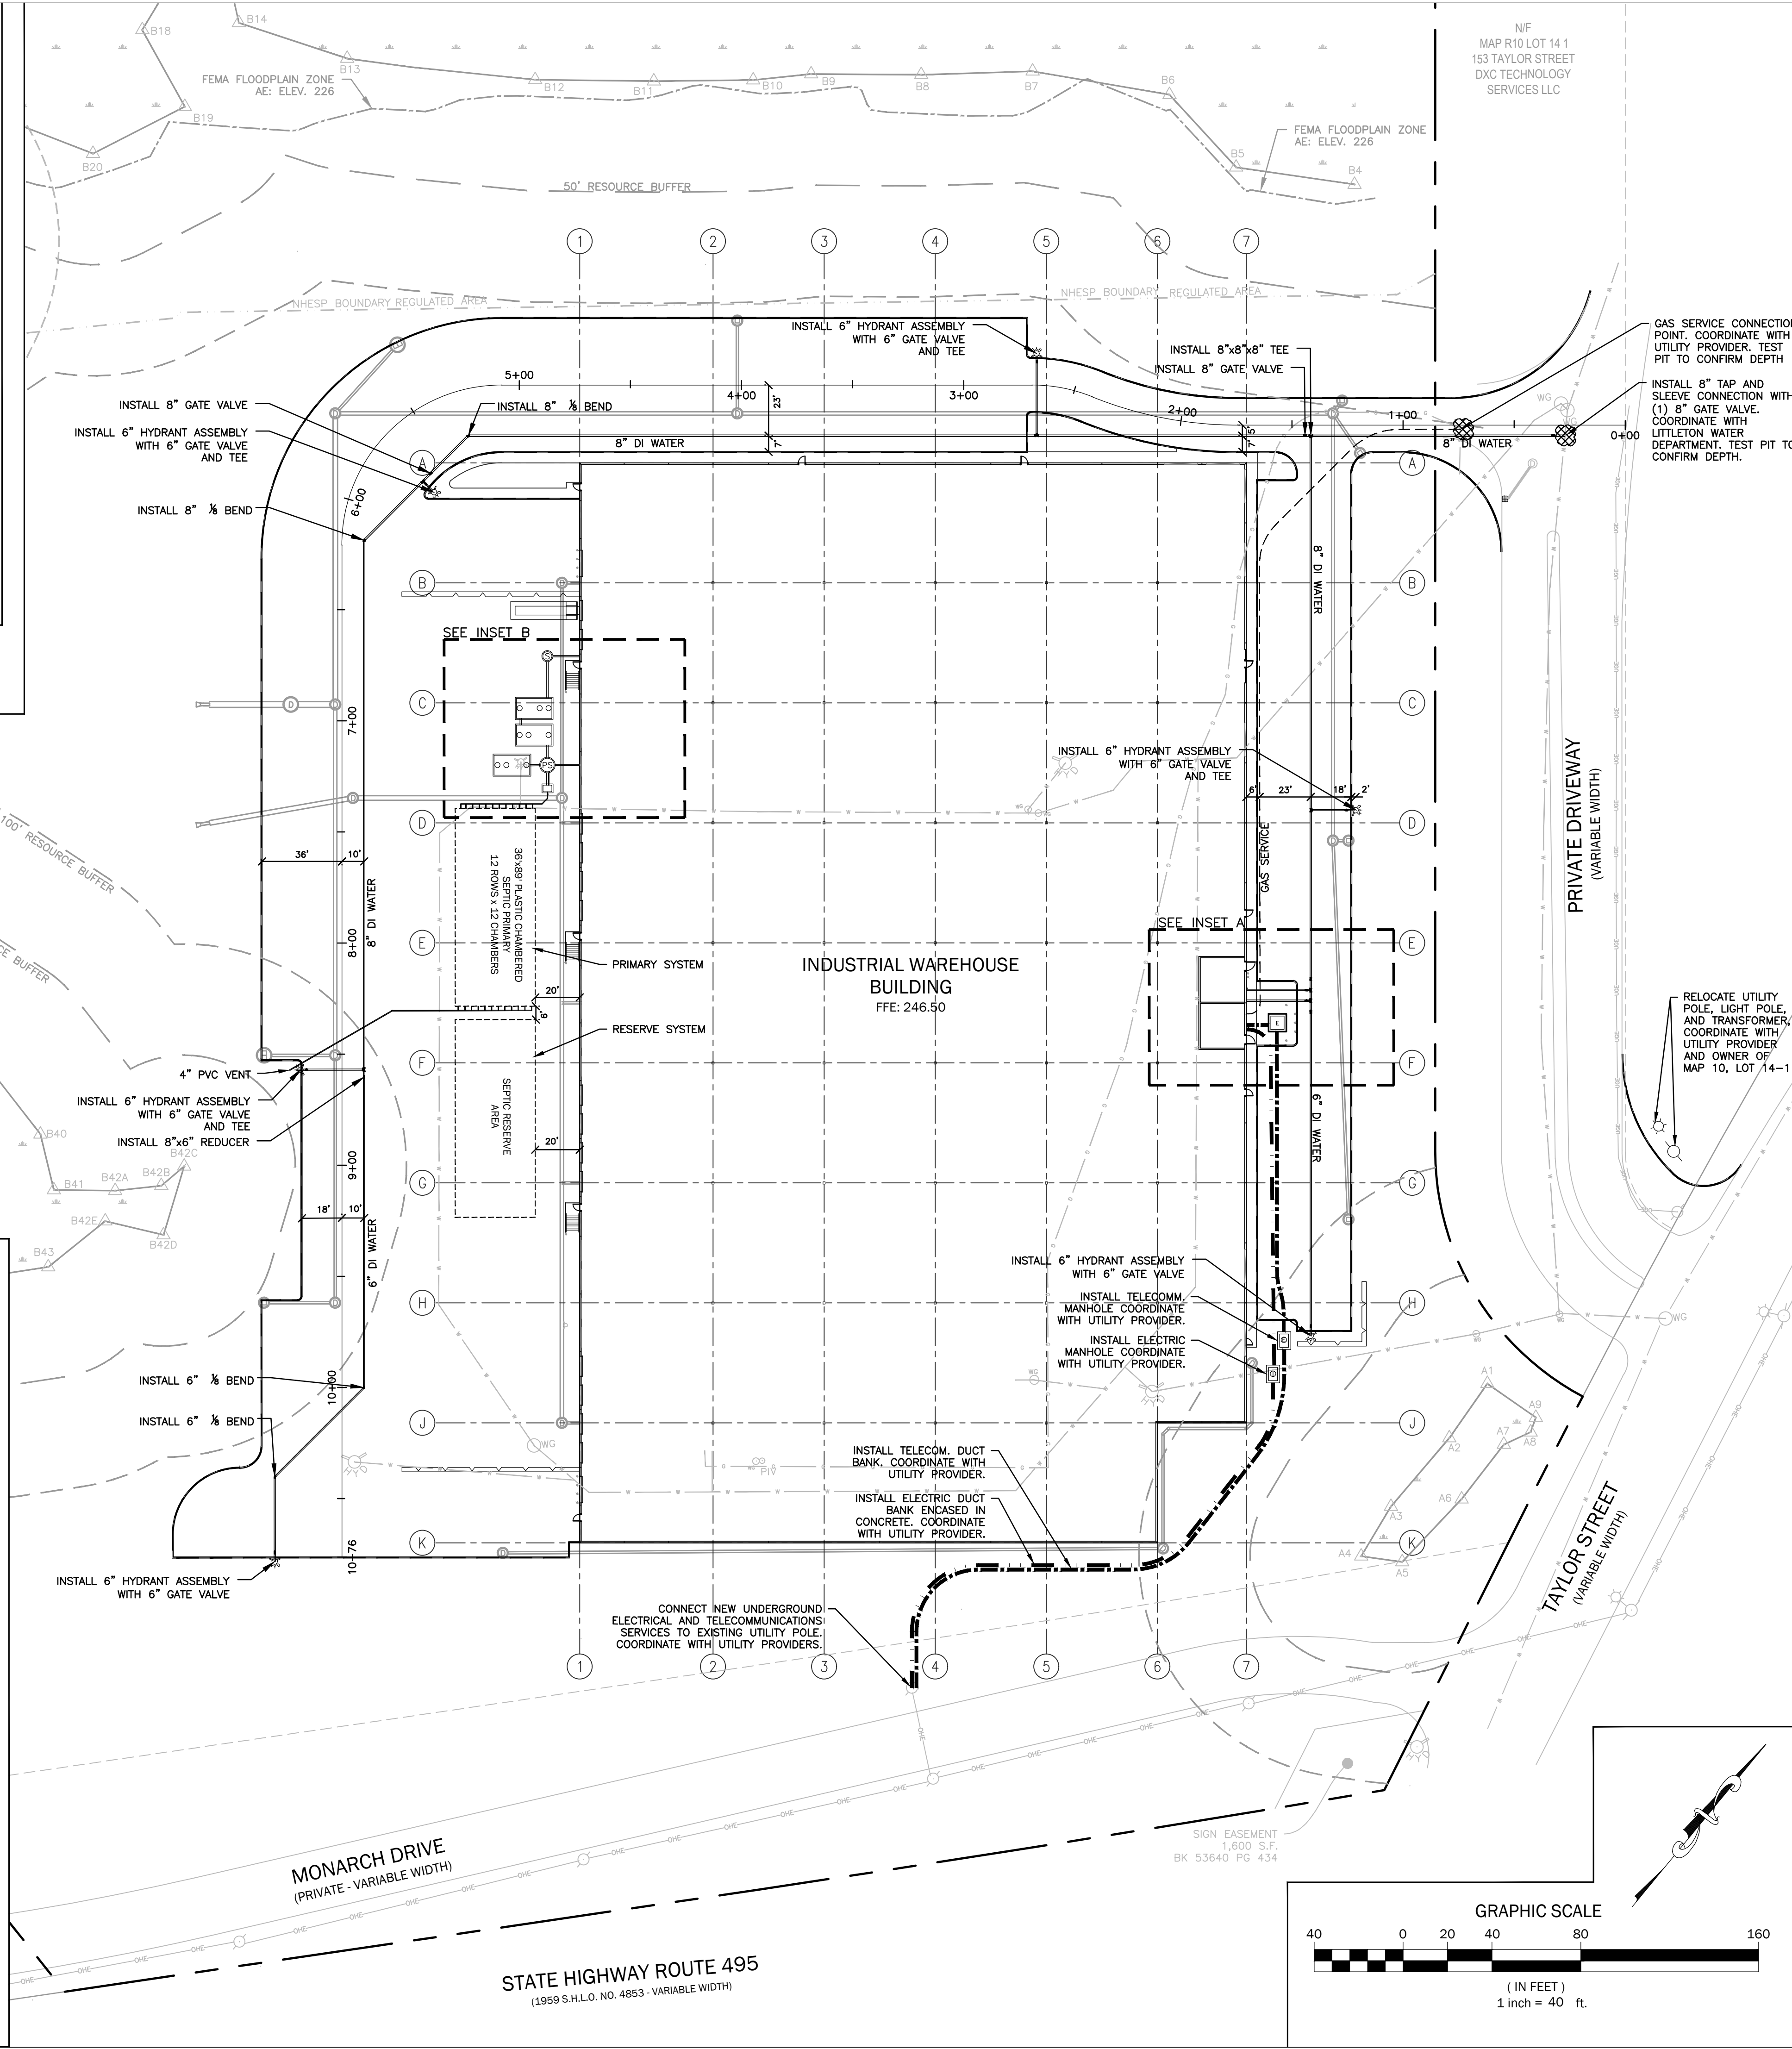

N/F  
MAP R10 LOT 14-1  
153 TAYLOR STREET  
DXC TECHNOLOGY  
SERVICES LLC

**BEALS ASSOCIATES INC.**  
3 PARK BLVD SUITE 200 BOSTON, MA 02116  
PHONE: 617-242-1120  
FAX: 617-242-1121  
PLANNING - ENGINEERING - PERMITTING - MANAGEMENT

**NORTHBRIDGE PARTNERS**  
NBP II Littleton, LLC.  
401 Edgewater Place, Suite 107  
Wakefield, MA 01880

**Warehouse Facility**  
151 Taylor Street  
Littleton, Massachusetts

NO.	REVISION	DATE

Not for Construction  
**Permit Drawings**

Designed by: MEC    Checked by: TPM  
Proj. No.: C-1071    Issue Date: 12.05.19  
Drawing Scale: 1"=40'

**SITE UTILITY PLAN**

Sheet Number  
**C3.0**